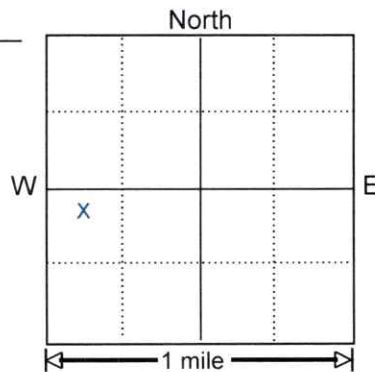


## SOUTH DAKOTA WELL AND TEST HOLE PLUGGING REPORT 11-02

Location NW  $\frac{1}{4}$  SW  $\frac{1}{4}$  Sec 32 Twp 111N Rg 79W

Well Owner:

County HughesPlease mark well  
location with an "X"Name: City of PierreAddress: 2301 Patron ParkwayCity, State, Zip: Pierre SD 57501

Comments:

West of Discovery Center  
805 W. Sioux Avenue, Pierre, SDDC-1  
Flush-mount wellPlugging Completion Date July 1, 2025

## CHECK APPROPRIATE BOX

EXISTING WELL ☒TEST HOLE ☐Well depth 27.5'Casing material PVCCasing size(s) 2"Casing condition Good

Hole depth \_\_\_\_\_

Hole size \_\_\_\_\_

Describe plugging procedure:

Monitoring Well DC-1 water level from top of casing was 14.45 feet. The flush mount protective cover was removed. The well casing was filled with sand from bottom up to approximately 15 feet below grade and with bentonite chips up to 2 feet below ground surface. The top portion of the well casing was cut below grade and removed and the surface area was backfilled with matching surface material.

Describe grout or plugging material:

bentonite chips.Type of non-slip plug: Not ApplicableThis well or test hole was plugged under license # 575 and this report is true and accurate.Drilling firm: American Engineering Testing, Inc.

Signature of Licensed Representative: \_\_\_\_\_

Signature of Well Owner: \_\_\_\_\_

Date: \_\_\_\_\_

RECEIVED

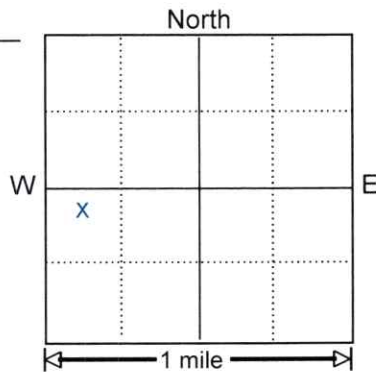
JUL 07 2025

OFFICE OF  
WATER



**SOUTH DAKOTA WELL AND TEST HOLE PLUGGING REPORT 11-02**Location NW  $\frac{1}{4}$  SW  $\frac{1}{4}$  Sec 32 Twp 111N Rg 79W

Well Owner:

County HughesPlease mark well  
location with an "X"Name: City of PierreAddress: 2301 Patron ParkwayCity, State, Zip: Pierre SD 57501

Comments:

Northeast of Discovery Center  
805 W. Sioux Avenue, Pierre, SD

DC-2  
Aboveground Protective Cover

Plugging Completion Date July 1, 2025**CHECK APPROPRIATE BOX**EXISTING WELL ☒TEST HOLE ☐Well depth 24'Casing material PVCCasing size(s) 2"Casing condition Good

Hole depth \_\_\_\_\_

Hole size \_\_\_\_\_

Describe plugging procedure:

Monitoring Well DC-2 water level from top of casing was 16.08 feet. The well casing was filled with sand from bottom up to approximately 16 feet and with bentonite chips up to 3 feet below ground surface. The aboveground protective cover was removed and the well casing broke and removed to a depth of approximately 4 feet below grade. The area was backfilled with matching surface material.

Describe grout or plugging material:

bentonite chips.

Type of non-slip plug: Not ApplicableThis well or test hole was plugged under license # 575 and this report is true and accurate.Drilling firm: American Engineering Testing, Inc.

Signature of Licensed Representative: \_\_\_\_\_

Signature of Well Owner: \_\_\_\_\_

Date: \_\_\_\_\_

**RECEIVED****JUL 07 2025**
**OFFICE OF  
WATER**

JOB NO. 6600 87-1031

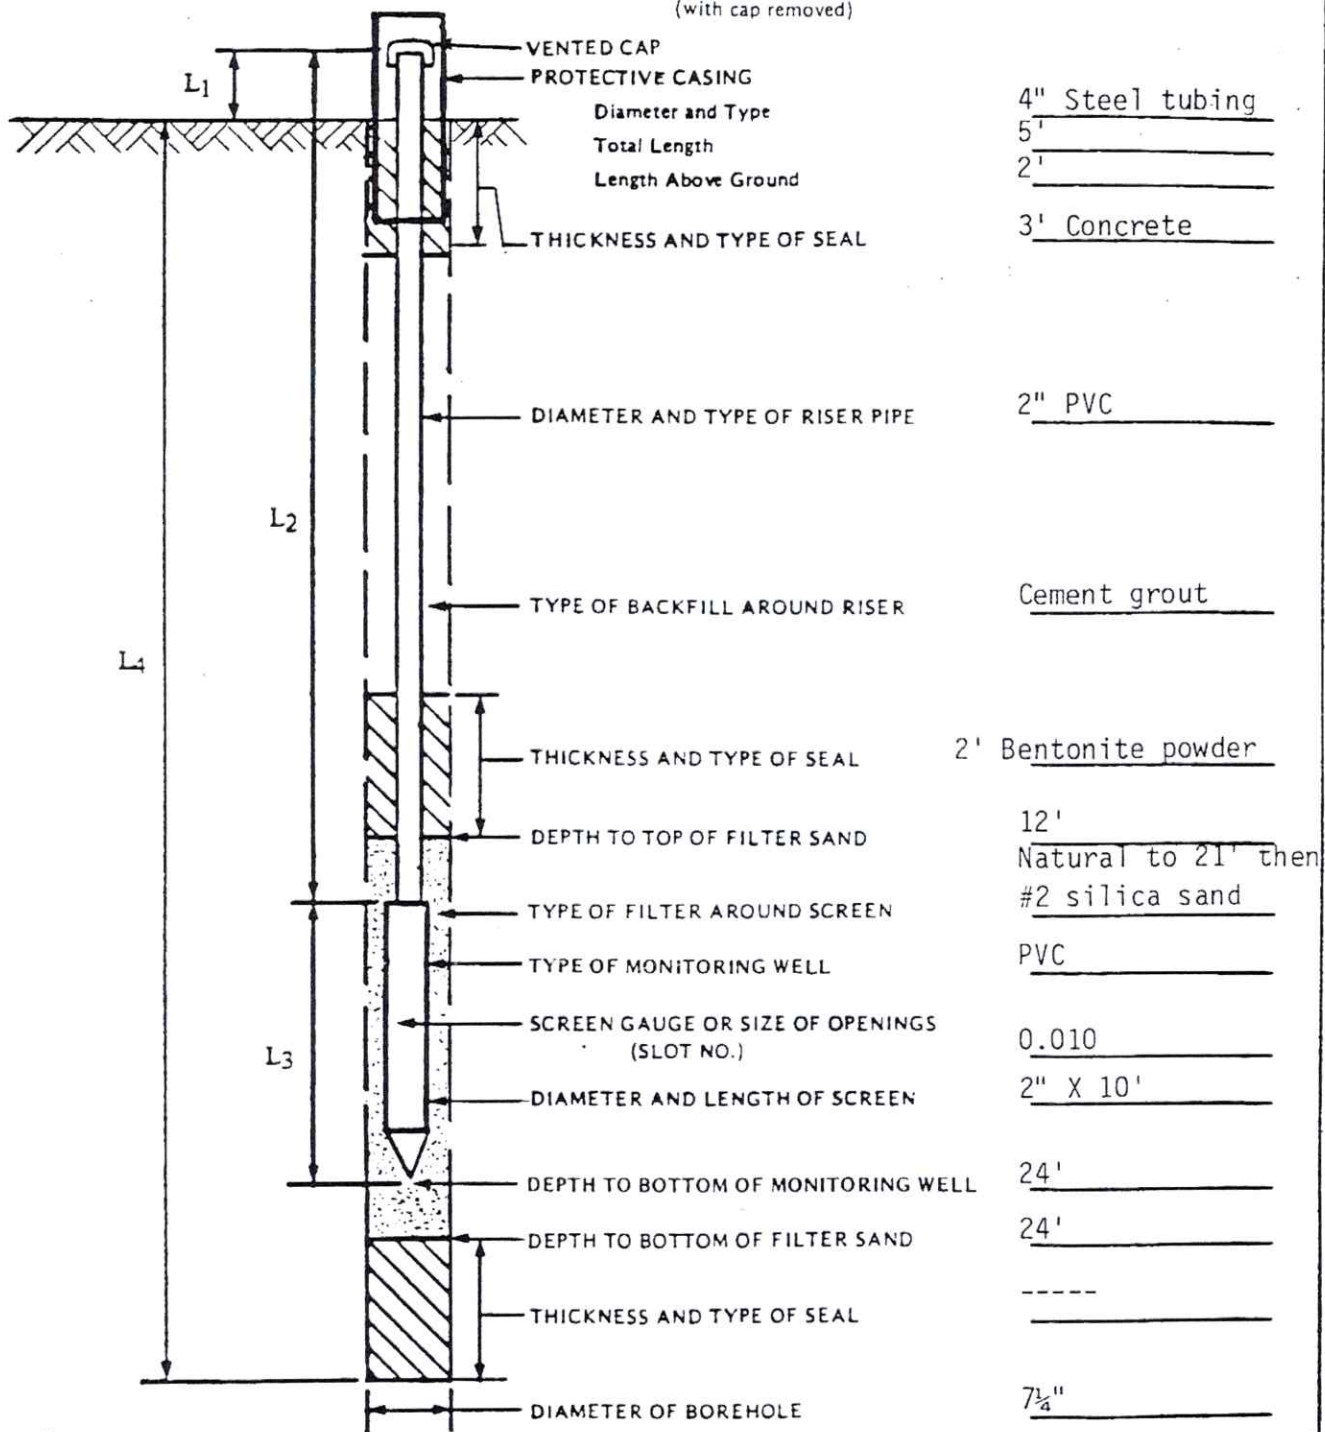
MONITORING WELL NO.

4

(DC-Z)

GASOLINE LOSS, KERR MCGEE STATION, PIERRE, SOUTH DAKOTA

GROUND SURFACE ELEVATION 100.0' TOP OF RISER PIPE ELEVATION 101.83'  
(with cap removed)



L<sub>1</sub> = 2 FT

L<sub>2</sub> = 16 FT

L<sub>3</sub> = 10 FT

L<sub>4</sub> = 24 FT

INSTALLATION COMPLETED:

Date 10-21-87 Time 11:30

| MONITORING WELL WATER LEVEL MEASUREMENTS |       |               |               |
|------------------------------------------|-------|---------------|---------------|
| DATE                                     | TIME  | BAILED DEPTHS | WATER LEVEL * |
| 10-23-87                                 | 11:15 | -----         | 19.60'        |
| 10-27-87                                 | 3:50  | -----         | 20.36'        |
|                                          |       |               |               |
|                                          |       |               |               |

(\* ) DEPTH BELOW TOP OF RISER PIPE

RECEIVED

JUL 07 2025

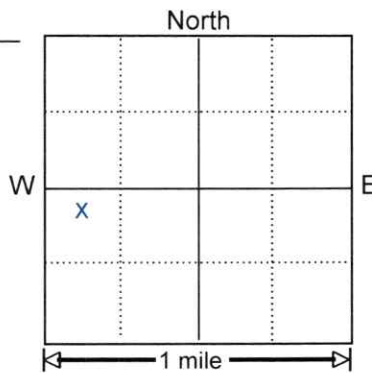


TWIN CITY TESTING CORPORATION

OFFICE OF WATER

**SOUTH DAKOTA WELL AND TEST HOLE PLUGGING REPORT** 11-02Location NW  $\frac{1}{4}$  SW  $\frac{1}{4}$  Sec 32 Twp 111N Rg 79W

Well Owner:

County HughesPlease mark well  
location with an "X"Plugging Completion Date July 1, 2025Name: City of PierreAddress: 2301 Patron ParkwayCity, State, Zip: Pierre SD 57501

Comments:

East of Chamber of Commerce  
800 W. Dakota Avenue, Pierre, SD

DC-4  
Flush-mount well

**CHECK APPROPRIATE BOX**EXISTING WELL ☒TEST HOLE ☐Well depth 27'Casing material PVCCasing size(s) 2"Casing condition Good

Hole depth \_\_\_\_\_

Hole size \_\_\_\_\_

Describe plugging procedure:

Monitoring Well DC-4 water level from top of casing was 13.39 feet. The flush mount protective cover was removed. The well casing was filled with sand from bottom up to approximately 14 feet below grade and with bentonite chips up to 2 feet below ground surface. The top portion of the well casing was cut below grade and removed and the surface area was backfilled with matching surface material.

Describe grout or plugging material:

bentonite chips.

Type of non-slip plug: Not ApplicableThis well or test hole was plugged under license # 575 and this report is true and accurate.Drilling firm: American Engineering Testing, Inc.

Signature of Licensed Representative: \_\_\_\_\_

Signature of Well Owner: \_\_\_\_\_

Date: July 2, 2025**RECEIVED****JUL 07 2025****OFFICE OF  
WATER**



**GEOTEK ENGINEERING  
& TESTING SERVICES, INC.**  
909 E. 50th Street North  
Sioux Falls SD 57104  
605-335-5512 Fax 605-335-0773

# **ENVIRONMENTAL SOIL BORING LOG / WELL CONSTRUCTION INFORMATION**

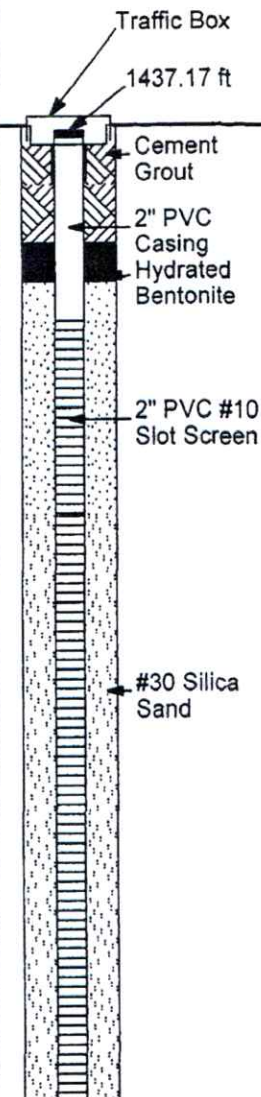
GEOTEK # 11-703

BORING / WELL NO. DC-MW4 (1 of 1)

PROJECT Pierre Flooding Fuel Oil Response, Downtown Pierre, Pierre, SD

| DEPTH<br>in<br>FEET | DESCRIPTION OF MATERIAL                                                               | GEOLOGIC<br>ORIGIN | PID /<br>FID | WL | SAMPLE |      |
|---------------------|---------------------------------------------------------------------------------------|--------------------|--------------|----|--------|------|
|                     |                                                                                       |                    |              |    | NO.    | TYPE |
|                     | <u>SURFACE ELEVATION 1437.4 ft</u>                                                    |                    |              |    |        |      |
|                     | <u>LEAN CLAY</u> : brown, moist to wet, (CL)                                          | FINE<br>ALLUVIUM   | ND           |    | 1      | HSA  |
|                     |                                                                                       |                    | ND           |    | 2      | SS   |
|                     |                                                                                       |                    | ND           |    | 3      | SS   |
|                     |                                                                                       |                    | ND           |    | 4      | SS   |
|                     |                                                                                       |                    | ND           |    | 5      | SS   |
|                     |                                                                                       |                    | ND           |    | 6      | SS   |
|                     |                                                                                       |                    | ND           |    | 7      | SS   |
|                     |                                                                                       |                    | ND           |    | 8      | SS   |
| 19½                 | <u>LEAN CLAY</u> : gray, wet, (CL)                                                    | FINE<br>ALLUVIUM   | ND           |    | 9      | SS   |
|                     |                                                                                       |                    | ND           |    | 10     | SS   |
| 24½                 | <u>SAND</u> : a trace of gravel, fine to medium<br>grained, brown, waterbearing, (SP) | COARSE<br>ALLUVIUM | ND           |    | 11     | SS   |
| 27                  | Bottom of borehole at 27 feet.                                                        |                    |              |    |        |      |

## **Well Construction Details**



## **WATER LEVEL MEASUREMENTS**

START 9-2-11 COMPLETE 9-2-11 10:15 am

| DATE   | TIME    | DEPTH BELOW |           | WATER<br>ELEVATION |
|--------|---------|-------------|-----------|--------------------|
|        |         | SURFACE     | TOR / TOC |                    |
| 9-6-09 | 2:30 pm | 12.8        | 12.53     | 1424.64            |
| --     | --      | --          | --        | --                 |
| --     | --      | --          | --        | --                 |
| --     | --      | --          | --        | --                 |

CREW CHIEF Roy Hanson

**RECEIVED**

**JUL 07 2025**

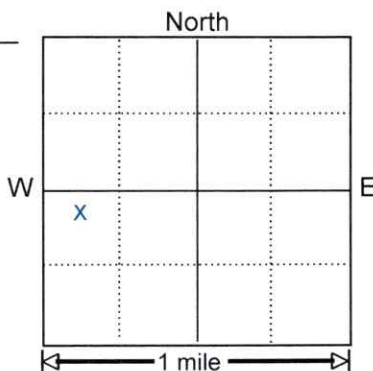
OFFICE OF  
WATER

ENVIRONMENTAL WELL LOG 11-703.GPJ GEOTEKENG.GDT 3/7/12

## SOUTH DAKOTA WELL AND TEST HOLE PLUGGING REPORT 11-02

Location NW ¼ SW ¼ Sec 32 Twp 111N Rg 79W

Well Owner:

County HughesPlease mark well  
location with an "X"Name: City of PierreAddress: 2301 Patron ParkwayCity, State, Zip: Pierre SD 57501

Comments:

Between Discovery Center & Chamber of Commerce  
800 W. Dakota Avenue, Pierre, SD

DC-5  
Flush-mount well

Plugging Completion Date July 1, 2025

## CHECK APPROPRIATE BOX

EXISTING WELL ☒TEST HOLE ☐Well depth 30'Casing material PVCCasing size(s) 2"Casing condition Good

Hole depth \_\_\_\_\_

Hole size \_\_\_\_\_

Describe plugging procedure:

Monitoring Well DC-5 water level from top of casing was 16.77 feet. The flush mount protective cover was removed. The well casing was filled with sand from bottom up to approximately 17 feet below grade and with bentonite chips up to 2 feet below ground surface. The top portion of the well casing was cut below grade and removed and the surface area was backfilled with matching surface material.

Describe grout or plugging material:

bentonite chips.

Type of non-slip plug: Not ApplicableThis well or test hole was plugged under license # 575 and this report is true and accurate.Drilling firm: American Engineering Testing, Inc.

Signature of Licensed Representative: \_\_\_\_\_

Signature of Well Owner: \_\_\_\_\_

Date: July 2, 2025

RECEIVED

JUL 07 2025

OFFICE OF  
WATER



AMERICAN  
ENGINEERING  
TESTING, INC.

## BORING/WELL CONSTRUCTION LOG

PROJECT NUMBER 18-20136  
PROJECT NAME Pierre Water Treatment Plant - Discovery Center  
LOCATION Pierre, South Dakota  
DRILLING METHOD 4.25" ID Hollow-Stem Auger  
SAMPLING METHOD Split-Spoon  
GROUND ELEVATION 1437.99  
TOP OF CASING 1437.52  
LOGGED BY DS  
REMARKS Surveyed relative to TOC elevation of DC-1

BORING/WELL NUMBER DC-5  
DATE DRILLED 6/4/2020  
CASING TYPE/DIAMETER Flush Threaded 2" PVC  
SCREEN TYPE Flush Threaded 2" PVC Screen  
PACKING TYPE 10-20 Silica Sand  
GROUT TYPE Bentonite/Portland Cement  
DEPTH TO WATER (BTOC) 14.88'  
GROUND WATER ELEVATION 1422.64'

| PID (ppm) | Blow Count | RECOVERY (inches) | SAMPLER TYPE | INTERVAL | DEPTH (ft. BGL) | U.S.C.S. | GRAPHIC LOG | MATERIAL DESCRIPTION                                                                      | GW LEVEL | WELL CONSTRUCTION         |
|-----------|------------|-------------------|--------------|----------|-----------------|----------|-------------|-------------------------------------------------------------------------------------------|----------|---------------------------|
| 0.1       |            | 18                | HSA          | 1        | 1               | SC       |             | CLAYEY SILTY SAND with Gravel dark brown, Fill.                                           |          | Concrete Seal             |
|           |            |                   | 1            | 2        | 2               |          |             |                                                                                           |          |                           |
| 0.1       |            | 18                | HSA          | 3        | 3               | ML       |             | SANDY SILT with Gravel dark brown, moist.                                                 |          | 2" PVC Riser              |
|           |            |                   | 2            | 4        | 4               |          |             |                                                                                           |          |                           |
| 5         |            | 18                | HSA          | 5        | 5               | CL       |             | CLAYEY SILT, brown, some roots, moist.                                                    |          |                           |
| 1.5       |            |                   | 3            | 6        | 6               | ML       |             | SILT, brown, moist.                                                                       |          |                           |
|           |            |                   | 3            | 7        | 7               |          |             |                                                                                           |          |                           |
| 8         |            | 18                | HSA          | 8        | 8               | ML       |             | SANDY SILT with Clay brown, moist.                                                        |          |                           |
| 0.5       |            |                   | 4            | 9        | 9               |          |             |                                                                                           |          |                           |
|           |            |                   | 4            | 10       | 10              | ML       |             | SANDY SILT, brown, moist-wet.                                                             |          |                           |
| 0.8       |            | 18                | HSA          | 5        | 11              |          |             |                                                                                           |          |                           |
|           |            |                   | 5            | 12       | 12              |          |             |                                                                                           |          |                           |
| 2         |            | 18                | HSA          | 6        | 13              | CL       |             | SILTY CLAY, brown, wet-waterbearing.                                                      |          |                           |
| 0.7       |            |                   | 6            | 14       | 14              |          |             |                                                                                           |          |                           |
|           |            |                   | 6            | 15       | 15              |          |             |                                                                                           |          |                           |
| 0.8       |            | 18                | HSA          | 7        | 16              |          |             |                                                                                           |          |                           |
|           |            |                   | 7            | 17       | 17              | ML       |             | SANDY SILT with Clay brown, waterbearing.                                                 |          | Bentonite Seal            |
| 0.6       |            | 18                | HSA          | 8        | 18              |          |             | SANDY SILT, brown, iron staining, waterbearing.                                           |          |                           |
|           |            |                   | 8            | 19       | 19              | ML       |             |                                                                                           |          |                           |
| 10        |            | 18                | HSA          | 9        | 20              |          |             | SILTY SAND fine grained, brown, iron staining, waterbearing.                              |          |                           |
| 0.9       |            |                   | 9            | 21       | 21              | SM       |             |                                                                                           |          |                           |
|           |            |                   | 9            | 22       | 22              |          |             |                                                                                           |          |                           |
|           |            |                   | 9            | 23       | 23              |          |             |                                                                                           |          |                           |
|           |            |                   | 9            | 24       | 24              |          |             | SAND with some CLAYEY SAND seams fine-medium grained, brown, waterbearing, heaving sands. |          |                           |
|           |            |                   | 9            | 25       | 25              |          |             |                                                                                           |          |                           |
| 0.5       |            | 18                | HSA          | 10       | 26              | SP       |             |                                                                                           |          | 2" PVC 0.010" Slot Screen |
|           |            |                   | 10           | 27       | 27              |          |             |                                                                                           |          |                           |
|           |            |                   | 10           | 28       | 28              |          |             |                                                                                           |          |                           |
|           |            |                   | 10           | 29       | 29              |          |             | SAND with Gravel & Silt fine-medium grained, brown, waterbearing, heaving sands.          |          | 10-20 Silica Sand         |
|           |            |                   | 10           | 30       | 30              | SP       |             |                                                                                           |          |                           |
| 0.6       |            | 22                | HSA          | 11       | 31              |          |             |                                                                                           |          |                           |
|           |            |                   | 11           | 32       | 32              |          |             | End of Boring                                                                             |          |                           |
|           |            |                   |              |          |                 |          |             | Water level 15.4' below ground surface 6/10/20.                                           |          |                           |

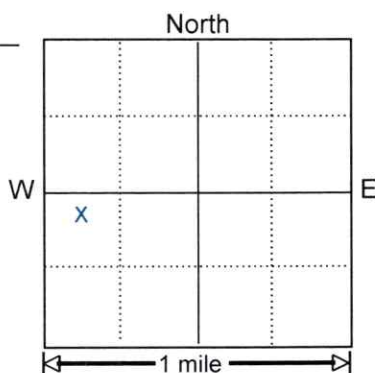
RECEIVED

JUL 07 2025

OFFICE OF  
WATER

**SOUTH DAKOTA WELL AND TEST HOLE PLUGGING REPORT 11- 02**Location NW  $\frac{1}{4}$  SW  $\frac{1}{4}$  Sec 32 Twp 111N Rg 79W

Well Owner:

County HughesPlease mark well  
location with an "X"Plugging Completion Date July 1, 2025Name: City of PierreAddress: 2301 Patron ParkwayCity, State, Zip: Pierre SD 57501

Comments:

West of Chamber of Commerce  
800 W. Dakota Avenue, Pierre, SDDC-6  
Flush-mount well**CHECK APPROPRIATE BOX**EXISTING WELL ☒TEST HOLE ☐Well depth 30'Casing material PVCCasing size(s) 2"Casing condition Good

Hole depth \_\_\_\_\_

Hole size \_\_\_\_\_

Describe plugging procedure:

Monitoring Well DC-6 water level from top of casing was 13.50 feet. The flush mount protective cover was removed. The well casing was filled with sand from bottom up to approximately 15 feet below grade and with bentonite chips up to 2 feet below ground surface. The top portion of the well casing was cut below grade and removed and the surface area was backfilled with matching surface material.

Describe grout or plugging material:

bentonite chips.Type of non-slip plug: Not ApplicableThis well or test hole was plugged under license # 575 and this report is true and accurate.Drilling firm: American Engineering Testing, Inc.

Signature of Licensed Representative: \_\_\_\_\_

Signature of Well Owner: \_\_\_\_\_

Date: July 2, 2025**RECEIVED****JUL 07 2025****OFFICE OF  
WATER**



AMERICAN  
ENGINEERING  
TESTING, INC.

## BORING/WELL CONSTRUCTION LOG

PROJECT NUMBER 18-20136  
PROJECT NAME Pierre Water Treatment Plant - Discovery Center  
LOCATION Pierre, South Dakota  
DRILLING METHOD 4.25" ID Hollow-Stem Auger  
SAMPLING METHOD Split-Spoon  
GROUND ELEVATION 1437.16  
TOP OF CASING 1436.52  
LOGGED BY DS  
REMARKS Surveyed relative to TOC elevation of DC-1

BORING/WELL NUMBER DC-6  
DATE DRILLED 6/4/2020  
CASING TYPE/DIAMETER Flush Threaded 2" PVC  
SCREEN TYPE Flush Threaded 2" PVC Screen  
PACKING TYPE 10-20 Silica Sand  
GROUT TYPE Bentonite/Portland Cement  
DEPTH TO WATER (BTOW) 13.79'  
GROUND WATER ELEVATION 1422.73'

| PID (ppm)                                       | Blow Count | RECOVERY (inches) | SAMPLER TYPE | INTERVAL | DEPTH (ft. BGL) | U.S.C.S. | GRAPHIC LOG | MATERIAL DESCRIPTION                                                      | GW LEVEL | WELL CONSTRUCTION         |
|-------------------------------------------------|------------|-------------------|--------------|----------|-----------------|----------|-------------|---------------------------------------------------------------------------|----------|---------------------------|
| 0.1                                             |            | 18                | HSA          | 1        | 1               | ML       |             | ASPHALT                                                                   |          | Concrete Seal             |
|                                                 |            |                   | 1            | 2        | 2               | ML       |             | BASECOARSE Clayey Gravel, dark brown, moist.                              |          |                           |
|                                                 |            | 18                | HSA          | 3        | 3               |          |             | SANDY SILT with Gravel dark brown, moist.                                 |          |                           |
| 0.1                                             |            |                   | 2            | 4        | 4               | ML       |             | SANDY SILT, brown, moist.                                                 |          | 2" PVC Riser              |
|                                                 | 3          | 18                | HSA          | 5        | 5               |          |             | SILTY SAND very fine grained, brown, moist.                               |          |                           |
| 0.2                                             |            |                   | 3            | 6        | 6               | SM       |             |                                                                           |          |                           |
|                                                 | 4          | 18                | HSA          | 7        | 7               |          |             | SANDY SILT with SILTY CLAY Seams brown, moist-wet.                        |          |                           |
| 0.5                                             |            |                   | 4            | 8        | 8               |          |             |                                                                           |          |                           |
|                                                 | 7          | 18                | HSA          | 9        | 9               | ML       |             |                                                                           |          |                           |
| 0.4                                             |            |                   | 5            | 10       | 10              | CL       |             |                                                                           |          |                           |
|                                                 | 2          | 18                | HSA          | 11       | 11              |          |             | SILTY CLAY, brown, laminated, wet.                                        |          | Bentonite Seal            |
| 0.4                                             |            |                   | 6            | 12       | 12              | CL       |             |                                                                           |          |                           |
|                                                 | 6          | 18                | HSA          | 13       | 13              |          |             | SANDY SILT, brown, waterbearing.                                          |          |                           |
| 0.3                                             |            |                   | 7            | 14       | 14              | MLS      |             |                                                                           |          |                           |
|                                                 | 8          | 18                | HSA          | 15       | 15              |          |             | SILTY SAND very fine grained, brown, iron staining, waterbearing.         |          |                           |
| 0.4                                             |            |                   | 8            | 16       | 16              | SM       |             |                                                                           |          |                           |
|                                                 | 8          | 18                | HSA          | 17       | 17              |          |             | SAND with Silt fine-medium grained, brown, waterbearing.                  |          |                           |
| 0.3                                             |            |                   | 9            | 18       | 18              | SP       |             |                                                                           |          |                           |
|                                                 |            |                   |              | 19       | 19              |          |             | SAND, fine-medium grained, brown, waterbearing, heaving sands.            |          |                           |
|                                                 |            |                   |              | 20       | 20              |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 21       | 21              |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 22       | 22              |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 23       | 23              |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 24       | 24              |          |             |                                                                           |          |                           |
|                                                 | 25         | 18                | HSA          | 25       | 25              | SP       |             |                                                                           |          | 2" PVC 0.010" Slot Screen |
| 0.9                                             |            |                   | 10           | 26       | 26              |          |             |                                                                           |          | 10-20 Silica Sand         |
|                                                 |            |                   |              | 27       | 27              |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 28       | 28              |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 29       | 29              |          |             |                                                                           |          |                           |
|                                                 | heave      | 18                | HSA          | 30       | 30              |          |             |                                                                           |          |                           |
| 0.3                                             |            |                   | 11           | 31       | 31              | SM       |             | SILTY SAND very fine grained, brown, waterbearing, heaving sands.         |          |                           |
|                                                 |            |                   |              | 32       | 32              | SP       |             | SAND with Gravel fine-medium grained, brown, waterbearing, heaving sands. |          |                           |
| End of Boring                                   |            |                   |              |          |                 |          |             |                                                                           |          |                           |
| Water level 14.4' below ground surface 6/10/20. |            |                   |              |          |                 |          |             |                                                                           |          |                           |

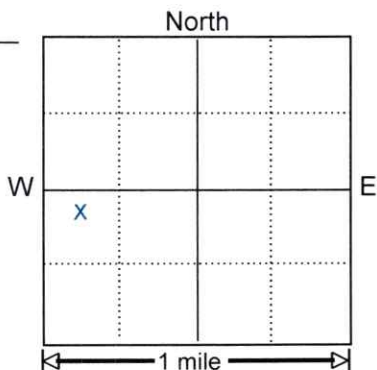
RECEIVED

JUL 07 2025

OFFICE OF  
WATER

**SOUTH DAKOTA WELL AND TEST HOLE PLUGGING REPORT 11-02**Location NW ¼ SW ¼ Sec 32 Twp 111N Rg 79W

Well Owner:

County HughesPlease mark well  
location with an "X"Name: City of PierreAddress: 2301 Patron ParkwayCity, State, Zip: Pierre SD 57501

Comments:

Southwest of Chamber of Commerce  
800 W. Dakota Avenue, Pierre, SD

DC-7  
Flush-mount well

Plugging Completion Date July 1, 2025**CHECK APPROPRIATE BOX**EXISTING WELL ☒TEST HOLE ☐Well depth 30'Casing material PVCCasing size(s) 2"Casing condition Good

Hole depth \_\_\_\_\_

Hole size \_\_\_\_\_

Describe plugging procedure:

Monitoring Well DC-7 water level from top of casing was 13.45 feet. The flush mount protective cover was removed. The well casing was filled with sand from bottom up to approximately 14 feet below grade and with bentonite chips up to 2 feet below ground surface. The top portion of the well casing was cut below grade and removed and the surface area backfilled with matching surface material.

Describe grout or plugging material:

bentonite chips.

Type of non-slip plug: Not ApplicableThis well or test hole was plugged under license # 575 and this report is true and accurate.Drilling firm: American Engineering Testing, Inc.

Signature of Licensed Representative: \_\_\_\_\_

Signature of Well Owner: \_\_\_\_\_

Date: July 2, 2025**RECEIVED****JUL 07 2025**OFFICE OF  
WATER



AMERICAN  
ENGINEERING  
TESTING, INC.

## BORING/WELL CONSTRUCTION LOG

PROJECT NUMBER 18-20139 BORING/WELL NUMBER DC-7  
PROJECT NAME Pierre Water Treatment Plant - Dewatering DATE DRILLED 6/3/2020  
LOCATION Pierre, South Dakota CASING TYPE/DIAMETER Flush Threaded 2" PVC  
DRILLING METHOD 4.25" ID Hollow-Stem Auger SCREEN TYPE Flush Threaded 2" PVC Screen  
SAMPLING METHOD Split-Spoon PACKING TYPE 10-20 Silica Sand  
GROUND ELEVATION 1437.45 GROUT TYPE Bentonite/Portland Cement  
TOP OF CASING 1436.86 DEPTH TO WATER (BTOC) 14.21'  
LOGGED BY DS GROUND WATER ELEVATION 1422.65'  
REMARKS Surveyed relative to TOC elevation of DC-1

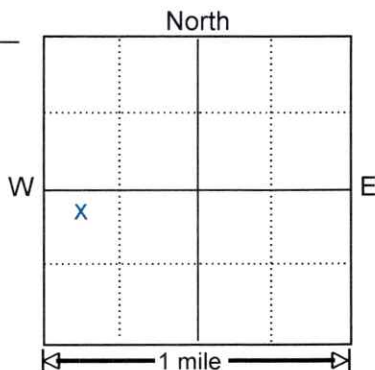
| PID (ppm)                                       | Blow Count | RECOVERY (inches) | SAMPLER TYPE | INTERVAL | DEPTH (ft. BGL) | U.S.C.S. | GRAPHIC LOG | MATERIAL DESCRIPTION                                                         | GW LEVEL | WELL CONSTRUCTION         |
|-------------------------------------------------|------------|-------------------|--------------|----------|-----------------|----------|-------------|------------------------------------------------------------------------------|----------|---------------------------|
| 0.1                                             |            | 18                | HSA          | 1        | 1               | ML       |             | SILT, dark brown, moist.                                                     |          | Concrete Seal             |
|                                                 |            |                   | 1            | 2        | 2               |          |             |                                                                              |          |                           |
| 0.1                                             |            | 18                | HSA          | 3        | 3               | ML       |             | CLAYEY SILT, dark brown, moist.                                              |          |                           |
|                                                 |            |                   | 2            | 4        | 4               |          |             |                                                                              |          |                           |
|                                                 | 5          | 18                | HSA          | 5        | 5               |          |             | SANDY SILT, brown, moist.                                                    |          | 2" PVC Riser              |
| 0.1                                             |            |                   | 3            | 6        | 6               |          |             |                                                                              |          | Bentonite Seal            |
|                                                 |            |                   |              | 7        | 7               |          |             |                                                                              |          |                           |
| 0.2                                             | 8          | 18                | HSA          | 4        | 8               | ML       |             |                                                                              |          |                           |
|                                                 |            |                   |              | 9        | 9               |          |             |                                                                              |          |                           |
| 0.2                                             | 7          | 18                | HSA          | 5        | 10              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 6        | 11              |          |             |                                                                              |          |                           |
| 0                                               | 4          | 18                | HSA          | 6        | 12              |          |             | SILT with Clay, gray-brown, iron staining, wet-waterbearing.                 |          |                           |
|                                                 |            |                   |              | 7        | 13              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 8        | 14              | ML       |             |                                                                              |          |                           |
| 0.1                                             | 4          | 18                | HSA          | 7        | 15              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 8        | 16              |          |             | SILTY CLAY layered with SANDY SILT, gray-brown, iron staining, waterbearing. |          |                           |
| 0.1                                             |            |                   |              | 9        | 17              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 10       | 18              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 11       | 19              |          |             |                                                                              |          |                           |
| 0.1                                             | 9          | 18                | HSA          | 9        | 20              | CL       |             |                                                                              |          | 2" PVC 0.010" Slot Screen |
|                                                 |            |                   |              | 10       | 21              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 11       | 22              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 12       | 23              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 13       | 24              |          |             | SAND with Gravel fine-medium grained, brown, waterbearing, heaving sands.    |          |                           |
| 0.3                                             | 13         | 18                | HSA          | 10       | 25              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 11       | 26              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 12       | 27              | SP       |             |                                                                              |          | 10-20 Silica Sand         |
|                                                 |            |                   |              | 13       | 28              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 14       | 29              |          |             |                                                                              |          |                           |
| 0.3                                             | 12         | 18                | HSA          | 11       | 30              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 12       | 31              |          |             |                                                                              |          |                           |
|                                                 |            |                   |              | 13       | 32              |          |             | End of Boring                                                                |          |                           |
| Water level 14.8' below ground surface 6/10/20. |            |                   |              |          |                 |          |             |                                                                              |          |                           |

RECEIVED

JUL 07 2025

OFFICE OF  
WATER

## SOUTH DAKOTA WELL AND TEST HOLE PLUGGING REPORT 11-02

Location NW  $\frac{1}{4}$  SW  $\frac{1}{4}$  Sec 32 Twp 111N Rg 79W Well Owner:County HughesPlease mark well  
location with an "X"Name: City of PierreAddress: 2301 Patron ParkwayCity, State, Zip: Pierre SD 57501

Comments:

West of Chamber of Commerce  
800 W. Dakota Avenue, Pierre, SDDC-8  
Flush-mount wellPlugging Completion Date May 8, 2025

## CHECK APPROPRIATE BOX

EXISTING WELL ☒TEST HOLE ☐Well depth 32.5'Casing material PVCCasing size(s) 2"Casing condition Good

Hole depth \_\_\_\_\_

Hole size \_\_\_\_\_

Describe plugging procedure:

Monitoring Well DC-8 water level from top of casing was 13.55 feet. The flush mount protective cover was removed. The well casing was filled with sand from bottom up to approximately 14 feet below grade and with bentonite chips up to 2 feet below ground surface. The top 2.5 feet of the well casing was removed and the surface area backfilled with matching surface material.

Describe grout or plugging material:

bentonite chips.Type of non-slip plug: Not ApplicableThis well or test hole was plugged under license # 575 and this report is true and accurate.Drilling firm: American Engineering Testing, Inc.

Signature of Licensed Representative: \_\_\_\_\_

Signature of Well Owner: \_\_\_\_\_

Date: July 2, 2025

RECEIVED

JUL 07 2025

OFFICE OF  
WATER



AMERICAN  
ENGINEERING  
TESTING, INC.

## BORING/WELL CONSTRUCTION LOG

PROJECT NUMBER 18-20139 BORING/WELL NUMBER DC-8  
PROJECT NAME Pierre Water Treatment Plant - Dewatering DATE DRILLED 6/3/2020  
LOCATION Pierre, South Dakota CASING TYPE/DIAMETER Flush Threaded 2" PVC  
DRILLING METHOD 4.25" ID Hollow-Stem Auger SCREEN TYPE Flush Threaded 2" PVC Screen  
SAMPLING METHOD Split-Spoon PACKING TYPE 10-20 Silica Sand  
GROUND ELEVATION 1437.14 GROUT TYPE Bentonite/Portland Cement  
TOP OF CASING 1436.67 DEPTH TO WATER (BTOC) 13.96'  
LOGGED BY DS GROUND WATER ELEVATION 1422.71'  
REMARKS Surveyed relative to TOC elevation of DC-1

| PID (ppm)                                       | Blow Count | RECOVERY (inches) | SAMPLER TYPE | INTERVAL | DEPTH (ft. BGL) | U.S.C.S. | GRAPHIC LOG | MATERIAL DESCRIPTION                                                      | GW LEVEL | WELL CONSTRUCTION         |
|-------------------------------------------------|------------|-------------------|--------------|----------|-----------------|----------|-------------|---------------------------------------------------------------------------|----------|---------------------------|
| 0.3                                             |            | 18                | HSA          | 1        | 1               | ML       |             | SILT, dark brown, moist.                                                  |          | Concrete Seal             |
|                                                 |            |                   | 1            | 2        |                 |          |             |                                                                           |          |                           |
| 0.2                                             |            | 18                | HSA          | 3        | 3               | ML       |             | SANDY SILT with Gravel dark brown, moist (FILL).                          |          |                           |
|                                                 |            |                   | 2            | 4        |                 |          |             |                                                                           |          |                           |
| 0                                               | 2          | 18                | HSA          | 5        | 5               | ML       |             | SANDY SILT, brown, moist.                                                 |          | 2" PVC Riser              |
|                                                 |            |                   | 3            | 6        |                 |          |             |                                                                           |          | Bentonite Seal            |
| 0                                               | 6          | 18                | HSA          | 7        | 7               |          |             | SILTY CLAY, brown, moist-wet.                                             |          |                           |
|                                                 |            |                   | 4            | 8        |                 | CL       |             |                                                                           |          |                           |
| 0.4                                             | 7          | 18                | HSA          | 11       | 11              |          |             | CLAYEY SILT with SILTY CLAY seams brown, moist-wet.                       |          |                           |
|                                                 |            |                   | 5            | 12       |                 |          |             |                                                                           |          |                           |
| 0.1                                             | 10         | 18                | HSA          | 13       | 13              |          |             |                                                                           |          |                           |
|                                                 |            |                   | 6            | 14       |                 | CL ML    |             |                                                                           |          |                           |
| 0                                               | 2          | 18                | HSA          | 15       | 15              |          |             |                                                                           |          |                           |
|                                                 |            |                   | 7            | 16       |                 |          |             |                                                                           |          |                           |
| 0.1                                             | 5          | 18                | HSA          | 18       | 18              | SM       |             | SILTY SAND very fine grained, brown, iron staining, waterbearing.         |          |                           |
|                                                 |            |                   | 8            | 19       |                 |          |             |                                                                           |          |                           |
| 0                                               | 12         | 18                | HSA          | 20       | 20              | CL       |             | SILTY CLAY with SILTY SAND seams brown, waterbearing.                     |          | 2" PVC 0.010" Slot Screen |
|                                                 |            |                   | 9            | 21       |                 |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 22       |                 | SM       |             | SILTY SAND, fine grained, gray, waterbearing.                             |          |                           |
|                                                 |            |                   |              | 23       |                 |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 24       |                 |          |             | SAND, fine-medium grained, gray to brown, waterbearing, heaving sands.    |          |                           |
| 0.2                                             | 14         | 18                | HSA          | 25       | 25              | SP       |             |                                                                           |          | 10-20 Silica Sand         |
|                                                 |            |                   | 10           | 26       |                 |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 27       |                 |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 28       |                 |          |             | SAND with Gravel fine-medium grained, brown, waterbearing, heaving sands. |          |                           |
|                                                 |            |                   |              | 29       |                 |          |             |                                                                           |          |                           |
| 0                                               | heave      | 18                | HSA          | 30       | 30              | SP       |             |                                                                           |          |                           |
|                                                 |            |                   | 11           | 31       |                 |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 32       |                 |          |             |                                                                           |          |                           |
| End of Boring                                   |            |                   |              |          |                 |          |             |                                                                           |          |                           |
| Water level 14.4' below ground surface 6/10/20. |            |                   |              |          |                 |          |             |                                                                           |          |                           |

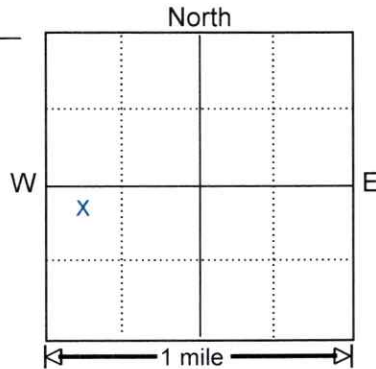
RECEIVED

JUL 07 2025

OFFICE OF  
WATER

**SOUTH DAKOTA WELL AND TEST HOLE PLUGGING REPORT** 11-02Location NW  $\frac{1}{4}$  SW  $\frac{1}{4}$  Sec 32 Twp 111N Rg 79W

Well Owner:

County HughesPlease mark well  
location with an "X"Name: City of PierreAddress: 2301 Patron ParkwayCity, State, Zip: Pierre SD 57501

Comments:

West of Discovery Center & Chamber of Commerce  
800 W. Dakota Avenue, Pierre, SDDC-9  
Flush-mount wellPlugging Completion Date July 1, 2025**CHECK APPROPRIATE BOX**EXISTING WELL ☒TEST HOLE ☐Well depth 30'Casing material PVCCasing size(s) 2"Casing condition Good

Hole depth \_\_\_\_\_

Hole size \_\_\_\_\_

Describe plugging procedure:

Monitoring Well DC-9 water level from top of casing was 14.40 feet. The flush mount protective cover was removed. The well casing was filled with sand from bottom up to approximately 15 feet below grade and with bentonite chips up to 2 feet below ground surface. The top portion of the well casing was cut below grade and removed and the surface area was backfilled with matching surface material.

Describe grout or plugging material:

bentonite chips.Type of non-slip plug: Not ApplicableThis well or test hole was plugged under license # 575 and this report is true and accurate.Drilling firm: American Engineering Testing, Inc.

Signature of Licensed Representative: \_\_\_\_\_

Signature of Well Owner: \_\_\_\_\_

Date: July 2, 2025**RECEIVED****JUL 07 2025****OFFICE OF  
WATER**



AMERICAN  
ENGINEERING  
TESTING, INC.

## BORING/WELL CONSTRUCTION LOG

|                  |                                            |                        |                              |
|------------------|--------------------------------------------|------------------------|------------------------------|
| PROJECT NUMBER   | 18-20139                                   | BORING/WELL NUMBER     | DC-9                         |
| PROJECT NAME     | Pierre Water Treatment Plant - Dewatering  | DATE DRILLED           | 6/2/2020                     |
| LOCATION         | Pierre, South Dakota                       | CASING TYPE/DIAMETER   | Flush Threaded 2" PVC        |
| DRILLING METHOD  | 4.25" ID Hollow-Stem Auger                 | SCREEN TYPE            | Flush Threaded 2" PVC Screen |
| SAMPLING METHOD  | Split-Spoon                                | PACKING TYPE           | 10-20 Silica Sand            |
| GROUND ELEVATION | 1435.70                                    | GROUT TYPE             | Bentonite/Portland Cement    |
| TOP OF CASING    | 1435.16                                    | DEPTH TO WATER (BTOC)  | 12.49'                       |
| LOGGED BY        | DS                                         | GROUND WATER ELEVATION | 1422.67'                     |
| REMARKS          | Surveyed relative to TOC elevation of DC-1 |                        |                              |

| PID (ppm)                                       | Blow Count | RECOVERY (inches) | SAMPLER TYPE | INTERVAL | DEPTH (ft. BGL) | U.S.C.S. | GRAPHIC LOG | MATERIAL DESCRIPTION                                                      | GW LEVEL | WELL CONSTRUCTION         |
|-------------------------------------------------|------------|-------------------|--------------|----------|-----------------|----------|-------------|---------------------------------------------------------------------------|----------|---------------------------|
| 0.2                                             |            | 18                | HSA          | 1        | 1               |          |             | SILT, dark brown to brown, moist.                                         |          | Concrete Seal             |
|                                                 |            |                   | 1            | 2        | 2               | ML       |             |                                                                           |          |                           |
| 0.2                                             |            | 18                | HSA          | 3        | 3               |          |             |                                                                           |          |                           |
|                                                 |            |                   | 2            | 4        | 4               |          |             |                                                                           |          |                           |
| 0.2                                             | 5          | 18                | HSA          | 5        | 5               | ML       |             | SANDY SILT with Clay brown, moist.                                        |          | 2" PVC Riser              |
|                                                 |            |                   | 3            | 6        | 6               |          |             |                                                                           |          | Bentonite Seal            |
| 0.2                                             | 8          | 18                | HSA          | 7        | 7               |          |             | SANDY SILT, brown, moist-wet.                                             |          |                           |
|                                                 |            |                   | 4            | 8        | 8               | ML       |             |                                                                           |          |                           |
| 0.2                                             |            |                   |              | 9        | 9               |          |             |                                                                           |          |                           |
| 0.2                                             | 5          | 18                | HSA          | 10       | 10              | ML       |             | SILT with Clay, brown, moist-wet.                                         |          |                           |
|                                                 |            |                   | 5            | 11       | 11              | CL       |             | SILTY CLAY, brown, moist -wet.                                            |          |                           |
| 0.2                                             |            |                   |              | 12       | 12              |          |             | SANDY SILT with SILTY CLAY seams wet.                                     |          |                           |
| 0.2                                             | 2          | 18                | HSA          | 13       | 13              | ML       |             |                                                                           |          |                           |
|                                                 |            |                   | 6            | 14       | 14              |          |             |                                                                           |          |                           |
| 0.2                                             |            |                   |              | 15       | 15              | SM       |             | SILTY SAND fine grained, brown, waterbearing.                             |          |                           |
| 0.2                                             | 3          | 18                | HSA          | 16       | 16              | ML       |             | SANDY SILT, brown, iron staining, waterbearing.                           |          |                           |
|                                                 |            |                   | 7            | 17       | 17              |          |             | SILTY SAND fine grained, brown, waterbearing.                             |          |                           |
| 0.6                                             | 4          | 18                | HSA          | 18       | 18              | SM       |             |                                                                           |          |                           |
|                                                 |            |                   | 8            | 19       | 19              |          |             | SAND, fine grained, brown, iron staining, waterbearing.                   |          |                           |
| 0.2                                             | 10         | 18                | HSA          | 20       | 20              | SP       |             |                                                                           |          | 2" PVC 0.010" Slot Screen |
|                                                 |            |                   | 9            | 21       | 21              |          |             | SAND with Gravel fine-medium grained, brown, waterbearing, heaving sands. |          |                           |
| 6.7                                             |            |                   |              | 22       | 22              |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 23       | 23              |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 24       | 24              |          |             |                                                                           |          |                           |
|                                                 | 11         | 18                | HSA          | 25       | 25              |          |             |                                                                           |          | 10-20 Silica Sand         |
|                                                 |            |                   | 10           | 26       | 26              | SP       |             |                                                                           |          |                           |
|                                                 |            |                   |              | 27       | 27              |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 28       | 28              |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 29       | 29              |          |             |                                                                           |          |                           |
| 0.6                                             | 22         | 18                | HSA          | 30       | 30              |          |             |                                                                           |          |                           |
|                                                 |            |                   | 11           | 31       | 31              |          |             |                                                                           |          |                           |
|                                                 |            |                   |              | 32       | 32              |          |             | End of Boring                                                             |          |                           |
| Water level 13.0' below ground surface 6/10/20. |            |                   |              |          |                 |          |             |                                                                           |          |                           |

RECEIVED

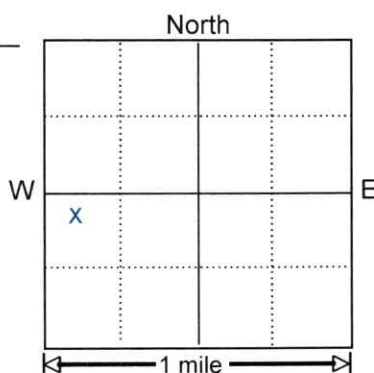
JUL 07 2025

OFFICE OF  
WATER

## SOUTH DAKOTA WELL AND TEST HOLE PLUGGING REPORT 11-02

Location NW ¼ SW ¼ Sec 32 Twp 111N Rg 79W

Well Owner:

County HughesPlease mark well  
location with an "X"Plugging Completion Date July 1, 2025Name: City of PierreAddress: 2301 Patron ParkwayCity, State, Zip: Pierre SD 57501

Comments:

Pierre Water Treatment Plant  
800 W. Sioux Avenue

P-1  
Flush-mount cover - Piezometer

## CHECK APPROPRIATE BOX

EXISTING WELL ☒TEST HOLE ☐Well depth 33.5'Casing material PVCCasing size(s) 1"Casing condition Good

Hole depth \_\_\_\_\_

Hole size \_\_\_\_\_

Describe plugging procedure:

Piezometer P-3 water level from top of casing was 8.90 feet. The flush mount protective cover was removed. The well casing was filled with sand from bottom up to approximately 10 feet below grade and with granular bentonite up to 2 feet below ground surface. The top portion of the well casing was cut below grade and removed and the surface area was backfilled with matching surface material.

Describe grout or plugging material:

Granular bentoniteType of non-slip plug: Not ApplicableThis well or test hole was plugged under license # 575 and this report is true and accurate.Drilling firm: American Engineering Testing, Inc.

Signature of Licensed Representative: \_\_\_\_\_

Signature of Well Owner: \_\_\_\_\_

Date: July 2, 2025

RECEIVED

JUL 07 2025

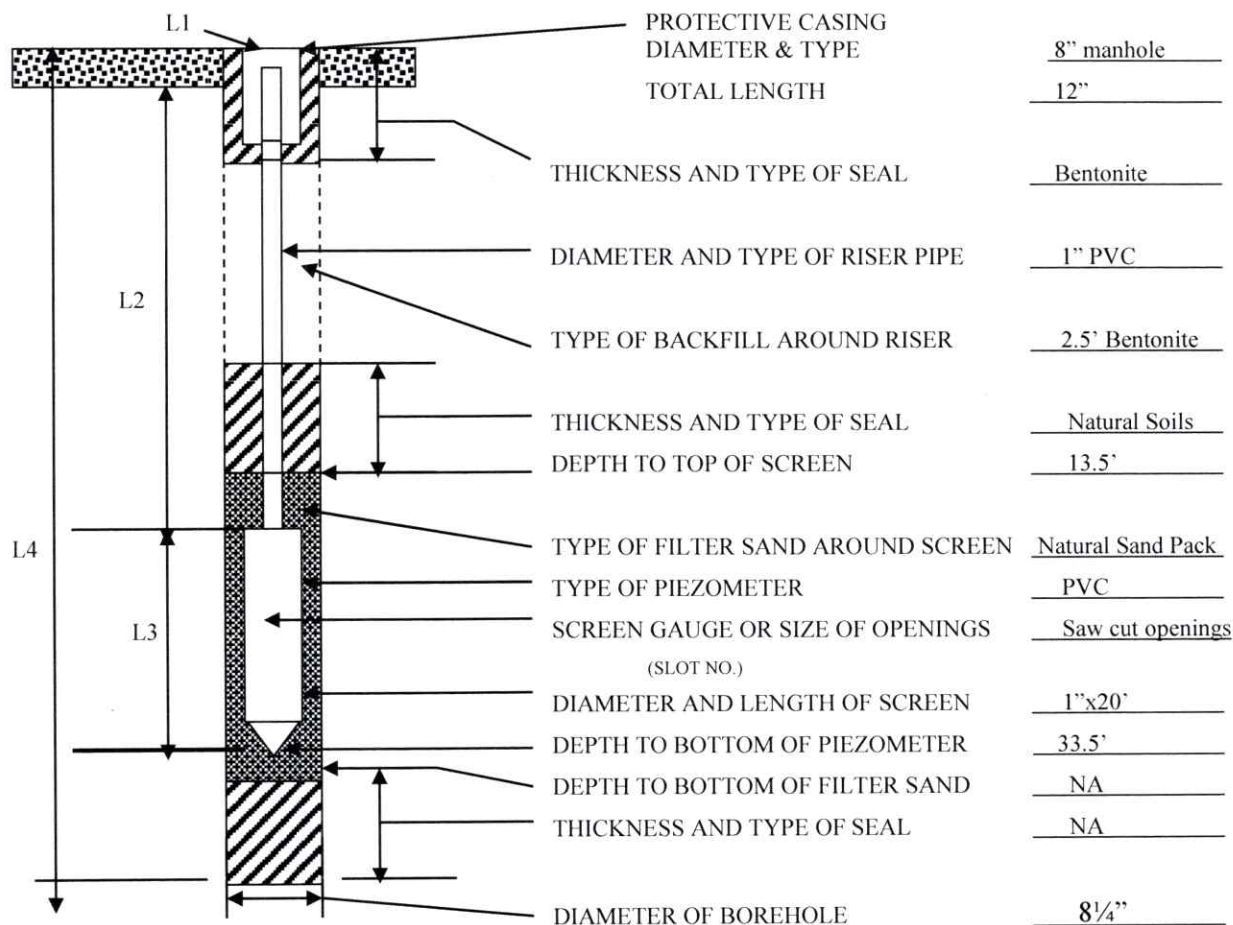
OFFICE OF  
WATER

RECEIVED

JUL 07 2025

OFFICE OF  
WATER

## INSTALLATION OF PIEZOMETER

JOB NO. 17-20073 PIEZOMETER NO. P-1 BORING NO. 1PROJECT: Water Treatment Plant, Pierre, South DakotaGROUND SURFACE ELEVATION 97.0' TOP OF RISER PIPE ELEVATION 96.8'  
(WITH CAP REMOVED)

| DATE    | TIME  | SAMPLED<br>DEPTH | CASING<br>DEPTH | WATER LEVEL FROM<br>GROUND SURFACE | WATER LEVEL FROM<br>TOP OF RISER | DEPTH TO<br>CAVE IN |
|---------|-------|------------------|-----------------|------------------------------------|----------------------------------|---------------------|
| 7-12-18 | 12:33 | 35'              | 33.5'           |                                    | 10.2'                            | 33.5'               |
| 7-16-18 | 14:45 | 35'              | 33.5'           |                                    | 9.7'                             | 33.5'               |

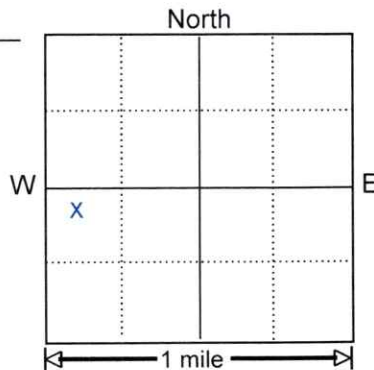
L1 = -0.2'L2 = 13.3'L3 = 20'L4 = 33.5'

INSTALLATION COMPLETED:

DATE: 17-11-18 TIME: 17:15

**SOUTH DAKOTA WELL AND TEST HOLE PLUGGING REPORT 11-02**Location NW ¼ SW ¼ Sec 32 Twp 111N Rg 79W

Well Owner:

County HughesPlease mark well  
location with an "X"Name: City of PierreAddress: 2301 Patron ParkwayCity, State, Zip: Pierre SD 57501

Comments:

Pierre Water Treatment Plant  
800 W. Sioux AvenueP-3  
Flush-mount cover - PiezometerPlugging Completion Date July 1, 2025**CHECK APPROPRIATE BOX**EXISTING WELL ☒TEST HOLE ☐Well depth 34.5'Casing material PVCCasing size(s) 1"Casing condition Good

Hole depth \_\_\_\_\_

Hole size \_\_\_\_\_

Describe plugging procedure:

Piezometer P-3 water level from top of casing was 14.41 feet. The flush mount protective cover was removed. The well casing was filled with sand from bottom up to approximately 15 feet below grade and with granular bentonite up to 2 feet below ground surface. The top portion of the well casing was cut below grade and removed and the surface area was backfilled with matching surface material.

Describe grout or plugging material:

Granular bentoniteType of non-slip plug: Not ApplicableThis well or test hole was plugged under license # 575 and this report is true and accurate.Drilling firm: American Engineering Testing, Inc.

Signature of Licensed Representative: \_\_\_\_\_

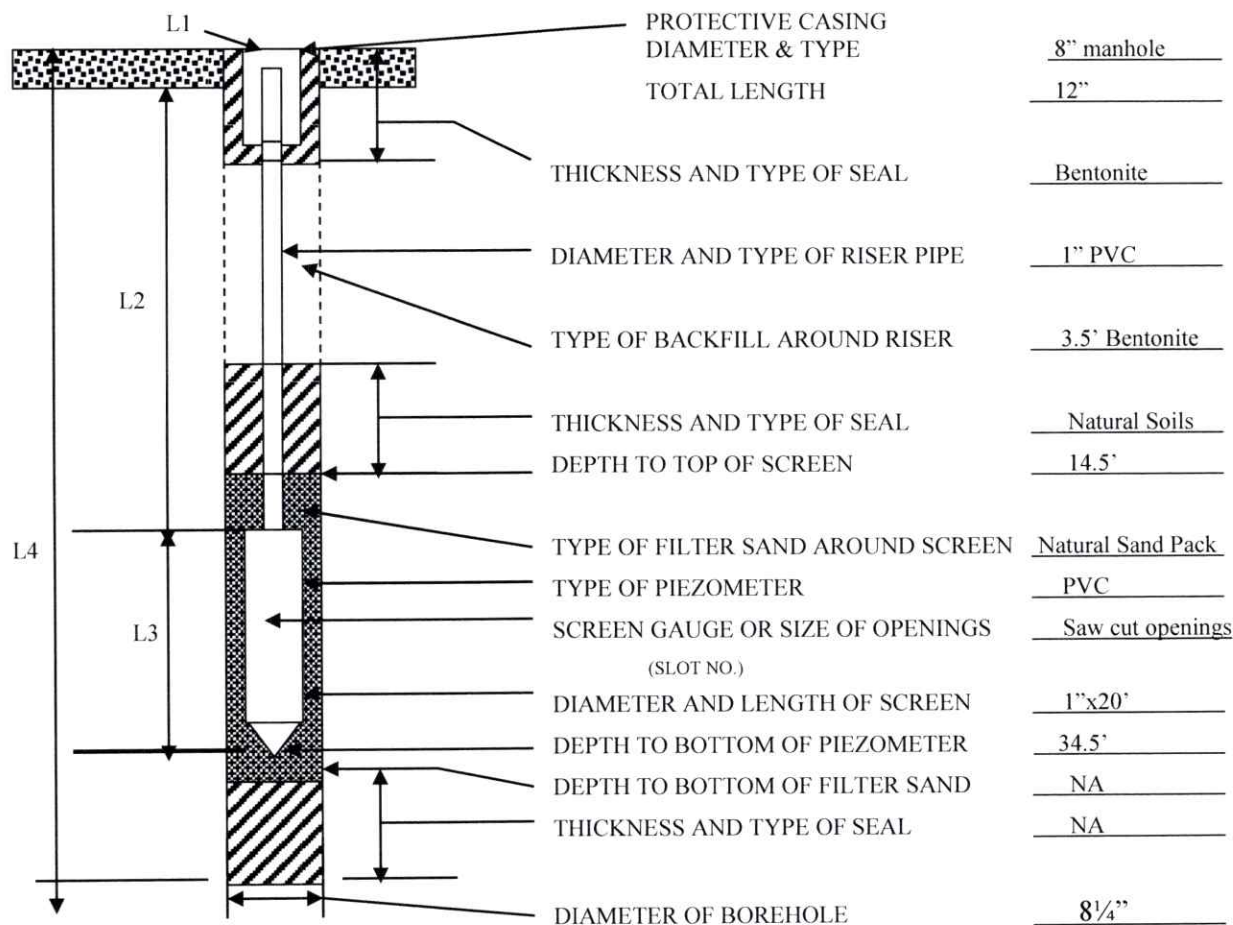
Signature of Well Owner: \_\_\_\_\_

Date: July 2, 2025**RECEIVED****JUL 07 2025****OFFICE OF  
WATER**

RECEIVED

JUL 07 2025

## INSTALLATION OF PIEZOMETER

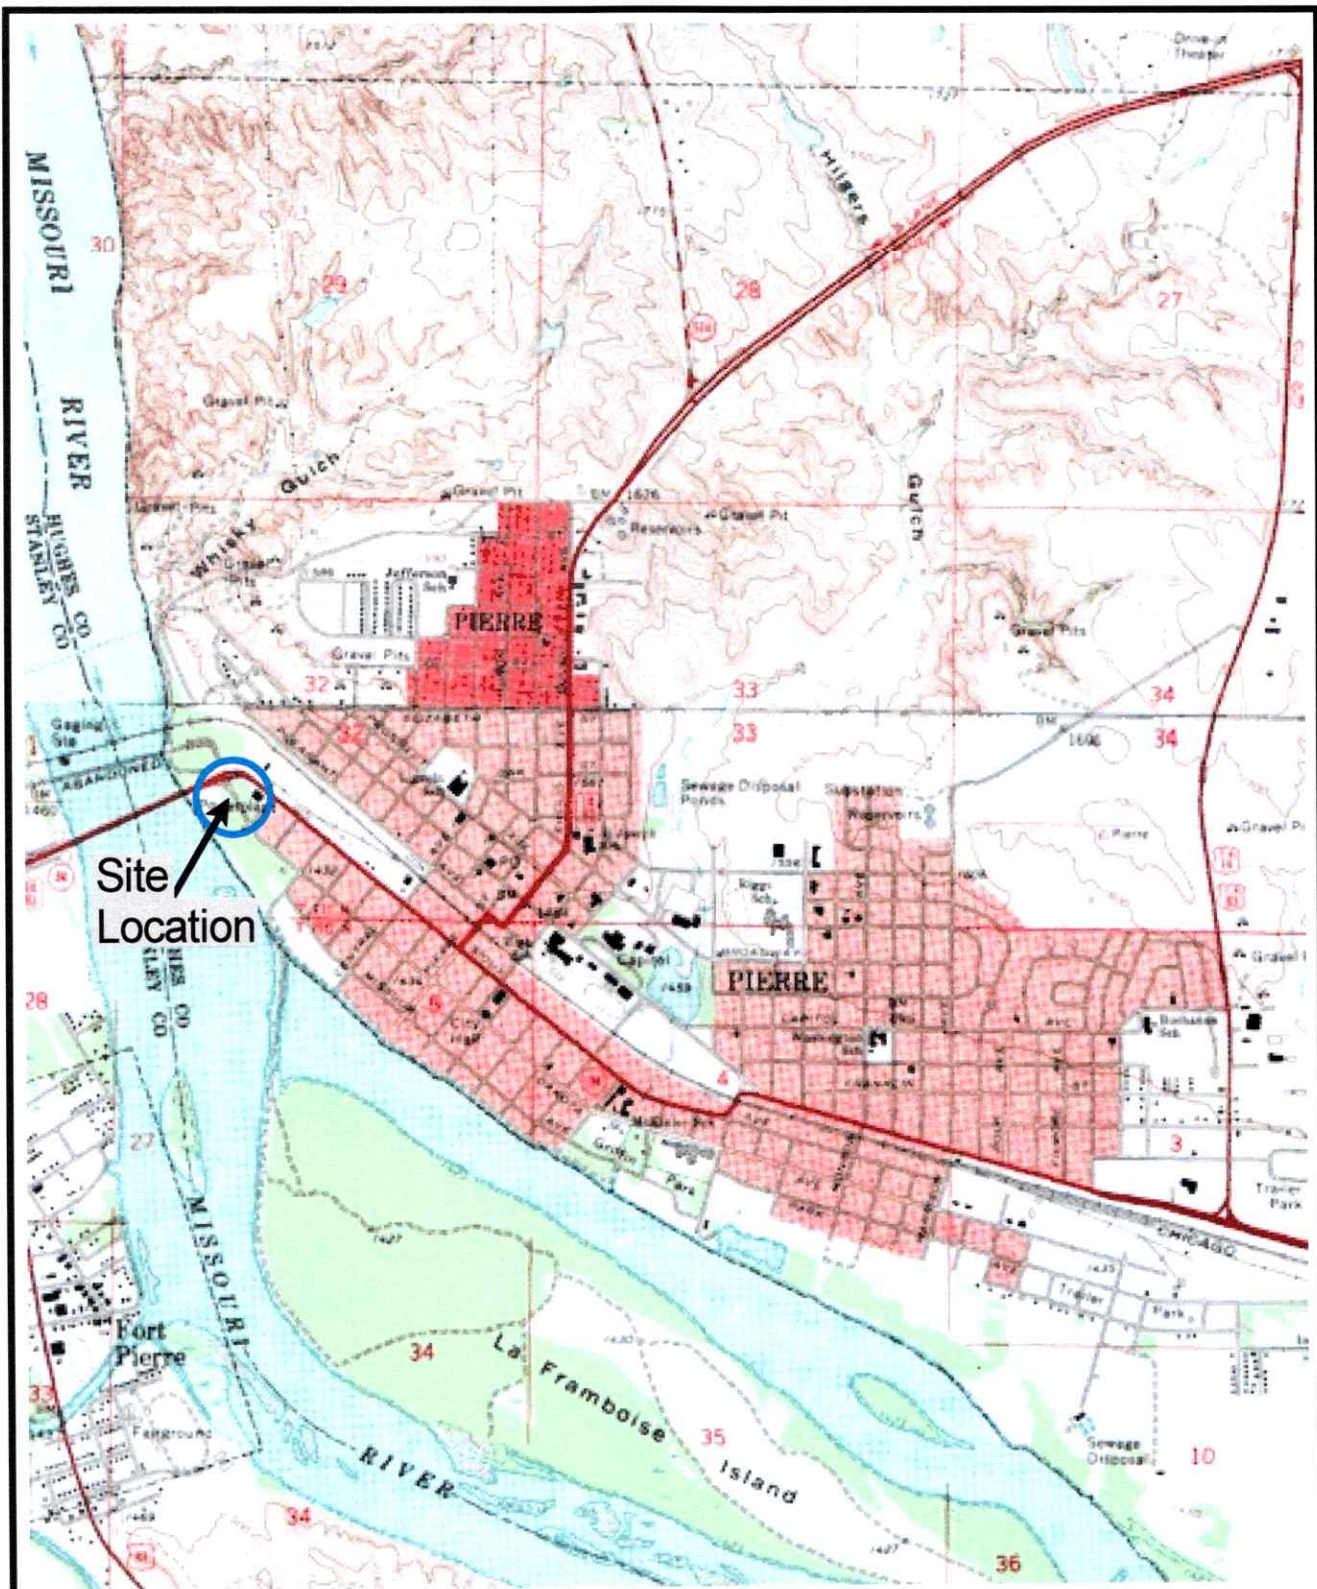
OFFICE OF  
WATERJOB NO. 17-20073 PIEZOMETER NO. P-3 BORING NO. 3PROJECT: Water Treatment Plant, Pierre, South DakotaGROUND SURFACE ELEVATION 99.7' TOP OF RISER PIPE ELEVATION 99.5'  
(WITH CAP REMOVED)

| DATE    | TIME  | SAMPLED DEPTH | CASING DEPTH | WATER LEVEL FROM GROUND SURFACE | WATER LEVEL FROM TOP OF RISER | DEPTH TO CAVE IN |
|---------|-------|---------------|--------------|---------------------------------|-------------------------------|------------------|
| 7-12-18 | 12:38 | 35'           | 34.5'        |                                 | 12.5'                         | 34.5'            |
| 7-16-18 | 14:55 | 35'           | 34.5'        |                                 | 12.7'                         | 34.5'            |

L1 = -0.2'L2 = 14.3'L3 = 20'L4 = 34.5'

INSTALLATION COMPLETED:

DATE: 17-12-18 TIME: 9:00



Site  
Location

American Engineering Testing, Inc.

PROJECT DESCRIPTION

Well Plugging/Abandonment  
Discovery Center & Water Treatment Plant  
Pierre, South Dakota

SITE  
LOCATION  
MAP

FIGURE 1.

AET Project No. P-0043436



SOUTH DAKOTA  
Pierre

PIERRE QUADRANGLE  
SOUTH DAKOTA - HUGHES CO.  
7.5 MINUTE SERIES (TOPOGRAPHIC)  
T11N, R79W, SW 1/4 Section 32

RECEIVED

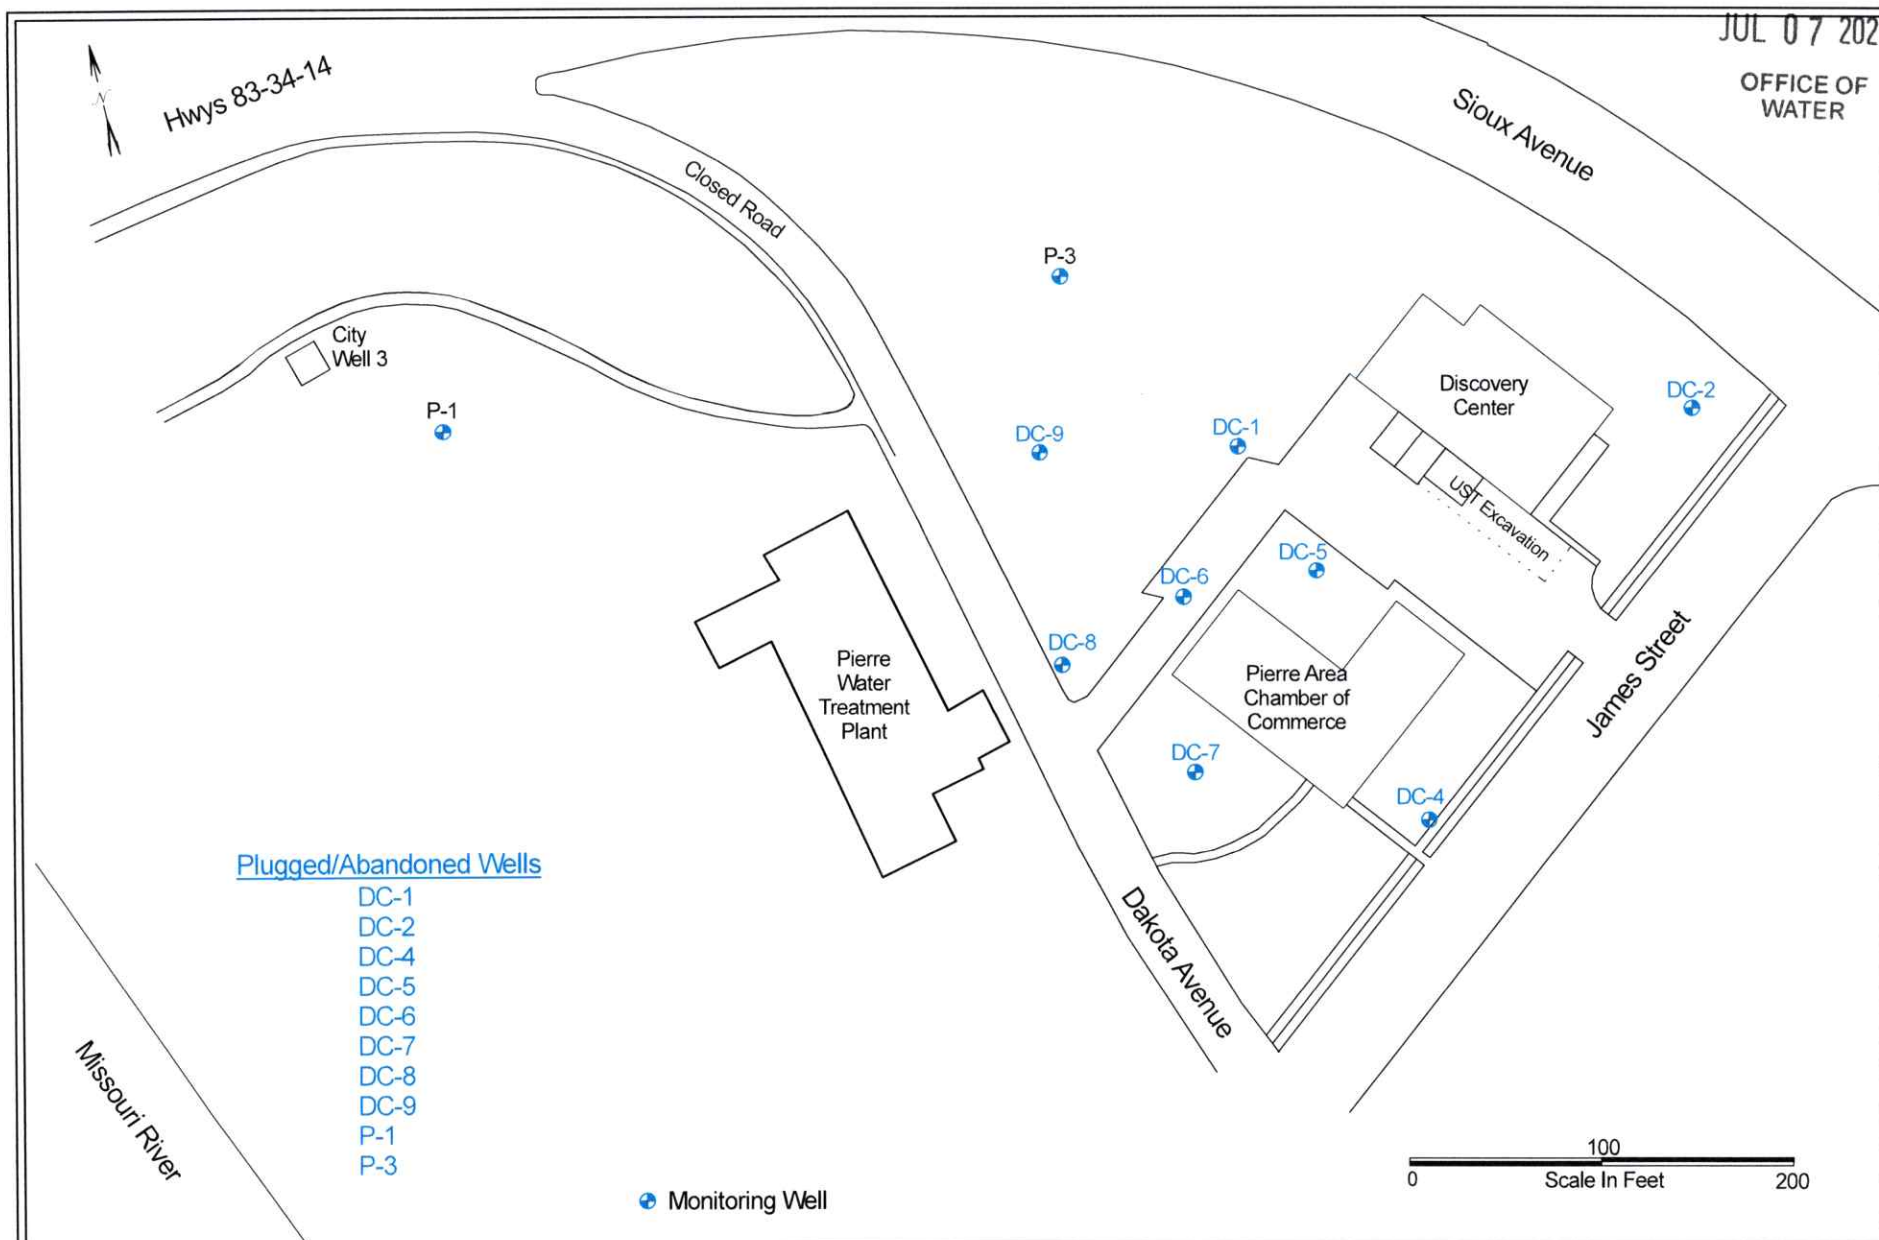
JUL 07 2025

OFFICE OF  
WATER

RECEIVED

JUL 07 2025

OFFICE OF  
WATER



Project:  
Well Plugging/Abandonment  
Discovery Center & Water Treatment Plant  
Pierre, South Dakota

Subject:  
Well Location Site Sketch

Scale:  
1" = 100'

Date:  
7-2-2025

Prepared By:  
DLS

Checked By:  
BPB

AET Project No.:  
P-0043436

Figure:  
2