

Considered: _____

WATER PERMIT NO. 1367-1

MAP No. same

Name of Applicant Deloris Morgen / Dew Drop Inn

Post Office Address Mahto SD 57643

Amount of Water Claimed .10 cfs Total Acres NA

Source of Water Supply ground water

Water to be used for commercial use County Corson

About _____ miles _____ of _____ in Mahto.

PROOF OF PUBLICATION: Received _____ Not Received _____

APPLICATION: Approved 12/10/86 Subject to _____

F.F. & C.L. Adopted _____ Not Approved _____ Deferred _____

PRIORITY _____ Date Received July 3, 1986 Fee \$50.00 Remarks _____

7/3/86

Corrected Application Received Aug 15, 1986 Period of Annual Use Jan - Dec 31


WATER QUALITY APPROVAL RECEIVED NA APPROVED/CONDITIONAL (Circle one)

WI-1 Description same as Application YES _____ NO _____ REMARKS _____

Diversion Point well: Lot 20, Block 5, N 1/2

section 29 - T21N - R28E

Land to be Irrigated NA

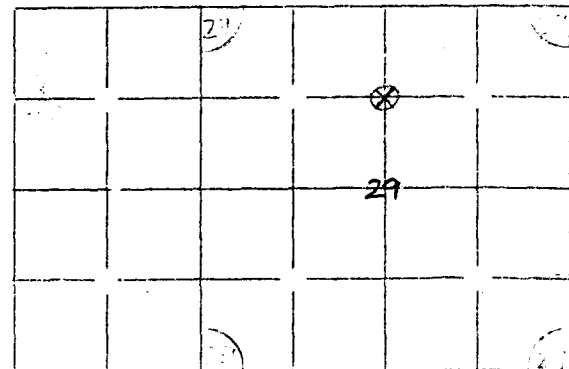

Well Log: Driller not available Licensed YES _____ NO _____

Depth of Well 40 feet REMARKS _____

Type of Map topo PREPARED BY Deloris Morgen & Ron Duvall Reviewed and the Number


assigned on October 15, 1986 By Ron Duvall

No. 1367-1 Hydrologic Unit 10130102
 Map No. same Basin Missouri River
 Newspaper McLaughlin Messenger Box 388 (thru)

Application For Permit To Appropriate Water Within The State Of South Dakota

Check use of water: Industrial ☐ Commercial ☒ Municipal ☐ Other Common Distribution System ☐
 Rural Water System ☐ Suburban Housing ☐ Geothermal Heat ☐ Institutional ☐ Recreational ☐
 Domestic ☐ (above 18gpm) Other ☐

Type of Application: Check one or more of the following

New ☒ Vested Right ☐ Future Use ☐ Change Use ☐☐ Amend Permit No. _____ with old priority date retainedChange diversion point(s) ☐ Add diversion point(s) ☐ Other ☐☐ Application to: Change diversion point(s) ☐ Add diversion point(s) ☐ on Permit No. _____☐ Construction to use water reserved by Future Use Permit No. _____1. Name of Applicant Deloris Morgen Phone No. 823-4926Dew Drop InnPost Office Address Mahto, South Dakota

(Street, RR or Box)

State 57643

Zip Code

2. Amount of water claimed (c.f.s.) 45 gallons per minute (0.10 cfs)3. Source of water supply private well - ground water4. Location of point of diversion Lot 20, Block 5, ^{N¹}/₂ in Section 29, Township 21, Range 2
8, Mahto, Corson County, South Dakota 57643_____ County Corson5. Counties where water will be used Corson County6. Annual period during which water is to be used yearly Jan 1 - Dec 31

7. Give a brief description of proposed project. When available include any preliminary engineering report or other reports or information that will help explain the project. (Attach sheet if more space is needed)

Water is being used from an existing well which well was drilled or dug in 1959 and was used in 1960. This well serves two single family dwellings and it is piped then to the Dew Drop Inn cafe and lounge at Mahto, South Dakota. The only commercial use is in the cafe and lounge. There is no drilling log or other information concerning the facts relating to the drilling of the well.

Attachments: Attach Form 2A if diversion from a well or dugout, or if storage of water, is proposed. Attach map (see instruction)

STATE OF SOUTH DAKOTA)
 County of CORSON)^{ss}

I, Deloris Morgen the applicant, certify that I have read the foregoing application, have examined the attached map and that the matters therein stated are true and that I intend, and am able to complete the necessary construction.

Signed Deloris MorgenSubscribed and sworn to before me this 2nd day of July 1986Barbara Cipri

Notary Public (or other qualified officer)

My commission expires: 8-20-92

WATER PERMIT

The Water Management Board hereby approves Water Permit Application No. 1367-1
Deloris Margen / Dew Drop Inn Mahto
(Applicant) (Post Office Address)
SD 57643 With the following qualifications.
(State) (Zip Code)

The well approved under this Permit is located near domestic wells which may obtain water from the same aquifer. The well owner, under this Permit, shall control his withdrawals so there is not a reduction of needed water supplies in adequate domestic wells.

Date of first receipt of application July 3, 19 86.
 Date of return to applicant for correction, amendments or changes required August 12, 19 86.
 Date of receipt of corrected application August 15, 19 86. Approved December 10, 19 86.

The Water Management Board hereby approves this Water Permit No. 1367-1 authorizing the construction of the water use system and the placing of water to beneficial use as stated in the Application and as qualified in the Water Permit approval, subject, however, to the following limitations and conditions:

1. The date from which applicant may claim right is July 3, 19 86.
2. The equivalent of at least one-fifth of the specified work is ~~to be~~ completed ~~on or before~~ , 19 .
3. The whole of said work is ~~to be~~ completed ~~on or before~~ , 19 .
4. The limit of time from proof of beneficial use of water appropriated in accordance herewith is , 19 .
5. The water appropriated shall be used for the purpose of commercial use by a cafe and lounge.
6. The prior right of all persons who, by compliance with the laws of the State of South Dakota, have acquired a right to the use of water must not be unlawfully impaired by this appropriation.
7. The amount of the appropriation herein granted shall not exceed 0.10 cubic feet per second; neither shall it exceed the capacity of the above described water supply system nor shall it exceed the amount of water needed for beneficial uses served and to which water is actually and beneficially applied for commercial purposes ~~on or before~~ , 19 ; said water to be used during the following described annual period: Jan. 1 - Dec. 31

WATER MANAGEMENT BOARD
 By: John Mahto
Chief Engineer
 Division of Water Rights
 Dept. of Water and Natural Resources
FEB 17 1987
 , 19

Supplemental Information

(type or print in ink)

1. Well Information - Proposed construction

- a) Drill Hole Diameter 2 feet Depth 35 to 40 feet
- b) Casing Type concrete culvert Diameter 2 feet Thickness 2 inches
- c) Screen Type _____ Diameter _____ Thickness _____
- d) Gravel Pack Thickness _____ Length of Gravel Pack _____
- e) Depth to Top of Water Bearing Material _____
- f) Depth of Water (ground surface to water level) 36 feet (approximately)
- g) Distance to nearest existing domestic well:

On applicants property None On property owned by others 550 feet
Well was drilled in 1959 - no drilling logs available.

2. Dugout Information Estimates

- a) Surface Dimensions _____ Depth _____
- b) Depth to water (ground surface to water level) _____

3. Water Storage Dams

If the proposed water use system contains one or more storage dams, please furnish the information requested below. The locations of each dam should be shown on the map submitted with the application.

- a) If a private engineering firm or government agency was involved in the design of this dam please give their name and address

b) Freeboard _____

c) Crest Width _____

Crest Length _____

d) Height _____

e) Outlet Dimensions:
 Pipe diameter _____

Spillway width _____


f) X & Y Slope
 Upstream _____

Downstream _____

Surface Area of Impoundment _____

Storage _____ acre feet

Drainage area above dam _____

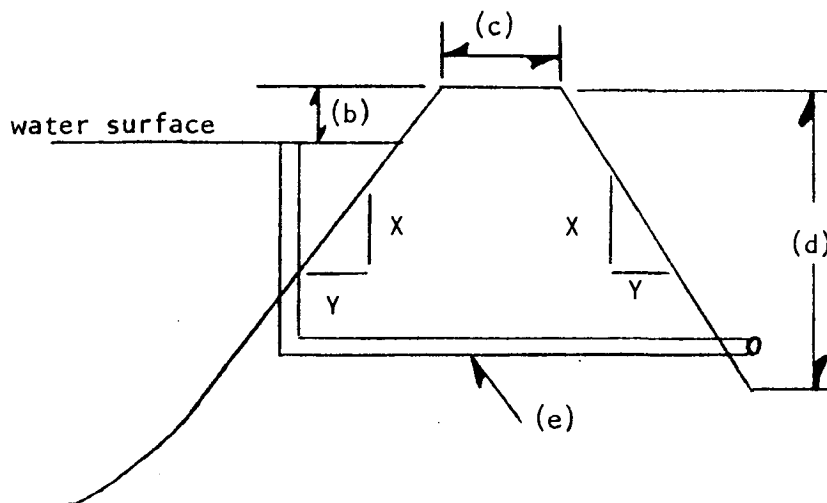

Signature of Applicant _____

RECEIPT

Division of Water Rights

South Dakota Department of Water and Natural Resources

410481

Pierre, July 7, 1986

RECEIVED OF Deloris Morgen, Dew Drop Inn, Mahto SD 57543


the following amount in fees for services rendered as provided for by law:

Fee for Application for Permit No. <u>1367-1</u> to Appropriate Water, to construct works and to put water to beneficial use _____	50	00
Fee for Application for Permit No. _____ to Appropriate Water for Future Use _____		
Fee to retain Future Use Permit No. _____ after period of seven years.		
Fee for Inspecting Constructed Works, confirming beneficial use and issuing Water License No. _____		
Fee for Filing Transfer Form _____		
Fee for Filing Extension Request _____		
Fee for Certified Copy of _____		
Fee for Print Copy of Map _____		
Fee for Certifying _____		
Fee for _____		
(Any Other Work Provided by Law)	Total	50 00

By


John Hatch
Chief Engineer

JOHN HATCH (ks)

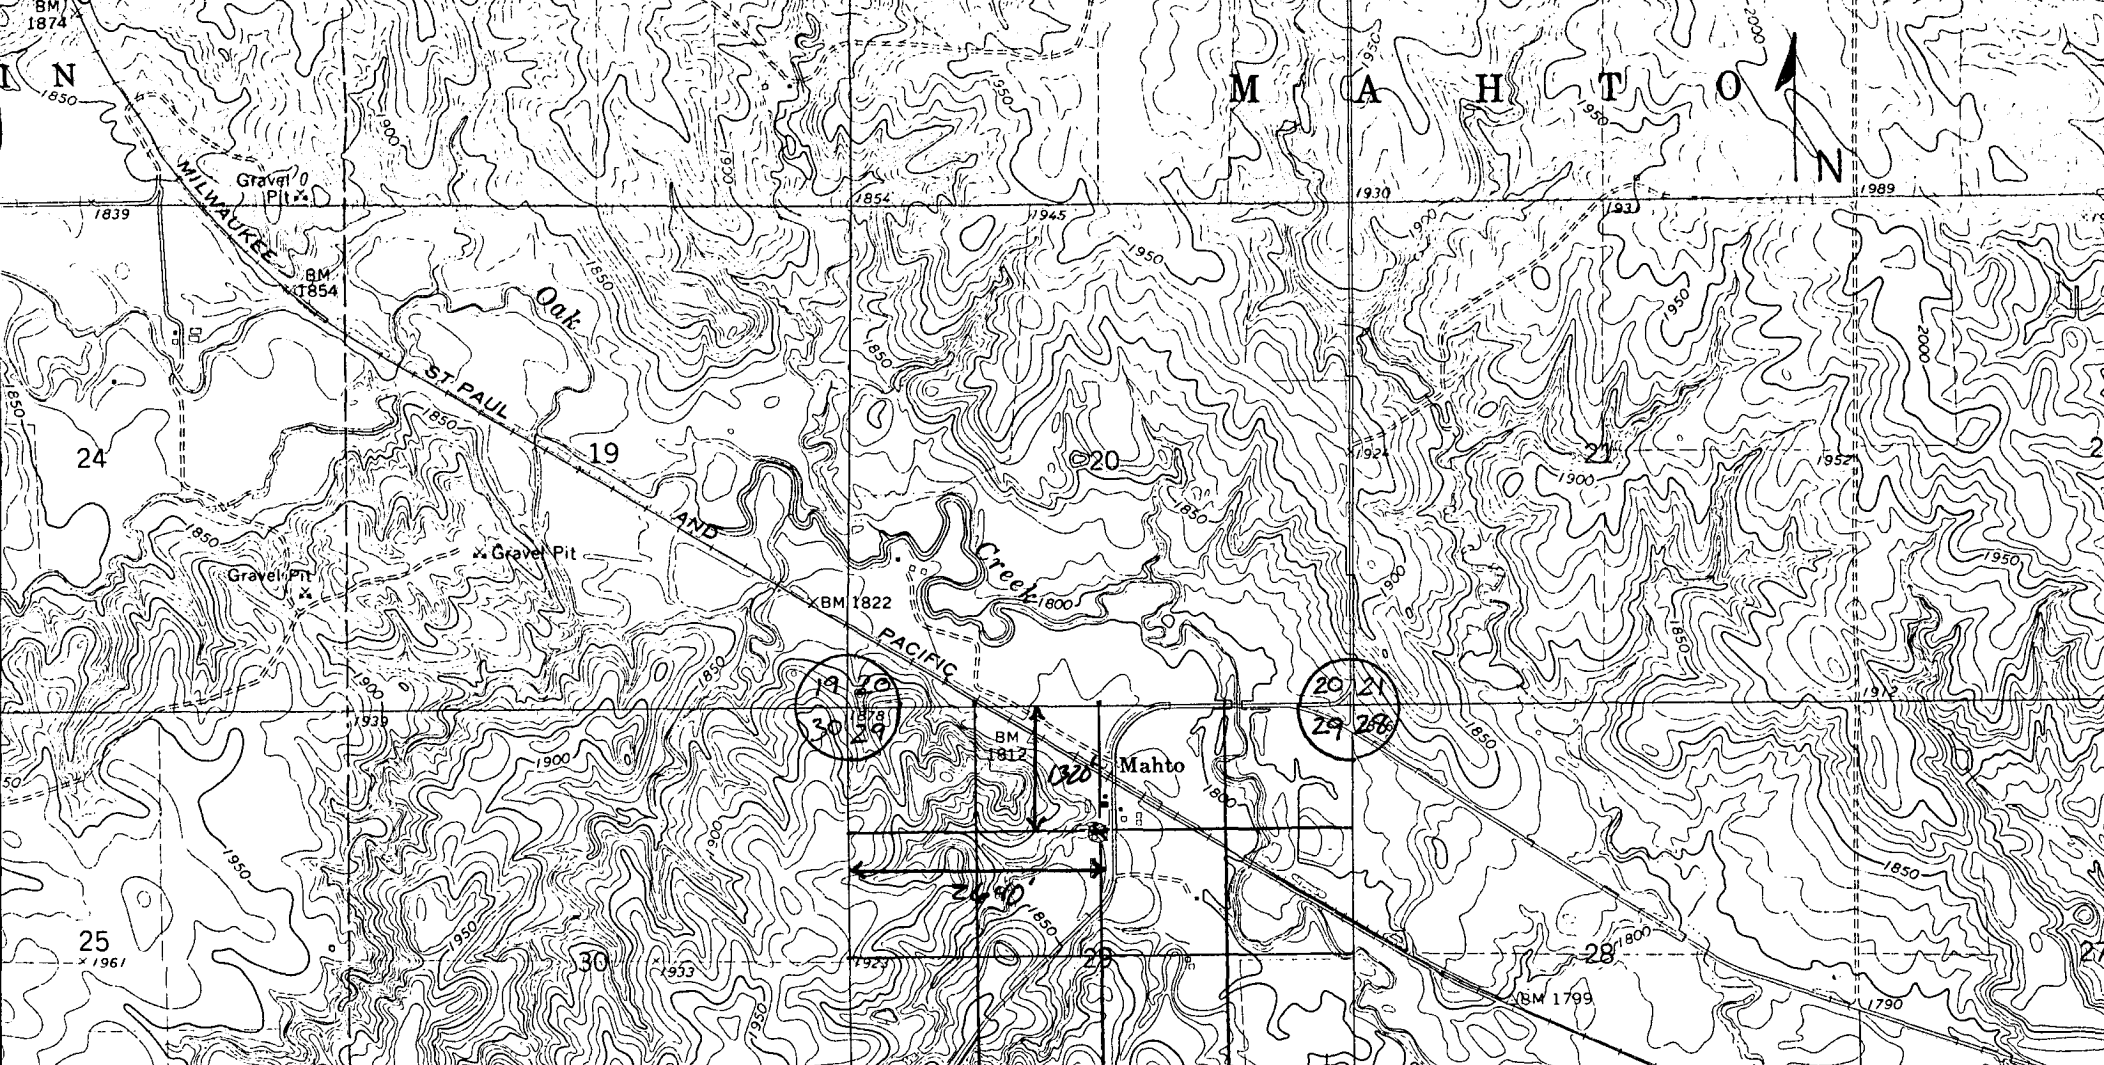


6 MI. TO S. DAK. 20 R. 27 E. 42'30" R. 28 E. 368 (WAKPALA NW) 369 5875 II NW 370 401 371 000m. E. INTERIOR-GEOLOGICAL SURVEY WASH. D.C. WAKPALA 9 MI.

SCALE 1:24 000

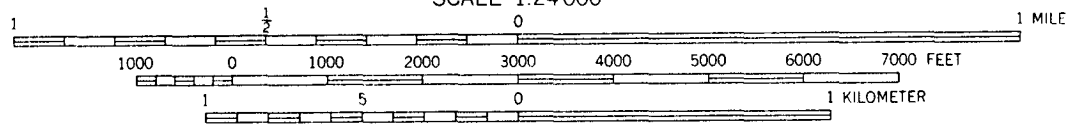

CONTOUR INTERVAL 10 FEET
DATUM IS MEAN SEA LEVEL




GRID AND 1966 MAGNETIC NORTH
DECLINATION AT CENTER OF SHEET

FOR SALE BY U.S.
A FOLDE


*Deloris Morgan
New Drop Inn
Mahto, S. D. 57643*

*x-well
Ron Durrell
Natural Resources Eng
10/17/96*

S
SHINGTON, D. C. 20242
ON REQUEST



QUADRANGLE LOCATION



Appl. No. 1367-1

ROAD CLASSIFICATION

Heavy-duty ——— Light
Unimproved dirt = - - -
U.S. Road

BORMANN, BUCKMEIER & BORMANN
ATTORNEYS-AT-LAW
BORMANN BUILDING
116 FOURTH STREET WEST
MOBRIDGE, SOUTH DAKOTA 57601

I. F. BORMANN
A. N. BUCKMEIER
C. J. BORMANN

Post Office Box 9
Telephone 845-7282
Area Code 605

July 2, 1986

Mr. John Hatch
Chief Engineer
Water Rights Division
South Dakota Department of Water and
Natural Resources
Joe Foss Building
523 East Capitol
Pierre, South Dakota 57501



Dear Mr. Hatch:

Re: Deloris Morgen - Dew Drop Inn
Mahto, South Dakota

At the request of Mrs. Morgen, I am enclosing herewith the Application For Permit to Appropriate Water. Attached is the supplemental information and her check in the amount of \$50.00. The Application is submitted in duplicate.

We would appreciate you advising when this matter will be given final consideration. Thank you.

Very truly yours,

BORMANN, BUCKMEIER & BORMANN

I. F. Bormann
I. F. Bormann (by E.O.)

IFB:bo
Enclosures

SOUTH Dakota Department of
Water & Natural Resources

Joe Foss Building
523 East Capitol
Pierre, South Dakota 57501-3181

August 12, 1986

Delores Morgen
Dew Drop Inn
Mahto SD 57643

Dear Ms. Morgen:

This letter is in response to the water permit application for the Dew Drop Inn received on July 3, 1986.

A map showing the location of the well needs to be submitted with the application. Enclosed is a map of the area where the well is located. Mark the location of the well with an "X", sign the map and return to the Division of Water Rights. The permit application can not be processed until the application has been completed. Please contact us if you have any questions.

Thank you for your time and consideration.

Sincerely,



RON DUVALL
Natural Resources Engineer

RD:ks

enclosure

REPORT ON APPLICATION NO. 1367-1
THE DEW DROP INN c/o DELORIS MORGEN
October 6, 1986

This application proposes to appropriate 0.10 cfs from one well 40 feet deep located in Lot 20, Block 5, N 1/2 Section 29, T21N, R28E BHM. The water is for commercial use by the Dew Drop Inn.

Aquifer - unknown, Fox Hills or Pierre Shale

Geology and Aquifer Characteristics

No well log is available and the geologic map of the Mahto Quadrangle (Baldwin, 1950) indicates the Pierre Shale and Fox Hills contact is in this area. The well is apparently a large diameter bored well and this would indicate a low yield well with the large diameter necessary for storage. There are no other records which would indicate the quantity, quality or the formation the water is coming from for this area.

Review of Existing Water Rights

There are no existing water permits for groundwater in this area.

Conclusions

1. Water is available.
2. The well has been used for these purposes since 1960.
3. Because of the well construction, this well should be tested periodically to determine if the water is safe.
4. There is no indication that this well is capable of producing 45 gpm.


JAMES A GOODMAN
Hydrologist

Bibliography

Baldwin, Brewster, 1950, Areal Geology of the Mahto Quadrangle, SDGS, Vermillion SD. 57069.


RECOMMENDATION OF CHIEF ENGINEER FOR WATER PERMIT
APPLICATION NO. 1367-1

Pursuant to SDCL 46-2A-2, the following is the recommendation of the Chief Engineer, Water Rights Division, Department of Water and Natural Resources concerning Water Permit Application No. 1367-1, Dew Drop Inn, c/o Deloris Morgen, Mahto SD.

The Chief Engineer is recommending APPROVAL of Application No. 1367-1 because 1) there is reasonable probability that there is unappropriated water available for the applicant's proposed use, 2) the proposed diversion can be developed without unlawful impairment of existing rights, 3) the proposed use is a beneficial use and 4) in the public interest with the following qualifications:

The well approved under this Permit is located near domestic wells which may obtain water from the same aquifer. The well owner, under this Permit, shall control his withdrawals so there is not a reduction of needed water supplies in adequate domestic wells.

See the attached report for additional information.



JOHN HATCH, Chief Engineer
October 7, 1986



Department of Water & Natural Resources

Joe Foss Building
523 East Capitol
Pierre, South Dakota 57501-3181

Water Rights Division
605 773-3352

October 30, 1986

NOTE:

TO BE SURE OF PUBLICATION ON
THE CORRECT DATES, CONTACT THE
NEWSPAPER RIGHT AWAY.

Deloris Morgen
Dew Drop Inn
Mahto, South Dakota 57643

Dear Ms. Morgen:

Your Application No. 1367-1 for a permit to appropriate water for

commercial use, has been examined and found to
comply with the South Dakota Water Laws and applicable rules. A notice of
your intent to appropriate water has been sent to the Publisher of the

McLaughlin Messenger printed at McLaughlin

South Dakota. For your information, a copy of this notice, the recommendation
of the Chief Engineer and a report on the application are enclosed. Please
review this notice prior to publication and notify this office, if you have
any corrections or questions.

Be sure to contact the above newspaper to authorize publication of your notice
of intent to appropriate water and to arrange for payment. Early contact with
the paper can eliminate delays. The publisher has been instructed to publish
your notice once each week for two consecutive weeks with the last publication
to occur at least thirty days before the board meeting. We must receive
Proof of Publication before the application can be considered by the Water
Management Board.

Sincerely,

RON DUVALL
Natural Resources Engineer

enclosures



Department of Water & Natural Resources

Joe Foss Building
523 East Capitol
Pierre, South Dakota 57501-3181

Water Rights Division
605 773-3352

October 30, 1986

McLaughlin Messenger
Box 388
McLaughlin, South Dakota 57642

Dear Sir:

Enclosed is a Notice of Intent to Appropriate Water by Deloris Morgen Dew Drop Inn
Application No. 1367-1, in Corson County, South Dakota. Please
publish this notice once each week for two consecutive weeks in your paper. The
first publication should be on, or before November 6, 1986.

The APPLICANT MUST VERIFY TO YOU THAT THE NOTICE IS TO BE PUBLISHED, before you
make the first publication. The applicant is to pay the cost of publication and
should make the necessary arrangements with you to pay these costs.

A copy of BOTH publications must be sent to the Water Rights Division. IMMEDIATELY
after the FIRST publication, return a copy of the notice with the FIRST Publication
Transmittal form on the bottom of this page. The first copy is needed to check
the publication for errors so any corrections can be made before the second
notice is published.

Please be sure the SECOND publication is returned with the enclosed Proof of
Publication form. The permit application cannot be considered by the Water
Management Board until proof of publication has been received.

Thank you for your assistance.

Sincerely,

RON DUVALL
Natural Resources Engineer

cc: applicant

***** CUT HERE *****

FIRST
Publication
Transmittal

No. _____ Date _____
TO: Water Rights Division
Joe Foss Building
Pierre SD 57501-3181

We are in receipt of your letter dated _____ and Notice of Hearing to
Appropriate Water by Application No. _____. The notice was first published
in our issue dated _____. ENCLOSED IS A COPY OF THIS FIRST PUBLICATION.

NAME _____ NEWSPAPER _____

Equal Opportunity Employer

No. 1367-1

Instruction to Newspaper - Publish first publication of the following Notice on or before November 6, 1986 with 2nd publication 1 week later. The applicant is responsible for payment.

NOTICE OF HEARING on Application No. 1367-1 to Appropriate Water
and/or to Amend Water Permit or Water Right No. _____

Notice is hereby given that the Dew Drop Inn c/o Deloris Morgan whose mailing address is Mahto, South Dakota has made an application for a permit

to appropriate .10 cubic feet of water per second from one well 40 feet deep located in Lot 20, Block 5, N $\frac{1}{2}$ Section 29-T21N-R28E. The water is for commercial use by the Dew Drop Inn.

Pursuant to SDCL 46-2A-2 the Chief Engineer of the Water Rights Division recommends APPROVAL of Application No. 1367-1 because 1) unappropriated water is available, 2) will be no unlawful impairment of existing rights, 3) is beneficial use of water and 4) is in the public interest.

This application will be considered by the Water Management Board at room 216, Joe Foss Building, 523 E. Capitol, Pierre, South Dakota, December 10 19 86 at 10:00 am.

The recommendation of the Chief Engineer is not final or binding upon the Board and the Board is authorized to 1) approve, 2) approve with qualifications, 3) defer, or 4) deny this application after it reaches a conclusion based upon facts presented at the public hearing. Any interested person who may be affected by a Board decision and who intends to participate in the hearing before the Board and present evidence or cross-examine witnesses according to SDCL 1-26, must file a written petition with BOTH the applicant and the Chief Engineer by November 28, 1986. The petition may be informal, but it must include a statement describing the petitioners interest in the application, the reasons for the petitioner's opposition to or support of the application, and the signature and mailing address of the petitioner or his legal counsel if legal counsel is obtained. The applicant need not file a petition.

This application is made pursuant to the provisions of SDCL 46-1-1 thru 46-1-9, 46-1-12 thru 46-1-15; 46-2-3.1, 46-2-9, 46-2-11, 46-2-13, 46-2-17; 46-2A-1 thru 46-2A-10, 46-2A-12, 46-2A-14, 46-2A-15; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-24, 46-5-25, 46-5-30.2 46-5-30.4, 46-5-31; ~~(ground)~~ 46-6-3, 46-6-3.1, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14; ~~(future use)~~ 46-5-38 thru 46-5-40; ~~(transfer lands)~~ 46-5-30.4, 46-5-33 thru 46-5-35; ~~(10,000 AFA)~~ 46-5-20.1, 46-5-8.1; and Board Rules ARSD 74:02:01:01 thru 74:02:01:15; ~~(future use)~~ 74:02:01:24 thru 74:02:01:25; ~~(10,000 AFA)~~ 74:02:01:15:02 thru 74:02:01:15:05.

This hearing is an adversary proceeding. The applicant or any person, after filing a petition, has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any person wishing a copy of the Chief Engineer's recommendation, further information on this application or to assure access to the hearing by the handicapped can contact the Water Rights Division, DWNR, Joe Foss Bldg, Pierre SD (605 773-3352) for assistance prior to the hearing date. The time of the hearing will be automatically extended for at least twenty days upon written request of the applicant or any person who has filed a petition to oppose or support the application. The request for extension must be filed with the Chief Engineer by November 28, 1986.

No. 1367-1

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County Corson) ss.

I, Rosemary Verbanas hereby

certify that the annexed printed copy of Notice of Intent to Appropriate

Water was taken from the McLaughlin Messenger

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the

City of McLaughlin

County of Corson and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

11/6/86

11/13/86

Rosemary Verbanas
(Signature)

Bookkeeper
(Title)

11/13/86
(Date Signed)



Cost of Printing: \$ 41.72

**Notice of Hearing
on Application No. 1367-1 to
Appropriate Water**

Notice is hereby given that the Dew Drop Inn c/o Deloris Morgen whose mailing address is Mahto, South Dakota has made an application for a permit to appropriate 10 cubic feet of water per second from one well 40 feet deep located in Lot 20, Block 5, N½ Section 29-T21N-R28E. The water is for commercial use by the Dew Drop Inn.

Pursuant to SDCL 46-2A-2 the Chief Engineer of the Water Rights Division recommends APPROVAL of Application No. 1367-1 because 1) unappropriated water is available, 2) will be no unlawful impairment of existing rights, 3) is beneficial use of water and 4) is in the public interest.

This application will be considered by the Water Management Board at room 216, Joe Foss Building, 523 E. Capitol, Pierre, South Dakota, December 10, 1986 at 10:00 a.m.

The recommendation of the Chief Engineer is not final or binding upon the Board and the Board is authorized to 1) approve, 2) approve with qualifications, 3) defer, or 4) deny this application after it reaches a conclusion based upon facts presented at the public hearing. Any interested person who may be affected by a Board decision and who intends to participate in the hearing before the Board and present evidence or cross-examine witnesses according to SDCL 1-26, must file a

written petition with BOTH the applicant and the Chief Engineer by November 28, 1986. The petition may be informal, but it must include a statement describing the petitioner's interest in the application, the reasons for the petitioner's opposition to or support of the application, and the signature and mailing address of the petitioner or his legal counsel if legal counsel is obtained. The applicant need not file a petition.

This application is made pursuant to the provisions of SDCL 46-1-1 thru 46-1-9, 46-1-12 thru 46-1-15; 46-2-3.1, 46-2-9, 46-2-11, 46-2-13, 46-2-17; 46-2A-1 thru 46-2A-10, 46-2A-12, 46-2A-14, 46-2A-15; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-24, 46-5-25, 46-5-30.2, 46-5-30.4, 46-5-31; 46-6-3.1, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14; and Board Rules ARSD 74:02:01:01 thru 74:02:01:15.

This hearing is an adversary proceeding. The applicant or any person, after filing a petition, has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any person wishing a copy of the Chief Engineer's recommendation, further information on this application or to assure access to the hearing by the handicapped can contact the Water Rights Division, DWNr, Joe Foss Bldg, Pierre SD (605 773-3352) for assistance prior to the hearing date. The time of the hearing will be automatically extended for at least twenty days upon written request of the applicant or

any person who has filed a petition to oppose or support the application. The request for extension must be filed with the Chief Engineer by November 28, 1986.

(Mess Nov. 6-13)





Department of Water & Natural Resources

Joe Foss Building
523 East Capitol
Pierre, South Dakota 57501-3181

Water Rights Division
605 773-3352

FEB 17 1987

Deloris Morgen
Dew Drop Inn
Mahto SD 57643

Dear Ms. Morgen:

Enclosed is your Water Permit No. 1367-1 as approved by the Water Management Board authorizing the water diversion system and apply the water to beneficial use, not exceeding the limits as specified in the Water Permit.

We will schedule an inspection so that the Water License may be issued to you, thus completing your acquisition of a Water Right.

Very truly yours,

A handwritten signature in black ink that reads "John Hatch". The signature is written in a cursive, flowing style.

JOHN HATCH, Chief Engineer
Water Rights Division

JH:ks

enclosure



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

August 5, 1993

1367-1

Dew Drop Inn
% Deloris Morgen
Box 2
Mahto, SD 57643

Dear Ms. Morgen:

The inspection of your water use system and the inspection of the extent of application of water to beneficial use, as developed under Water Permit No. 1367-1, has been completed. Your final water right document, the Water License, can now be issued.

Statutes require that we charge a \$50.00 fee for the inspection and issuance of the Water License. Upon receipt of the \$50.00 fee from you, we will begin processing your Water License.

South Dakota Water Law 46-5-30.1 requires that a permit holder may not divert water until the \$50.00 license fee has been paid. Please contact us if you have any questions.

Sincerely,

Cheryl F. Frost
Secretary
Water Rights Division
(605) 773-3352

NOTE: On check or money order, please specify your permit number. This will insure proper handling of the fee.

RECEIPT

413849

Division of Water Rights

South Dakota Department of Environment and Natural Resources

Pierre, _____ August 9, 19 93

RECEIVED OF Deloris Morgen, Dew Drop Inn, Mahto, SD 57643

the following amount in fees for services rendered as provided for by law:

Fee for Application for Permit No. _____ to Appropriate Water, to construct and to put water to beneficial use _____		
Fee for Application for Permit No. _____ to Appropriate Water, for Future Use _____		
Fee to retain Future Use Permit No. _____ after period of seven years.		
Fee for Inspecting Constructed Works, confirming beneficial use and issuing Water License No. <u>1367-1</u>	50	00
Fee for Filing Transfer Form _____		
Fee for Filing Extension Request _____		
Fee for _____		

(Any Other Work Provided by Law)	Total	50 00

By

Chief Engineer

John Hatch

Permit No. 1367-1
Grand River - Water District

Report Of Examination Of Works And/Or Application of Water To Beneficial Use

TO: Chief Engineer, Division of Water Rights, DENR, Foss Bldg., Pierre, SD 57501

I have this day made a thorough examination of the water use system constructed by Dew Drop Inn c/o Deloris Morgen of Box 2, Mahto, SD 57643 holder of Permit No. 1367-1, bearing the priority of July 3, 1986 authorizing the diversion of 0.10 cu. ft. per second for commercial use purposes, in Corson County.

↑ from groundwater (one well)

(initials)

I have to report on the conditions of the same as follows:

A. Works used to divert the water:

A submersible pump with a 45 gpm capacity.

The system is in the following condition good. The point of diversion is located from the NW corner of Section 29 T21N-R28E: 2640 feet E and 1320 feet S. The works are capable of diverting and conveying to the place of use 0.10 cu. ft. per second of water which is to be used for commercial. The license should be issued for 0.10 cfs.

Applicable permit qualifications have been complied with: Yes ☒ No

Exceptions to compliance are: none

Date: 6/21/93



Mark D. Rath
Natural Resources Engineer
DENR, Water Rights Division

REPORT ON INSPECTION OF PERMIT NO. 1367-1

DATE: 6/21/93

DIVERSION POINT LEGAL LOCATION: from the NW corner of Section 29 T21N-R28E: 2640 feet E and 1320 feet S.

WELL INFORMATION:

- 1) Well Drilling Firm: unknown
- 2) No. of Wells 1
- 3) Depth(s) 45 feet
- 4) Well log is available N
- 5) Comment:

Casing:

- 1) Diameter 24 inches
- 2) Length 45 feet
- 3) Type concrete

Screen:

- 1) Type concrete

Pump:

- 1) Make Monitor submersible
- 2) Model submersible
- 4) Capacity 45 GPM

Motor:

- 1) Make Monitor submersible

PERMIT QUALIFICATIONS AND REGULATIONS:

- 1) Special qualifications to permit being abided by Y
- 2) All structures, wells and lands on map Y

STATE OF SOUTH DAKOTA
WATER LICENSE NO. 1367-1

(1) Deloris Morgen, dba Dew Drop Inn, of Box 2, Mahto, SD 57643 made Application No. 1367-1, July 3, 1986 for a water permit to appropriate 0.10 cubic feet of water per second from groundwater (one well), Corson County, South Dakota for commercial purposes. Permit No. 1367-1, with a priority date of July 3, 1986 was approved December 10, 1986 and issued to the applicant for diversion of water with construction of the described water supply system completed and the application to beneficial use of said water completed.

(2) It is certified that the applicant has complied with the provisions of South Dakota State Law relating to completion of the construction of the water supply system and is entitled to divert 0.10 cubic feet of water per second for beneficial use. The location of the diversion point is 2640 feet east and 1320 feet south of the NW corner of Section 29, T21N, R28E.

(3) The applicant has complied with the provisions of South Dakota State Law relating to the application of water to beneficial use.

(4) Pursuant to South Dakota Water Law 46-5-30.1 Deloris Morgen, dba Dew Drop Inn of Box 2, Mahto, SD 57643 the holder and/or owner of Water Permit No. 1367-1 is issued a license to appropriate water, the right to use 0.10 cubic feet of water per second from groundwater (one well) with a priority date of July 3, 1986 from the location specified in (2) of this license. The water is to be utilized for commercial purposes. This license is subject to any limitations or qualifications listed in Water Permit No. 1367-1 and subject to South Dakota State Law.



SEP 20 1993

JOHN HATCH, Chief Engineer
Water Rights Division
Department of Environment and Natural Resources



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

SEP 20 1993

1367-1

Deloris Morgen
Dew Drop Inn
Box 2
Mahto, SD 57643

Dear Ms. Morgen:

Enclosed is Water License No. 1367-1. This is the final water right document completing your process of obtaining a Water Right. Enclosed is Receipt No. 413849 in the amount of \$50.00 which you paid for the inspection and issuance of the Water License.

For your information SDCL 46-6-27 requires that if the owner of an existing well, such as the well authorized by Water Right No. 1367-1, constructs a replacement well and does not plan to use the old well, the old well is considered abandoned and must be plugged. Also, any well that is being used or is not considered abandoned must be valved and controlled, if flowing, or sealed and capped so that no leaking occurs either underground or at the surface.

As long as you use the water beneficially, as stated in the Water License, the State Water Laws provide that you have a continuing right to use the water. If you have any questions, please contact our office.

Very truly yours,

JOHN HATCH, Chief Engineer
Water Rights Division
(605) 773-3352

gm
enclosures