

Considered: _____

WATER PERMIT NO. 2172-2

Phone: 255-4515

Name of Applicant: Custer State Park

Post Office Address: HC 83, Box 70, Custer SD 57730

Amount of Water Claimed: 25 gpm (0.05 cfs) Total Acres: _____

Source of Water Supply: groundwater

Water to be used for: recreational County: Custer

About 7 miles NE of Custer

PROOF OF PUBLICATION: Received _____ Not Received _____

APPLICATION: Approved _____ Subject to _____

F.F. & C/L. Adopted _____ Not Approved _____ Deferred _____

PRIORITY Date Received: 4-4-91 Fee: NA Remarks _____


Corrected Application Received _____ Period of Annual Use Jan 1 - Dec 31

WATER QUALITY APPROVAL RECEIVED NA APPROVED/CONDITIONAL (Circle one)

WI-1 Description same as Application YES _____ NO _____ REMARKS _____

Diversion Point: NE 1/4 SW 1/4 7-3S-6E

Land to be Irrigated: _____

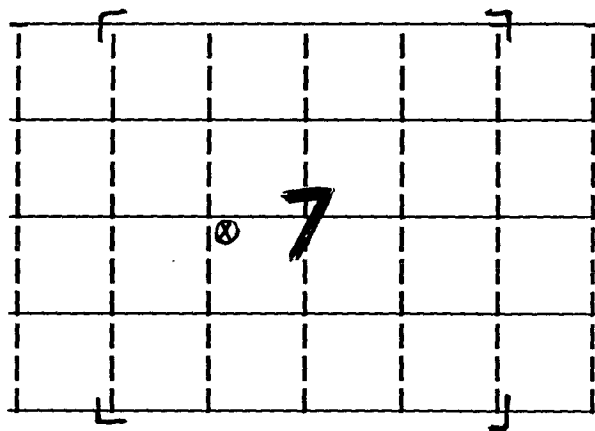

Well Log: Driller: _____ Licensed YES _____ NO _____

Depth of Well: 200' REMARKS _____

Type of Map: topo PREPARED BY: Greg Goebel Reviewed and the Number

Assigned on 4-8-91 By Karen Schlaak

Mail to: Water Rights Div.
DWNR, Foss Bldg.
Pierre, SD 57501
(605) 773-3352


No. 2172-2 Hydrologic Unit 10120109
Map No. _____ Basin Upper Cheyenne
Newspaper Custer Co. Chronicle, Box 551 (Wed)

Application For Permit To Appropriate Water Within The State Of South Dakota

Check use of water: Industrial ☐ Commercial ☐ Municipal ☐ Other Common Distribution System ☐
Rural Water System ☐ Suburban Housing ☐ Geothermal Heat ☐ Institutional ☐ Recreational ☒
Domestic ☐ (above 18gpm) Other ☐

Type of Application: Check one or more of the following

New ☒ Vested Right ☐ Future Use ☐ Change Use ☐
☐ Amend Permit No. _____ with old priority date retained
Change diversion point(s) ☐ Add diversion point(s) ☐ Other ☐ _____
☐ Application to: Change diversion point(s) ☐ Add diversion point(s) ☐ on Permit No. _____
☐ Construction to use water reserved by Future Use Permit No. _____



- Name of Applicant Custer State Park Phone No. 255-4515
Post Office Address HC 83, Box 70 Custer State SD 57730
(Street, RR or Box) (City) Zip Code
- Amount of water claimed (c.f.s.) ~~0.05 cfs~~ (25GPM) 0.05 cfs
- Source of water supply Groundwater
- Location of point of diversion Proposed well site is located in the NE 1/4, SW 1/4,
Sec. 7, T3S, R6E
County Custer
- Counties where water will be used Custer
- Annual period during which water is to be used January 1 to December 31
- Give a brief description of proposed project. When available include any preliminary engineering report or other reports or information that will help explain the project. (Attach sheet if more space is needed)
The proposed well is needed to replace a 7ft. deep old, shallow well that does not meet state well construction standards. The proposed well would supply potable water to Valhalla, a meeting facility in Custer State Park.

Attachments: Attach Form 2A if diversion from a well or dugout, or if storage of water, is proposed. Attach map (see instruction)

STATE OF SOUTH DAKOTA)
County of Custer)^{ss}

I, Rollie Noem, Director, Custer State Park the applicant, certify that I have read this application, have examined the attached map and that the matters stated are true and that I intend, and am able to complete the necessary construction.

Signed Rollie Noem

Subscribed and sworn to before me this 1 day of April 19 91

James F. Lester
Notary Public

Supplemental Information

(type or print in ink)

1. Well Information - Proposed construction

- a) Drill Hole Diameter 8 inches Depth 200 feet
Schedule 40
- b) Casing Type Black Steel Diameter 6 inches Thickness 0.280 inches
- c) Screen Type NA Diameter NA Thickness NA
- d) Gravel Pack Thickness NA Length of Gravel Pack NA
- e) Depth to Top of Water Bearing Material Unknown
- f) Depth to Water (ground surface to water level) Unknown
- g) Distance to nearest existing domestic well:
100 feet to existing shallow well to be abandoned according to state standards.
On applicants property _____ On property owned by others Approximately 3 miles


2. Dugout Information Estimates NA

- a) Surface Dimensions _____ Depth _____
- b) Depth to water (ground surface to water level) _____

3. Water Storage Dams	NA
-----------------------	----

If the proposed water use system contains one or more storage dams, please furnish the information requested below. The locations of each dam should be shown on the map submitted with the application.

- a) If a private engineering firm or government agency was involved in the design of this dam please give their name and address

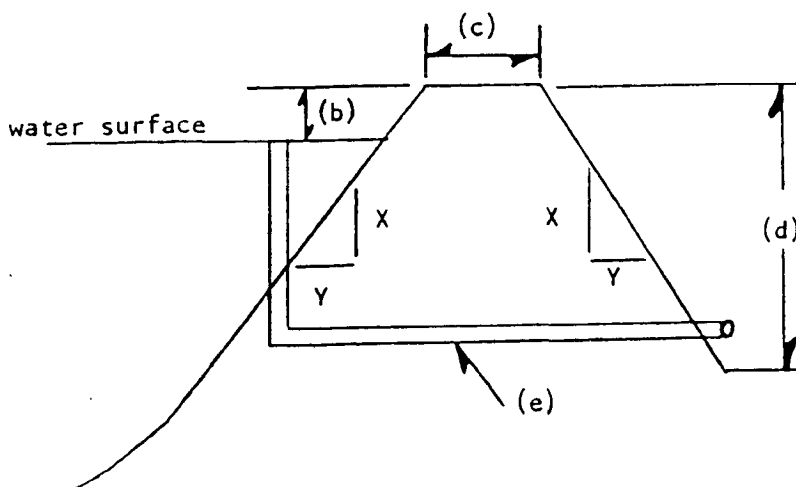

- b) Freeboard _____
- c) Crest Width _____
Crest Length _____
- d) Height _____
- e) Primary Outlet Capacity _____
If Pipe, diameter _____
- f) Secondary Spillway Capacity _____
Spillway width _____
- g) X & Y Slope
Upstream _____
Downstream _____
- Surface Area of Impoundment _____
- Storage _____ acre feet
- Drainage area above dam _____

Signature of Applicant

**SOUTH DAKOTA
WATER PERMIT No. 2172-2**

Date of first receipt of application April 4, 1991.

The Chief Engineer, on behalf of the Water Management Board, issues Water Permit No. 2172-2 to Custer State Park, HC 83, Box 70, Custer SD 57730 authorizing the construction of the water use system and the placing of water to beneficial use subject to the following limitations, conditions and qualifications:

1. Water Permit No. 2172-2 appropriates 25 gallons per minute (0.056 cubic feet of water per second) from one well (Precambrian Rock) 130 feet deep located in the NE 1/4 SW 1/4 Section 7-T3S-R6E.
2. The water appropriated shall be used for the purpose of supplying water at Valhalla, a meeting facility in Custer State Park and may not exceed the amount of water needed for beneficial use for recreational purposes.
3. The water is to be used during the following described annual period: January 1 - December 31.
4. The date of approval of Permit No. 2172-2 is July 17, 1991.
5. The date from which applicant may claim right is April 4, 1991.
6. Water rights obtained in compliance with the laws of the State of South Dakota may not be unlawfully impaired by this appropriation.

QUALIFICATION

The well approved under this Permit will be located near domestic wells and other wells which may obtain water from the same aquifer. The well owner under this Permit shall control his withdrawals so there is not a reduction of needed water supplies in adequate domestic wells or in adequate wells having prior water rights.

WATER MANAGEMENT BOARD

By: 
Chief Engineer, Water Rights Division
Department of Environment and Natural Resources

SEP 18 1991

date

Conversation or File Documentation


NAME OF PERSON OR FILE: G, F & P - Valhalla wellADDRESS: _____ COUNTY CusterDATE: 4/5/91 TELEPHONE _____RE: Greg Goebel

COMMENTS:

Mr. Goebel returned my phone call regarding their
water permit application. I asked him to clarify
the amount of water to be claimed since there was
a discrepancy on the application. He stated that
the amount should be 25gpm and not
3.1 cfs.


File in Permit or other file as necessary. Use to document conversations and what the other party was told; why action or decision was made.

NAME: Eric Thurland

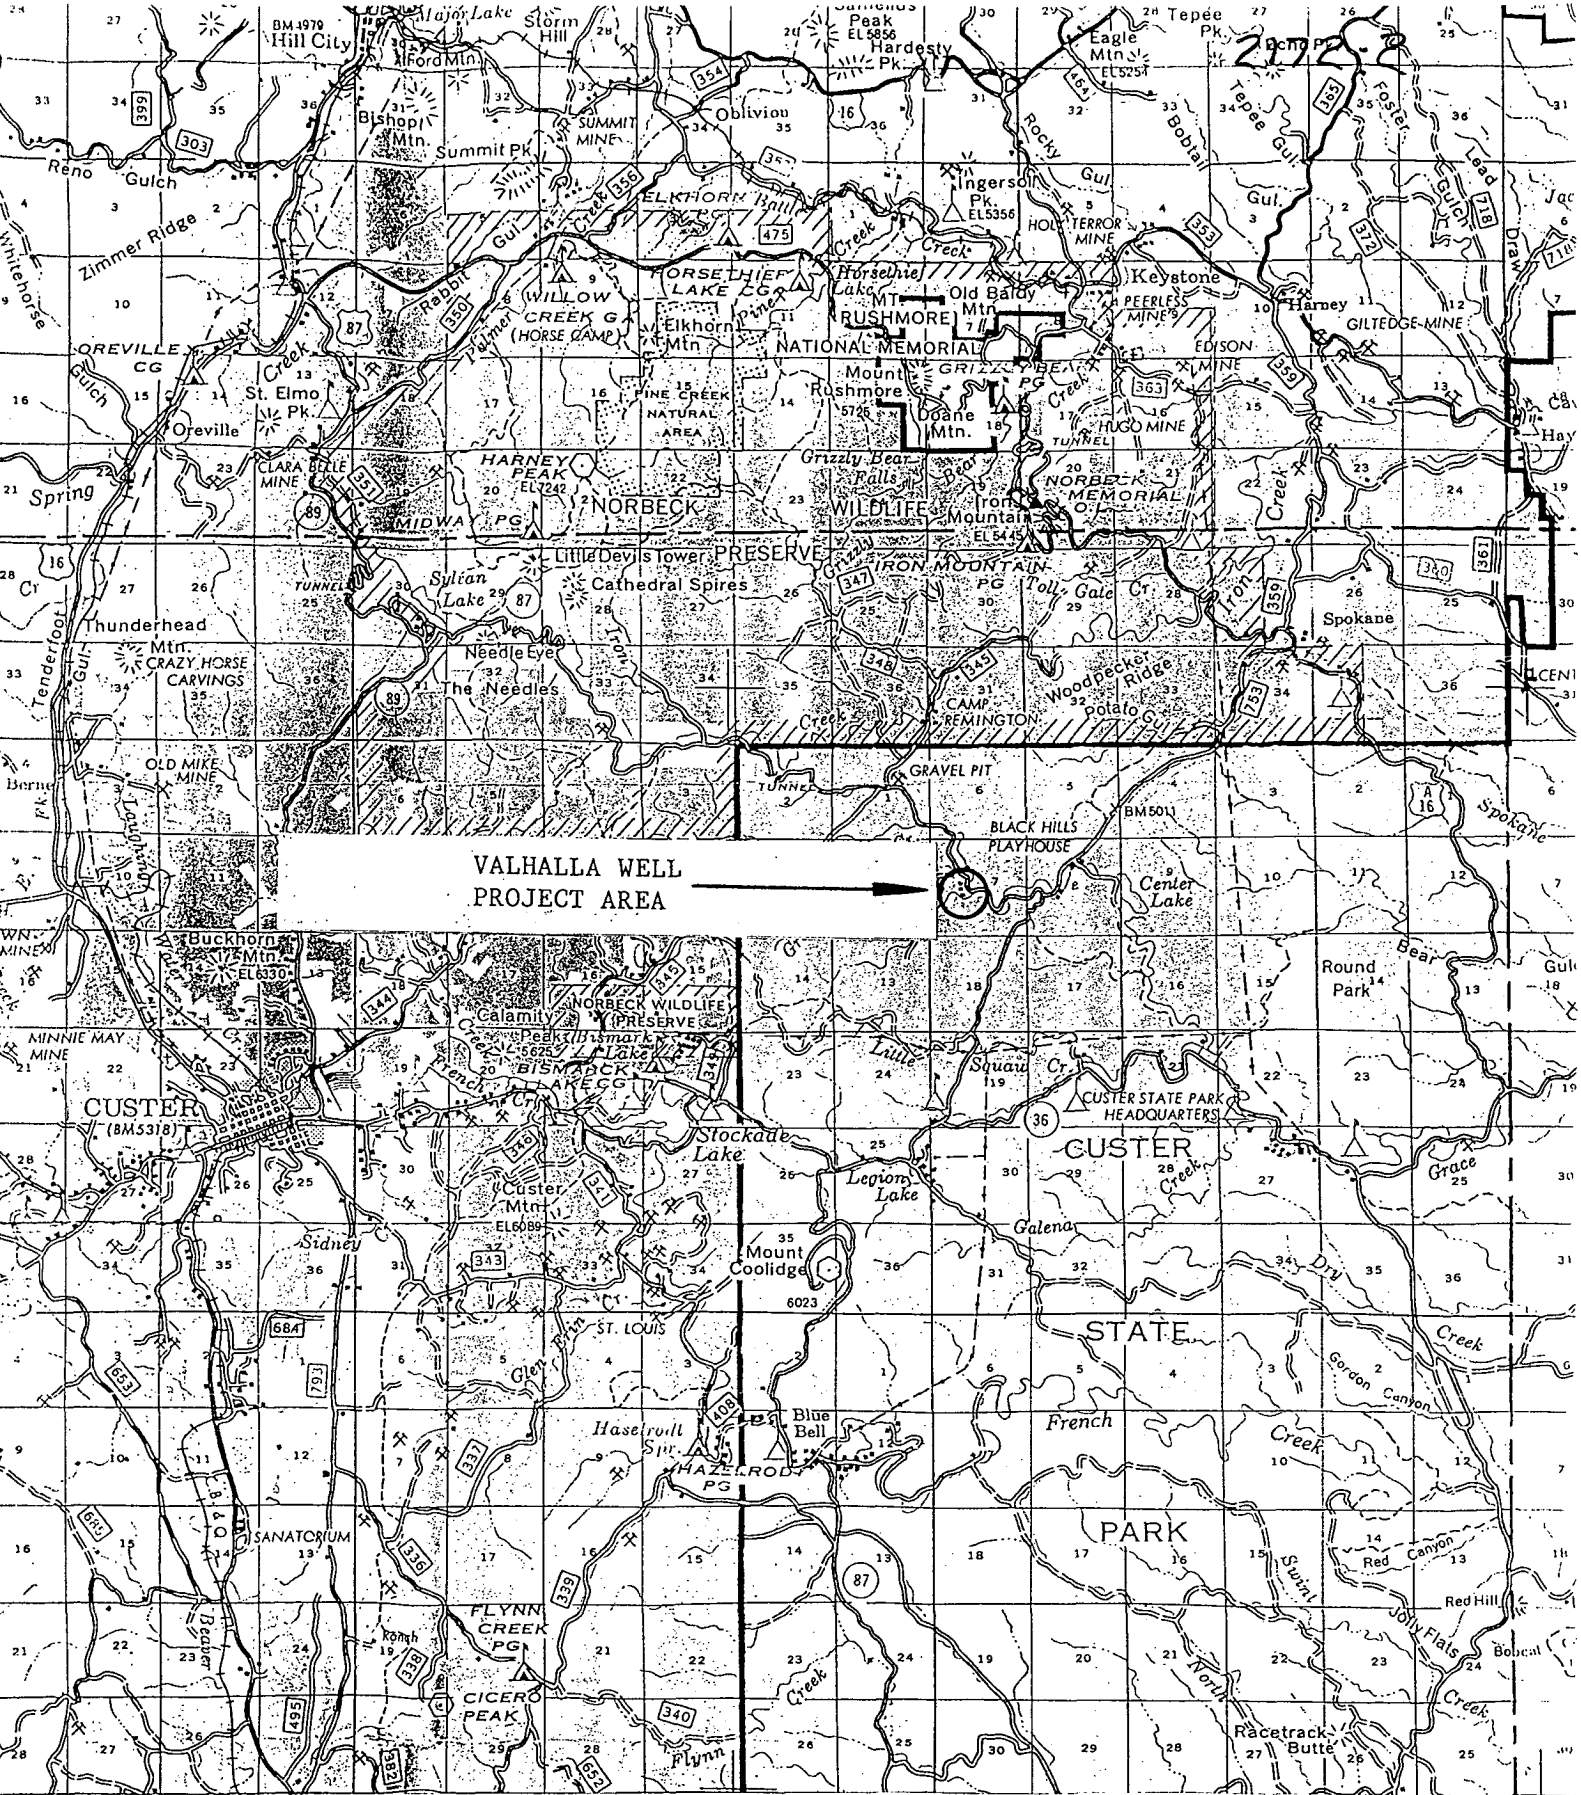

VICINITY MAP

VALHALLA WELL PROJECT

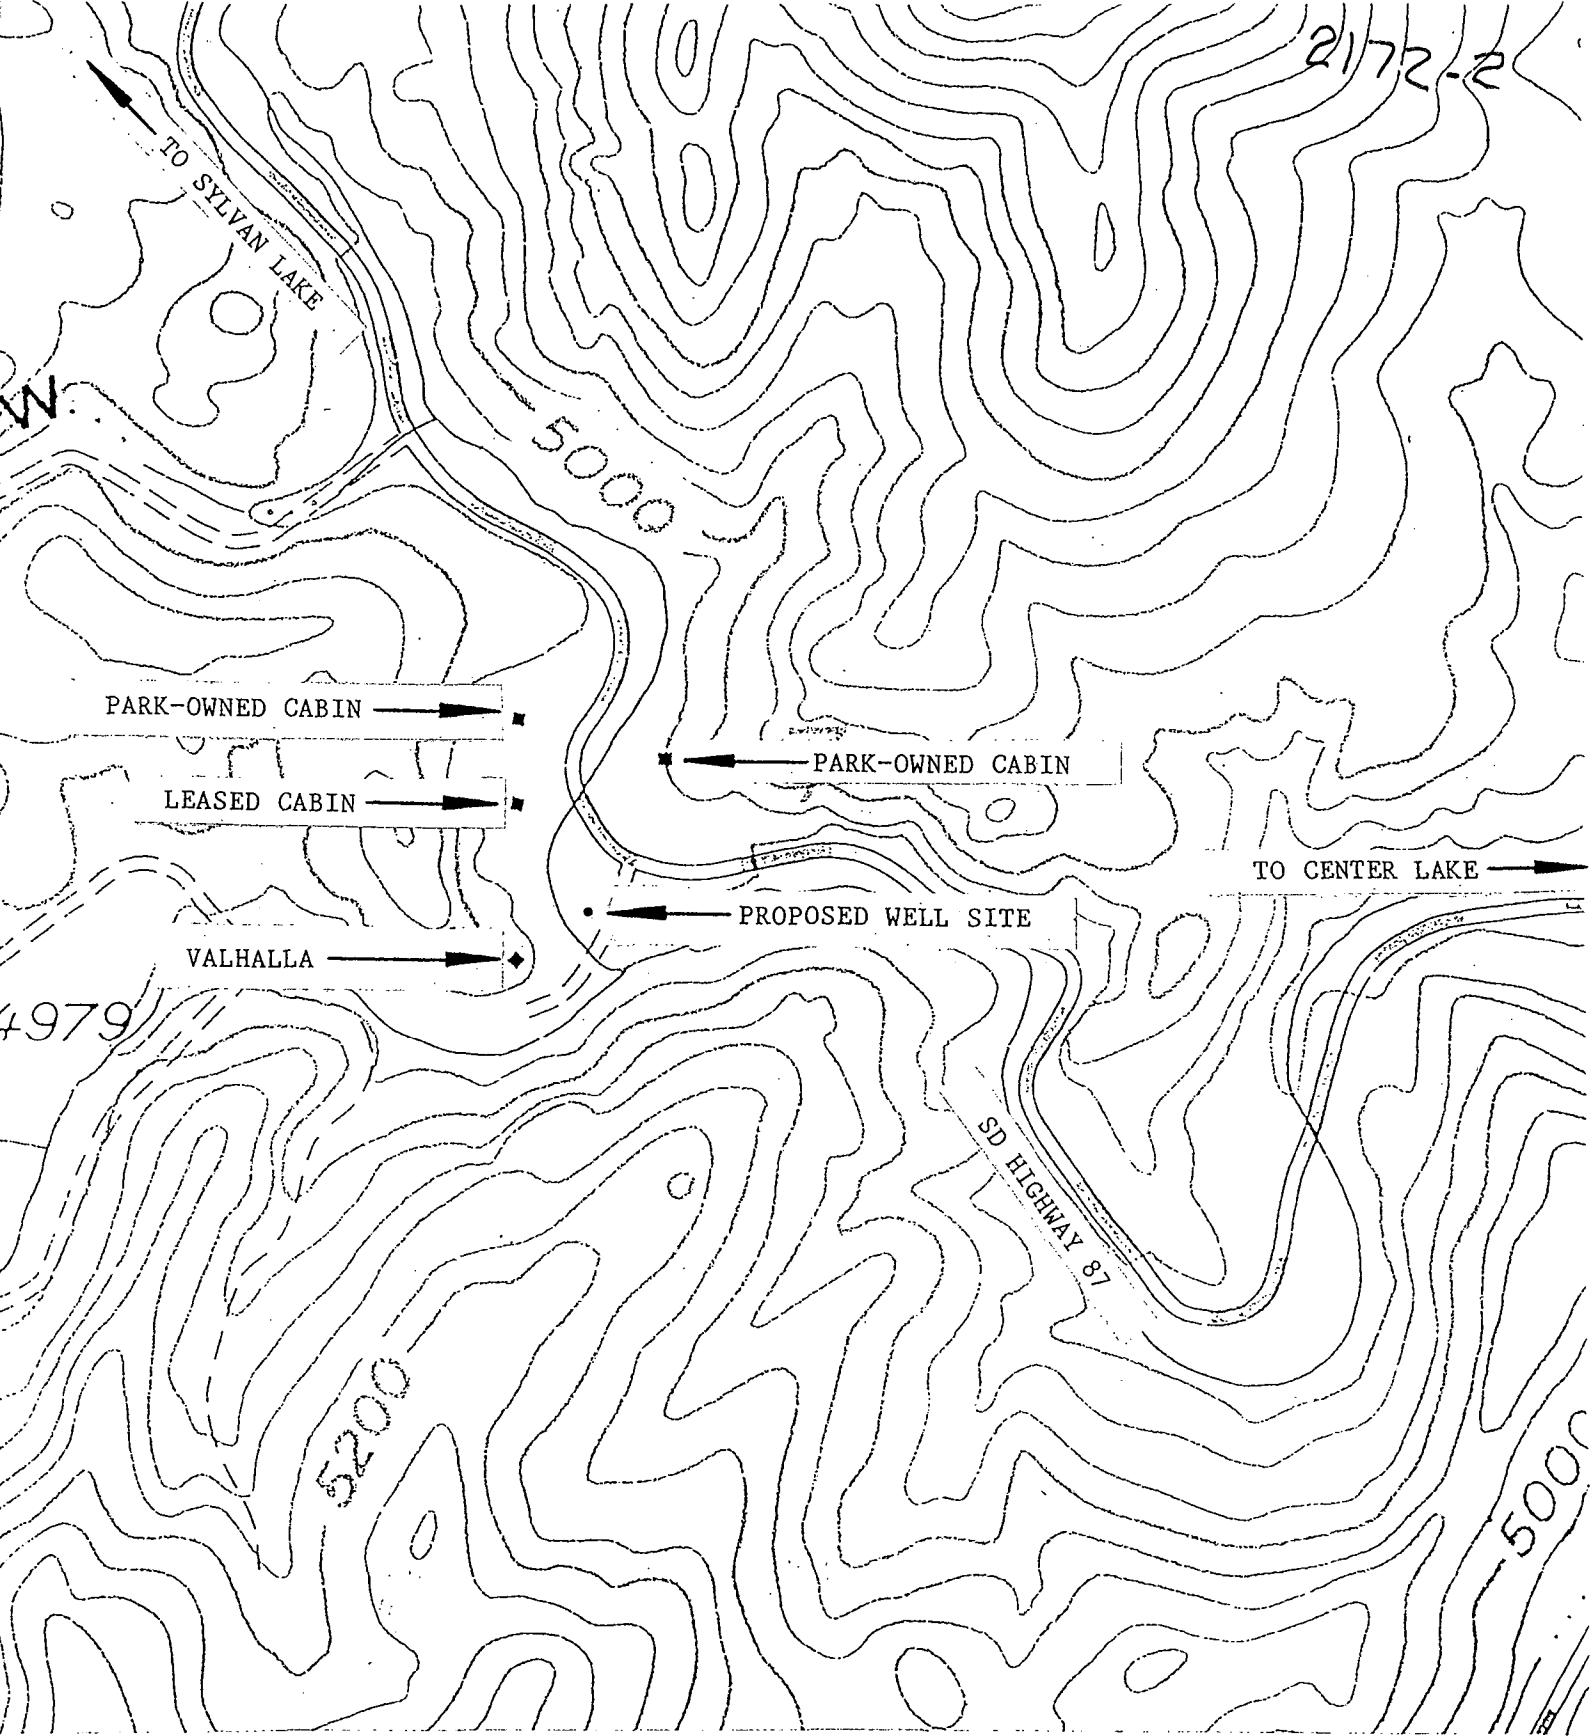

VALHALLA WELL PROJECT

Greg Gochel 2/28/91


SOUTH DAKOTA WATER WELL COMPLETION REPORT

10-85

Location 1/4 1/4 Sec Twp Rg

County

Please mark well location with an "X"

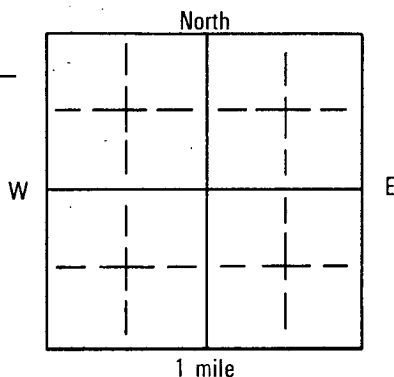

Well Completion Date 5-24-91

PROPOSED USE:

- ☒ Domestic ☐ Municipal ☐ Test Holes
☐ Irrigation ☐ Industrial ☐ Stock

Park Use

Method of Drilling:

Down hole Hammer

CASING DATA:

- ☒ Steel 3" ☐ Plastic ☐ Other 5"
 If other describe 280 Wall 6" ID, 6 5/8" OD

PIPEWEIGHT	DIAMETER	FROM	TO	HOLE DIAMETER
_____ LB/FT	_____ IN	_____ FT	_____ FT	_____ IN
_____ LB/FT	_____ IN	_____ FT	_____ FT	_____ IN
_____ LB/FT	_____ IN	_____ FT	_____ FT	_____ IN
_____ LB/FT	_____ IN	_____ FT	_____ FT	_____ IN

GROUT:

Was the well grouted? ☒ YES ☐ NO

To what depth? 7 TO 31' FEET

What is grouting material? Type III (High Early)

If cement, number of sacks? 32

Describe grouting procedure Poured between 6" casing & 24" of 8" casing which was pulled as well was grouted

What was grout weight? 14 ± LB/GAL

SCREEN: ☐ Perforated pipe ☐ Manufactured

Diameter _____ IN Length _____ FEET

Material _____

Slot Size _____ Set From _____ Feet To _____ Feet

Slot Size _____ Set From _____ Feet To _____ Feet

Slot Size _____ Set From _____ Feet To _____ Feet

Other information _____

Was a packer or seal used? ☐ YES ☒ NO

If so, what material? Steel drive into Hard Rock

Describe packer(s) and location? _____

Was well disinfected upon completion? ☐ YES ☒ NO

Explain _____

Bacteriological analysis ☐ YES ☐ NO

Laboratory sent to _____

Well Owner: State of South Dakota


Name Custer State Park

Address Heavens, SD

Well Log:

Depth

Formation	From	To
Drift	0	22
Pegmatite light brown	22	35
Pegmatite DARK BLK	35	45
" " DARK BROWN	45	75 8GPM
Pegmatite - Quartz - Light BL	76	90
Pegmatite - Quartz Dark	91	100
Pegmatite - Schist - Mt	100	114
Pegmatite - Brown Hard	114	130



STATIC WATER LEVEL 7 1/2' Feet

If flowing: closed in pressure _____ PSI

GPM flow _____ through _____ inch pipe

Controlled by ☐ Valve ☐ Reducers ☐ Other

If other, specify _____

Can well be completely shut in? _____

WELL TEST DATA:

☐ Pumped

☒ Bailed

☐ Other

Describe: Developed w/Bailer
NOT complete due to Time Restraints

Pumping Level Below Land Surface

_____ ft. After _____ Hrs. pumped _____ GPM

_____ ft. After _____ Hrs. pumped _____ GPM

_____ ft. After _____ Hrs. pumped _____ GPM

REMARKS:

Training Exercise for Reserves
Two Week Annual Training
7 7/8" Hole TO 24'
6 1/2" Hole TO 130'
Estimated 8 GPM Air Method Testing
Continuous for 10 Hours 5-22-91

This well was drilled under license # _____

And this report is true and accurate.

Drilling firm 9/6 Engstrom Bemank ND

Signature of License Representative:

SFC Val Gange 701223-7881

Signature of Well Owner:

Date _____

REPORT ON APPLICATION NO. 2172-2
for Custer State Park
May 30, 1991

This application proposes to appropriate 25 gpm (0.056 cfs) from one well approximately 200 feet deep located in the NE 1/4 SW 1/4 of section 7, T3S R6E in Custer County. The water is to be used for institutional purposes at Valhalla, a facility in Custer State Park.

AQUIFER - PRECAMBRIAN ROCK (CRSL)

The Precambrian rock in this area consists of the Harney Peak Granite to the west and a quartzite and sillimanite schist to the east (Redden, 1975). The proposed diversion could be in either of these rock types. Ground water will be encountered in fractures and natural foliations within the rock. Well yields are unpredictable, but a yield of 25 gpm is not unreasonable. The well is located on the floodplain of Grace Coolidge Creek and is probably hydraulically connected to the creek.


This well has been completed by the National Guard. According to Greg Goebel, Park Manager, the well was completed to a depth of 130 feet, was cased to a depth of 31 feet and produced about 10 gpm. He will be sending a completion report, but indications are that the well has been completed in accordance with SD Well Construction Standards.

REVIEW OF EXISTING WATER PERMITS/RIGHTS

There are no other permits/rights in this area. Interference will not be a problem.

CONCLUSIONS

1. Water is available from the Precambrian rock.
2. Interference should not be a problem.
3. Personal communication with Greg Goebel, Park Manager, would indicate that this well has been completed in accordance with SD Well Construction Standards.
4. This water will be used to supply the public.

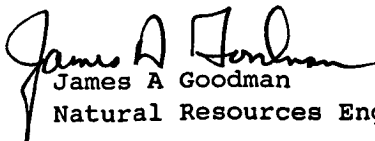
James A Goodman
Natural Resources Engineer

BIBLIOGRAPHY

Redden, J.A., 1975, Precambrian Geology of the Black Hills, SDGS Bulletin No. 16, Mineral and Water Resources of South Dakota, SD DENR, SDGS, Vermillion, SD, 57069.

RECOMMENDATION OF CHIEF ENGINEER FOR WATER PERMIT
APPLICATION NO. 2172-2, Custer State Park

Pursuant to SDCL 46-2A-2, the following is the recommendation of the Chief Engineer, Water Rights Division, Department of Environment and Natural Resources concerning Water Permit Application No. 2172-2, Custer State Park, HC 83, Box 70, Custer, SD 57730.

The Chief Engineer is recommending APPROVAL of Application No. 2172-2 because 1) there is reasonable probability that there is unappropriated water available for the applicant's proposed use, 2) the proposed diversion can be developed without unlawful impairment of existing rights, 3) the proposed use is a beneficial use and 4) in the public interest with the following qualification:

The well approved under this Permit will be located near domestic wells and other wells which may obtain water from the same aquifer. The well owner under this Permit shall control his withdrawals so there is not a reduction of needed water supplies in adequate domestic wells or in adequate wells having prior water rights.

See report on application for additional information.


JOHN HATCH, Chief Engineer
May 31, 1991



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

**NOTE: TO BE SURE OF PUBLICATION ON
THE CORRECT DATES, CONTACT
THE NEWSPAPER RIGHT AWAY.**

June 13, 1991

Rollie Noem, Director
Custer State Park
HC 83, Box 70
Custer, SD 57730

Dear Mr. Noem:

Water Permit Application No. 2172-2 for recreational use has been examined and found to comply with the South Dakota Water Laws and applicable rules. A notice of hearing has been sent to the Publisher of the Custer County Chronicle printed at Custer, SD. For your information, a copy of the notice, the recommendation of the Chief Engineer and a report on the application are enclosed. Please review the notice prior to publication and notify this office, if you have any corrections or questions.

Be sure to contact the above newspaper to authorize publication of your Notice of Hearing and to arrange for payment. Early contact with the paper can eliminate delays. The publisher has been instructed to publish your notice once each week for two consecutive weeks with the last publication to occur twenty days before the board meeting. The newspaper has been instructed to send us the Proof of Publication. We must receive Proof of Publication before action can be taken on the application.

Sincerely,

Eric Gronlund
Natural Resources Engineer
605 773-3352

enclosures

NOTE: If you plan to contest any part of the Chief Engineer's recommendation, you must file a petition pursuant to the procedures outlined in the attached notice of hearing. The Water Management Board will then consider your concerns during a hearing on the application.

South Dakota



GREAT FACES. GREAT PLACES.

**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

June 13, 1991

Custer County Chronicle
Box 551
Custer, SD 57730

ATTENTION: Legal Department

Enclosed is a Notice of Hearing on Application No. 2172-2 to be published twice. Please publish the first notice on June 19, 1991, with the second publication 7 days later.

The APPLICANT MUST VERIFY TO YOU THAT THE NOTICE IS TO BE PUBLISHED, before you make the first publication. Please BILL the APPLICANT for the cost of publication. The APPLICANT is Custer State Park, HC 83, Box 70, Custer, SD 57730.

A copy of BOTH publications must be SENT to the WATER RIGHTS DIVISION. IMMEDIATELY return the FIRST publication with the FIRST Transmittal form on the bottom of this page. The first copy is needed to check the publication for errors so any corrections can be made in the second publication. Publication errors can invalidate the public notice and cause the applicant costly delays.

Please be sure the SECOND publication is returned IMMEDIATELY with the enclosed Proof of Publication form. DO NOT WAIT until the end of the month or the billing cycle. No action may be taken on the permit application until proof of publication has been received.

Sincerely,

Eric Gronlund

Eric Gronlund
Natural Resources Engineer
605 773-3352

enclosures

-----CUT HERE-----

FIRST TRANSMITTAL NOTICE

TO: Eric Gronlund
Water Rights Division
Joe Foss Building
Pierre SD 57501-3181

No. _____

Date _____

We are in receipt of your letter of _____ enclosing Notice of Hearing to Appropriate Water by Application No. _____ which was first published in our issue of _____. ENCLOSED IS A COPY OF THIS FIRST PUBLICATION.

Name

Newspaper

Instruction to Newspaper - Publish first Notice on or before June 19, 1991, with the second publication 7 days later. The applicant is responsible for payment.

NOTICE OF HEARING on Application No. 2172-2 to Appropriate Water

Notice is given that Custer State Park, HC 83, Box 70, Custer, SD 57730 has filed an application for a water permit to appropriate 25 gallons per minute from one well (Precambrian Rock) 200 feet deep located in the NE 1/4 SW 1/4 Section 7-T3S-R6E. The water is to be used for recreational purposes at Valhalla, a meeting facility in Custer State Park.

Pursuant to SDCL 46-2A-2, the Chief Engineer recommends APPROVAL of Application No. 2172-2 because 1) unappropriated water is available, 2) existing rights will not be unlawfully impaired, 3) it is a beneficial use of water, and 4) it is in the public interest. Unless a petition is filed opposing the application or the applicant files a petition contesting the chief engineer's recommendation, the Water Management Board will NOT CONDUCT a HEARING to consider this application and the chief engineer will issue the permit as recommended. Petitions filed in support of the application will NOT require the Board to hear the application.

Any person interested in opposing or supporting this application must file a written petition with BOTH the applicant and Chief Engineer. The applicant must also file a petition if opposed to the Chief Engineer's recommendation. The Chief Engineer's address is "Water Rights Division, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)" and the applicant's mailing address is given above. A petition filed by either an interested person or the applicant must be filed by July 8, 1991. The petition may be informal, but must include a statement describing the petitioner's interest in the application, the petitioner's reasons for opposing or supporting the application, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained.

For purposes of publishing 1) the notice of hearing on Application No. 2172-2 and 2) the chief engineer's recommendation, a special Board meeting is scheduled for July 17, 1991, at 9:00 am in Room 413, Joe Foss Building, 523 E Capitol, Pierre SD. If this application is opposed or the recommendation is contested, the July 17, 1991, hearing date may be rescheduled for another Board meeting. If the hearing is rescheduled, notice of the time and place will be given by First Class Mail to the applicant and persons filing petitions. Anyone not filing a petition, but interested in attending the hearing, may contact the Division of Water Rights to confirm a hearing date and location. The July 17, 1991, hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from the applicant or any interested person opposing the application. The request for an automatic delay must be filed by July 8, 1991.

If a hearing is held, the Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) approve with qualifications, 3) defer, or 4) deny this application based on the facts presented at the public hearing. Any hearing will be an adversary proceeding. Any person filing a petition and/or the applicant have the right to be represented by a lawyer and may present evidence or cross-examine witnesses according to SDCL 1-26. These and other due process rights will be forfeited if not exercised. Decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law. Contact the Water Rights Division to request copies of information pertaining to this application or to assure access to the hearing by the handicapped.

This application is made pursuant to SDCL 46-1-1 thru 46-1-9, 46-1-12 thru 46-1-16; 46-2-3.1, 46-2-9, 46-2-11, 46-2-13, 46-2-17; 46-2A-1 thru 46-2A-10, 46-2A-12, 46-2A-14, 46-2A-15; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-24, 46-5-25, 46-5-30.2, 46-5-30.4, 46-5-31; 46-6-3, 46-6-3.1, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14, 46-6-26; and Board Rules ARSD 74:02:01:01 thru 74:02:01:15.

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
 County Custer) ss.

I, Terri Tuggle

certify that the attached printed Notice was taken
 from the Custer County Chronicle

A newspaper which during the whole time of publication of
 said notice herein after stated, has been and is printed and
 published in the _____

City of Custer

County of Custer and State of South Dakota;
 that the said notice was published in said newspaper on the
 following two dates:

6/19/91

6/26/91

Terri Tuggle
 (Signature)

Publisher
 (Title)

6-28-91
 (Date Signed)

Cost of Printing: 45.16



Notice of Hearing

on Application No. 2172-2
 to Appropriate Water

Notice is given that Custer State Park, HC 83, Box 70, Custer, SD 57730 has filed an application for a water permit to appropriate 25 gallons per minute from one well (Precambrian Rock) 200 feet deep located in the NE 1/4 SW 1/4 Section 7-T3S-R6E. The water is to be used for recreational purposes at Valhalla, a meeting facility in Custer State Park.

Pursuant to SDCL 46-2A-2, the Chief Engineer recommends APPROVAL of Application No. 2172-2 because 1) unappropriated water is available, 2) existing rights will not be unlawfully impaired, 3) it is a beneficial use of water, and 4) it is in the public interest. Unless a petition is filed opposing the application or the applicant files a petition contesting the chief engineer's recommendation, the Water Management Board will NOT CONDUCT a HEARING to consider this application and the chief engineer will issue the permit as recommended. Petitions filed in support of the application will NOT require the Board to hear the application.

Any person interested in opposing or supporting this application must file a written petition with BOTH the applicant and Chief Engineer. The applicant must also file a petition if opposed to the Chief Engineer's recommendation. The Chief Engineer's address is "Water Rights Division, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)" and the applicant's mailing address is given above. A petition filed by either an interested person or the applicant must be filed by July 8, 1991. The petition may be informal, but must include a statement describing the petitioner's interest in the application, the petitioner's reasons for opposing or supporting the application, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained.

For purposes of publishing 1) the notice of hearing on Application No. 2172-2 and 2) the chief engineer's recommendation, a special Board meeting is scheduled for July 17, 1991, at 9:00 am in Room 413, Joe Foss Building, 523 E Capitol, Pierre SD. If this application is opposed or the recommendation is contested, the July 17, 1991, hearing date may be rescheduled for another Board meeting. If the hearing is rescheduled, notice of the time and place will be given by First Class Mail to the applicant and persons filing petitions. Anyone not filing a petition, but interested in attending the hearing, may contact the Division of Water Rights to confirm a hearing date and location. The July 17, 1991, hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from the applicant or any interested person opposing the application. The request for an automatic delay must be filed by July 8, 1991.

If a hearing is held, the Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) approve with qualifications, 3) defer, or 4) deny this application based on the facts presented at the public hearing. Any hearing will be an adversary proceeding. Any person filing a petition and/or the applicant have the right to be represented by a lawyer and may present evidence or cross-examine witnesses according to SDCL 1-26. These and other due process rights will be forfeited if not exercised. Decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law. Contact the Water Rights Division to request copies of information pertaining to this application or to assure access to the hearing by the handicapped.

This application is made pursuant to SDCL 46-1-1 thru 46-1-9, 46-1-12 thru 46-1-16; 46-2-3.1, 46-2-9, 46-2-11, 46-2-13, 46-2-17; 46-2A-1 thru 46-2A-10, 46-2A-12, 46-2A-14, 46-2A-15; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-24, 46-5-25, 46-5-30.2, 46-5-30.4, 46-5-31; 46-6-3, 46-6-3.1, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14, 46-6-26; and Board Rules ARSD

South Dakota



GREAT FACES. GREAT PLACES.

SEP 18 1991

**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

Rollie Noem, Director
Custer State Park
HC 83 Box 70
Custer, SD 57730

Dear Mr. Noem:

Enclosed is Water Permit No. 2172-2 authorizing construction of the water system and the application of water beneficial use, not exceeding the limits as specified in the Water Permit.

We will schedule an inspection so that the Water License may be issued to you, thus completing your acquisition of a Water Right.

Very truly yours,

JOHN HATCH, Chief Engineer
Water Rights Division
605 773-3352

enclosures

**Permit No. 2172-2
Custer County**

To: Chief Engineer, Water Rights Program, DENR Foss Bldg., Pierre, SD 57501

Other permit/license(s) associated with project:

Contact Person & Address: **Greg Goebel, Custer State Park, HC83 Box 70, Custer, SD 57730**

Report Of Examination of Works:

On **June 5, 2001**, I made a thorough examination of the water use system authorizing the appropriation of **0.056 cubic feet per second (cfs)** of water from a **130-foot well** for recreational purposes at the **Custer State Park Valhalla Meeting Facility** bearing a priority date of April 4, 1991.

The well and system are in **good condition**. This well was completed in 1991 and is in the **NE¼ SW¼ Section 7 T3S R6E 2000 feet East and 2850 feet South of the NW Corner of Section 7 (N43.8024° W103.4507°)** in Custer County. The works are capable of diverting and conveying to the place of use **0.056 cfs** of water for **recreational purposes**.

Review of Permit Qualifications and Regulations:

- 1) Special qualifications to permit being abided by: **Yes**
- 2) All structures, wells and lands on map: **Yes**
- 3) Irrigation Questionnaires checked to determine if permit owner started irrigation by the end of construction period: **NA**
- 4) Exceptions to compliance are: **None**

Report on the Specifics of the System

Diversion Point Information:

- | | |
|---|------------------------------------|
| 1) Well Drilling Firm: ND National Guard | 2) No. of Wells: 1 |
| 3) Depth(s): 130 feet | 4) Well logs available: Yes |

Casing:

- 1) Diameter: **6 5/8 inch OD**
- 2) Length: **31 feet**
- 3) Type: **Steel**

Screen:

- | | |
|--|----------------------|
| 1) Type: None | 2) Length: NA |
| 3) Static water level: 7.5 foot | |

Pump\ Motor:


- | | |
|---|------------------------------------|
| 1) Pump Make: Unknown, Submersible, Electric | 2) Pump Model: NA |
| 3) Capacity: Unknown gpm | 4) Motor Make: NA |
| 5) Motor Model No.: Unknown | 6) Horsepower rating: NA hp |

Distribution System:

- 1) Type: **Unknown**
- 2) Length: **NA feet**

COMMENTS:


The well should be licensed for 0.056 cfs of water for recreational purposes.



Donald E. Stroup

Natural Resources Project Engineer
DENR, Water Rights Program

9/20/01
Date

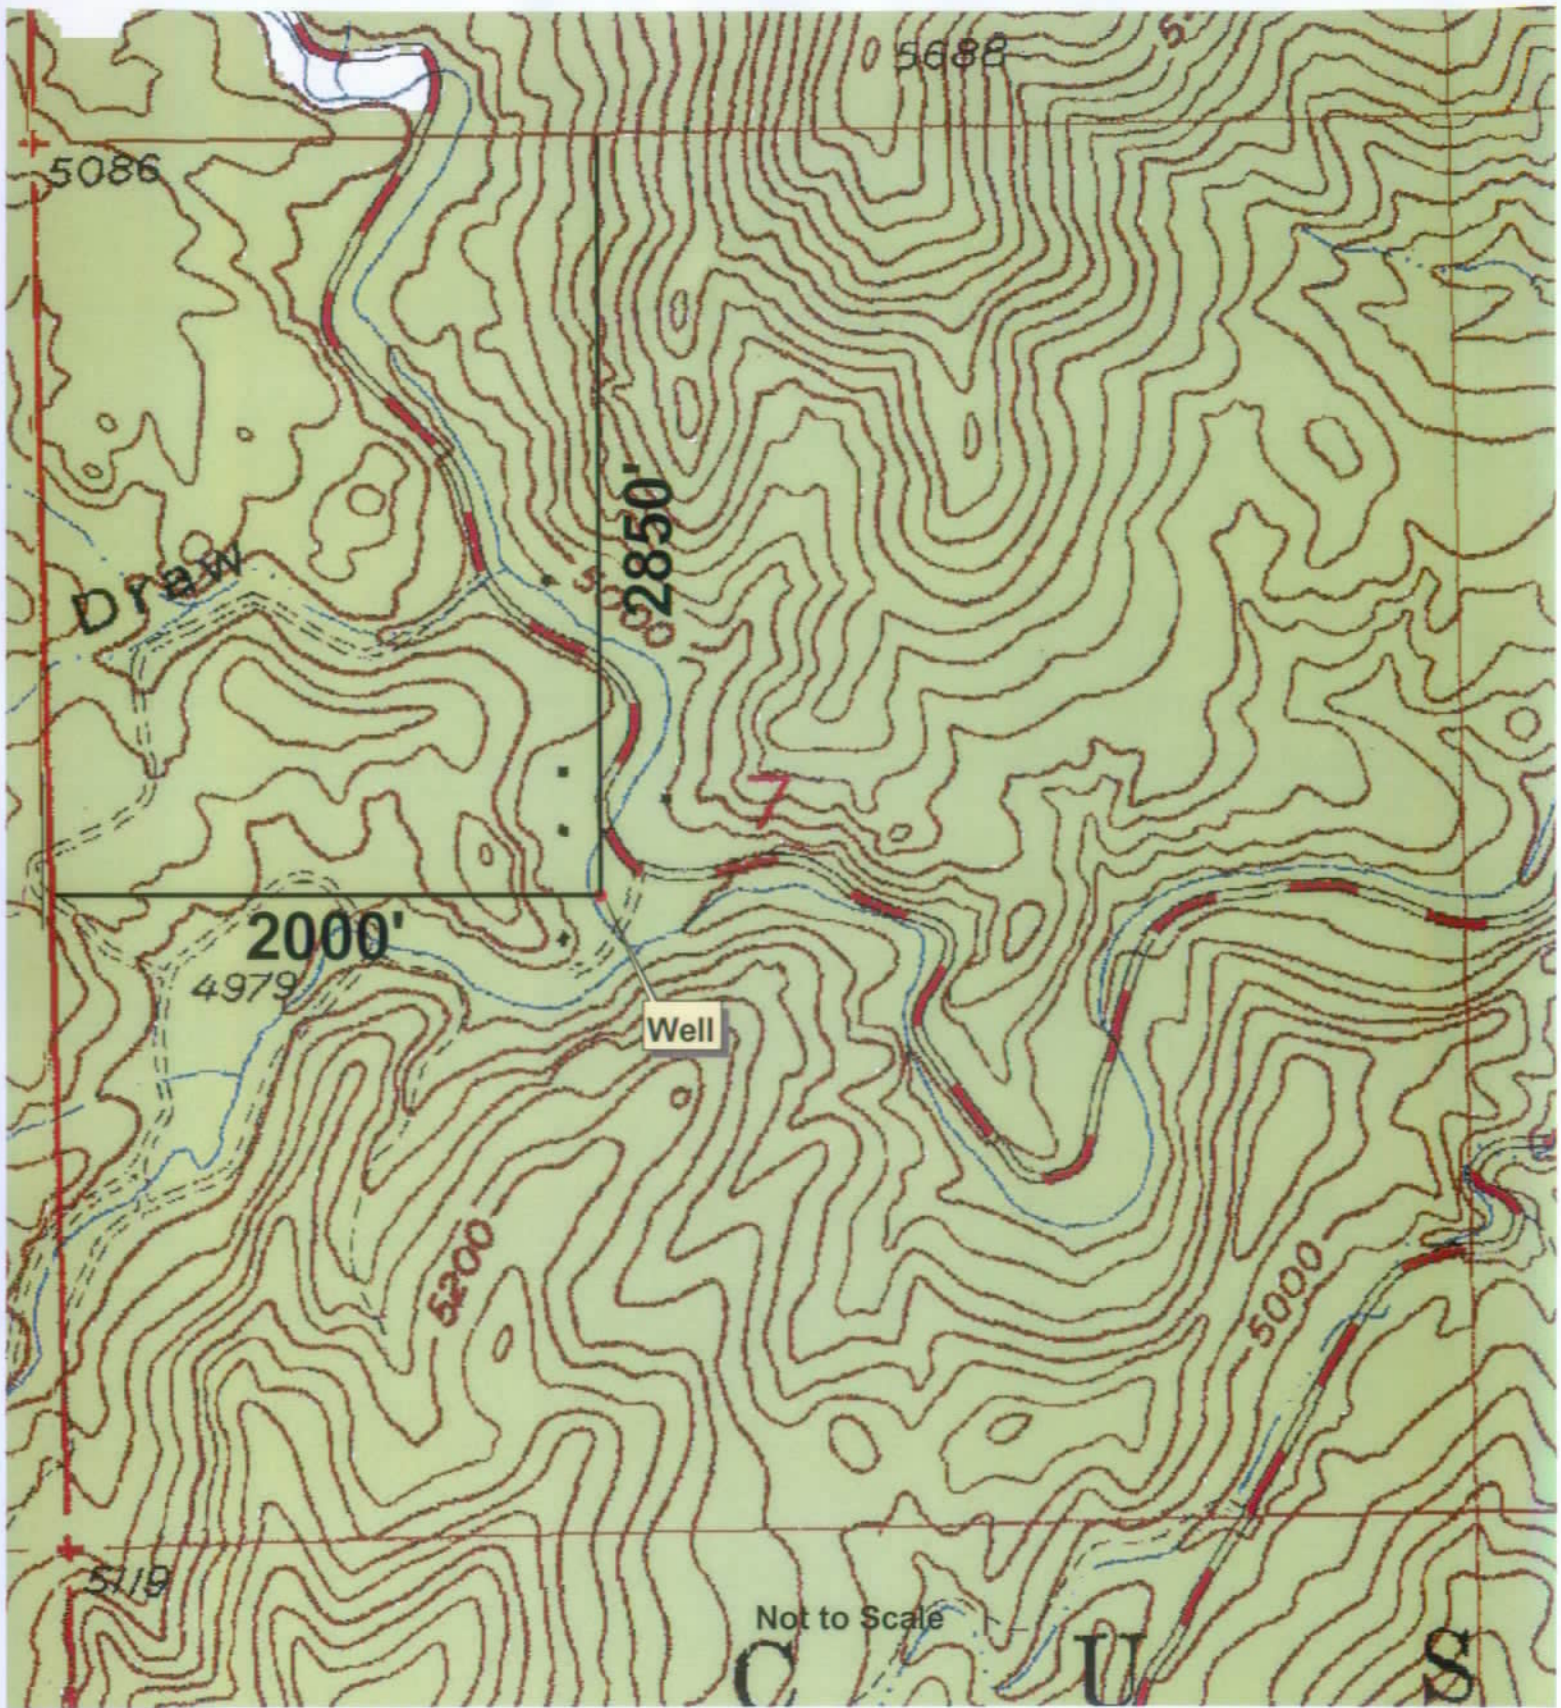

#2172-2
Valhalla Meeting Facility
Custer State Park

Donald E. Stroup
Donald E. Stroup
Natural Resources Project Engineer
DENR Water Rights Program

STATE OF SOUTH DAKOTA

WATER LICENSE NO. 2172-2

(1) Custer State Park, HC 83 Box 70, Custer SD 57730 made Application No. 2172-2, April 4, 1991 for a water permit to divert 0.056 cubic feet of water per second from groundwater (one well), Custer County, South Dakota for recreational purposes. Permit No. 2172-2, with a priority date of April 4, 1991 was approved July 17, 1991 and issued to the applicant for diversion of water with construction of the described water supply system and the application to beneficial use of said water completed.

(2) It is certified that the permit holder has complied with the provisions of South Dakota State Law relating to completion of the construction of the water supply system and is entitled to divert 0.056 cubic feet of water per second for beneficial use. The location of the diversion point is 2,000 feet east and 2,850 feet south of the northwest corner of Section 7-T3S-R6E (NE ¼ SW ¼).

(3) The permit holder has complied with the provisions of South Dakota State Law relating to the application of water to beneficial use at Valhalla, a meeting facility in Custer State Park.

(4) Pursuant to South Dakota Water Law 46-5-30.1 Custer State Park, HC 83 Box 70, Custer SD 57730 the holder and/or owner of Water Right No. 2172-2 is issued a license to appropriate water, the right to use 0.056 cubic feet of water per second from groundwater (one well) with a priority date of April 4, 1991 from the location specified in (2) of this license for recreational purposes. This license is subject to any limitations or qualifications listed in Water Right No. 2172-2 and subject to South Dakota State Law.



GARLAND ERBELE, Chief Engineer
Water Rights Program
Department of Environment and Natural Resources

MAR 04 2002

date





**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
www.state.sd.us/denr

MAR 04 2002

2172-2
2028-2

Greg Goebel
Custer State Park
HC 83 Box 70
Custer, SD 57730

Dear Mr. Goebel:

Enclosed are Water License Nos. 2172-2, 2028-2. This is the final water right document completing your process of obtaining a Water Right.

For your information SDCL 46-6-27 requires that if the owner of an existing well, such as the wells authorized by Water Right Nos. 2172-2, and 2028-2, constructs a replacement well and does not plan to use the old wells, the old wells are considered abandoned and must be plugged. Also, any well that is being used or is not considered abandoned must be valved and controlled, if flowing, or sealed and capped so that no leaking occurs either underground or at the surface.

As long as you use the water beneficially, as stated in the Water License, the State Water Laws provide that you have a continuing right to use the water. If you have any questions, please contact our office.

Sincerely,

Garland Erbele, Chief Engineer
Water Rights Program
(605) 773-3352

NOTE: The applicable portions of No. 1847-2 are incorporated into Water License No. 2028-2.

enclosures