

Considered: _____

WATER PERMIT NO. 2237-2

Phone: 673-2464

Name of Applicant: BEAVER LAKE CAMPGROUND

Post Office Address: RR 1, Box 55H, Custer SD 57730

Amount of Water Claimed: 30 gpm 0.066 cfs Total Acres: NA

Source of Water Supply: groundwater

Water to be used for: commercial County: Custer

About 2 miles SW of Custer

PROOF OF PUBLICATION: Received _____ Not Received _____

APPLICATION: Approved _____ Subject to _____

F.F.& C/.L. Adopted _____ Not Approved _____ Deferred _____

PRIORITY Date Received: 7-16-92 Fee: \$50.00 Remarks _____

Corrected Application Received _____ Period of Annual Use May 1 - Nov 1

WATER QUALITY APPROVAL RECEIVED NA APPROVED/CONDITIONAL (Circle one)

WI-1 Description same as Application YES ____ NO ____ REMARKS _____

Diversion Point: SW 1/4 SW 1/4 Sec 33-T3S-R4E

			33		

Land to be Irrigated: _____

Well Log: Driller: unknown Licensed YES ____ NO ____

Depth of Well: 230' REMARKS log not available

Type of Map: topo PREPARED BY: Don Frye Reviewed and the Number

Assigned on 7-16-92 By Karen Schlaak

523 E. Capitol
Pierre, SD 57501
(605) 773-3352

No. 2237-2 Hydrologic Unit 10120109
 Map No. _____ Basin Upper Cheyenne
 Newspaper Custer Co Chronicle, Box 551

673-2271 (Wed)

For Permit To Appropriate Water Within The State Of South Dakota

Use of water: Industrial ☐ Commercial ☒ Municipal ☐ Other Common Distribution System ☐
 Rural Water System ☐ Suburban Housing ☐ Geothermal Heat ☐ Institutional ☐ Recreational ☐
 Domestic ☐ (above 18gpm) Other ☐

Type of Application: Check one or more of the following

New ☒ Vested Right ☐ Future Use ☐ Change Use ☐

☐ Amend Permit No. _____ with old priority date retained

Change diversion point(s) ☐ Add diversion point(s) ☐ Other ☐ _____

☐ Application to: Change diversion point(s) ☐ Add diversion point(s) ☐ on Permit No. _____

☐ Construction to use water reserved by Future Use Permit No. _____

1. Name of Applicant BEAVER LAKE CAMPGROUND Phone No. 673-2464

Post Office Address RR 1, Box 55H CUSTER State SD Zip Code 57730
(Street, RR or Box) (City)

2. Amount of water claimed (c.f.s.) 30 GPM (0.066 cfs)

3. Source of water supply 1 WELL

4. Location of point of diversion SW 1/4 SW 1/4 SEC 33, T 35, R 4E

County CUSTER

5. Counties where water will be used CUSTER

6. Annual period during which water is to be used MAY 1 TO NOV 1

7. Give a brief description of proposed project. When available include any preliminary engineering report or other reports or information that will help explain the project. (Attach sheet if more space is needed)

PROVIDE WATER TO CAMPGROUND - 52 HOOK UPS, STORE/OFFICE, AND SWIMMING POOL WITH A WATER SLIDE.

Attachments: Attach Form 2A if diversion from a well or dugout, or if storage of water, is proposed. Attach map (see instruction)

STATE OF SOUTH DAKOTA)

County of Custer)^{ss}

I, Craig W. Vander Vorste the applicant, certify that I have read this application, have examined the attached map and that the matters stated are true and that I intend, and am able to complete the necessary construction.

Signed Craig W. Vander Vorste

Subscribed and sworn to before me this 15th day of July, 1992

Sharon A. Braden
 Comm Exp 3-13-95 Notary Public

SOUTH DAKOTA
WATER PERMIT No. 2237-2

Date of first receipt of application July 16, 1992.

The Chief Engineer, on behalf of the Water Management Board, issues Water Permit No. 2237-2 to Beaver Lake Campground, RR 1, Box 55H, Custer SD 57730 authorizing the construction of the water use system and the placing of water to beneficial use subject to the following limitations, conditions and qualifications:

1. Water Permit No. 2237-2 appropriates 30 gallons per minute (0.066 cubic feet of water per second) from one well (Precambrian Rock) 230 feet deep located in the SW 1/4 SW 1/4 Section 33-T3S-R4E.
2. The water appropriated shall be used for the purpose of supplying water for a campground, store, office and swimming pool and may not exceed the amount of water needed for beneficial use for commercial purposes.
3. The water is to be used during the following described annual period: January 1 - December 31.
4. The date of approval of Permit No. 2237-2 is September 30, 1992.
5. The date from which applicant may claim right is July 16, 1992.
6. Water rights obtained in compliance with the laws of the State of South Dakota may not be unlawfully impaired by this appropriation.

WATER MANAGEMENT BOARD

By: 
John Hatch, Chief Engineer, Water Rights Division
Department of Environment and Natural Resources

NOV 17 1992
date

Bever Lake

Supplemental Information

(type or print in ink)

1. Well Information - Proposed construction

- a) Drill Hole Diameter 3' Depth 230' *well log unavailable*
- b) Casing Type PLASTIC Diameter _____ Thickness _____
- c) Screen Type _____ Diameter _____ Thickness _____
- d) Gravel Pack Thickness _____ Length of Gravel Pack _____
- e) Depth to Top of Water Bearing Material 130'
- f) Depth to Water (ground surface to water level) _____
- g) Distance to nearest existing domestic well:
- On applicants property None On property owned by others 1/4 MILE

2. Dugout Information Estimates

- a) Surface Dimensions _____ Depth _____
- b) Depth to water (ground surface to water level) _____

3. Water Storage Dams

If the proposed water use system contains one or more storage dams, please furnish the information requested below. The locations of each dam should be shown on the map submitted with the application.

- a) If a private engineering firm or government agency was involved in the design of this dam please give their name and address

b) Freeboard _____

c) Crest Width _____

Crest Length _____

d) Height _____

e) Primary Outlet Capacity _____
 If Pipe, diameter _____

f) Secondary Spillway Capacity _____
 Spillway width _____


g) X & Y Slope
 Upstream _____

Downstream _____


Surface Area of Impoundment _____

Storage _____ acre feet

Drainage area above dam _____

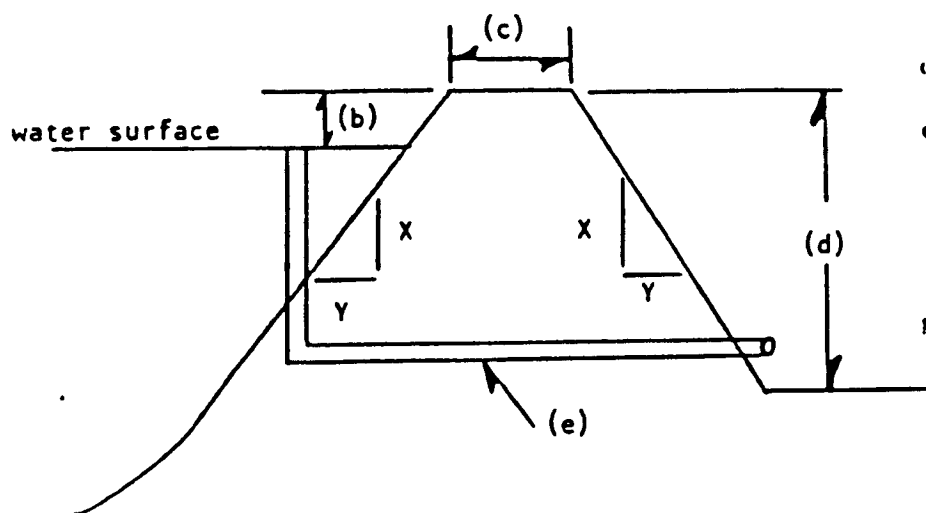

Signature of Applicant _____

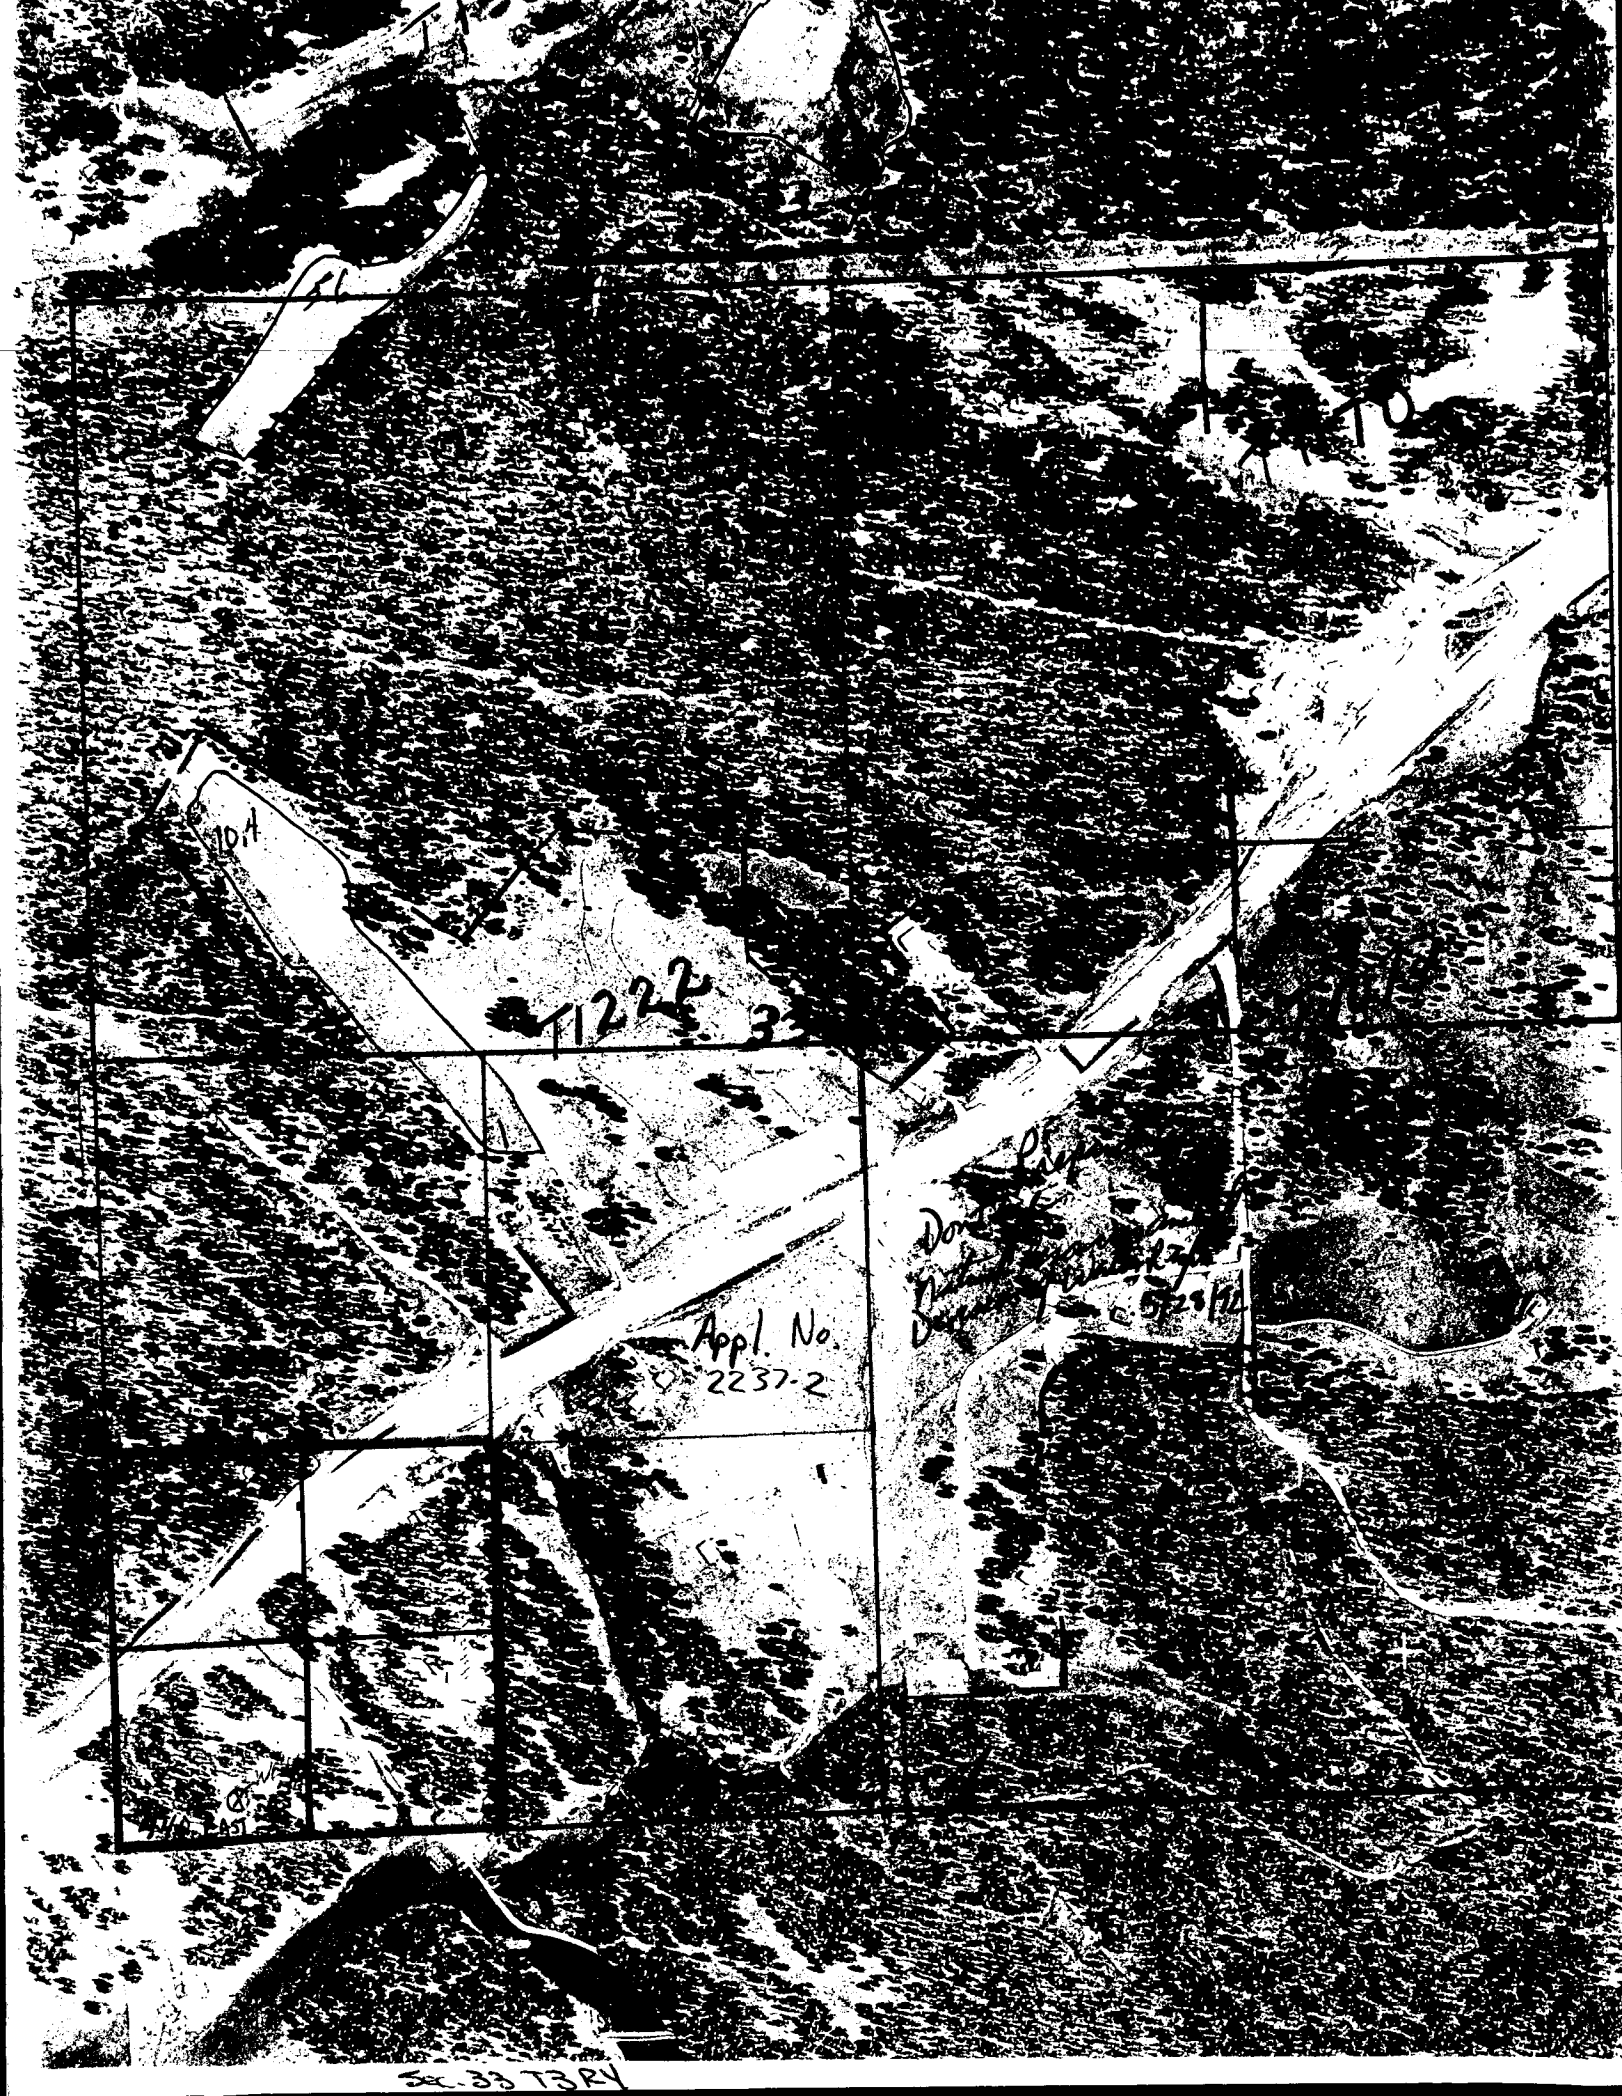

10/1

122

33

Appl. No.
2237-2

Don't
Don't
Don't

RECEIPT

Division of Water Rights

South Dakota Department of Water and Natural Resources

Pierre, July 16, 19 92


413811

RECEIVED OF Sandy Vander Vorste, Beaver Lake Campground Inc) Rt 1 Box 55H, Custer, SD
the following amount in fees for services rendered as provided for by law: 57730

Fee for Application for Permit No. <u>2237-2</u> to Appropriate Water, to construct works and to put water to beneficial use _____	50	00
Fee for Application for Permit No. _____ to Appropriate Water for Future Use _____		
Fee to retain Future Use Permit No. _____ after period of seven years.		
Fee for Inspecting Constructed Works, confirming beneficial use and issuing Water License No. _____		
Fee for Filing Transfer Form _____		
Fee for Filing Extension Request _____		
Fee for Certified Copy of _____		
Fee for Print Copy of Map _____		
Fee for Certifying _____		
Fee for _____		
(Any Other Work Provided by Law) Total	50	00

By John Hatch
Chief Engineer

South Dakota

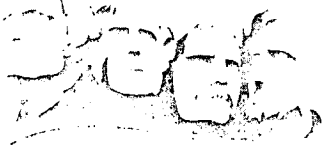

GREAT FACES. GREAT PLACES.

**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

June 19, 1991

HOYT NICHOLAS
BEAVER LAKE CG
RR 1 BOX 55H
CUSTER SD 57730

Dear MR. NICHOLAS:

I am writing to follow-up on my October 1990 letter concerning the requirement to apply for a water permit. We have not received any response from you on this matter and would appreciate your earliest reply.

Based on information we have received from the Office of Drinking Water, we believe you may need a water permit. A water permit must be obtained for any water use except for domestic uses. Water use by commercial businesses, such as campgrounds, tourist attractions, resorts, cafes, gas stations, etc. must be permitted regardless of the amount or type of water use. Schools using more than 18 gallons of water per minute must also be permitted. Please complete and return the enclosed application forms, with the required fee, to the "Water Rights Division, 523 E. Capitol, Pierre, SD 57501" by July 31, 1991.

If you need assistance completing the application forms or if you do not believe you need a water permit, please contact Don Frye at (605) 773-3352.

Thank you for your attention to this matter.

Very truly yours,

Ron Duvall, Natural Resources Engineer
for JOHN HATCH, Chief Engineer
Water Rights Division
enclosure



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

February 12, 1992

HOYT NICHOLAS
BEAVER LAKE CG
RR 1 BOX 55H
CUSTER SD 57730


Dear MR. NICHOLAS:

I am writing to follow-up on my October 1990 and June 19, 1991 letters regarding the need for a permit to appropriate water for use in your facility. Based on the information we have, we believe you need a permit. We would appreciate your earliest attention to this matter.

Pursuant to South Dakota Codified Laws 46-1-15 and 46-5-10, except for private domestic use, a water permit is required to use water from any water source. Examples of commercial enterprises that require permits for private water supplies are: truckstops, motels, restaurants, tourist attractions, bars, clubs, commercial campgrounds and any other business operation. Examples of institutions that require permits for private water supplies are: churches, hospitals and nursing homes (any amount of water) and schools that pump more than 18 gallons per minute or use water outside of the school building.

An existing business or institution without a required water permit has no legal right to the use of water. Water users without a water permit are not protected if their water use is interfered with by someone who has a water right. If you believe you already have a water permit or if you have a permit issued under another name, please contact us.

We have previously sent you water permit application forms and an instruction sheet. Please complete and return the application with the required fee to the "Water Rights Division, 523 E. Capitol, Pierre, SD 57501". If you have questions, or don't believe you need a water permit, contact Don Frye, Natural Resources Analyst (605-773-3352).

Very truly yours,


RON DUVAL, Natural Resources Engineer
for JOHN HATCH, Chief Engineer
Water Rights Division



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

June 30, 1992

Craig and Sandy Van Der Vorst
Beaver Lake CG
RR 1 Box 55H
Custer SD 57730

Dear Mr & Mrs Van Der Vorst:

I am writing this letter as a follow-up to the visit I made to your business on May 27, 1992. At that time, I was under the impression you were going to complete the application I left you, but I have not heard from you.

I would appreciate your attention to this matter. If you need further assistance, please feel free to call me at 605-773-3352.

Sincerely,

DON FRYE, Natural Resources Analyst
Water Rights Division

Water Rights Division - DENR
Conversation File Documentation

NAME OF PERSON OR FILE: Beaver Lake Campground - WP Appl. No. 2237-2

ADDRESS: RR 1 Box 55H, Custer, SD 57730 COUNTY: Custer

DATE: 8/26/92 TELEPHONE: 673-2464

RE: Discussion with Craig Vander Vorste about their wastewater system

COMMENTS:

I contacted Mr. Vander Vorste regarding the the type of wastewater disposal system that the campground utilizes. Mr. Vander Vorste stated that they have two septic tanks.

1. A 4000 gallon tank which is use for the store, office, campsite. This tank drains to a drain field.
2. A 2000 gallon tank which is for the showers. This tank also drains to a seperate drain field.

Mr. Vander Vorste stated that he does not know when the system was constructed as he and his wife purchased the system only last March. He did know that the systems were on file and had been inspected by the County Planning Officer because he checked on this prior to purchase of the campground.

File in Permit or other file as necessary. Use to document conversations and what the other party was told; why action or decision was made.

NAME:

Eric Ironlund

REPORT ON APPLICATION NO. 2237-2
for Beaver Lake Campground
August 19, 1992

Application No. 2237-2 proposes to appropriate 30 gpm (0.066 cfs) from one well approximately 230 feet deep located in the SW 1/4 SW 1/4 of section 33, T3S R4E BHM in Custer County. The water is for commercial use for the campground, store, office and swimming pool.

AQUIFER - PRECAMBRIAN ROCK (CRSL)

The Precambrian rock in this area consists of metagraywacke and quartz-mica schist or phyllite (Redden, 1975). The rock is under unconfined (water table) conditions and ground water is obtained from fractures the natural foliations within these rock types. Well yields are typically low for this type of rock and depend almost entirely on the number and extent of fractures encountered during drilling. There is no well log available for this well. No estimate is available for the amount of water in storage or the amount of recharge that can be expected in this terrain.

The Division of Water Rights monitors an observation located in the town of Custer about 4 miles northeast of this site. Water levels for this well respond with climatic conditions, that is, rising during wet years and gradually declining during dry years. The data for this well would not represent the rock type at this site but would be generally representative of the geohydrologic conditions of the area (Water Rights, 1992).

REVIEW OF EXISTING WATER PERMITS/RIGHTS

There is one existing Water Permit No. 1936-2 which obtains water from the same source and is located within 1/4 mile of this application. Interference is not expected to be a concern. These are relatively small diversions and drawdown caused by this diversion should not be significant.

CONCLUSIONS

1. Water is available from the Precambrian rock.
2. Interference is not expected to be a concern. This is an existing well that has been in use for many years with no apparent problem.
3. There is no information available to determine the well construction at this site.

4. As of yet their method of wastewater disposal is unknown.


James A Goodman

Natural Resources Engineer

BIBLIOGRAPHY

Redden, J.A., 1975, Precambrian Geology of the Black Hills, in SDGS Bulletin 16, SD DENR, SDGS, Vermillion, SD, 57609.

Water Rights, 1992, Unpublished Observation Well Data for Custer County, SD DENR, Division of Water Rights, Pierre, SD, 57501.

RECOMMENDATION OF CHIEF ENGINEER FOR WATER PERMIT
APPLICATION NO. 2237-2, Beaver Lake Campground

Pursuant to SDCL 46-2A-2, the following is the recommendation of the Chief Engineer, Water Rights Division, Department of Environment and Natural Resources concerning Water Permit Application No. 2237-2, Beaver Lake Campground, c/o Craig Vander Vorste, RR 1 Box 55H, Custer, SD 57730.

The Chief Engineer is recommending APPROVAL of Application No. 2237-2 because 1) there is reasonable probability that there is unappropriated water available for the applicant's proposed use, 2) the proposed diversion has been developed without unlawful impairment of existing rights, 3) the proposed use is a beneficial use and 4) it is in the public interest.

See report on application for additional information.

A handwritten signature in cursive script, appearing to read "John Hatch".

JOHN HATCH, Chief Engineer
August 20, 1992



GREAT FACES. GREAT PLACES.

**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

NOTE: TO BE SURE OF PUBLICATION ON
THE CORRECT DATES, CONTACT
THE NEWSPAPER RIGHT AWAY.

August 26, 1992

Craig Vander Vorste
Beaver Lake Campground
RR 1 Box 55H
Custer, SD 57730

Dear Mr. Vander Vorste:

Water Permit Application No. 2237-2 for commercial use has been examined and found to comply with the South Dakota Water Laws and applicable rules. A notice of hearing has been sent to the Publisher of the Custer Co. Chronicle printed at Custer, SD (Ph # 673-2271). For your information, a copy of the notice, the recommendation of the Chief Engineer and a report on the application are enclosed. Please review the notice prior to publication and notify this office, if you have any corrections or questions.

Be sure to contact the above newspaper to authorize publication of your Notice of Hearing and to arrange for payment. Early contact with the paper can eliminate delays. The publisher has been instructed to publish your notice once each week for two consecutive weeks with the last publication to occur twenty days before the board meeting. The newspaper has been instructed to send us the Proof of Publication. We must receive Proof of Publication before action can be taken on the application.

Sincerely,

Eric Gronlund
Natural Resources Engineer
605 773-3352

enclosures

NOTE: If you plan to contest any part of the Chief Engineer's recommendation, you must file a petition pursuant to the procedures outlined in the attached notice of hearing. The Water Management Board will then consider your concerns during a hearing on the application.



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

GREAT FACES. GREAT PLACES.

August 26, 1992

Custer Co. Chronicle
Box 551
Custer, SD 57730

ATTENTION: Legal Department

Enclosed is a Notice of Hearing on Application No. 2237-2 to be published twice. Please publish the first notice on September 2, 1992, with the second publication 7 days later.

The APPLICANT MUST VERIFY TO YOU THAT THE NOTICE IS TO BE PUBLISHED, before you make the first publication. Please BILL the APPLICANT for the cost of publication. The APPLICANT is Beaver Lake Campground, RR 1 Box 55H, Custer, SD 57730 (Ph # 673-2464).

A copy of BOTH publications must be SENT to the WATER RIGHTS DIVISION. IMMEDIATELY return the FIRST publication with the FIRST Transmittal form on the bottom of this page. The first copy is needed to check the publication for errors so any corrections can be made in the second publication. Publication errors can invalidate the public notice and cause the applicant costly delays.

Please be sure the SECOND publication is returned IMMEDIATELY with the enclosed Proof of Publication form. DO NOT WAIT until the end of the month or the billing cycle. No action may be taken on the permit application until proof of publication has been received.

Sincerely,

Eric Gronlund
Natural Resources Engineer
605 773-3352

enclosures

-----CUT HERE-----
FIRST TRANSMITTAL NOTICE

TO: Eric Gronlund
Water Rights Division
Joe Foss Building
Pierre SD 57501-3181

No. _____

Date _____

We are in receipt of your letter of _____ enclosing Notice of Hearing to
Appropriate Water by Application No. _____ which was first published in our issue
of _____. ENCLOSED IS A COPY OF THIS FIRST PUBLICATION.

Name

Newspaper

Instruction to Newspaper - Publish first Notice on September 2, 1992, with the second publication 7 days later. The applicant is responsible for payment.

NOTICE OF HEARING on Application No. 2237-2 to Appropriate Water

Notice is given that Beaver Lake Campground, RR 1 Box 55H, Custer, SD 57730 has filed an application for a water permit to appropriate 30 gallons per minute (0.066 cubic feet of water per second) from one well (Precambrian Rock) 230 feet deep located in the SW 1/4 SW 1/4 Section 33-T3S-R4E. The water is for commercial use for the campground, store, office and swimming pool.

Pursuant to SDCL 46-2A-2, the Chief Engineer recommends APPROVAL of Application No. 2237-2 because 1) unappropriated water is available, 2) existing rights will not be unlawfully impaired, 3) it is a beneficial use of water, and 4) it is in the public interest. Unless a petition is filed opposing the application or the applicant files a petition contesting the chief engineer's recommendation, the Water Management Board will NOT CONDUCT a HEARING to consider this application and the chief engineer will issue the permit as recommended. Petitions filed in support of the application will NOT require the Board to hear the application.

Any person interested in opposing or supporting this application must file a written petition with BOTH the applicant and Chief Engineer. The applicant must also file a petition if opposed to the Chief Engineer's recommendation. The Chief Engineer's address is "Water Rights Division, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)" and the applicant's mailing address is given above. A petition filed by either an interested person or the applicant must be filed by September 21, 1992. The petition may be informal, but must include a statement describing the petitioner's interest in the application, the petitioner's reasons for opposing or supporting the application, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained.

If a petition is filed opposing the application or the applicant files a petition contesting the chief engineer's recommendation, the Board will consider this application at 10:00 am, September 30, 1992, Floyd Matthew Training Center, Joe Foss Building, 523 East Capitol, Pierre, SD. If a hearing is held, the Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) approve with qualifications, 3) defer, or 4) deny this application based on the facts presented at the public hearing. The September 30, 1992, hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from the applicant or any interested person opposing the application. The request for an automatic delay must be filed by September 21, 1992.

Any hearing will be an adversary proceeding. Any person filing a petition and/or the applicant have the right to be represented by a lawyer and may present evidence or cross-examine witnesses according to SDCL 1-26. These and other due process rights will be forfeited if not exercised. Decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law. Contact Eric Gronlund by September 21, 1992, at the above Water Rights Division address to request copies of information pertaining to this application, to assure access to the hearing by the handicapped or to obtain an interpreter for the hearing impaired.

This application is made pursuant to SDCL 46-1-1 thru 46-1-9, 46-1-12 thru 46-1-16; 46-2-3.1, 46-2-9, 46-2-11, 46-2-13, 46-2-17; 46-2A-1 thru 46-2A-10, 46-2A-12, 46-2A-14, 46-2A-15, 46-2A-20, 46-2A-21; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-24, 46-5-25, 46-5-30.2, 46-5-30.4, 46-5-31; 46-6-3, 46-6-3.1, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14, 46-6-26; and Board Rules ARSD 74:02:01:01 thru 74:02:01:15. Robert E. Roberts, Secretary, Department of Environment and Natural Resources.

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
 County Custer) ss.

I, Terri Tugale

certify that the attached printed Notice was taken
 from the Custer County Chronicle

A newspaper which during the whole time of publication of
 said notice herein after stated, has been and is printed and
 published in the _____

City of Custer

County of Custer and State of South Dakota;
 that the said notice was published in said newspaper on the
 following two dates:

9-2-92

9-9-92

Terri Tugale
 (Signature)

Publisher
 (Title)

9-21-92

(Date Signed)

Cost of Printing: 51.16

NOTICE OF HEARING TO APPROPRIATE WATER.

NOTICE OF HEARING on Application No. 2237-2 to Appropriate Water.

Notice is given that Beaver Lake Campground, RR 1 Box 55H, Custer, SD 57730 has filed an application for a water permit to appropriate 30 gallons per minute (0.066 cubic feet of water per second) from one well (Precambrian Rock) 230 feet deep located in the SW 1/4 SW 1/4 Section 33-T3S-R4E. The water is for commercial use for the campground, store, office and swimming pool.

Pursuant to SDCL 46-2A-2, the Chief Engineer recommends APPROVAL of Application No. 2237-2 because 1) unappropriated water is available, 2) existing rights will not be unlawfully impaired, 3) it is a beneficial use of water, and 4) it is in the public interest. Unless a petition is filed opposing the application or the applicant files a petition contesting the chief engineer's recommendation, the Water Management Board will NOT CONDUCT a HEARING to consider this application and the chief engineer will issue the permit as recommended. Petitions filed in support of the application will NOT require the Board to hear the application.

Any person interested in opposing or supporting this application must file a written petition with BOTH the applicant and Chief Engineer. The applicant must also file a petition if opposed to the Chief Engineer's recommendation. The Chief Engineer's address is "Water Rights Division, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)" and the applicant's mailing address is given above. A petition filed by either an interested person or the applicant must be filed by September 21, 1992. The petition may be informal, but must include a statement describing the petitioner's interest in the application, the petitioner's reasons for opposing or supporting the application, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained.

If a petition is filed opposing the application or the applicant files a petition contesting the chief engineer's recommendation, the Board will consider this application at 10:00 am, September 30, 1992, Floyd Matthew Training Center, Joe Foss Building, 523 East Capitol, Pierre, SD. If a hearing is held, the Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) approve with qualifications, 3) defer, or 4) deny this application based on the facts presented at the public hearing. The September 30, 1992, hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from the applicant or any interested person opposing the application. The request for an automatic delay must be filed by September 21, 1992.

Any hearing will be an adversary proceeding. Any person filing a petition and/or the applicant have the right to be represented by a lawyer and may present evidence or cross-examine witnesses according to SDCL 1-26. These and other due process rights will be forfeited if not exercised. Decisions of the Board may be appealed to the

Circuit Court and State Supreme Court as provided by law. Contact Eric Gronlund by September 21, 1992, at the above Water Rights Division address to request copies of information pertaining to this application, to assure access to the hearing by the handicapped or to obtain an interpreter for the hearing impaired.

This application is made pursuant to SDCL 46-1-1 thru 46-1-9, 46-1-12 thru 46-1-16; 46-2-3.1, 46-2-9, 46-2-11, 46-2-13, 46-2-17; 46-2A-1 thru 46-2A-10, 46-2A-12, 46-2A-14, 46-2A-15, 46-2A-20, 46-2A-21; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-24, 46-5-25, 46-5-30.2, 46-5-30.4, 46-5-31; 46-6-3, 46-6-3.1, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14, 46-6-26; and Board Rules ARSD 74:02:01:01 thru 74:02:01:15.

Robert E. Roberts, Secretary,
 Department of Environment and Natural
 Resources.

#3034 9/2 9/9



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

NOV 17 1992

Craig Vander Vorste
Beaver Lake Campground
RR 1 Box 55H
Custer, SD 57730

Dear Mr. Vander Vorste:

Enclosed is Water Permit No. 2237-2 authorizing your water diversion system and beneficial use of the water, not exceeding the limits as specified in the Water Permit.

The final inspection has been completed on this Permit, and we are ready to issue the Water License. Statutes require we charge \$50 for the inspection and issuance of the final papers. Upon receipt of this amount the Water License will be sent to you.

Very truly yours,

JOHN HATCH, Chief Engineer
Water Rights Division
605 773-3352

enclosures



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

January 21, 1993

SECOND NOTICE

PERMIT NO: 2237-2

NOTICE OF WATER LICENSE INSPECTION FEE REQUIREMENT

Craig Vander Vorste
Beaver Lake Campground
RR 1, Box 55H
Custer, SD 57730

Dear Mr. Vander Vorste:

On November 17, 1992, you were notified the final inspection fee of \$50.00 is due before Water License No. 2237-2 can be issued. As of this date, the fee has not been received.

The fee is a final step in the legal process of obtaining and perfecting a water right and is required by SDCL 46-2-13(3). Upon receipt of the \$50.00 fee, your Water License will be sent to you. This is the final document for the perfection of your Water Right. A perfected water right is similar to a property right and once a water right is perfected, it cannot be lost as long as the water is used.

South Dakota Water Law 46-5-30.1 requires that a permit holder may not divert water until the License fee has been paid. Please submit the required fee immediately to avoid jeopardizing your water permit.

Very truly yours,

John Hatch, Chief Engineer
Water Rights Division
Phone: (605) 773-3352

Is your RETURN ADDRESS completed on the reverse side?

SENDER:

- Complete items 1 and/or 2 for additional services.
- Complete items 3, and 4a & b.
- Print your name and address on the reverse of this form so that we can return this card to you.
- Attach this form to the front of the mailpiece, or on the back if space does not permit.
- Write "Return Receipt Requested" on the mailpiece below the article number.
- The Return Receipt will show to whom the article was delivered and the date delivered.

I also wish to receive the following services (for an extra fee):

1. ☐ Addressee's Address
2. ☐ Restricted Delivery

Consult postmaster for fee.

3. Article Addressed to:

2237-2

Craig Vander Vorste
Beaver Lake Campground
RR 1, Box 55H
Custer, SD 57730

4a. Article Number

P 906 559 971

4b. Service Type

- ☐ Registered ☐ Insured
☒ Certified ☐ COD
☐ Express Mail ☐ Return Receipt for Merchandise

7. Date of Delivery

JAN 29

5. Signature (Addressee)

6. Signature (Agent)

8. Addressee's Address (Only if requested and fee is paid)

PS Form 3811, December 1991 ☆ U.S.G.P.O.: 1992-307-530

DOMESTIC RETURN RECEIPT

Thank you for using Return Receipt Service.

Water Rights Division - DENR
Conversation File Documentation

NAME OF PERSON OR FILE: Beaver Lake Campground - WP No. 2237-2

ADDRESS: _____ COUNTY: _____

DATE: 1/29/93 TELEPHONE: _____

RE: Discussion with Mrs. Vandervorst

COMMENTS:

Mrs Vandervorst called to say she just received the second notice requiring the \$50 inspection fee. Said she never received the first and was concern that this would jeopardize her permit. She was going to send the fee right away.

Stated part of the problem might be that they live in Washington during the winter.

There winter season address is

Craig Vandervorst
RR 1 Box 1087
Benton City, WA 99320

File in Permit or other file as necessary. Use to document conversations and what the other party was told; why action or decision was made.

NAME: Eric Houlston



**Beaver Lake
Campground**

Route 1, Box 55H
Custer, SD 57730
605-673-2464
800-346-4383

1/29/93

Dear John Hatch,

Enclosed is the \$50.00 required
for our H₂O permit. (Check #2676) Permit No: 2237-2.

Please send all correspondence regarding
Beaver Lake Campground (until 4/1/93) to:

Rt. 1 Box 1087

Benton City, Wn. 99320

We are temporarily staying in WA. for the
winter. Thank you.

Sandy VanderVaate
owner.

RECEIPT

413623

Division of Water Rights

South Dakota Department of Environment and Natural Resources

Pierre, _____ February 5, 19 93

RECEIVED OF Sandy Vander Vorste, PO Box 455, Selah, WY 83942 (Beaver Lake Campground)
the following amount in fees for services rendered as provided for by law:

Fee for Application for Permit No. _____ to Appropriate Water, to construct and to put water to beneficial use _____	WY	
Fee for Application for Permit No. _____ to Appropriate Water, for Future Use _____		
Fee to retain Future Use Permit No. _____ after period of seven years.		
Fee for Inspecting Constructed Works, confirming beneficial use and issuing Water License No. <u>2237-2</u>	50	00
Fee for Filing Transfer Form _____		
Fee for Filing Extension Request _____		
Fee for _____		

(Any Other Work Provided by Law)	Total	50 00

By John H. H. H.
Chief Engineer

Permit No. 2237-2
Water District: Upper Cheyenne

REPORT OF EXAMINATION OF WORKS AND/OR APPLICATION OF WATER TO BENEFICIAL USE

I have this day made a thorough examination of the water use system constructed by Beaver Lake Campground holder of Permit No. 2237-2, bearing the priority of July 16, 1992 authorizing the diversion of 0.066 cu. ft. per second of groundwater for commercial purposes in Custer County.

I have to report on the conditions of the same as follows:

A. Works used to divert the water:

One well, 230' deep and a submersible pump rated at 30 GPM.

B. Works used to transport water to place of use:

A system of 1" PVC pipe running throughout the campground.

C. Works used to apply water to beneficial use:

A 160 gallon pressure tank and the campground's water distribution system.

The system is in the following condition good. The point of diversion is located 440' east and 132' north of SW corner of the SW1/4 Sec 33, T3S, R4E.

The works are capable of diverting and conveying to the place of use 0.066 cu. ft. per second of water which is to be used for commercial purposes.

Water has been put to beneficial use to the maximum extent as follows:

Water is used in a campground with 52 hookups, a store/office and a swimming pool with a water slide and should be issued for 0.066 cfs.

Applicable permit qualifications have been complied with ☒ Yes ☐ No

Exceptions to compliance are: None

Date Inspected: 5/27/92



DONALD E. FRYE, JR.
Natural Resources Analyst
DENR, Water Rights Division

STATE OF SOUTH DAKOTA
WATER LICENSE NO. 2237-2

(1) Beaver Lake Campground, of RR #1 Box 55H, Custer, SD 57730 made Application No. 2237-2, July 16, 1992 for a water permit to appropriate 0.066 cubic feet of water per second (30 gallons per minute) from groundwater (one well), Custer County, South Dakota for commercial purposes. Water Permit No. 2237-2, with a priority date of July 16, 1992 was approved September 30, 1992 and issued to the applicant(s) for diversion of water with construction of the described water supply system completed and the application to beneficial use of said water completed.

(2) It is certified that the applicant has complied with the provisions of South Dakota State Law relating to completion of the construction of the water supply system and is entitled to divert 0.066 cubic feet of water per second for beneficial use. The location of the diversion point is 440 feet east and 132 feet north of the SW corner of the SW 1/4 Section 33, T3S, R4E (SW 1/4 SW 1/4).

(3) The applicant has complied with the provisions of South Dakota State Law relating to the application of water to beneficial use in a campground with 52 hookups, a store/office and a swimming pool with a waterslide.

(4) Pursuant to South Dakota Water Law 46-5-30.1 Beaver Lake Campground of RR #1 Box 55H, Custer, SD 57730 the holder(s) and/or owner(s) of Water Permit No. 2237-2 is issued a license to appropriate water, the right to use 0.066 cubic feet of water per second from groundwater (one well) with a priority date of July 16, 1992 from the location specified in (2) of this license. The water is to be used for the purpose of commercial use. This license is subject to any limitations or qualifications listed in Water Permit No. 2237-2 and subject to South Dakota State Law.



APR 1 1993

JOHN HATCH, Chief Engineer
Water Rights Division
Department of Environment and Natural Resources



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

APR 1 1993

2237-2

Sandy VanderVorste
Beaver Lake Campground
RR 1, Box 55H
Custer, SD 57730

Dear Ms. VanderVorste:

Enclosed is Water License No. 2237-2. This is the final water right document completing your process of obtaining a Water Right. Enclosed is Receipt No. 413623 in the amount of \$50.00 which you paid for the inspection and issuance of the Water License.

For your information SDCL 46-6-27 requires that if the owner of an existing well, such as the well authorized by Water Right No. 2237-2, constructs a replacement well and does not plan to use the old well, the old well is considered abandoned and must be plugged. Also, any well that is being used or is not considered abandoned must be valved and controlled, if flowing, or sealed and capped so that no leaking occurs either underground or at the surface.

As long as you use the water beneficially, as stated in the Water License, the State Water Laws provide that you have a continuing right to use the water. If you have any questions, please contact our office.

Very truly yours,

JOHN HATCH, Chief Engineer
Water Rights Division
(605) 773-3352

enclosures



2237-2

DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES

PMB 2020
JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
www.state.sd.us/denr

AUG 08 2005

2504-2
2237-2

Max Hammer
Beaver Creek Campground
12005 W Hwy 16
Custer SD 57730

Dear Mr. Hammer:

Enclosed is Water License No. 2504-2. This is the final water right document completing your process of obtaining a Water Right. Also enclosed is a copy of the map showing the well location for well #2.

For your information SDCL 46-6-27 requires that if the owner of an existing well, such as the well authorized by Water Right No. 2504-2, constructs a replacement well and does not plan to use the old well, the old well is considered abandoned and must be plugged. Also, any well that is being used or is not considered abandoned must be valved and controlled, if flowing, or sealed and capped so that no leaking occurs either underground or at the surface.

As long as you use the water beneficially, as stated in the Water License, the State Water Laws provide that you have a continuing right to use the water. If you have any questions, please contact our office.

Sincerely,

Garland Erbele, Chief Engineer
Water Rights Program
(605) 773-3352

enclosures

Note: The applicable portions of Water Right No. 2237-2 have been incorporated into Water License No. 2504-2