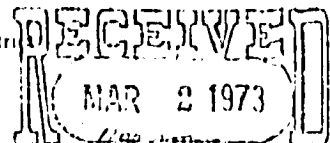


Work Right Number 1973-3

1. Considered May 23, 1973, 1973
2. Name of Applicant City of Gettysburg
3. Post Office Address Gettysburg, S.D.
4. Amount of water claimed 1.55
5. Source of water supply Missouri River
6. Water to be used for Municipal purposes
- Acres to be irrigated --
7. Water to be diverted and used in Potter County
about 15 W Miles of GETTYSBURG
8. Proof of Publication Received ~~March 1973~~ 3-19-73
- Not received _____
9. Application Approved _____
- Subject to _____
- Not approved _____
- Action deferred _____

10. Remarks:

Map No. 937-3 Water Division No. 3 MISSOURI RIVER District 1
 (Blanks to be Filled by the Engineer for the W. R. C.)


APPLICATION FOR PERMIT

STATE WATER RESOURCES COMMISSION
SIOUX FALLS, SOUTH DAKOTA

To Appropriate Water within the State of South Dakota

(NOTE - Draw a line through items not applicable)

 1. Name of Applicant City of Gettysburg
 Postoffice address Gettysburg State S. Dak.
 If a corporation show date and place of incorporation _____

2. Method of accomplishing work (contract, employment of others, or by direct labor) _____

3. Name of diversion work Oahe Water Supply4. Amount of water claimed (cubic feet per second) 1.555. Source of water supply Missouri River
 6. Location of point of diversion Between Points Where the River Crosses the
N. Line and S. Line of Section 16, T118N, R78W.
County Potter7. Annual period or periods during which water is to be used Continuously8. Use to be made of water. (irrigation, industrial, municipal, commercial, recreation, etc.) Municipal

9. For irrigation use. Total number of acres to be irrigated _____

List below each forty-acre subdivision, or lot, or fraction thereof and show number of acres to be irrigated in each.

Land Description	No. Acres Irr.	Land Description	No. Acres Irr.

Attach sheet if more space is needed

 10. Time required to complete construction of water supply system 5 years. Additional time required to complete application of water to the proposed beneficial use 4 years.
11. Choice of newspaper for Notice of Intent to Appropriate Water publication: Potter County News, Gettysburg, SD

12. Principal Features of the Proposed Water Supply System:

A. Works proposed to divert water from its natural source:

Intake Structure (Pumping Station)

B. Works proposed to transport water to place of use:

Transmission Line and Booster Pumping Equipment.

C. Works proposed to apply water to beneficial use:

Ground storage tank, Water Treatment Plant, existing watermains.Estimated Total Cost \$260,000.00
 Attachments: Attach Form 2A if diversion from a well or dugout, or if storage of water, is proposed. Attach map.
 (See instructions concerning preparation.)

STATE OF SOUTH DAKOTA)

County of Potter)I, V. L. Klein the applicant, certify that I have read the foregoing application and have examined the attached map and that the matters therein stated are true and that I intend and am able to complete the necessary construction.Signed V. L. KleinSubscribed and sworn to before me this 1st day of March 1973.
Healey Thomas Pickett
 Notary Public (or other qualified officer)

WATER RIGHT APPLICATION APPROVAL

The Water Resources Commission hereby approves Water Right Application No. 1973-3

CITY OF GETTYSBURG
(Applicant)

(Post Office Address)

SOUTH DAKOTA
(State) With the following modifications

THIS PERMIT REPLACES PERMIT NO 1325-3 WHICH WAS CANCELLED.

Date of first receipt of application MARCH 2 19 73

Date of return to applicant for correction, amendments or changes required — 19 —

Date of receipt of corrected application — 19 —

Approved MAY 23 19 73 Recorded in Book 12 Page 208

WATER RIGHT PERMIT NO. 1973-3

The Water Resources Commission hereby grants and issues this Water Right Permit No. 1973-3 authorizing the construction of the water use system and the putting of water to beneficial use as stated in the Application and as modified in the Water Right Application approval, subject, however, to the following limitations and conditions:

1. The date from which applicant may claim right is MARCH 2 19 73
2. The equivalent of at least one-fifth of the work above specified is to be completed on or before NOVEMBER 23 19 75
3. The whole of said work is to be completed on or before MAY 23 19 78
4. The limit of time from proof of beneficial use of water appropriated in accordance herewith is MAY 23 19 82
5. The water appropriated shall be used for the purpose of MUNICIPAL USE

6. The prior right of all persons who, by compliance with the laws of the State of South Dakota, have acquired a right to the use of water must not be injuriously affected by this appropriation.

7. The amount of the appropriation herein granted shall not exceed 1.55 cubic feet per second; neither shall it exceed the capacity of the above described water supply system, nor shall it exceed the amount of water needed for ~~irrigation~~ USE FOR MUNICIPAL PURPOSES and if for the irrigation purpose and appropriation shall be limited to not more than ~~one acre of land to which water is actually and beneficially applied for irrigation~~ on or before MAY 23 19 82 said water to be used during the following described annual period: CONTINUOUSLY

Witness my hand this 29TH day of MAY 19 73

WATER RESOURCES COMMISSION

By

[Signature]
Chief Engineer, Executive Officer

Certificate of Construction Issued — 19 —

Water License Issued — 19 —

No. 1973-3

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
) ss.
County Potter)

I, William R. Claus hereby
certify that the annexed printed copy of Notice of Intent to Appropriate
Water was taken from the Potter County News

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the _____

City of Gettysburg

County of Potter and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

March 15, 1973

March 22, 1973

William R. Claus
(Signature)

Bookkeeper
(Title)

3-16-73

(Date Signed)

Form 6, Notice of Intent
to Appropriate Water
No. 1973-3
Publish first publication, on or
before May 10, 1973

NOTICE, INTENT
TO APPROPRIATE WATER
Pierre, South Dakota 57501
March 9, 1973

Notice is hereby given that the
City of Gettysburg, South
Dakota, has made application
in accordance with the
provisions of the water law, of
South Dakota for a permit to
appropriate for beneficial use
1.55 cubic feet of water per
second of time from the Missouri
River through the Oahe Water
Supply, the point of diversion of
which is to be located in between
points in the NE $\frac{1}{4}$ NE $\frac{1}{4}$ and in
the SE $\frac{1}{4}$ SE $\frac{1}{4}$ of Section 16, Twp.
118N, Range 78W. Said water to
be used for the purpose of
providing municipal supplies for
the City of Gettysburg.

This application No. 1973-3 will
be considered by the Water
Resources Commission at their
office at Pierre upon the 23rd day
of May, 1973, at 2:00 p.m. All
interested persons may appear
and be heard.

Water Resources Com-
mission

By: Burton F. Jones
Water Rights Specialist
(Mar. 15, 22, 1973)

RECEIVED
MAR 19 1973

STATE WATER RESOURCES COMMISSION
PIERRE, SOUTH DAKOTA

No. 1973-3

Publish first publication, on or before May 10, 1973

**NOTICE
INTENT TO APPROPRIATE WATER**

Pierre, South Dakota 57501

March 9, 1973

Notice is hereby given that the City of Gettysburg

~~WHEREFORE I HEREBY REQUEST~~
_____, South Dakota, has made an application in accordance
with the provisions of the water laws of South Dakota for a permit to appropriate for beneficial use
1.55 cubic feet of water per second of time from the Missouri River

Oshe Water Supply, the point of diversion of which is to be located ~~in~~
between points in the NE $\frac{1}{4}$ NE $\frac{1}{4}$ and in the SE $\frac{1}{4}$ SE $\frac{1}{4}$

of Section 16, Twp. 118N, Range 78W. Said water to be used for the purpose
of providing ~~water for the City of Gettysburg~~
municipal supplies for the City of Gettysburg.

This application No. 1973-3 will be considered by the Water Resources Commission at their office at
Pierre upon the 23rd day of May, 1973, at 2:00 P. M. All interested
persons may appear and be heard.

WATER RESOURCES COMMISSION

By:

BURTON F. JONES

Water Rights Specialist

cc: Dick Newland, Auditor, City of Gettysburg 57442

Received Water Resources Commission office Jan. 3, 1973
Copy of original letter to City of Gettysburg, filed in W/R 1325-3

MRORE-O

January 2, 1973

Mr. Richard Newland
Office of the City Auditor
Gettysburg, S.D. 57442

Re: Oahe-Request for Easement

Dear Mr. Newland:

Receipt is acknowledged of your letter of 27 December 1972 wherein you requested permission to take water from Lake Oahe for municipal use.

According to information furnished by the office of the State Water Commission your Application for Permit No. 1325-3 has expired. It will be necessary that the City have a valid, approved Application before final consideration of your request can be made.

Current policy requires that the City enter into a Contract with the United States for the withdrawal of water from Lake Oahe. Preparation of the Contract will depend somewhat on the terms and conditions of approved Permit from the State.

Please feel free to contact this office if you need further assistance in this matter.

Sincerely yours,

S/ K. L. Ehrenfelt
Chief, Pierre Real Estate Office

CF:
Water Resources Commission
State of South Dakota, Pierre, SD

AM, Ft. Pierre Area



1473-3

DEPARTMENT OF THE ARMY
OMAHA DISTRICT, CORPS OF ENGINEERS
7410 U.S. POST OFFICE AND COURT HOUSE
OMAHA, NEBRASKA 68102

MROOP-N

4 October 1973

Missouri River Mile 1152.5
plus 1½ miles up Cheyenne Creek
City of Gettysburg, South Dakota
Water Intake Structure

NOTICE OF PERMIT PENDING

The application of the City of Gettysburg, South Dakota 57442, for approval of plans and issuance of a permit under authority of the Secretary of the Army is being considered by the District Engineer, U.S. Army Engineer District, Omaha, Nebraska.

The applicant requests permission to construct and maintain a water intake structure. The proposed intake is to be located approximately 1¼ miles west and 1½ miles north of Gettysburg, South Dakota, and approximately 1½ miles up the Cheyenne Creek arm of Oahe Reservoir from Missouri River mile 1152.5 (1960 mileage). The proposed work is to consist of an intake line and a pumphouse. A 12-inch casing is to be placed from the intake opening in the reservoir through a bored shaft initiating in the reservoir at an elevation of 1553', rising up a slope, through a knoll, and to a pumphouse. The elevation of the pumphouse is to be approximately 1625 feet. All areas disturbed by construction are to be returned to natural grade and reseeded.

The decision whether to issue a permit will be based on an evaluation of the probable impact of the proposed activity on the public interest. That decision will reflect the national concern for both protection and utilization of important resources. The benefit which reasonably may be expected to accrue from the proposal must be balanced against its reasonably foreseeable detriments. All factors which may be relevant to the proposal will be considered; among those are conservation, economics, aesthetic, general environmental concerns, historic values, fish and wildlife values, flood damage prevention, land use classification, navigation, recreation, water supply, water quality and, in general, the needs and welfare of the people. No permit will be granted unless its issuance is found to be in the public interest.

An environmental assessment has been made and is on file in this office.

Any interested party (particularly officials of any town, city, county, state, federal agency, or local association whose interests may be affected by the proposed work) is invited to submit to this office written facts, arguments, or objections on or before November 3, 1973. Any agency or individual having an objection to the work should specifically identify it as an objection with clear and specific reasons.



A permit, if granted, will be under Section 10 of the River and Harbor Act of 1899 (33 U.S.C. 403).

Drawings showing the location and extent of the work are attached to this notice.

FOR THE DISTRICT ENGINEER:

3 Attachments
As stated



KENNETH B. AUSTIN
LTC, Corps of Engineers
Deputy District Engineer

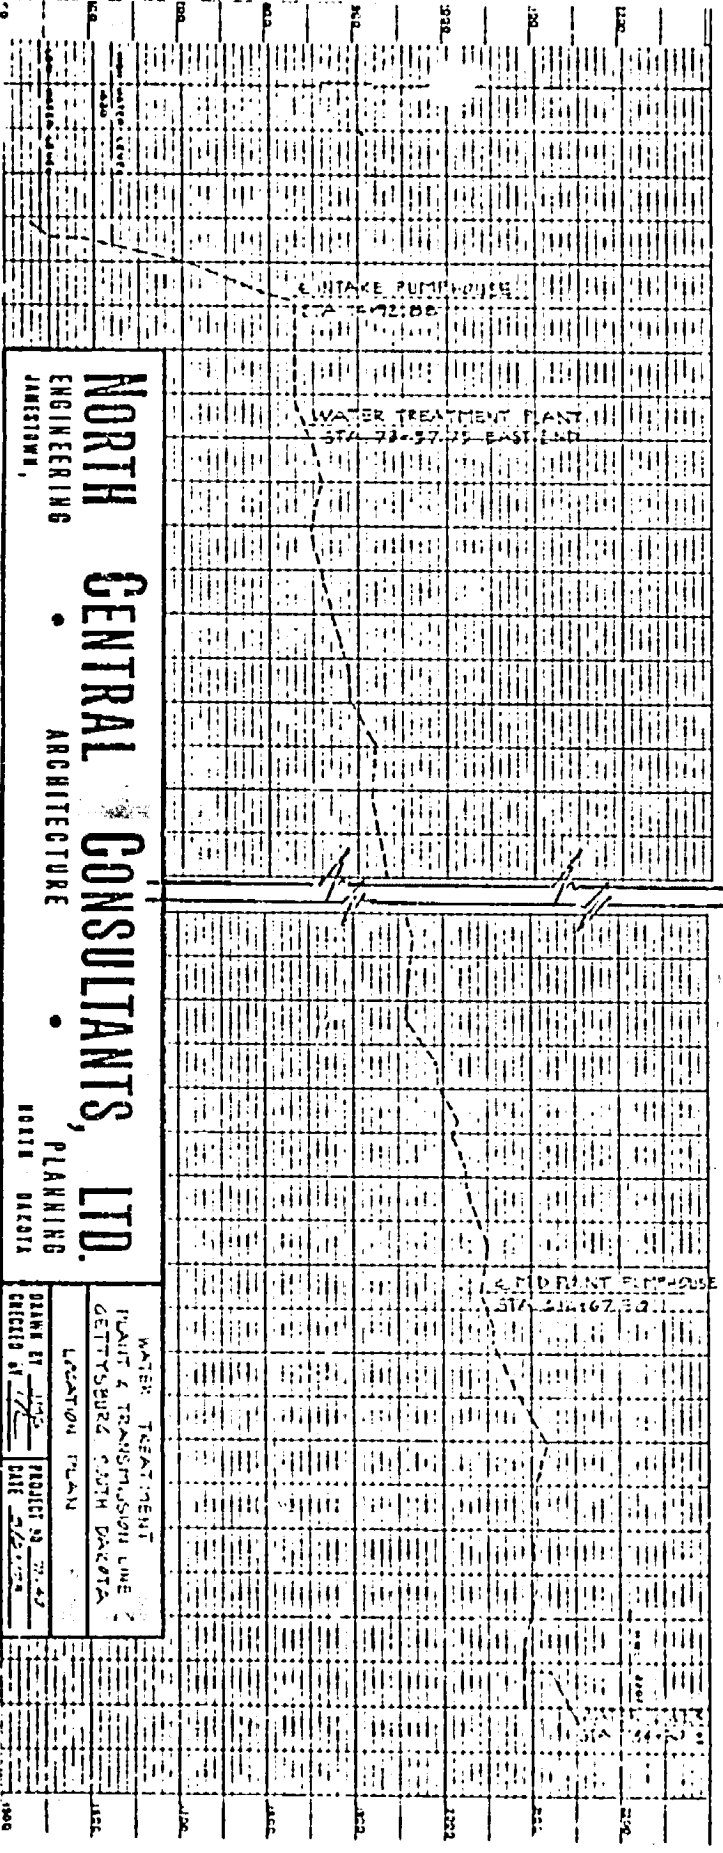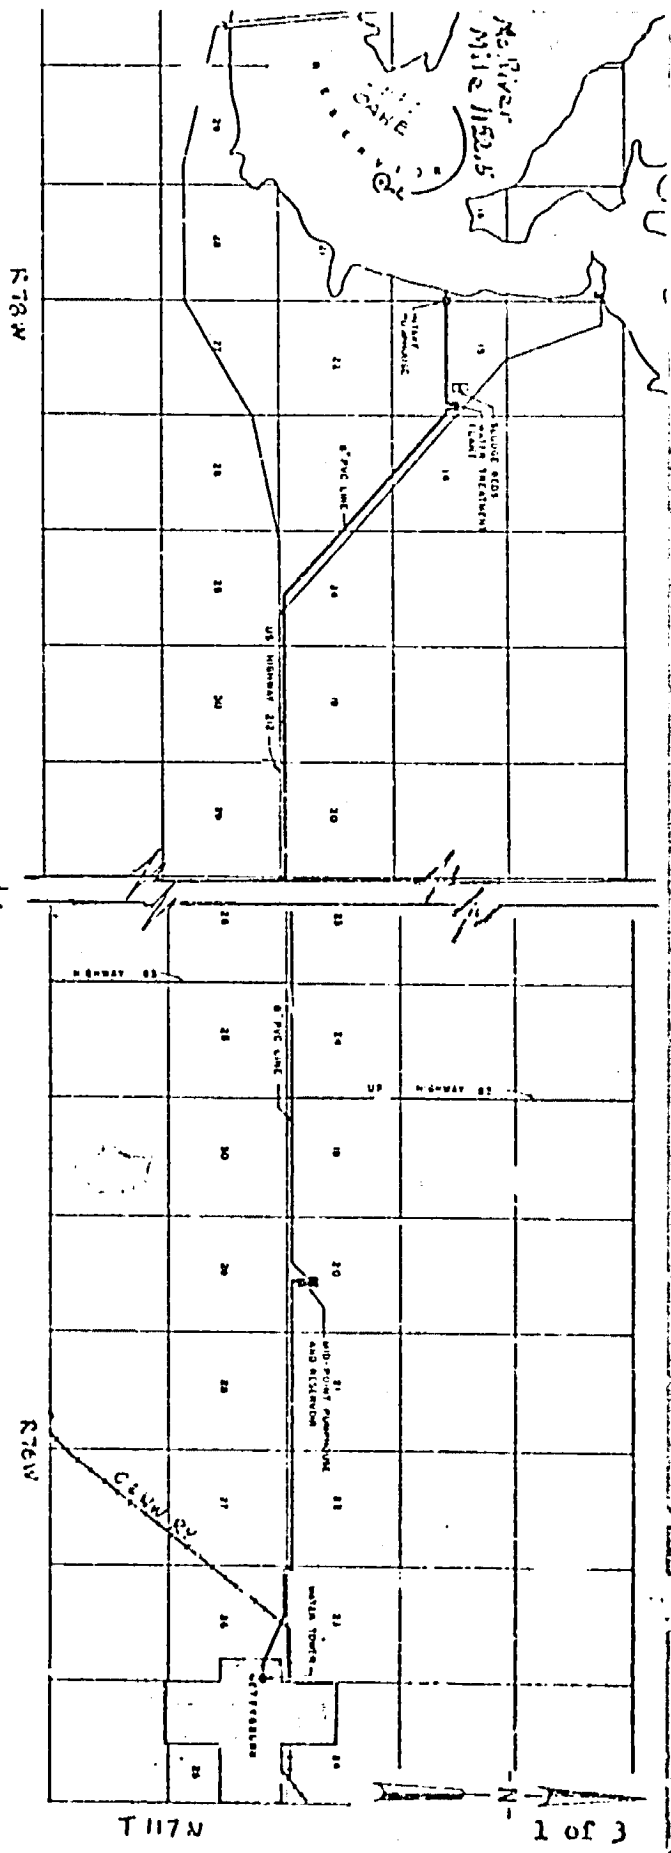

NORTH CENTRAL CONSULTANTS, LTD.
 ENGINEERING • ARCHITECTURE • PLANNING
 JANSSEN, NORTH DAKOTA

WATER TREATMENT
 PLANT & TRANSMISSION LINE
 GETTYSBURG, SOUTH DAKOTA
 LOCATION PLAN
 DRAWN BY JLD
 CHECKED BY JLD
 PROJECT NO. 77-47
 DATE 5/2/58



T117N

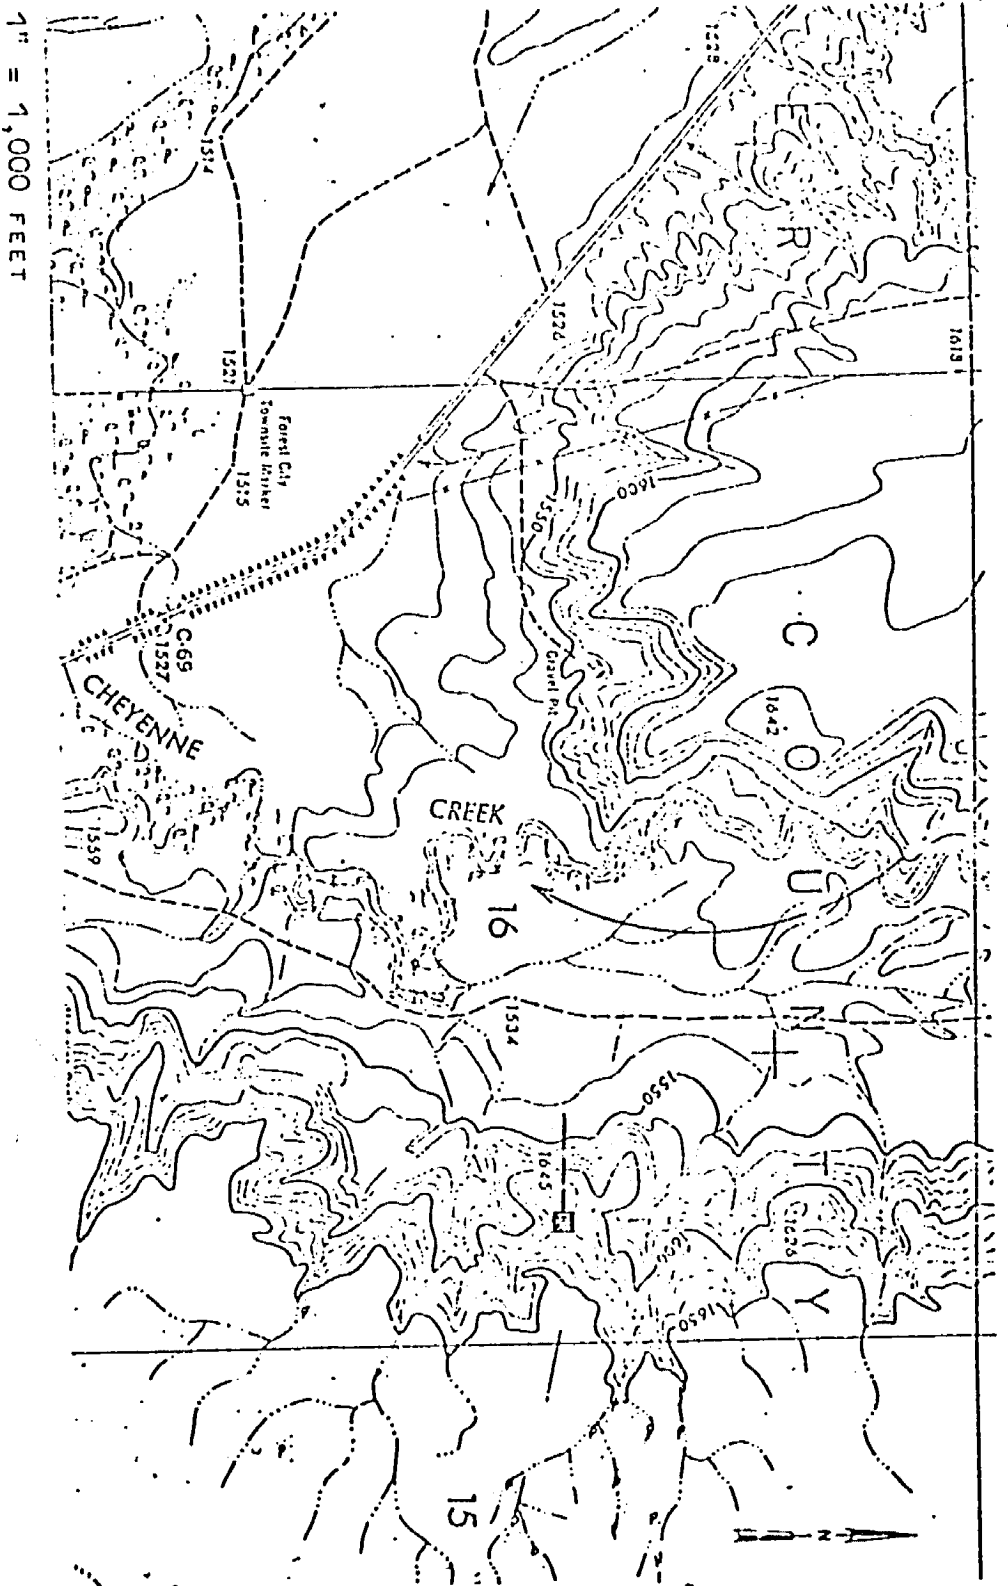

PROPOSED INTAKE STRUCTURE IN THE Oahe RESERVOIR
POTTER COUNTY, SOUTH DAKOTA APPLICATION BY CITY OF
GETTYSBURG

AUGUST 28, 1973

V.L. Klein
V.L. KLEIN
MAYOR

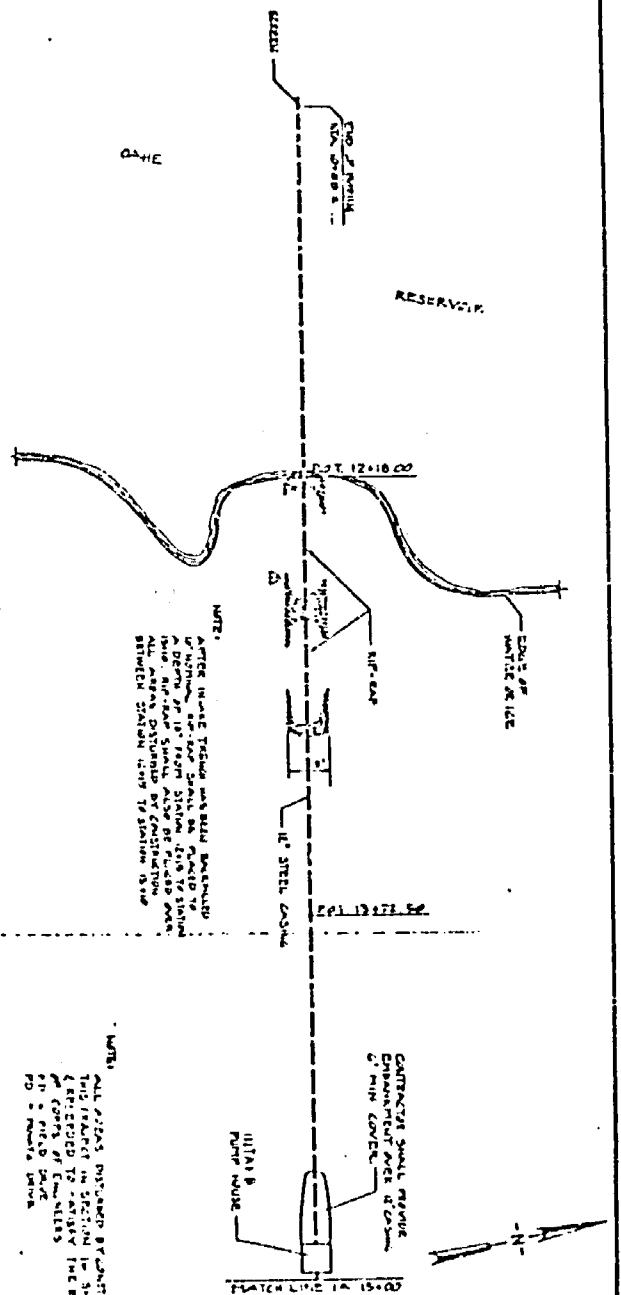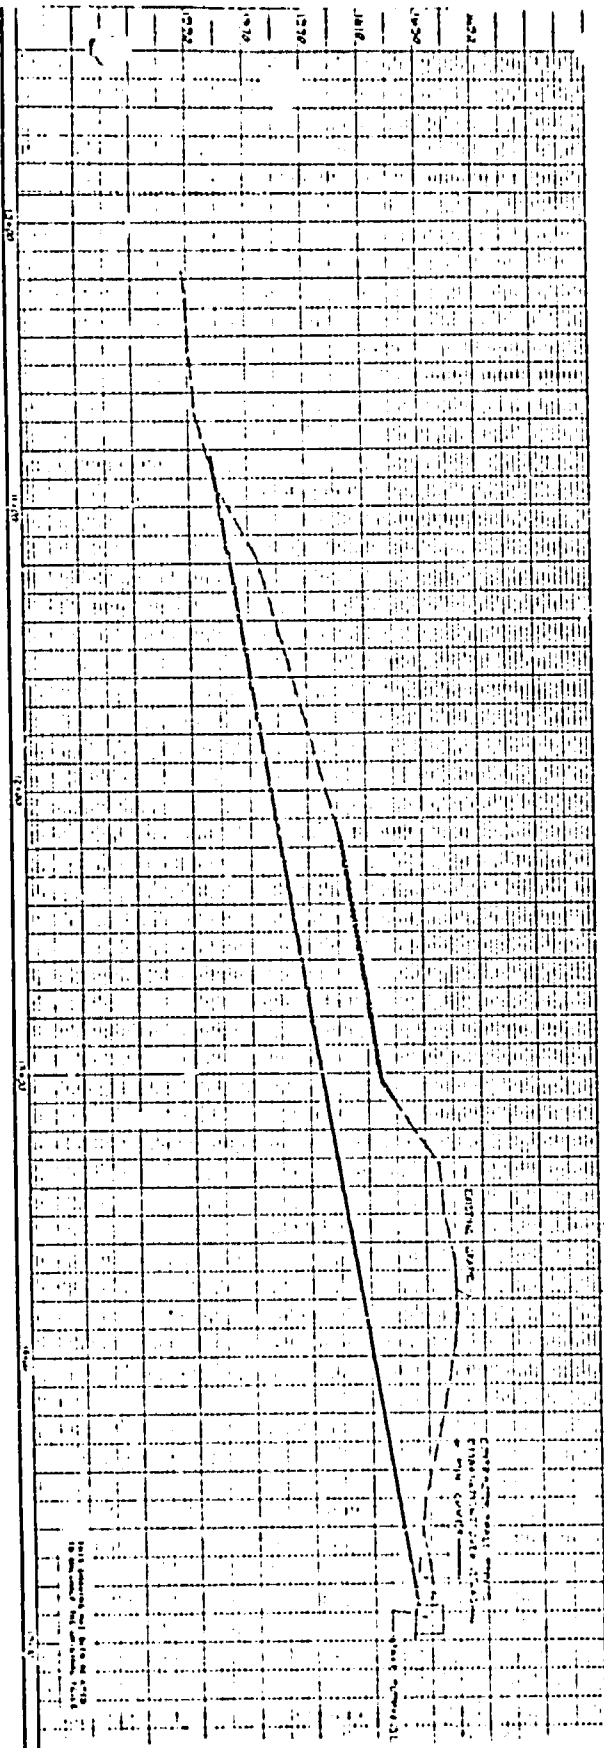

NOTE: ALL PIPES DISCHARGING TO THE TREATMENT PLANT SHALL BE 12" STEEL CORROSION RESISTANT AND SHALL BE PROVIDED WITH A DEPTH OF 12" FROM THE TOP OF THE PIPE TO THE BOTTOM OF THE COVER. THE AREA BETWEEN THE COVER AND THE PIPE SHALL BE FILLED WITH GRAVEL.

NOTE: AFTER INSTALLATION OF THE DRAIN, THE AREA BETWEEN THE DRAIN AND THE EXISTING DRAINAGE SHALL BE FILLED WITH GRAVEL TO A DEPTH OF 12" FROM THE TOP OF THE PIPE TO THE BOTTOM OF THE COVER. THE AREA BETWEEN THE COVER AND THE PIPE SHALL BE FILLED WITH GRAVEL.

SHEET NO. 1



NORTH CENTRAL CONSULTANTS, LTD.
ENGINEERING ARCHITECTURE PLANNING
1000 BROADWAY, SUITE 1000, NEW YORK, N.Y. 10018

WATER TREATMENT PLANT	
DATE OF PREPARATION	1960
DATE OF REVISION	1960
DATE OF REVIEW	1960
DATE OF APPROVAL	1960

1913-3

 **Department of
Water & Natural Resources**
Joe Foss Building
Pierre, South Dakota 57501

May 12, 1980

Mr. Donald Woodford, Mayor
110 East Commercial
Gettysburg, South Dakota 57442

Re: Proposed Irrigation Site

Dear Mayor Woodford:

The Department of Water and Natural Resources has completed the evaluation of the on-site inspection of the proposed Gettysburg irrigation site. DWR concurs with your stand that at this time you will meet the requirements noted in the Criteria for Design of Wastewater Collection. In your letter of April 18, 1980, you had questioned the applicability of some of the items listed in the above referenced document. Based on the conditions observed during the on-site investigation conducted by DWR, we will waive the requirements for test holes and monitoring wells. It is not necessary to waive the criteria that the site be fenced as it was noted that the area is enclosed by a fence at the present time.

It should be noted that you will have to observe the criteria for minimal holding times in your sewage lagoon to assure that the effluent is of the satisfactory quality for irrigation purposes. It is further recommended that a yearly sampling be made to insure that the quality of the effluent remains suitable. It is also advisable that good management practices be adhered to in order to preserve the integrity of the soil in the proposed area. Mr. Jim Ridler of the Soil Conservation Service will be able to provide you with information pertaining to this matter.


Equal Opportunity Employer

Donald Woodford
Page 2
May 12, 1980

During the inspection it was further noted that although some of the area of the lagoons have been riprapped, there are still areas where the wind and wave action are causing erosion. It is recommended that the present efforts to riprap continue and if possible be expanded. Also, the weeds observed in the secondary cell should be removed.

DWR would like to commend the City of Gettysburg for initiating this project and we are happy to be of assistance whenever possible. A representative of our staff will be in attendance at your council meeting on Monday, June 2, 1980, to answer any additional questions the council may have. Continued success as you work toward completion of your project.

Respectfully,

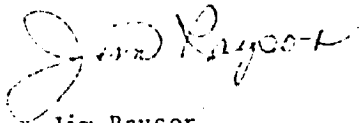

Jim Raysor
Natural Resource Engineer I
Office of Water Quality
Phone: 773-4065

cc: Jim Ridler, Soil Conservation Service, Gettysburg, SD
John Hatch, Water Rights
A52505JR

STATE OF SOUTH DAKOTA
WATER LICENSE NO. 1973-3

(1) City of Gettysburg of PO Box 132, Gettysburg, SD 57442-0132 made Application No. 1973-3, March 2, 1973 for a water permit to appropriate 1.55 cubic feet of water per second from the Missouri River, Potter County, South Dakota for municipal purposes. Permit No. 1973-3, with a priority date of March 2, 1973 was approved May 23, 1973 and issued to the applicant for diversion of water with construction of the described water supply system to be completed on or before May 23, 1978 and for the application to beneficial use of said water on or before May 23, 1982.

(2) It is certified that the applicant has complied with the provisions of South Dakota State Law relating to completion of the construction of the water supply system and is entitled to divert 0.67 cubic feet of water per second for beneficial use. The location of the diversion point is at the Missouri River - 380 feet north and 540 feet west of the E 1/4 corner Section 16, T118N, R78W (SE 1/4 NE 1/4).

(3) The applicant has complied with the provisions of South Dakota State Law relating to the application of water to beneficial use.

(4) Pursuant to South Dakota Water Law 46-5-30.1 City of Gettysburg of PO Box 132, Gettysburg, SD 57442-0132 the holder and/or owner of Water Permit No. 1973-3 is issued a license to appropriate water, the right to use 0.67 cubic feet of water per second from the Missouri River with a priority date of March 2, 1973 from the location specified in (2) of this license. The water is to be used for municipal purposes. This license is subject to any limitations or qualifications listed in Water Permit No. 1973-3 and subject to South Dakota State Law.



John Hatch, Chief Engineer
Water Rights Program
Department of Environment and Natural Resources

DEC 18 1995

date



REPORT ON INSPECTION OF PERMIT NO. 1973-3

DATE: 7-25-95

Other permit(s) associated with the project:

DIVERSION POINT LEGAL LOCATION: At the Missouri River, 380 feet N and 540 feet W of the E 1/4 corner Section 16, T118N, R78W, which is in the SE 1/4 NE 1/4 Section 16.

Pump:

- 1) Make Valley pump, submersible
- 2) Model 6H24
- 3) Size 4"-8 stage
- 4) Capacity 300 GPM

Motor:

- 1) Make Franklin Electric
- 2) Model No. 2366176010
- 3) Horsepower rating 40 hp

Pump: At the treatment plant.

- 1) Make 2-Fairbanks and Morse, submersible
- 2) Model K2V2-072833 and K2V2-072633
- 3) Size 6"-8 stage
- 4) Capacity 300 GPM

Motor:

- 1) Make 2-U.S. Electric
- 2) Model No. R-2077149 and R-2075524
- 3) Horsepower rating 30 hp

Pump: At Midpoint pumphouse.

- 1) Make 2-Franklin and Morse, submersible
- 2) Model K2V1073716-1
- 3) Size 2"- turbine
- 4) Capacity 300 GPM

Motor:

- 1) Make 2-Reliance Electric
- 2) Model No. IMA4G2926-G1-BZ
- 3) Horsepower rating 30 hp

DISTRIBUTION LINES OR CANALS:

- 1) Type pvc 2) Size 8 inches 3) Length 14 miles
- 1) Type galvanized 2) Size 4 inches 3) Length 400 feet

PERMIT QUALIFICATIONS AND REGULATIONS:

- 1) Special qualifications to permit being abided by Y
- 2) All structures, wells and lands on map Y

Report Of Examination Of Works And/Or Application of Water To Beneficial Use

TO: Chief Engineer, Division of Water Rights, DENR, Foss Bldg., Pierre, SD 57501

I have this day made a thorough examination of the water use system constructed by City of Gettysburg of Gettysburg, SD 57442 holder of Permit No. 1973-3, bearing the priority of March 2, 1973 authorizing the diversion of 1.55 cu. ft. per second of the waters of Missouri River for municipal purposes, in Potter County.

I have to report on the conditions of the same as follows:

- A. Works used to divert the water:
From the Missouri River: Valley submersible pump, model 6H24, 300 gpm capacity and Franklin Electric motor, model 2366176010, 40 hp.
From treatment plant: 2-Fairbanks and Morse pumps, model nos. K2V2-072833 and K2V2-072633, 300 gpm each and 2-Franklin Electric notors, model nos. R-2077149 and R-2075524, 30 hp each.
From the midpoint pumphouse: 2-Franklin and Morse submersible pumps, model no. K2V1073716-1, 300 gpm each, and 2-Reliance Electric motors, model no. IMA4G2926-G1-BZ, 30 hp each.
- B. Works used to transport water to place of use:
14 miles of 8 inch pvc pipe and 400 feet of 4 inch galvanized pipe.
- C. Works used to apply water to beneficial use:
Municipal water system.

The system is in the following condition good. The point of diversion is located at the Missouri River, 380 feet N and 540 feet W of the E 1/4 corner Section 16, T118N, R78W. The works are capable of diverting and conveying to the place of use 0.67 cu. ft. per second of water which is to be used for municipal water supply. Water has been put to beneficial use to the maximum extent as follows:

Municipal water supply.

and the license should be issued for 0.67 cfs.

Applicable permit qualifications have been complied with: ☒ Yes ☐ No

Exceptions to compliance are: none

Date: 7-31-95

Comments:

Lynn Beck
Lynn Beck
Natural Resources Engineer
DENR, Water Rights Division



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3181

November 3, 1995

1973-3

William Davis, Mayor
City of Gettysburg
P.O. Box 132
Gettysburg, SD 57442-0132

Dear Mr. Davis:

The inspection of your water use system and the inspection of the extent of application of water to beneficial use, as developed under Water Permit No. 1973-3, has been completed. Your final water right document, the Water License, can now be issued.

Statutes require that we charge a \$50.00 fee for the inspection and issuance of the Water License. Upon receipt of the \$50.00 fee from you, we will begin processing your Water License.

Please remit fee to:
Department of Environment & Natural Resources
Water Rights Program
523 E. Capitol
Pierre, SD 57501-3181

South Dakota Water Law 46-5-30.1 requires that a permit holder may not divert water until the \$50.00 license fee has been paid. Please contact us if you have any questions.

Sincerely,

Cheryl F. Frost
Secretary
Water Rights Program
(605) 773-3352

NOTE: On check or money order, please specify your permit number. This will insure proper handling of the fee.



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3181

DEC 18 1995

1973-3

Ladonna Schneider
Finance Officer
City of Gettysburg
P.O. Box 132
Gettysburg, SD 57442-0132

Dear Ms. Schneider:

Enclosed is Water License No. 1973-3 and Receipt No. 414662 for \$50.00 which was assessed for an inspection and issuance of the license. Water License No. 1973-3 is the final document which completes the process of obtaining a water right.

As long as you use the water beneficially, as stated in the Water License, State Water Laws provide that you have a continuing right to use the water.

Very truly yours,

JOHN HATCH, Chief Engineer
Water Rights Program
(605) 773-3352

gm
enclosures

RECEIPT

Division of Water Rights

South Dakota Department of Environment and Natural Resources

1973-3
414662


Pierre, _____ November 9, 1995

RECEIVED OF City of Gettysburg, P.O. Box 122, Gettysburg, SD 57442-0132

the following amount in fees for services rendered as provided for by law:

Fee for Application for Permit No. _____ to Appropriate Water, to construct and to put water to beneficial use _____	50	00
Fee for Application for Permit No. _____ to Appropriate Water, for Future Use _____		
Fee to retain Future Use Permit No. _____ after period of seven years.		
Fee for Inspecting Constructed Works, confirming beneficial use and issuing Water License No. <u>1973-3</u>		
Fee for Filing Transfer Form _____		
Fee for Filing Extension Request _____		
Fee for _____		

(Any Other Work Provided by Law)	Total	50 00

By *John H. Hotal* 
Chief Engineer

NOT TO SCALE


88-L

Prepared by:

Lynn Beck

Lynn Beck
Natural Resources Engineer
Water Rights Program
9-28-95

.16


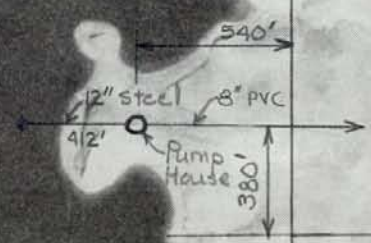


Mar
Deb

Mary Ann Knudson
Tom Knudson
Marian Buckley
Debra Cronin

118-78


Bernice Quamme

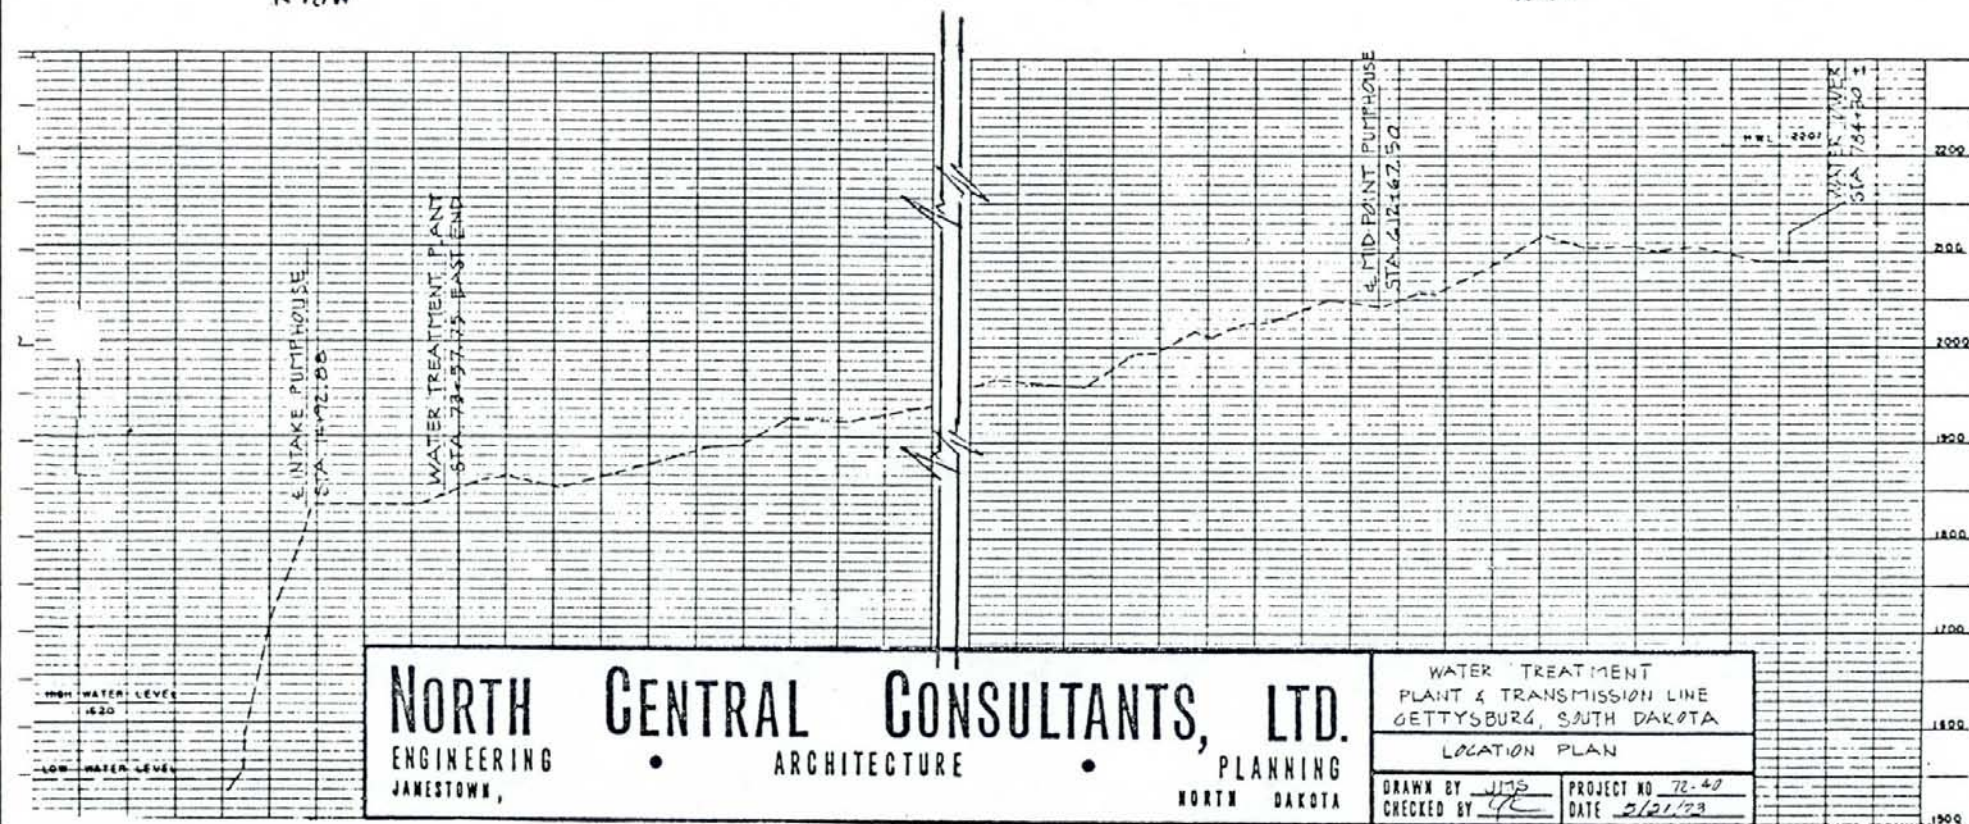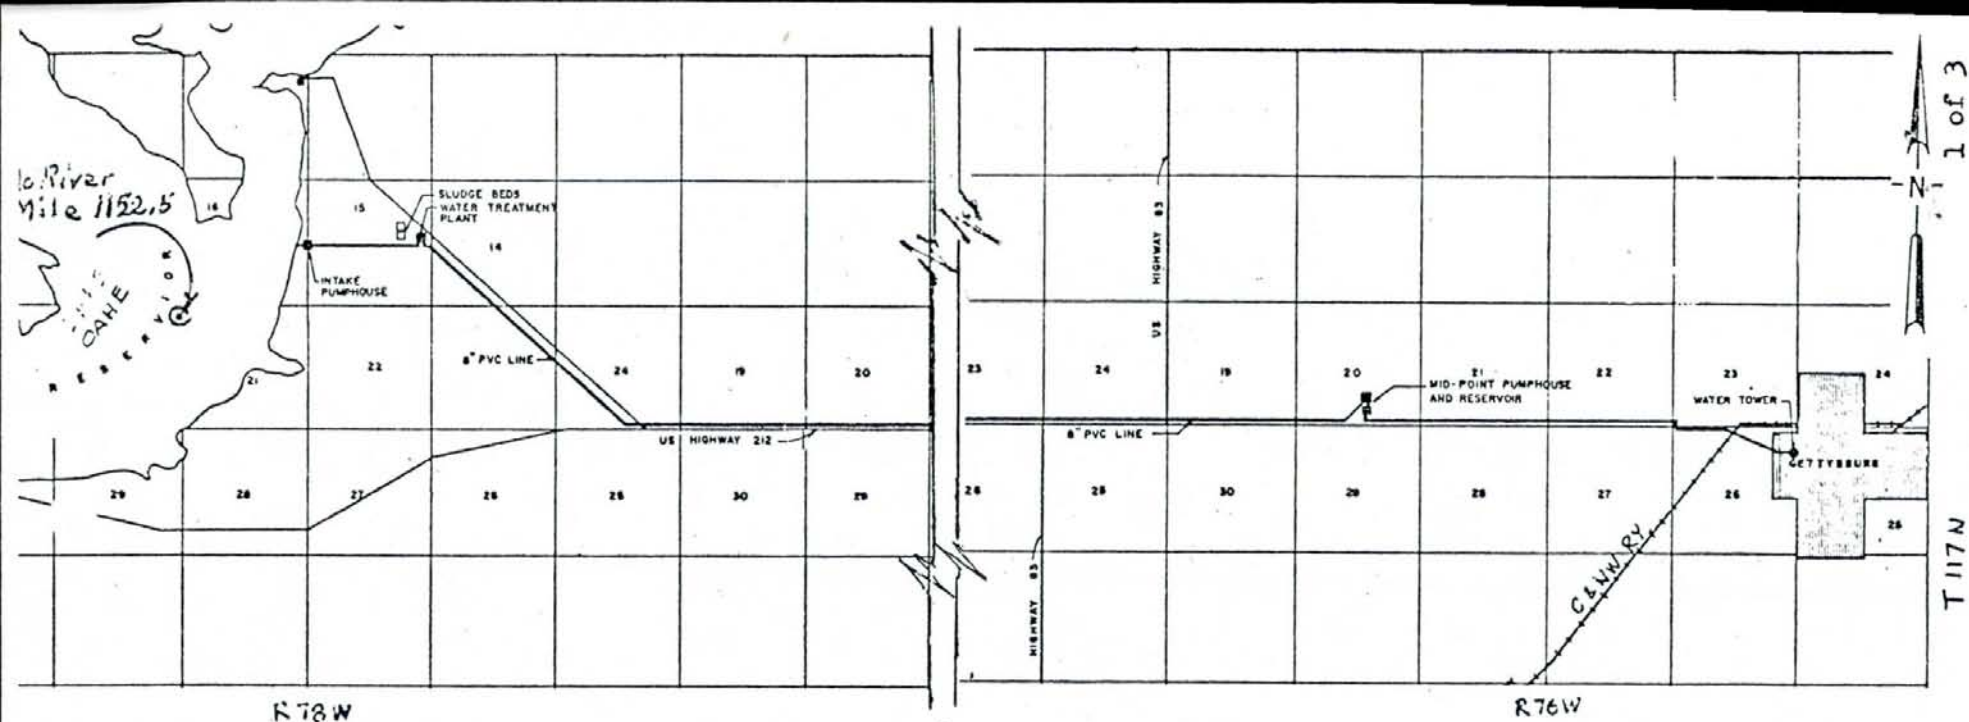

1973-3

1973-3

2 of 3


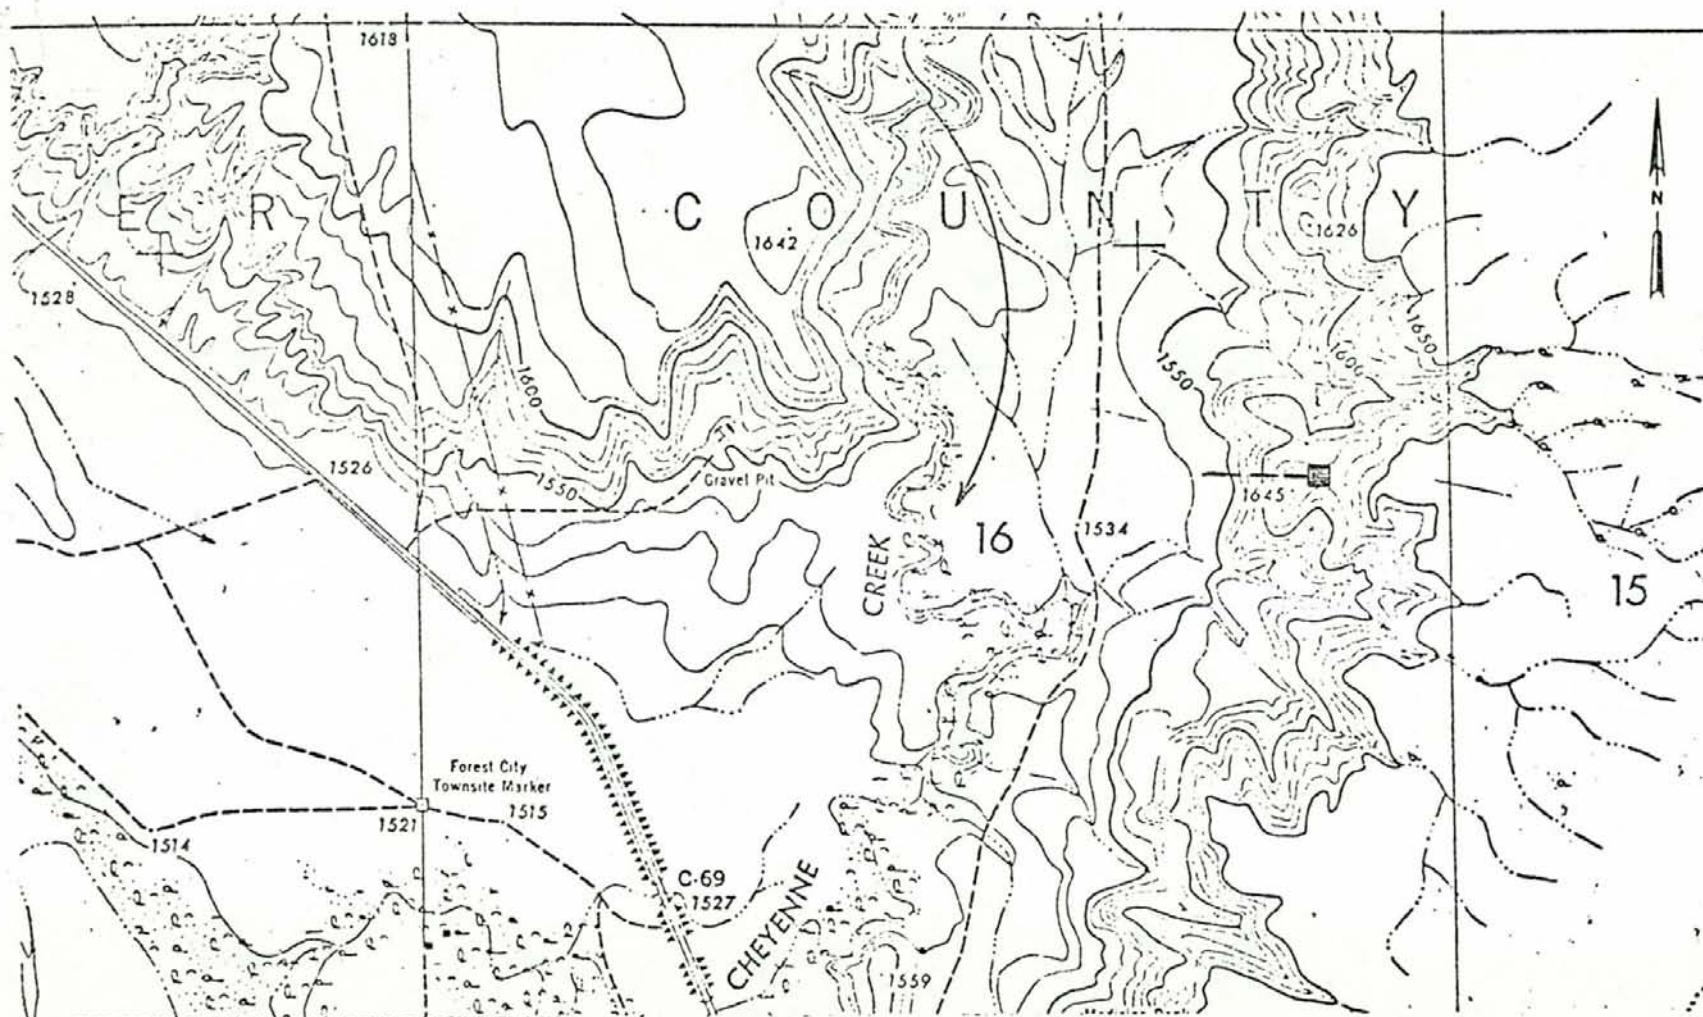


1" = 1,000 FEET

PROPOSED INTAKE STRUCTURE IN THE OaHE RESERVOIR
POTTER COUNTY, SOUTH DAKOTA APPLICATION BY CITY OF
GETTYSBURG

AUGUST 28, 1973


V. L. Klein
V.L. KLEIN
MAYOR

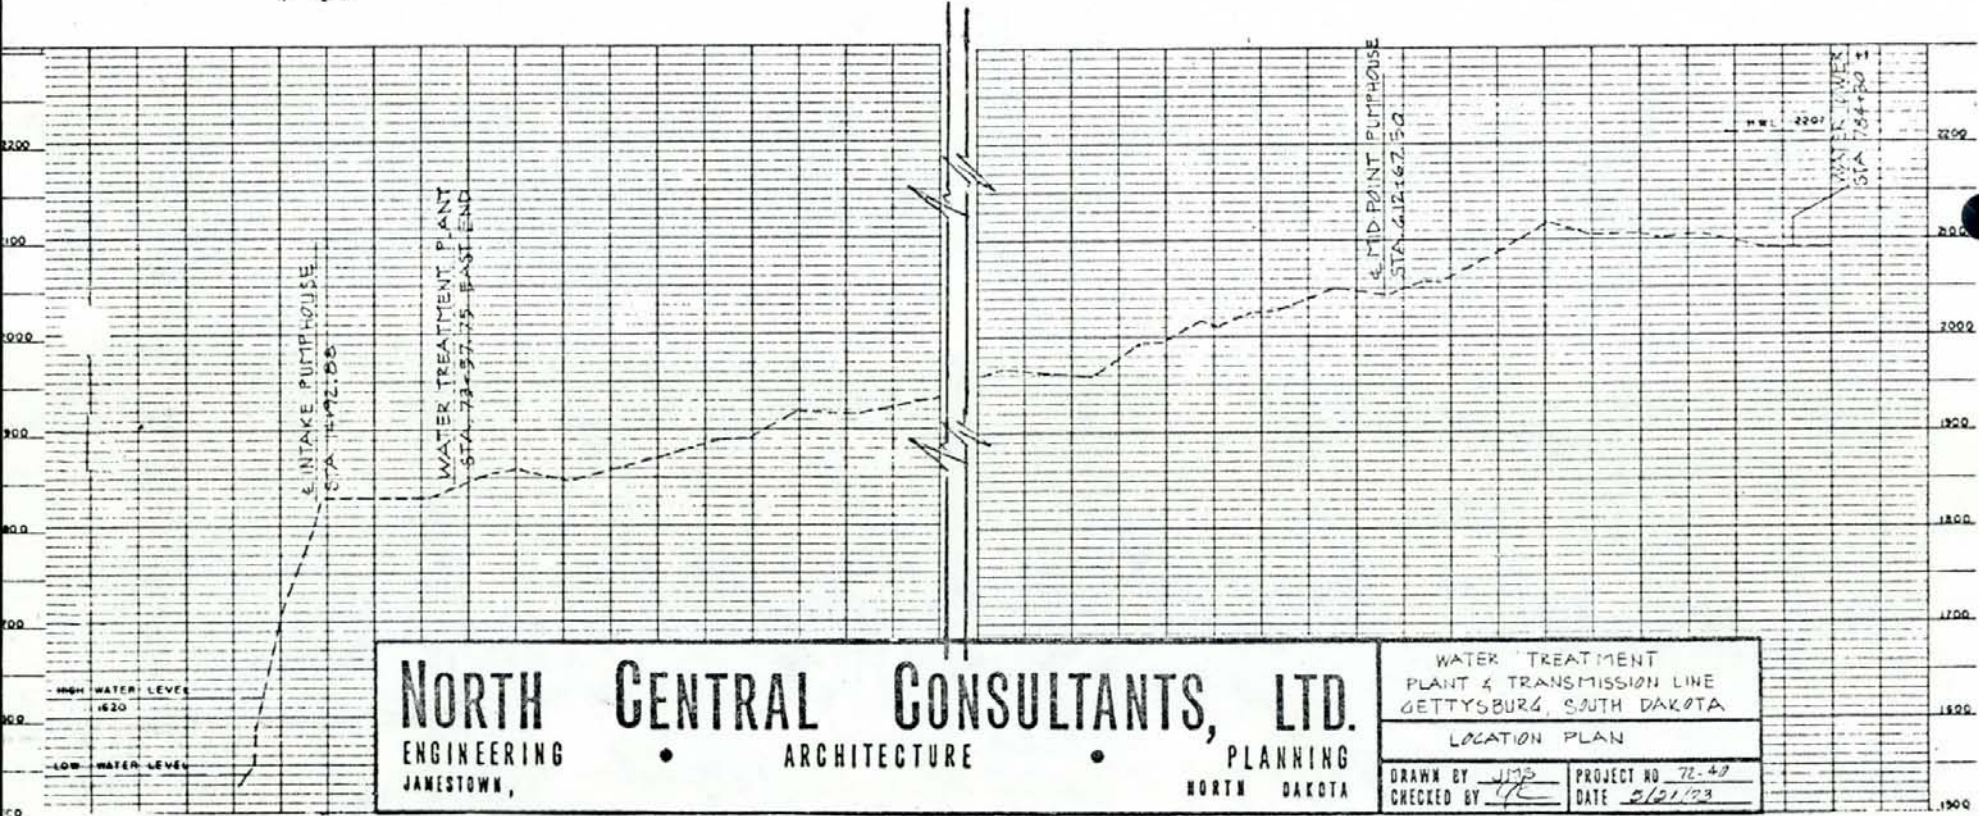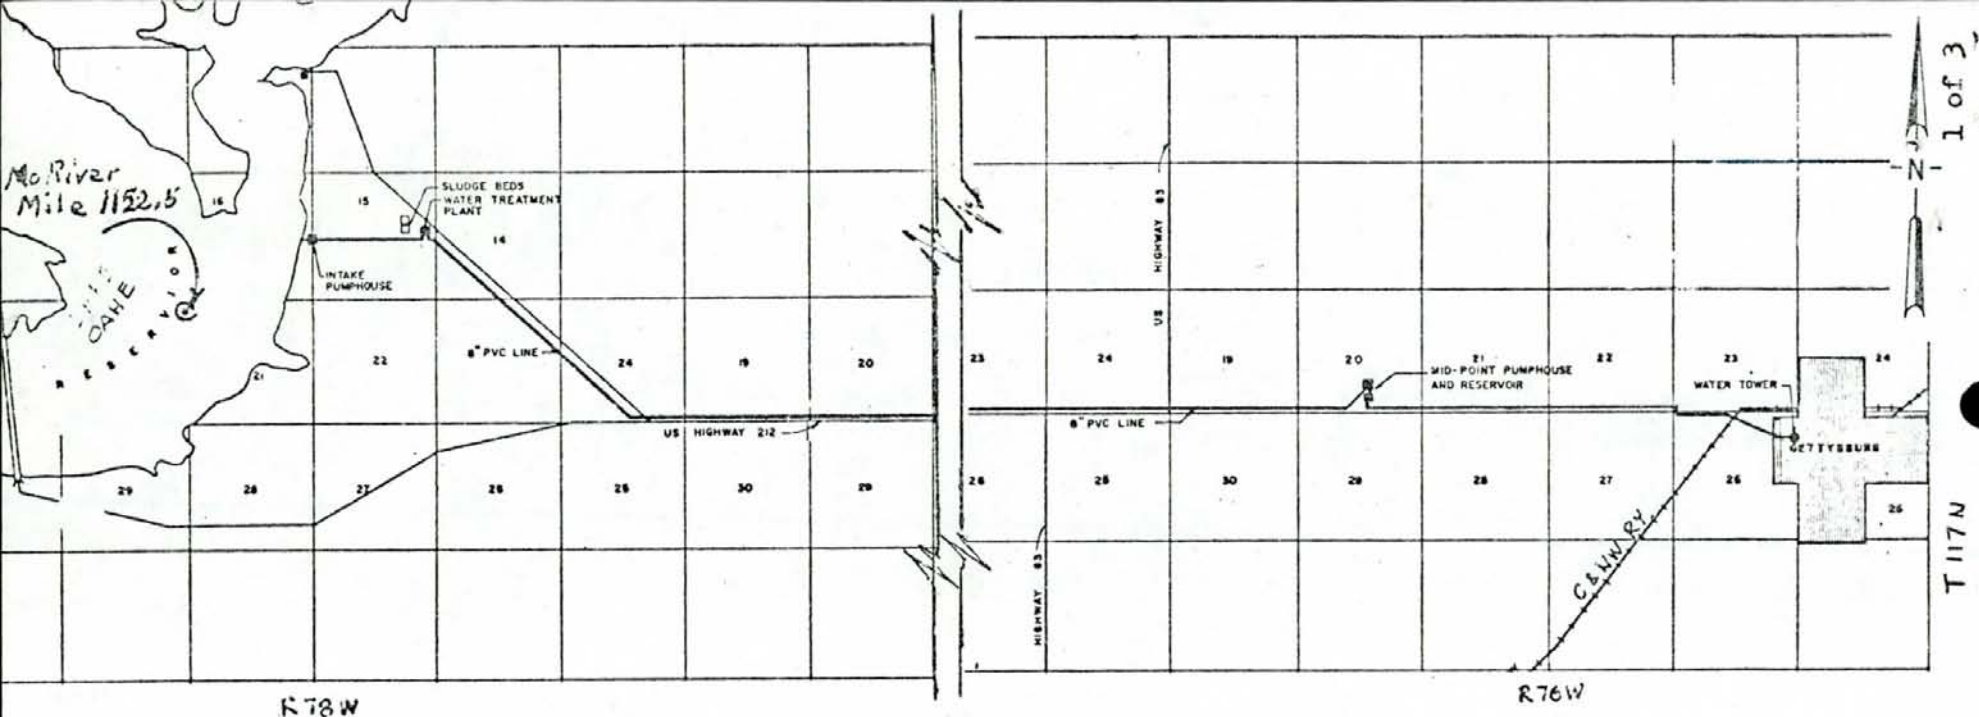

NORTH CENTRAL CONSULTANTS, LTD.
ENGINEERING ARCHITECTURE PLANNING
JAMESTOWN, NORTH DAKOTA

WATER TREATMENT
PLANT & TRANSMISSION LINE
GETTYSBURG, SOUTH DAKOTA
LOCATION PLAN

DRAWN BY JMS
CHECKED BY JRC
PROJECT NO. 72-49
DATE 5/21/73

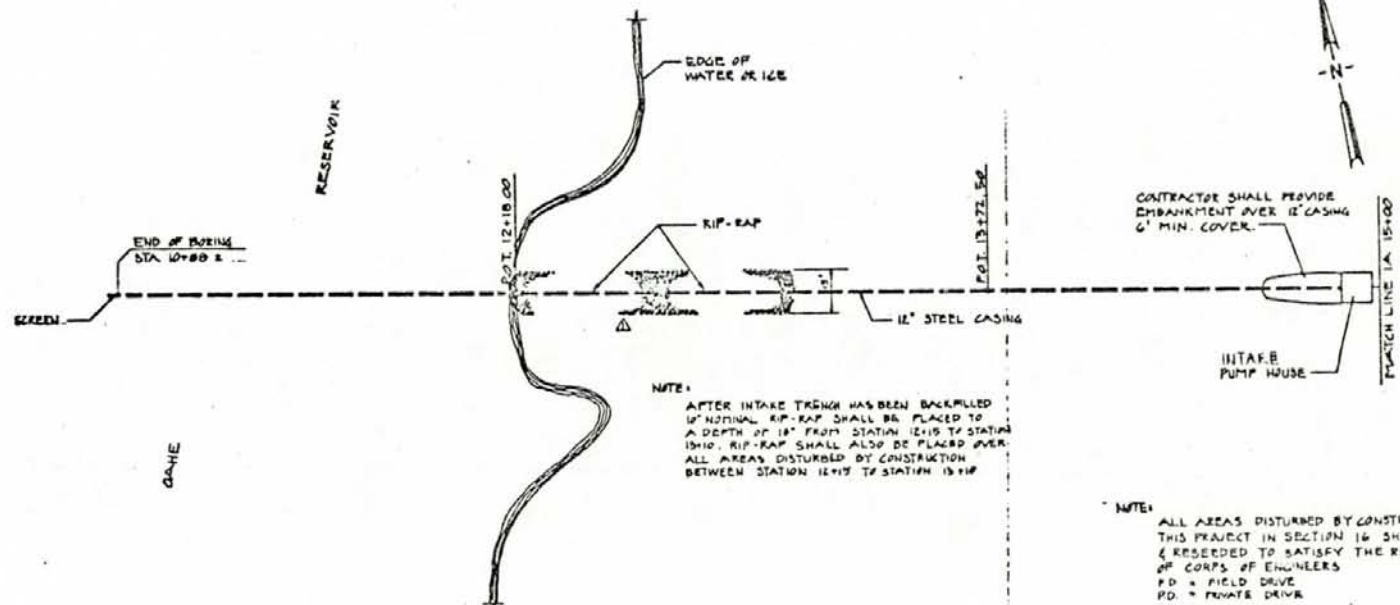


NOTE:
AFTER INTAKE TRENCH HAS BEEN BACKFILLED
12" NOMINAL RIP-RAP SHALL BE PLACED TO
A DEPTH OF 18" FROM STATION 12+18 TO STATION
13+10. RIP-RAP SHALL ALSO BE PLACED OVER
ALL AREAS DISTURBED BY CONSTRUCTION
BETWEEN STATION 12+18 TO STATION 13+10

CONTRACTOR SHALL PROVIDE
EMBANKMENT OVER 12" CASING
6' MIN. COVER.

INTAKE
PUMP HOUSE

NOTE:
ALL AREAS DISTURBED BY CONSTRUCTION OF
THIS PROJECT IN SECTION 16 SHALL BE GRAZED
& RESEED TO SATISFY THE REQUIREMENTS
OF CORPS OF ENGINEERS
PD = FIELD DRIVE
PD = PRIVATE DRIVE

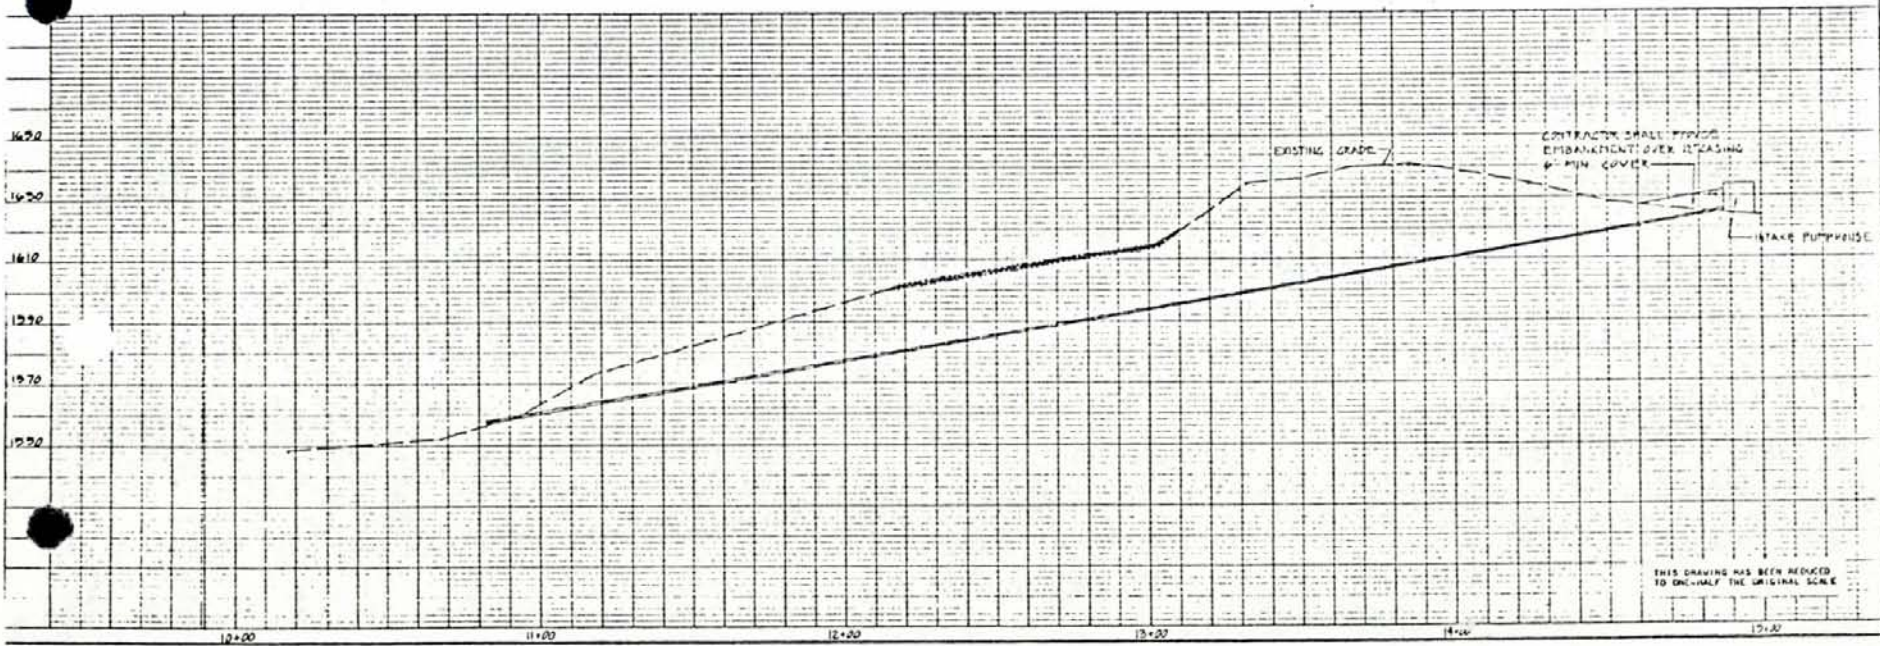

THIS DRAWING HAS BEEN REDUCED
TO ONE-HALF THE ORIGINAL SCALE

1973-3

WATER TREATMENT
PLANT & TRANSMISSION LINE
STATIONING SOUTH DAKOTA
STATION 10+00 TO 17+00
SHEET 1 OF 3

NORTH CENTRAL CONSULTANTS, LTD.
ARCHITECTURE
ENGINEERING
INTERIOR

3 of 3

SHEET NO.
P 1