

1. Considered May 24 19 79
2. Name of Applicant Huron Colony
3. Post Office Address Huron, S.D.
4. Amount of Water Claimed 1.9
5. Source of Water Supply 65' well
6. Water to be used for Tree
7. Acres to be Irrigated 132 maximum acre feet
8. Water to be diverted and used in Beadle County
about _____ miles of _____
9. PROOF OF PUBLICATION Received 5-15-79
Not Received _____

APPLICATION

Approved 5-27-81
Subject to WI - I.R.
Not Approved _____

Action deferred 5-24-79 - Invest.
until more information is obtained in the Area
Application Complete yes no _____ FEE 250.00

Priority
3-9-79
~~2-1-79~~

WQ app.

Remarks _____

WATER
QUALITY

Date information and/or
fee or corrected Application, received Jan 12, 1979
Period of Annual use April - thru October
Received yes 3/9/79 no _____ APPROVED/CONDITIONAL (Circle one)

WI-1 Description same as application yes _____ no _____ Remarks _____

Disapproved _____

Returned _____


Diversion Point _____

SE⁴ NE⁴ 23-113-62

Lands to be Irrigated _____

NE⁴. & N¹/₂ SE⁴

23-113-62

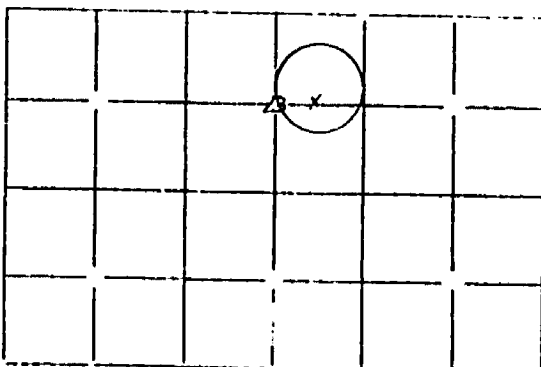

Remarks _____

WELL
LOG

Driller Pullman's Dr. Licensed yes no _____

Depth 65'

SECTION 25 T11S R14E S4
 4-7-79-83
 11th full
 DATE RECEIVED
 CASE NUMBER

Water Right No. 4400-3

MAP Map No. 3589-3 Map located in Water Right X Map file _____
Type of Map Aerial Prepared by S SCS

+++++

REVIEWED This Application was reviewed within 30 days of date received, accepted as complete, Number assigned and written up for advertisement before the Board on May 23, 1979.

B. J. Westland
(Signed)

+++++

PROTESTS Letters/Petitions in File - yes _____ no _____ Remarks _____

REMARKS Date _____
F.F. & C Final Decision, including F.F. & C of Law were adopted _____
OF LAW, Date _____
FINAL Final Decision mailed to parties and/or parties notified that Final Decision
DECISIONS was adopted _____
ETC.

Remarks _____

177
125
609

No. 1900-3
 Map No. 3589-3 Water Division No. 3 JAMES RIVER
 (Blanks to be filled by the Engineer for the W. R. C.)

10 100000

APPLICATION FOR PERMIT

To Appropriate Water within the State of South Dakota

(NOTE--Draw a line through items not applicable)

1. Name of Applicant Huron Colony
 Postoffice address Rt. 2 Box 185, Huron, State S. D. 57350
 If a corporation show date and place of incorporation _____
 2. Method of accomplishing work (contract, employment of others, or by direct labor) contract & direct labor
 3. Name of diversion work HURON COLONY IRRIGATION PROJECT
 4. Amount of water claimed (cubic feet per second) 1.9
 5. Source of water supply Ground water

6. Location of point of diversion Approximately 200 ft. west of midpoint on south fence line
SE⁴NE⁴ of NE 1/4 of Section 23, 113N - 62W SE⁴NE⁴ SEC. 23 - APPROX. SENE
80 RDS EAST OF THE CENTER OF SEC. 23. T. 113N - R. 62W 80 RDS E
 County Beadle 7 23
 7. Annual period or periods during which water is to be used April through October
 8. Use to be made of water, (irrigation, industrial, municipal, commercial, recreation, etc.) Irrigation SENE⁴
 9. For irrigation use, _____ Total number of acres to be irrigated 132

List below each forty acre subdivision, or lot, or fraction thereof and show number of acres to be irrigated in each.

Land Description	No. Acres Irr.	Land Description	No. Acres Irr.
NE¹NE¹ Sec 23, 113N-62W	31	<u>SE²NE⁴</u>	
SW¹NE¹ Sec 23, 113N-62W	32	<u>5/4 N²NE⁴</u>	
SE¹NE¹ Sec 23, 113N-62W	33	<u>N²SE⁴ Sec 23-113-62</u>	<u>132</u>
SW¹NE¹ Sec 23, 113N-62W	34		

Attach sheet if more space is needed

10. Time required to complete construction of water supply system 5 years. Additional time required to complete application of water to the proposed beneficial use 2 years.
 11. Choice of newspaper for Notice of Intent to Appropriate Water publication Daily Plainsman
 12. Principal Features of the Proposed Water Supply System.

A. Works proposed to divert water from its natural source.

Bowl pump

B. Works proposed to transport water to place of use.

Main line

C. Works proposed to apply water to beneficial use.

Center pivot

Estimated Total Cost \$ _____

Attachments. Attach Form 2A if diversion from a well or dugout, or if storage of water, is proposed. Attach map.
 (See instructions concerning preparation.)

STATE OF SOUTH DAKOTA)
) ss.
 County of Beadle)

I, Jake Wollman the applicant, certify that I have read the foregoing application and have examined the attached map and that the matters therein stated are true and that I intend, and am able to complete the necessary construction

Signed Huron Colony Jake WollmanSubscribed and sworn to before me this 10 day of Dec, 1978

Notary Public (or other qualified officer)

WATER RIGHT APPLICATION APPROVAL.

The Water Rights Commission hereby approves Water Right Application No. 4400-3
HURON COLONY R# #2 - Box 185 - HURON
 (Applicant) (Post Office Address)
SOUTH DAKOTA 57350 With the following modifications.
 (State)

The irrigation well approved under this Permit will be located near domestic wells and other irrigation wells which may obtain water from the same aquifer. The irrigation well owner, under this Permit, shall control his irrigation withdrawals so there is not a reduction of needed water supplies in adequate domestic wells or in irrigation wells having prior water rights.

This Permit is approved subject to the irrigation water use questionnaire being submitted each year.

Date of first receipt of application _____ December 27 _____, 19 78

Date of return to applicant for correction, amendments or changes required _____, 19 _____

Date of receipt of corrected application WQ _____ March 9 _____, 19 79

Approved May 27 _____, 19 81, Recorded in Book 22 Page 183

WATER RIGHT PERMIT NO. 4400-3

The Water Rights Commission hereby grants and issues this Water Right Permit No. 4400-3 authorizing the construction of the water use system and the putting of water to beneficial use as stated in the Application and as modified in the Water Right Application approval, subject, however, to the following limitations and conditions:

1. The date from which applicant may claim right is March 9, 1979
2. The equivalent of at least one-fifth of the work above specified is to be completed on or before November 27, 1983
3. The whole of said work is to be completed on or before May 27, 1986
4. The limit of time from proof of beneficial use of water appropriated in accordance herewith is May 27, 1988
5. The water appropriated shall be used for the purpose of IRRIGATION

6. The prior right of all persons who, by compliance with the laws of the State of South Dakota, have acquired a right to the use of water must not be injuriously affected by this appropriation.

7. The amount of the appropriation herein granted shall not exceed 1.9 cubic feet per second; neither shall it exceed the capacity of the above described water supply system, nor shall it exceed the amount of water needed for beneficial uses served, and if for the irrigation purposes said appropriation must be limited to not more than 3 acre feet per acre per year and be limited to not more than one-seventieth (1/70) of one cubic foot of water per second of time for each acre of land to which water is actually and beneficially applied for irrigation on or before May 27, 1988; said water to be used during the following described annual period: April thru October

Witness my hand this 1st day of June, 1981

WATER RIGHTS COMMISSION

Ity:

John Hatch
Chief Engineer, Executive Officer JOHN HATCH

Certificate of Construction Issued _____, 19____

Water License Issued _____ 19____

12. Principal Features of the Proposed Water Supply System (continued.)

D. Well Information or Estimates

- (1) Drill Hole, Diameter _____, Depth _____
- (2) Casing, Type _____ Diameter _____ Thickness _____
(wood, concrete, steel, etc)
- (3) Perforated Screen.
Type _____, Diameter _____, Length _____
- (4) Gravel Pack. Thickness _____, Length of gravel pack _____

E. Dugout Information or Estimates.

- (1) Surface dimensions _____, Depth _____

F. Fill out for Either a Well or a Dugout.

- (1) Water Bearing Materials. (Please attach a copy to test well log if available.)

Character of Water bearing materials	40-60 Med. sand and coal
0-20 yellow clay	60-65 Med coarse
20-35 yellow sand	65-66 Coal
35-40 fine sand	66-80 Shale

- Depth to top of water bearing material _____ 35'
- Depth to bottom of water bearing material _____ 66'
- Thickness of water bearing material _____ 31'
- Depth to water (ground surface to water level) _____ 23'

- (2) Distance to nearest existing household or livestock watering wells.

On same owner's property _____ 320+ rds. On property owned by others _____ 320+ rds.

G. Water Storage Dams.

If the proposed water use system contains one or more water storage dams, please show in the space below, the height, maximum water depth, surface area and storage capacity of each storage dam. The location of each water storage dam should be shown on the water right map.


Fluoride Supply Co. of Williams
Signature of Applicant

WELL DRILLERS REPORT
SOUTH DAKOTA WATER RIGHTS COMMISSION

4-78

Well Owner:
 Name HURON COLONEY
 Address HURON

Water Level Information:
 Static water level 23' below land surface
 If flowing: closed in pressure PSI
 rate of low GPM
 Controlled by:
☒ Valve ☐ Reducers ☐ Other
 If other; specify

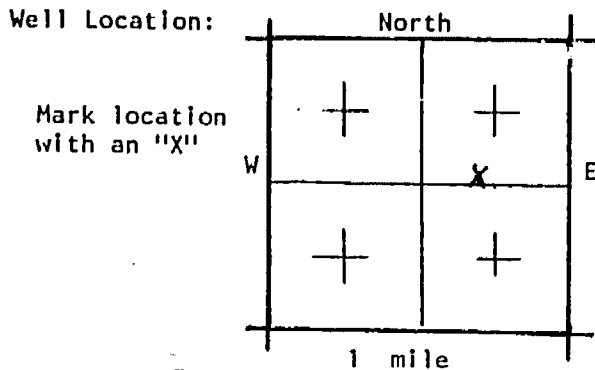

Well Test Data:
☒ Pumped PULPED WITH AIR
☐ Bailed Describe:
☐ Other
 Pumping Level Below Land Surface
 ft. After Hrs. pumped GPM
 " " " " " "
 " " " " " "

1/4 SW 1/4 NE 1/4 Sec. 23 Twp. 11.3 N Rg. 62 W

Proposed Use:
☐ Domestic ☐ Municipal ☒ Test Holes
☐ Irrigation ☐ Industrial ☐ Stock

Method of Drilling:
☒ Forward Rotary ☐ Bored ☐ Jetted
☐ Reverse Rotary ☐ Cable ☐ Other

Well Construction:
 Diameter of Hole 8"
 Depth 67'
 Casing ☐ Steel ☐ Concrete
☒ Plastic ☐ Other
 If other, specify

Was casing end left open no
 Was a well screen installed yes
 Describe Well Screen
 Diameter 4" Material 4"
 Slot size 25
 Was well gravel packed yes
 Was well grouted no
 Was water sample taken yes

Remarks:

Well Log:

Formation	Depth	
	From	To
YELLOW CLAY	0	20
YELLOW SAND	20	35
FINE SAND	35	40
MEDIUM SAND WITH COAL	40	60
MEDIUM COARSE	60	65
COAL	65	66
SHALE	66	80

(Use Back if Necessary)

Date Completed: 12-17-78

Driller:
PULLMAN'S DRILLING 440
 Driller's or Firm's Name License NO.

WOLSEY
 Address

Jeanie Pullman
 Signed By

12-20-78
 Date

No. 4400-3

Publish first publication, on or before May 4, 1979

NOTICE OF HEARING ON
APPLICATION TO APPROPRIATE WATER

Pierre, South Dakota 57501

April 18, 1979

Notice is hereby given that the Huron Colony whose post office

address is Huron, South Dakota, has made an application in accordance with the provisions of SDCL 46-1-1 thru 46-1-9, 46-1-14; 46-2-9 thru 46-2-11, 46-2-13; 46-5-1 thru 46-5-8; 46-5-10 thru 46-5-22, 46-5-41; 46-6-3, 46-6-3.1, 46-6-5, 46-6-6.1, 46-6-10, 46-6-14 and Commission Rules ARSD 52:01:01:01 thru 52:01:01:13, for a permit to appropriate for beneficial use 1.9 cubic feet of water per second of time from groundwater

~~(one well)~~ through the Huron Colony Irrigation Project the point(s) of diversion of which is ~~(xxx)~~ to be located in the SE 1/4 NE 1/4

of Section 23, Twp. 113N, Range 62W. Said water to be used for the purpose of providing irrigation on portions of the following described land:

NE 1/4 and 1/4 SE 1/4 all in Section 23-T113N-R62W.

This Application No. 4400-3 will be considered by the Water Rights Commission at Howard Johnson's Hotel,
2211 Lacrosse, Rapid City, SD 57701 upon the 24th day of May, 1979

at 10 A.M. The Commission is authorized to make a determination on this application at the hearing. All interested persons may appear and be heard. Any person who may be affected by a Commission decision who desires to present evidence or cross-examine witnesses according to SDCL 1-26 may notify the Commission in writing prior to the hearing or orally at the hearing.

This hearing is an adversary proceeding. Any person has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing. Decisions of the Commission may be appealed to the Courts as provided by law.

WATER RIGHTS COMMISSION

Betty Westlund,
Water Rights Specialist

cc: Huron Colony, R. R. #2, Box 185, Huron, SD 57350

December 27, 1976

*Neural map for
1-15-79*

Huron Colony
Rt. 2 Box 105
Huron SD 57350

Dear Sir:

Enclosed please find the map which you submitted with your application for a permit. The actual areas to be irrigated must clearly be delineated in red. The actual location of the well in rods or feet from the corner section must be shown. Poorly drawn maps are hard to interpret and may do a disservice to the farmer applying for the water right. An aerial photo can be obtained from the ASC offices.

Also, find your check in the amount of \$275.00. According to the acreage specified on your application a filing fee of \$250.00 is required.

The Soil/Water Compatibility approval has not been received from the State Conservation Commission.

Upon receipt of the above further processing of your completed application will proceed. If you have any questions please call this office.

Sincerely,

Karen Vernsmann
Staff Assistant IV

kjw

enclosure

cc: Dick Fadgen
Beadle Co. Ext. Agt.

*So 100 Rds of NE 4 }
N 80 Rds of SE 4 } 132
140*

23-113-62

STATE CONSERVATION COMMISSION
SOUTH DAKOTA DEPARTMENT OF AGRICULTURE

1 Amend 12-2
a) changes logics
b) adds the service S'm
c) changes old tested
w/ far right 343-3

TENANT'S NAME AND ADDRESS: (If Other Than Owner) Pleasant View Inn

This action must be taken by the holder of a water right within 6 months of receipt of such water right.

h. INDICATE NON-IRRIGATED AREAS AND (APPROX.) ACRES ON MAP ^{Use of land} (farmstead, shelterbelt, wetlands, etc.)

7. SHOW ANY PORTION OF LAND THAT PRESENTLY HOLDS AN IRRIGATION PERMIT; YEAR OBTAINED _____,
IN WHAT NAME: none on above lands under application

1. RESIDUAL SODIUM CARBONATE (meq/l.) c.c

Huron City, Mich. J. J. McNamee
APPLICANT'S SIGNATURE
A. L. Smith
APPROVED

* **CONDITIONAL**5-100 Acres of NE 1/4 and N 1/2 Sec. 20
of 564-23-113-62

SOUTH DAKOTA DEPARTMENT OF AGRICULTURE

DIVISION OF CONSERVATION

NAME OF APPLICANT Huron ColonySOIL RESTRICTIONS:THE SOIL(S) LISTED BELOW CANNOT BE IRRIGATED:

None

RECOMMENDED MANAGEMENT:

1. Water should not be applied more than 3-4 times during the irrigation season.
2. Each uninterrupted application (one rotation of center pivot) should be of at least 3 inches of water.
3. ☒ Yes ☐ No Surface drainage necessary on the flatter areas of 77A.
4. ☐ Yes ☐ No Subsurface drainage suggested on _____
5. ☒ Deep tillage (for the purpose of aiding movement of water through dense subsoils.

COMMENTS: **Particularly the 77A soils.**

6. ☐ Heavy fall application of irrigation water.
7. Type of irrigation system recommended for use on this application pivot/end gun.

GENERAL COMMENTS:

Beadle soils (77A) are irrigable with water of low salinity and low sodium. A 50-50 average mix of James River water and your well (Sample #78-1117) is of medium salinity and medium sodium. Therefore, conditions of surface drainage and use of deep tillage are necessary for continual irrigation and best possible production for years to come.

The slowly permeable clay soil in the Beadle soil profile generally lie between the 10 inch and 30 inch depth. Occasional chiseling to the 30 inch or more depth will be beneficial to the leaching process in dense subsoils.

For your own information, it would be well to keep records of crop yields and water applications for the next several years. This information along with soil sample monitoring every 3 years will show what can be done with Beadle Soils.

Copy to applicant
Copy to Water Rights
Copy on File



Soils have a high available water capacity and moderate permeability.

HKB - Highmore - Eakin silt loams - 2-5% slopes

Same physical composition as HKA - moderate erosion problems.

Mv - Munjor fine sandy loam - 0-2% slopes

Moderately rapid permeability, moderate or high available water capacity.


Residents of counties with published or up-to-date soil surveys shall contact their local Conservation District for a copy of the soils map for the area to be irrigated and the narrative explanation of the map.

Residents of counties with no up-to-date soil survey information shall contact the Soil Conservation Service or their local Conservation District to obtain the best information available. If soil survey information is not available, the applicant is requested to obtain this information from a private consultant or professional soil classifier.

NOTE: If at all possible, provide information concerning subsoil physical conditions.

MAP

PLEASE READ LEGAL DESCRIPTION #1 THROUGH #4 ON FRONT SHEET BEFORE COMPLETING THIS SECTION.

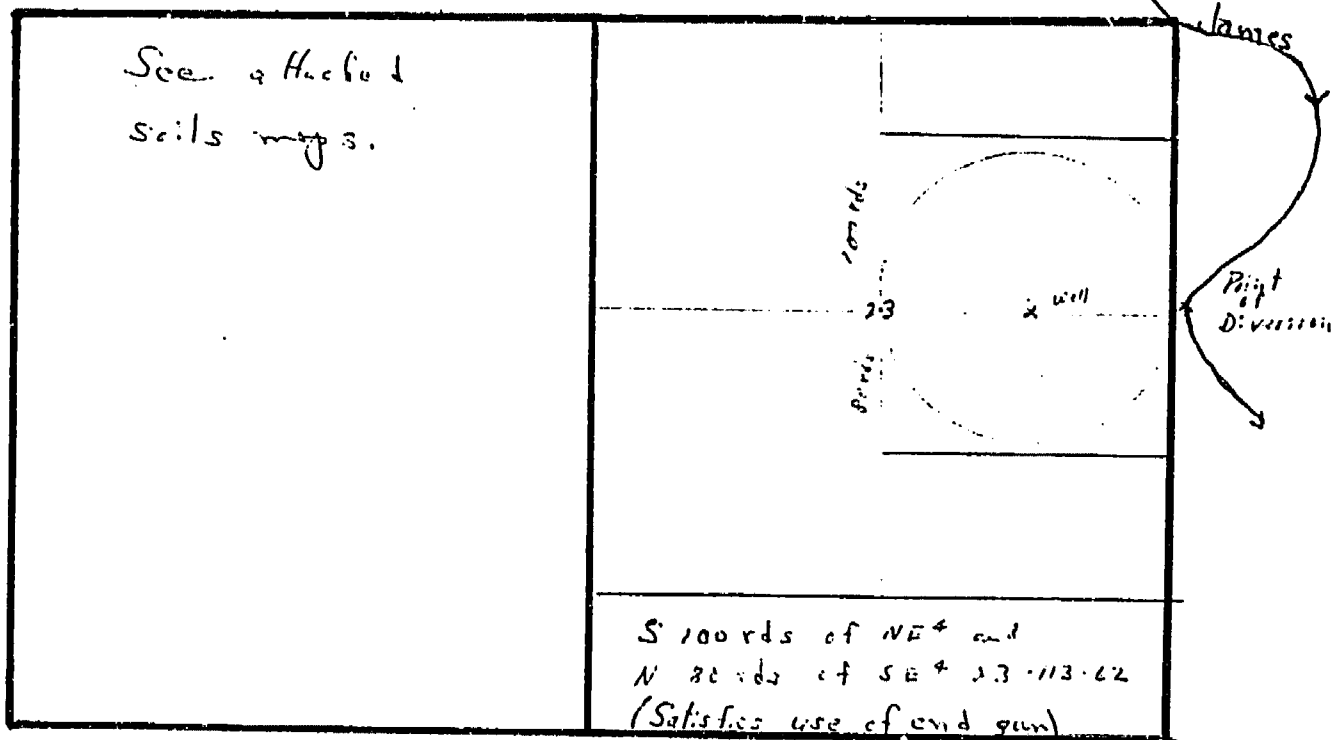

PLEASE USE BACK OF THIS SHEET FOR NARRATIVE
OR ATTACH SEPARATE SHEET

REPORT OF ANALYSIS
 Water Quality Laboratory
 Water Resources Research Institute
 South Dakota State University
 Brookings, South Dakota 57007

Submitted by: Huron Colony
 Address: Box 2, Box 185
Huron, SD 57350

Date Rec'd. December 27, 1978
 Sample No. 78-1117
 Identification Well
HEC, Sec. 23, T. 113N, R. 62E

WATER ANALYSIS

Calcium (Ca)	134	ppm*	6.70	me/l**		
Magnesium (Mg)	35	ppm	2.87	me/l		
Sodium (Na)	263	ppm	11.44	me/l		
Potassium (K)	12	ppm	0.31	me/l		
Sulfate (SO ₄)	530	ppm	11.02	me/l		
Nitrate (as N)		ppm		me/l		
Chloride (Cl)	6	ppm	0.17	me/l		
Bicarbonate (HCO ₃)	503	ppm	8.24	me/l		
Carbonate (CO ₃)		ppm		me/l		
Iron (Fe)		ppm		me/l		
Fluoride (F)		ppm		me/l		
Hardness (EDTA as CaCO ₃)		ppm		me/l		
Alkalinity (Methyl Orange)	412	ppm (as CaCO ₃)		g.p.g.***		
Alkalinity (Phenolphthalein)	0	ppm (as CaCO ₃)				
Electrical Conductivity	1800	micromhos per cm at 25° C.				
Sodium Adsorption Ratio	5.20	Adjusted SAR	14.00		21.81	2.4
Sodium	53.70	% of cations	13.80		1.57	1.315
Residual sodium carbonate	0.00	me/l			2.24	2.1
pH	7.06					2.5
Others:						2.52

*ppm=parts per million

**me/l=millequivalents per liter

***g.p.g.=grains per gallon

COMMENTS: Total cations 21.32 me/l
 Total anions 19.43 me/l

By: Shirley Litten

Service Performed

Amount Due

Irrigation analysis

\$15.00

Make checks payable to: Water Quality Laboratory

Cut along dotted line and return the lower portion with payment

Sample No. 78-1117

Amount Enclo \$

Signed

REPORT OF ANALYSIS
 Water Quality Laboratory
 Water Resources Research Institute
 South Dakota State University
 Brookings, South Dakota 57007

Submitted by: Kuron Colony
 Address: Box 2, Box 185
Huron, SD 57350

Date Rec'd. December 27, 1978
 Sample No. 78-1117
 Identification Well-
NE 1/4, Sec. 23, T 113N, R 62W

WATER ANALYSIS

Calcium (Ca)	134	ppm*	6.70	me/l**	
Magnesium (Mg)	35	ppm	2.87	me/l	
Sodium (Na)	263	ppm	11.44	me/l	
Potassium (K)	12	ppm	0.31	me/l	
Sulfate (SO ₄)	530	ppm	11.02	me/l	
Nitrate (as N)		ppm		me/l	
Chloride (Cl)	6	ppm	0.17	me/l	
Bicarbonate (HCO ₃)	503	ppm	8.24	me/l	
Carbonate (CO ₃)		ppm		me/l	
Iron (Fe)		ppm		me/l	
Fluoride (F)		ppm		me/l	
Hardness (EDTA as CaCO ₃)		ppm		g.p.g.***	
Alkalinity (Methyl Orange)	412	ppm (as CaCO ₃)			
Alkalinity (Phenolphthalein)	0	ppm (as CaCO ₃)			
Electrical Conductivity	1800	micromhos per cm at 25° C.		21.81	2.4
Sodium Adsorption Ratio	5.20	Adjusted SAR	14.00	7.57	1.325
Sodium	53.70	% of cations	13.80	2.24	2.015
Residual sodium carbonate	0.00	me/l			4.1
pH	7.06				1.527
Others:					5.30
					12.45

*ppm=parts per million
 **me/l=millequivalents per liter

***g.p.g.=grains per gallon

COMMENTS: Total cations 21.32 me/l
 Total anions 19.43 me/l

By: Shirley Hittan

Service Performed	Amount Due
Irrigation analysis	\$15.00

Make checks payable to: Water Quality Laboratory

Cut along dotted line and return the lower portion with payment

Sample No. 78-1117

Amount Enclosed

Form 8 - Proof of Publication - Notice of
Intent to Appropriate Water

No. 4400-3

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County Beadle) ss.

I, Linda Schlotter hereby

certify that the annexed printed copy of Notice of Intent to Appropriate

Water was taken from the Huron Daily Plainsman

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the

city of Huron

County of Beadle and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

May 11, 1979

May 11, 1979

Linda Schlotter
(Signature)

bookkeeper
(Title)

5-11-79

(Date Signed)

F.P. 54-71 L.P. 5-11-79
NOTICE OF HEARING
ON APPLICATION TO
APPROPRIATE WATER
Pierre, South Dakota 57501
April 13, 1979

Notice is hereby given that the
Huron Colony whose post office
address is Huron, South Dakota,
has made an application in ac-
cordance with the provisions of
SDCL 46-1-1 thru 46-1-5, 46-1-11, 46-
2-9 thru 46-2-11, 46-2-13, 46-3-1 thru
46-3-8, 46-3-10 thru 46-3-20, 46-3-41,
46-4-1, 46-4-3, 46-4-5, 46-4-
10, 46-4-14 and Commission Rules
ARSD 32:01:01 thru 32:01:03,
for a permit to appropriate for
beneficial use 1.9 cubic feet of
water per second of time from
groundwater (one well) through
the Huron Colony Irrigation
Project, the point of diversion of
which is to be located in the SE 1/4
NE 1/4 of Section 22, Twp. 13N,
Range 62W. Said water to be used
for the purpose of providing
irrigation on portions of the
following described land:

NE 1/4 and NW 1/4 SE 1/4 all in Section
23-T113N-R43W.

This Application No. 4400-3 will
be considered by the Water Rights
Commission at Howard Johnson's
Motel, 2211 Lacrosse, Rapid City,
S.D. 57701 upon the 24th day of
May, 1979 at 10 A.M. The Com-
mission is authorized to make a
determination on this application
at the hearing. All interested
persons may appear and be heard.
Any person who may be affected
by a Commission decision who
desires to present evidence or
cross-examine witnesses accord-
ing to SDCL 1-26 may notify the
Commission in writing prior to the
hearing or orally at the hearing.

This hearing is an adversary
proceeding. Any person has the
right to be present or to be repre-
sented by a lawyer. These and
other due process rights will be
forfeited if they are not exercised
at the hearing. Decisions of the
Commission may be appealed to
the Courts as provided by law.

Water Rights Commission
Betty Westlund
Water Rights Specialist
No. 226 (rev.)



RECEIPT

WATER RIGHTS COMMISSION

State of South Dakota

No 4 6697

PIERRE, January 12, 1979

RECEIVED OF Huron Hutterian Colony, Sam J. Waldner, RR 3, Box 185, Huron SD 57350
the following amount in fees for services rendered as provided for by law:

Fee for Application for Permit to Appropriate Water No. <u>4400-3</u> (examination, processing, recording and filing) -----	250	00
Fee for inspecting Construction, and issuing Cert. of Construction No.-----		
Fee for inspecting Beneficial Use, and issuing Water License No.-----		
Fee for issuing Location Certificate-Dry Draw, No.-----		
Fee for filing -----		
Fee for certified copy of -----		
Fee for Print copy of map -----		
Fee for Certifying -----		
Fee for ----- (any other work as provided by law)		
TOTAL	250	00

WATER RIGHTS COMMISSION

By John Hatch
Chief Engineer, Executive Officer
JOHN HATCH kjw



Department of Water & Natural Resources

Joe Foss Building
Pierre, South Dakota 57501

4400-3

DATE: May 13, 1981

TO: Jake Wollman, Huron Colony

FROM: John Hatch, Chief Engineer, Water Rights Division

SUBJECT: Reconsideration of Application 4400-3

The Water Management Board will reconsider deferred Water Permit Application No. 4400-3 in Beadle County on May 27, 1981 at 1:00 p.m., Knelp Building, Meeting Room #1, Church and Illinois, Pierre, South Dakota.

This reconsideration hearing will be conducted in accordance with the provisions of SDCL 46-1-1 thru 46-1-9; 46-1-14; 46-2-9 thru 46-2-11; 46-2-13; 46-5-1 thru 46-5-8; 46-5-10 thru 46-5-22; 46-5-41; 46-6-3; 46-6-5; 46-6-6.1; 46-6-10; 46-6-3.1; 46-6-14 and Board Rules ARSD 52:01:01:01 thru 52:01:01:13.

This application was previously deferred by the Board pending staff investigation.

After reconsideration of the deferred application the Board can approve, conditionally approve, defer, or deny all or part of the Applications.

This hearing is an adversary proceeding. Any person has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing. Decisions of the Board may be appealed to the Courts as provided by law.

You are also notified that SDCL 1-26 provides any interested party the opportunity to meet informally with the Water Rights Division Staff to discuss proposed recommendations by the staff to the Board prior to the scheduled hearing. If we do not hear from you, we will assume that the opportunity for an informal meeting is being waived and you wish to proceed directly to the hearing on the application before the Board.

Any handicapped person wishing to attend this hearing can contact the Water Rights Division, DWNR, Joe Foss Building, Pierre, SD, prior to the hearing date for assistance to assure access to the hearing.

a53203kw

Equal Opportunity Employer

No. 4871-3



Department of Water & Natural Resources

Joe Foss Building Water Rights Division
Pierre, South Dakota 57501

(605) 773-3352

April 16, 1982

Kenneth Huizenga
Hitchcock, South Dakota 57348

Dear Mr. Huizenga:

Enclosed herewith is your Water Right Permit No. 4871-3 as approved by the Water Management Board authorizing you to construct your water diversion system and apply the water to beneficial use, not exceeding the limits as specified in said Water Right Permit No. 4871-3.

Also enclosed is FORM 10, Notice of Completion of Works and Application of Water to Beneficial Use, which you are to complete and submit to the Water Management Board when you have completed the system and/or have put the water to beneficial use. The Board can then schedule an inspection so that your Certificate of Construction and/or Water License may be issued to you, thus completing your acquisition of a Water Right.

Very truly yours,

A handwritten signature in cursive script, reading "John Hatch".

JOHN HATCH, Chief Engineer
Water Rights Division

JH: ms

enclosure

cc: Jake Wollman, Huron Colony

NOTE: Portions of land authorized by this Permit No. 4871-3 in the SW 1/4 NE 1/4 Section 23 are also covered by Permit No. 4400-3 Huron Colony. You have advised that you own the west 30 acres of the SW 1/4 NE 1/4 and the Colony would not be irrigating any of your land. The Colony has soil-water compatibility approval for only the east 10 acres of the SW 1/4 NE 1/4 Section 23.

WNR-809-7/79

Forwarding Permit to Appropriate Water

NOTICE OF COMPLETION OF WORKS AND/OR
APPLICATION OF WATER TO BENEFICIAL USEPost Office Huron, S. Dak.Date May 28, 1982TO: Water Rights Commission
Joe Foss Building
Pierre, South Dakota 57501

Dear Sirs:

This is to inform you that I have completed the construction of the water diversion system and/or that I have put the water to beneficial use to maximum extent it is going to be used, not exceeding the amounts as specified in Water Right No.


4400-3.

Water Right Permit No. 4400-3 states that the diversion system is to be constructed by Huron Colony, and that the water is put to beneficial use by Huron Colony.

The diversion system was completed on May 21, 1982. Applying the water to beneficial use was completed on May 25, 1982.

You may schedule an inspection so that the Certificate of Construction and/or the Water License may be issued, thus completing my acquisition of a water right.

John F. Wollemann Huron Colony
(Signature)





DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

MAR 24 1992

4400A-3

Huron Colony
RR 2, Box 185
Huron, SD 57350


Dear Sirs:

Enclosed is Water License No. 4400A-3. This is the final water right document completing your process of obtaining a Water Right. Enclosed is Receipt No. 411198 in the amount of \$50.00 which you paid for the inspection and issuance of the Water License.

For your information SDCL 46-6-27 requires that if the owner of an existing well, such as the well authorized by Water Right No. 4400A-3, constructs a replacement well and does not plan to use the old well, the old well is considered abandoned and must be plugged. Also, any well that is being used or is not considered abandoned must be valved and controlled, if flowing, or sealed and capped so that no leaking occurs either underground or at the surface.

As long as you use the water beneficially, as stated in the Water License, the State Water Laws provide that you have a continuing right to use the water. If you have any questions, please contact our office.

Very truly yours,


JOHN HATCH, Chief Engineer
Water Rights Division
(605) 773-3352

enclosures

NOTE: The applicable portions of Water Permit No. (4400-3) are incorporated into this Water License No. 4400A-3.

113-6 BEADLE COUNTY A.S.C.
Box 1217
Huron, S. D. 57350

Handwritten signature

4

1.5 40

*Devel
No. 11212*

3-80B

96.8

97.3

*Ac. 23-11-14
Oleum 2nd-11-13
R. 62-11-13*

*East. 1st 11-13
South End
11-14*

23

60.0

43.2

20.1

241

Thurston

113-62

motor: U.S Electrical

pump: Western Land Allen

ID# R-6229-05-380

R1002198/M

1770 RPM, 40hp

2/26/86

Well is in the correct location as shown on the map

No well has been drilled at the center of section 23

For Permit No. 4871-3. However, power lines have been run to the center of section 23 from the west & probably power the colony's motor at the well. Therefore, power lines are available if another well was to be drilled at the center of Sec. 23.

NOT TO SCALE

