

1. Considered: December 9, 19 82 Water Right No. 4930-3
2. Name of Applicant WEB Water Development Assoc. Inc.
3. Post Office Address Box 1911, Aberdeen, SD 57401
4. Amount of Water Claimed 15.00 - (PEAK) maximum acre feet 7500 (ANNUAL)
5. Source of Water Supply Missouri River
6. Water to be used for RWS acres to be irrigated _____
7. County Walworth about 12 miles SE of MOBRIDGE
Brown, Beadle, Clark, Campbell, Hand, Potter, Faulk, Edmunds, McPherson, Day & Spink
8. PROOF OF PUBLICATION affidavits Received 12-9-82 Not Received _____
Rec'd 12-16-82
APPLICATION: Approved 12-9-82 Subject to OK
Not Approved _____ Action Deferred _____

PRIORITY 4/6/76 Dated Received 10/12/82 Application complete-yes x no _____ FEE n/a
Remarks From FU 2671-3- deducts 7500 ac ft from 10,000 remaining
2,500 acre feet on FU?

Corrected Application received _____ Period of Annual Use 1/1 to 12/31

WATER Received yes _____ no _____ APPROVED/CONDITIONAL (Circle one)
QUALITY WI-1 Description same as application-yes _____ no _____ Remarks _____

Disapproved _____ Returned _____

		32			
			•		

Diversion Point _____
SE $\frac{1}{4}$ SE $\frac{1}{4}$ Section 32-T123N-R78W

Land to be irrigated _____

WELL LOG Driller _____ Licensed - yes _____ no _____
Depth _____

Remarks _____


MAP Map No. 4130-3 Map located in Water Right _____ Map file _____
Type of Map Drawn Prepared by Engr

REVIEWED This Application was received within 30 days of the date received, accepted as complete, Number assigned and written up for advertisement before the Board on:
10/18/82

Deety Westlund
(Signed)

PROTESTS Letters/Petitions in File - yes _____ no _____ Remarks _____

REMARKS Date
F.F. & C. Final Decision, including F.F. & C. of Law were adopted _____
OF LAW, Date
FINAL Final Decision mailed to parties and/or parties notified that Final Decision was
DECISIONS adopted _____
ETC. Remarks _____

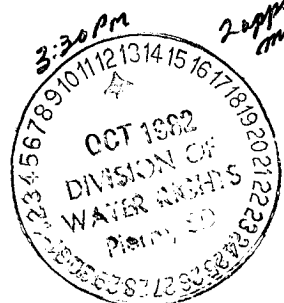No. **4930-3**Map No. **4130-3** Water Division No. **3** **MISSOURI RIVER** District
Above for Office Use **10130102**

APPLICATION FOR PERMIT To Appropriate Water within the State of South Dakota

Check one of the following:

New ☒ Vested Right _____ Future Use _____ (Future Use Permit 2671-3)

Change in Diversion _____ Additional Diversion _____

Change in Acreage _____ Additional Acreage _____

1. Name of Applicant WEB Water Development Assoc., Inc. Phone No. (605) 229-4749Post Office Address Box 511, Aberdeen State SD 57401
(Street, RR, or Box) (Town) (Zip Code)If a corporation show date and place of incorporation Nov. 2, 1978; Aberdeen, SD2. Method of accomplishing work (contract, employment of others, or by direct labor) Construction Contracts3. Name of diversion work WEB Rural Water Development Project4. Amount of water claimed (cubic feet per second) 15 cfs (peak) - 7500 acre-feet (annual)5. Source of water supply Missouri River (Lake Oahe)6. Location of point of diversion East shore of Lake Oahe in Southeast one-quarter of Section 32, T123N, R78W, approximately 12 miles southeast of Mobridge - See Attachment "A" consisting of 2 sheetsCounty Walworth7. Annual period or periods during which water is to be used Continual 12 month operation8. Use to be made of water, (irrigation, industrial, municipal, commercial, recreation, etc.) Municipal, Domestic & RWS9. For irrigation use, Total number of acres to be irrigated N/A *See*

List below each forty acre subdivision, or lot, or fraction thereof and show number of acres to be irrigated in each.

Land Description	No. Acres Irr.

Land Description	No. Acres Irr.

Attach sheet if more space is needed

10. Time required to complete construction of water supply system four-five years. Additional time required to complete application of water to the proposed beneficial use N/A 4 years.11. Choice of county newspaper for publication of Notice of Intent to Appropriate Water See Attachment "B"

12. Principal Features of the Proposed Water Supply System.

A. Works proposed to divert water from its natural source.

Intake facility and pumping station constructed on Lake Oahe Project Lands under permit of the U.S. Army Corp. Water Treatment Plant to be located approximately three miles to the east and along Highway 1804.

B. Works proposed to transport water to place of use.

Buried main transmission pipeline constructed generally along Highway 12 and secondary transmission pipelines providing potable water to towns and farmsteads. (See Plate A) Total length of pipeline estimated at 437 miles.

C. Works proposed to apply water to beneficial use.

Buried distribution pipelines construction in the rural areas and existing water systems of towns. (See Plate C) Estimated service population 30,237 people and livestock usage of 516,000 equivalent head of beef cattle. Total length of pipeline estimated at 3,170 miles.

Estimated Total Cost \$ 91,400,000 (Oct. 1983)

Attachments: Attach Form 2A if diversion from a well or dugout, or if storage of water, is proposed. Attach map. (see instructions concerning preparation.)

STATE OF SOUTH DAKOTA)
) ss.
County of _____)I, WEB Water Development Association, Inc the applicant, certify that I have read the foregoing application and have examined the attached map and that the matters therein stated are true and that I intend, and am able to complete the necessary construction.Signed Morris Bruce ChumSubscribed and sworn to before me this 7 day of October, 1982Charles Christensen
Notary Public (or other qualified officer)Com. Exp 1-28-89

WATER RIGHT APPLICATION APPROVAL

The Water Management Board hereby approves Water Right Application No. 4930-3

WEB WATER DEVELOPMENT ASSOCIATION INCORPORATED BOX 1911, Aberdeen

South Dakota 57401
(Applicant)
(State)

(Post Office Address)

With the following qualifications

Priority for this Permit was established under Future Use Withdrawal No. 2671-3. Development of this withdrawal reduces Permit No. 2671-3 by 7500 acre feet annually, leaving 2500 acre feet annually remaining for future development.

The diversion point may be moved up to one mile to obtain a suitable location for proper footings and intake structures.

Date of first receipt of application October 12, 19 82

Date of return to applicant for correction, amendments or changes required, 19

Date of receipt of corrected application, 19

Approved December 9, 19 82, Recorded in Book Page

WATER RIGHT PERMIT NO. 4930-3

The Water Management Board hereby grants and issues this Water Right Permit No. 4930-3 authorizing the construction of the water use system and the putting of water to beneficial use as stated in the Application and as qualified in the Water Right Application approval, subject, however, to the following limitations and conditions:

1. The date from which applicant may claim right is April 6, 19 76
2. The equivalent of at least one-fifth of the work above specified is to be completed on or before June 9, 19 85 December 9 87
3. The whole of said work is to be completed on or before, 19
4. The limit of time from proof of beneficial use of water appropriated in accordance herewith is December 9, 19 91
5. The water appropriated shall be used for the purpose of Rural Water System

6. The prior right of all persons who, by compliance with the laws of the State of South Dakota, have acquired a right to the use of water must not be injuriously affected by this appropriation.

7. The amount of the appropriation herein granted shall not exceed 7500 acre feet annually (15 cfs) cubic feet per second neither shall it exceed the capacity of the above described water supply system, nor shall it exceed the amount of water needed for beneficial uses served, and if for irrigation purposes said appropriation must be limited to not more than 2 acre feet per acre per year and be limited to not more than one seventh (1/7) of one cubic foot of water per second of time for each acre of land to which water is actually and beneficially applied used for a rural water system

for irrigation on or before December 9, 19 82; said water to be used during the following described annual period: January 1st thru December 31st

Witness my hand this 17th day of December, 19 82

THE WATER MANAGEMENT BOARD


By:

John Hatch
Chief Engineer, Water Rights

JOHN HATCH

Certificate of Construction Issued, 19

Water License Issued, 19

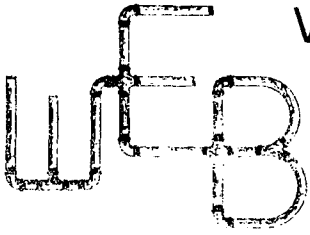

WATER DEVELOPMENT ASSOCIATION INC.

WALWORTH • EDMUNDS • BROWN • DAY • SPINK
CAMPBELL • FAULK • POTTER • McPHERSON

CHAIRMAN

Morris Kurle
Bowdle, SD 57428

VICE-CHAIRMAN

Marland Eldredge
Ashton, SD 57424

SECRETARY

Herb Brandner
Ipswich, SD 57451

TREASURER

Robert Yoder
Aberdeen, SD 57401

DIRECTORS:

Gordon Nelson
Groton, SD 57445

Kenneth Brockel
Java, SD 57452

Ed Blank
Roslyn, SD 57261

Orville Baer
Roscoe, SD 57471

Dean Lemburg
Selby, SD 57472

STAFF:

Anders Christensen
2223 N. State
Aberdeen, SD 57401
225-0300

October 8, 1982



Water Management Board - Water Rights
Department of Water and Natural Resources
Joe Foss Building
Pierre, SD 57501

Dear Sirs,

We are submitting two copies of WEB's application for a water rights permit with enclosed attachments "A" and "B". We would appreciate being placed on the agenda for action at the December 9th or 10th, 1982 meeting of the Water Management Board scheduled for Aberdeen. We are sending a list of the counties and newspapers in each county in the WEB service area that the publications of the notice of intent for water should be published. It is my understanding after talking with our system's engineers who were in touch with your office, that a filing fee is not necessary for this application. However, if there should be such a fee, please feel free to contact our office.

The WEB service area may include about 185 rural services in North Dakota (Stateline Cooperative) having an annual water use of about 50 acre feet. In a telephone conversation that our engineers had with your staff on September 27, 1982, you were uncertain as to whether or not other applications may be required for water delivered into North Dakota. If there are other applications that are necessary, please get in touch with me immediately and we will try to take care of them. If you have questions, or if there are additional steps which you feel are necessary for us to take prior to consideration on action for our permit, please contact me at the WEB office and we shall take care of them.

Sincerely,

Anders Christensen

enclosures: Application for permit
Attachments "A" and "B"

cc: Bruce McCollum
Lonnie Sharp
Lloyd Porter, USBR

off
226-1122
Oake Sub-Dept
called 10/18/82
ND not ready
for RWS. will
apply for add'l
if ever they
decide.



US Army Corps
of Engineers
Omaha District

Public Notice

Reply to:
Permits Branch
PO Box 5
Omaha, NE 68101

Application No: SD 2SB OXT 3 004939
Date: 27 NOV 1982
Expiration Date: 26 NOV 1982
Pierre, SD

MROOP-N-1

30-DAY NOTICE

WEB Water Development Association, Inc.
Water Intake, Commercial
Missouri River Mile 1183.60L (Lake Oahe)

NOTICE OF PERMIT PENDING

The application of the WEB Water Development Association, Inc., P.O. Box 1191, 422 Fifth Avenue SE, Aberdeen, South Dakota 57401, for approval of plans and issuance of a permit under authority of the Secretary of the Army is being considered by the District Engineer, U.S. Army Engineer District, Omaha, Nebraska.

The application was withdrawn 31 August 1981 due to lack of funds. The applicant, by letter dated 4 September 1982, requested to reinstate the application. The original public notice was dated 7 August 1981 under application no. SD 2SB OXT 3 003729 and is therefore being reinstated under no. SD 2SB OXT 3 004939 through the dates shown above with no proposed changes to the original project.

The project will consist of excavating, constructing the intake facility, backfilling and riprapping.

Construction activities will involve forming a pad for the proposed pumping station. This will be accomplished by performing site grading and stockpiling the stripped topsoil for later reuse. Approximately 12,500 cubic yards of earthen fill will be used to form the pad. An estimated 2,500 cubic yards of this material will be placed below the ordinary high waterline. Suitable fill materials will be obtained from grading for access roads.

A 10 to 15-foot diameter circular wet well will be excavated to a depth of approximately 70 feet, requiring the removal of an estimated 500 cubic yards of earthen materials. The excavated materials will be stockpiled for later use.

Approximately 405 linear feet of 30-inch diameter metal suction pipe will be installed from the wet well and extend into the lake basin. The placement of the approximately 230 lineal-foot horizontal portion of the pipe (see attached

drawing 4 on sheet 2 of 2 sheets) will be facilitated by using boring equipment to excavate the pipe tunnel. A trench will then be excavated to house the remaining approximately 175 lineal feet of suction pipe. The trench will be excavated to a minimum depth of 3 feet below the lake bottom. A total of approximately 500 cubic yards of materials will be excavated by barge-mounted equipment or shore-operated dragline for placement of the suction pipe. The suction pipe intake will be fitted with a $\frac{1}{4}$ -inch mesh cylindrical screen. After installation of the suction pipe, the trench will be backfilled with suitable excavated materials.

The wet well casing will be formed by casting concrete over a reinforced structure. Backfilling around the wet well will be performed utilizing suitable stockpiled materials.

The bankline below the pumping station will be graded to a 2-foot horizontal to 1-foot vertical slope and armor coated with an estimated 250 cubic yards of riprap.

The proposed pumping station will be equipped with three to five permanent pumps with combined horsepower of 800-1000 and combined capacity of 5400 gallons per minute (based on 3 pumps). The entrapment velocity through the screened suction pipe intake will be 0.5 feet per second at the maximum pumping rate. In the event water levels drop below the level of the suction pipe intake, one or more inclined electrical submersible pumps will be installed to discharge into the intake of the permanent suction pipeline. Screening materials as described above would be placed over the impact of the submersible pumps.

Construction is expected to take place during low water levels. Upon completion of construction activities all disturbed areas will be graded to drain and covered with the stockpiled topsoil which will be seeded with native grasses. Any unused stockpiled materials will be transported to an approved disposal site.

In addition to the water intake facility the proposed project will require the installation of approximately 3600 miles of water transmission and distribution line. The transmission and distribution line will cross numerous waters of the United States within the Omaha District's area of jurisdiction which are permitted pursuant to the "Nationwide Permit" as stated in 33 CFR Part 330 of the Interim Final Regulation as published in the Federal Register, Volume 47, No. 141 dated Thursday July 22, 1982.

The purpose of this proposed activity is to provide an adequate supply of good quality potable water for the residents of Brown, Campbell, Day, Edmunds, Faulk, Hand, McPherson, Potter, Spink and Walworth Counties in north-central South Dakota.

The Web Rural Water Development Project is authorized under Section 9 of the Rural Development Act of 1980. The Federal legislation was signed by President Reagan on October 1, 1982.

The State of South Dakota has waived its right to certify compliance with applicable water quality standards required under the provisions of Section 401

of the Clean Water Act. Accordingly, certification that the proposed project will not violate applicable water quality standards has been requested from the Regional Administrator, Environmental Protection Agency, Region VIII, Denver, Colorado.

An environmental assessment for the proposed project was prepared by the WEB Development Association, Inc. and the U.S. Bureau of Reclamation, Billings, Montana and circulated on 24 September 1982. Based on the Environmental Assessment the Bureau of Reclamation, Upper Missouri Region, Billings, Montana, have concluded that the proposed action will have no significant environmental impact.

In compliance with the National Environmental Policy Act of 1969 and Section 106 of the National Historic Preservation Act of 1966, as amended, the National Register of Historic Places and current supplements have been consulted. There are no sites included or which have been determined eligible for inclusion therein which will be affected by the proposed project. An intensive cultural resources survey has been conducted for the east bank of Lake Oahe by the University of Nebraska at Lincoln. A single site (39 WW 35) was discovered approximately ½-mile from the proposed project. It is not likely that the proposed project will disturb this site.

In compliance with the Endangered Species Act, our review indicates that the proposed activity will not affect species designated as threatened or endangered pursuant to the Endangered Species Act or their critical habitat.

The decision whether to issue a permit will be based on an evaluation of the probable impact including cumulative impacts of the proposed activity on the public interest. That decision will reflect the national concern for both protection and utilization of important resources. The benefit which reasonably may be expected to accrue from the proposal must be balanced against its reasonably foreseeable detriments. All factors which may be relevant to the proposal will be considered including the cumulative effects thereof; among those are conservation, economics, aesthetics, general environmental concerns, wetlands, cultural values, fish and wildlife values, flood hazards, flood plain values, land use, navigation, shoreline erosion and accretion, recreation, water supply and conservation, water quality, energy needs, safety, food production and, in general, the needs and welfare of the people. In addition, the evaluation of the impact of the activity on the public interest will include application of the guidelines promulgated by the Administrator, Environmental Protection Agency, under authority of Section 404(b) of the Clean Water Act (40 C.F.R., Part 230).

Any person may request, in writing, within the comment period specified in this notice, that a public hearing be held to consider this application. Request for public hearing shall state, with particularity, the reason for holding a public hearing. The request must be submitted to the District Engineer, Omaha District, Corps of Engineers, P.O. Box 5, Omaha, Nebraska 68101.

Any interested party (particularly officials of any town, city, county, state, federal agency, or local association whose interests may be affected by the proposed work) is invited to submit to this office written facts, arguments, or objections on or before 26 November 1982. Any agency or individual having an objection to the work should specifically identify it as an objection with clear and specific reasons. Comments, both favorable and unfavorable, will be accepted, made a part of the record and will receive full consideration in subsequent actions on this permit application.

Comments received after the Public Notice expiration date will not be considered.

A permit if granted, will be under Section 10 of the River and Harbor Act of 3 March 1899 (30 Stat. 1151; 33 USC 403) and under the provisions of Section 404 of the Clean Water Act.

Drawings showing the location and extent of the work are attached to this notice.

A handwritten signature in cursive script, reading "Ralph J. Miller".

Attachments
As stated

RALPH J. MILLER
Chief, Regulatory Functions Branch
Operations Division

4930-3 WEB



US Army Corps
of Engineers
Omaha District

Public Notice

Reply to:
Permits Branch
PO Box 5
Omaha, NE 68101

Application No: SD 2SB OXT 3 004939
Date: April 25, 1983
Expiration Date: May 24, 1983

MROOP-N-1
WEB Water Development Association, Inc.
Intake Structure/Fill
Missouri River Mile 1183.60 (Lake Oahe)

30 DAY NOTICE

REVISION NO. 1
NOTICE OF PERMIT PENDING

The Notice of Permit Pending Dated April 4, 1983 (which is re-printed here in its entirety) is being reissued for 30 days because it was inadvertently sent to Montana mailing addresses.

The original Notice of Permit Pending for WEB Water Development Association, Inc., P.O. Box 1191, 422 Fifth Avenue SE, Aberdeen, South Dakota 57401, dated October 27, 1982, is being revised to change the location of the project, scope of work, revise the drawing, and extend the comment period. To assure clarity, the description of the construction activities is being reissued in its entirety and will include Revision No. 1.

The proposed project will now consist of two alternate plans. The site grading will be the same for both alternatives with the pump station pad being constructed at elevation 1625 mean sea level (MSL). The site for the pump station will be prepared by grading and stockpiling the stripped topsoil. Approximately 75,000 cubic yards of earthen material will be excavated for the construction of the access road and pad.

Alternate #1 will consist of a pump house with 4 to 6 vertical turbine pumping units mounted atop a 24-foot, inside diameter, wet well--approximately 100 feet deep. A single 30-inch diameter intake line will be placed in an excavated trench from the pump house to elevation 1559(MSL) in the river (see attached drawing, sheet 2 of 2, alternate #1).

Alternate #2 will consist of 5 or 6 individually screened intake lines, 18 inches in diameter. The intake lines will be buried in a trench approximately 3 feet deep from the pump house to elevation 1559(MSL) in the river (see attached drawing, sheet 2 of 2, alternate #2). Excavated materials from the trench will be placed on the high bank to be reused, if suitable, for backfilling the trench after the pipes are installed.

The wet well casing will be formed by casting concrete over a reinforced structure. Backfilling around the wet well will be performed utilizing suitable stockpiled materials.

The bankline below the pumping station will be graded to a 2-foot horizontal to 1-foot vertical slope and armor coated with an estimated 250 cubic yards of riprap.

At such a time it appears the reservoir level may be going to drop below elevation 1565(MSL), it will be necessary to extend the pipeline further into the reservoir so the screened intake can be relocated at elevation 1535(MSL). The intake velocity through the screened suction pipe intake will be 0.5 feet per second at the maximum pumping rate.

Construction is expected to take place during low water levels. Upon completion of construction activities all disturbed areas will be graded to drain and covered with the stockpiled topsoil which will be seeded with native grasses. Any unused stockpiled materials will be transported to an approved disposal site.

In addition to the water intake facility the proposed project will require the installation of approximately 3,600 miles of water transmission and distribution line. The transmission and distribution line will cross numerous waters of the United States within the Omaha District's area of jurisdiction which are permitted pursuant to the "Nationwide Permit" as stated in 33 C.F.R. Part 330 of the interim Final Regulation as published in the Federal Register, Volume 47, No. 141 dated Thursday, July 22, 1982.

The purpose of this proposed activity is to provide an adequate supply of good quality potable water for the residents of Brown, Campbell, Day, Edmunds, Faulk, Hand, McPherson, Potter, Spink and Walworth Counties in north-central South Dakota.

The WEB Rural Water Development Project is authorized under Section 9 of the Rural Development Act of 1980. The Federal legislation was signed by President Reagan on October 1, 1982.

The State of South Dakota has waived its right to certify compliance with applicable water quality standards required under the provisions of Section 401 of the Clean Water Act. Accordingly, certification that the proposed project will not violate applicable water quality standards has been requested from the Regional Administrator, Environmental Protection Agency, Region VIII, Denver, Colorado.

The Environmental Assessment for the proposed project was prepared by the WEB Development Association, Inc. and the U.S. Bureau of Reclamation, Billings, MT and circulated on September 24, 1982. Based on the Environmental Assessment the Bureau of Reclamation, Upper Missouri Region, Billings, Montana, have concluded that the proposed action will have no significant environmental impact.

In compliance with the National Environmental Policy Act of 1969 and Section 106 of the National Historic Preservation Act of 1966, as amended, the National Register of Historic Places and current supplements have been consulted. There are no sites included or which have been determined eligible for inclusion therein which will be affected by the proposed project. 39WWS6 will be avoided as agreed to by the permittee and the District.

In compliance with the Endangered Species Act, our review indicates that the proposed activity will not affect species designated as threatened or endangered pursuant to the Endangered Species Act or their critical habitat.

The decision whether to issue a permit will be based on an evaluation of the probable impact including cumulative impacts of the proposed activity on the public interest. That decision will reflect the national concern for both protection and utilization of important resources. The benefit which reasonably may be expected to accrue from the proposal must be balanced against its reasonably foreseeable detriments. All factors which may be relevant to the proposal will be considered including the cumulative effects thereof; among those are conservation, economics, aesthetics, general environmental concerns, wetlands, cultural values, fish and wildlife values, flood hazards, flood plain values, land use, navigation, shoreline erosion and accretion, recreation, water supply and conservation, water quality, energy needs, safety, food production and, in general, the needs and welfare of the people. In addition, the evaluation of the impact of the activity on the public interest will include application of the guidelines promulgated by the Administrator, Environmental Protection Agency, under authority of Section 404(b) of the Clean Water Act (40 C.F.R., Part 230).

Any person may request, in writing, within the comment period specified in this notice, that a public hearing be held to consider this application. Request for a public hearing shall state, with particularity, the reason for holding a public hearing. The request must be submitted to the District Engineer, Omaha District, Corps of Engineers, P.O. Box 5, Omaha, Nebraska 68101.

Any interested party (particularly officials of any town, city, county, state, Federal agency, or local association whose interests may be affected by the proposed work) is invited to submit to this office written facts, arguments, or objections on or before May 24, 1983. Any agency or individual having an objection to the work should specifically identify it as an objection with clear and specific reasons. Comments, both favorable and unfavorable, will be accepted, made a part of the record and will receive full consideration in subsequent actions on this permit application.

Comments received after public notice expiration date will not be considered.

A permit, if granted, will be under Section 10 of the River and Harbor Act of 1899 (30 Stat. 1151; 33 USC 403) and under the provisions of Section 404 of the Clean Water Act.

Drawings showing the location and extent of the work are attached to this notice.



Ralph J. Miller
Chief, Regulatory Functions Branch
Operations Division

Attachments

DATE: 14 MARCH 1983 (AMENDED)

WEB WATER DEVELOPMENT ASSOCIATION, INC.

APPLICATION BY:

COUNTY, SD.


IN MISSOURI RIVER (LAKE OAH) 12 MILES
SOUTHEAST OF MOBRIDGE, WALWORTH

PROPOSED PUMPING STATION AND PIPELINE



PURPOSE:
SOURCE OF SUPPLY FOR RURAL WATER
SYSTEM.




DATUM PLANE:
USGS, a) HIGH WATER EL = 1620
b) NORMAL WATER EL = 1608

PROPERTY OWNED BY USA

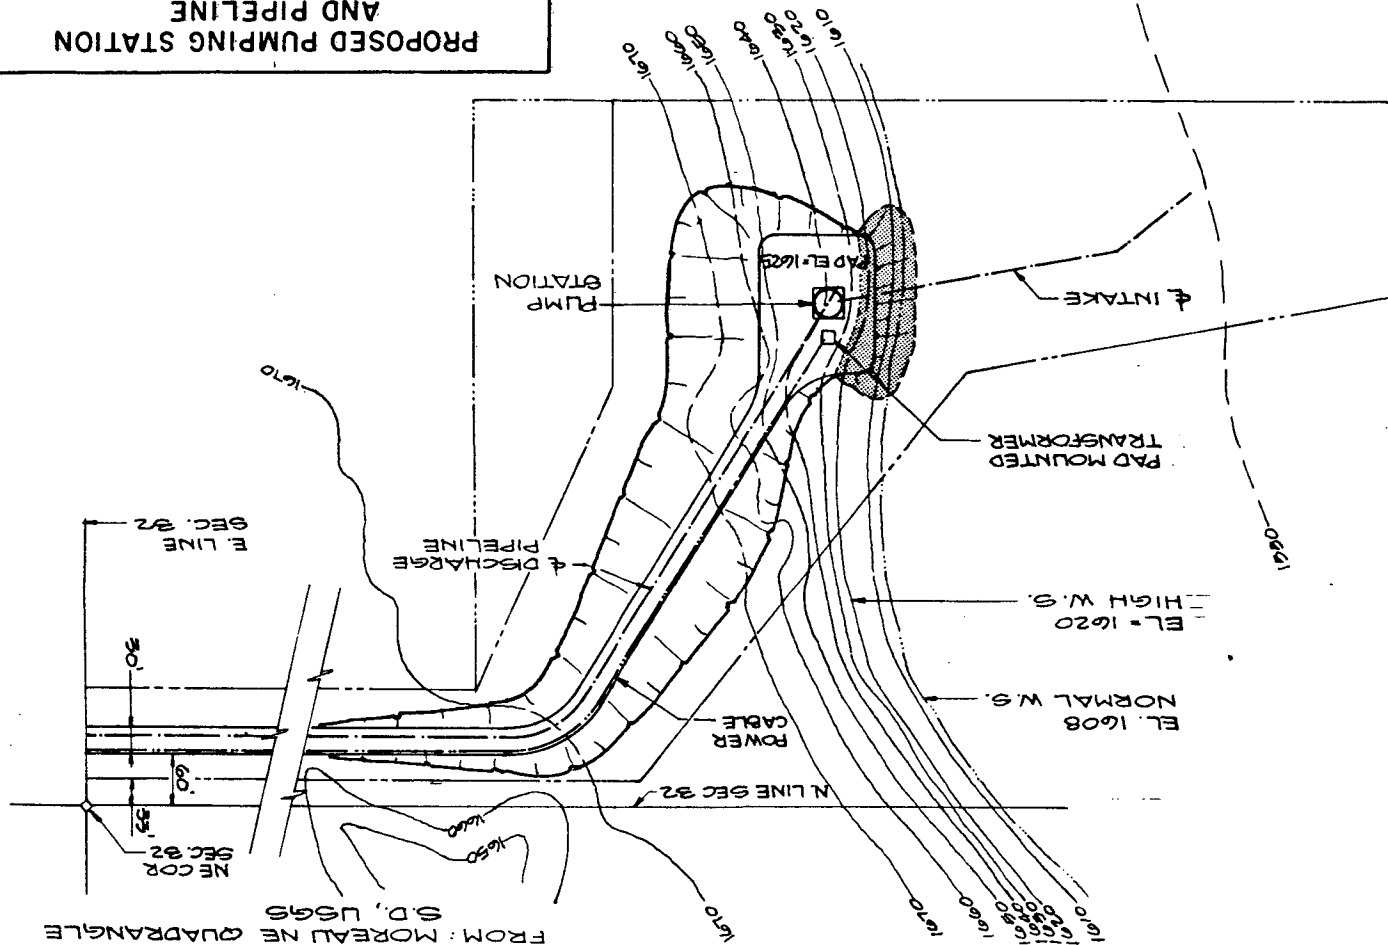

FROM: MOREAU NE QUADRANGLE
S.D., USGS

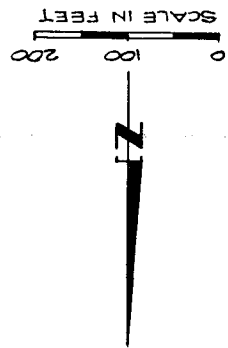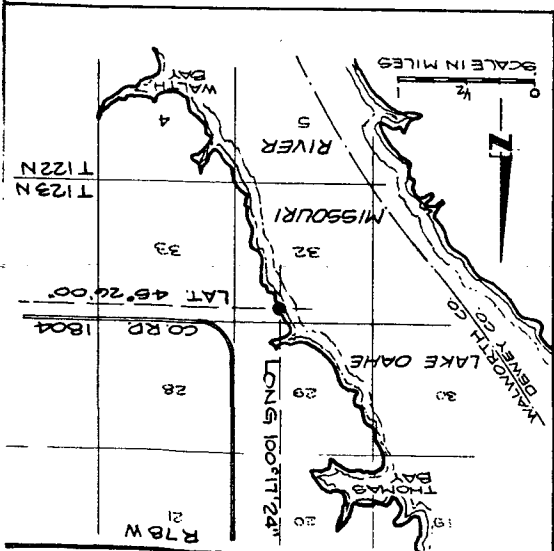

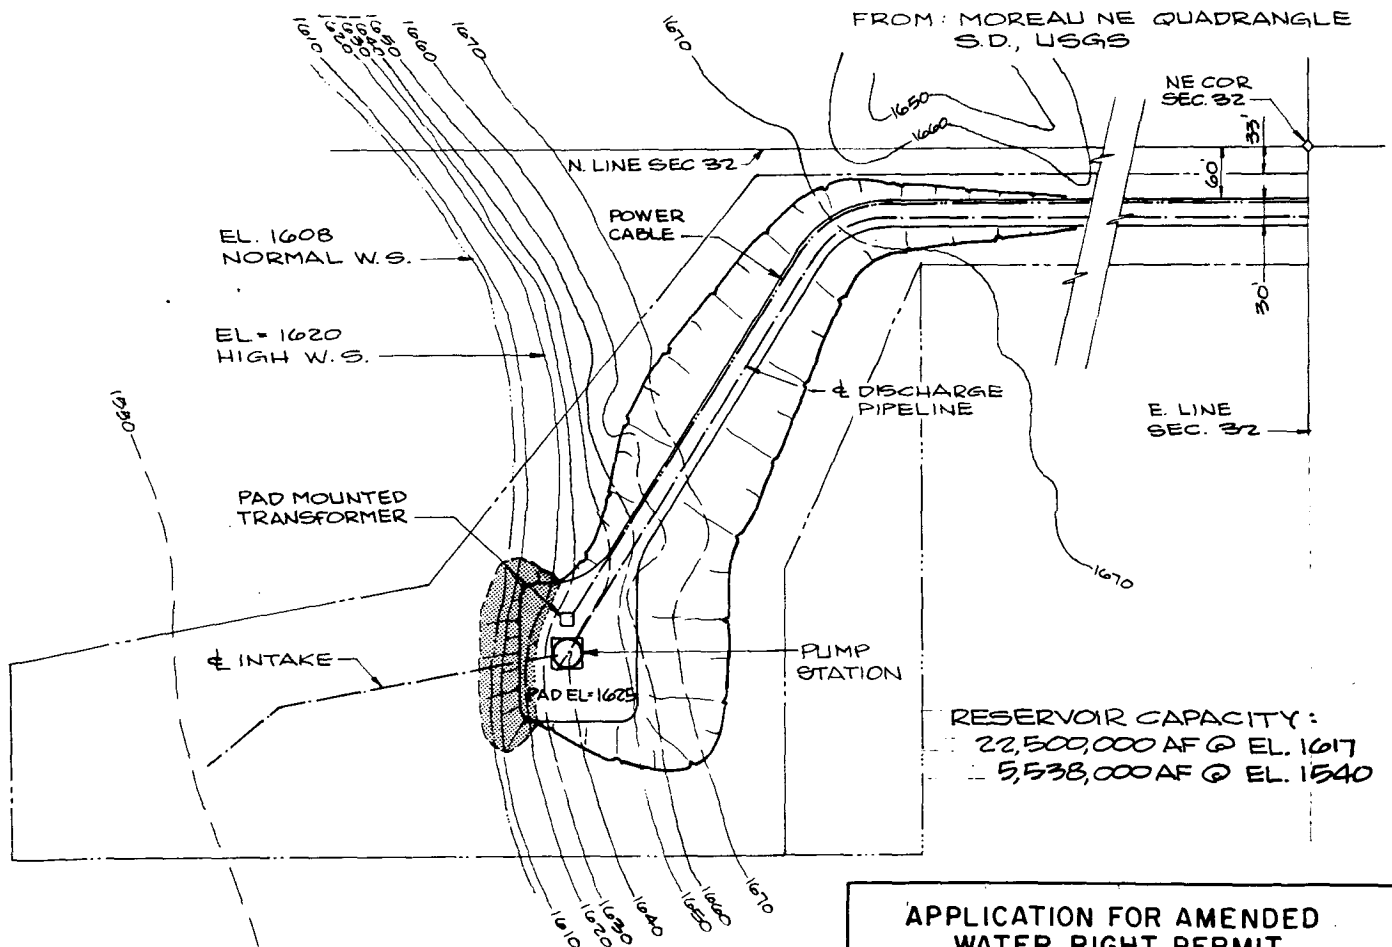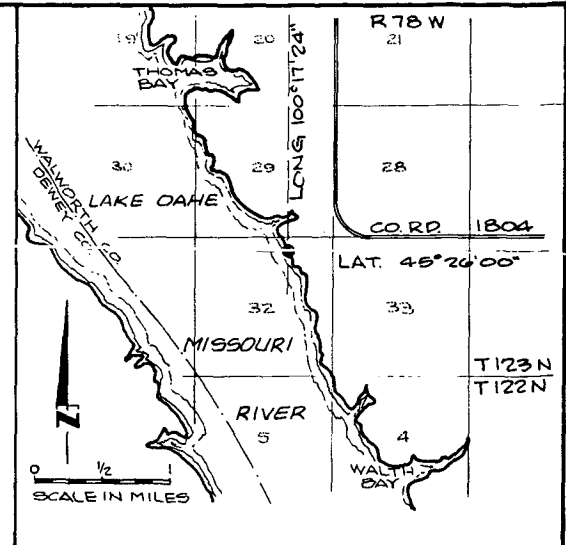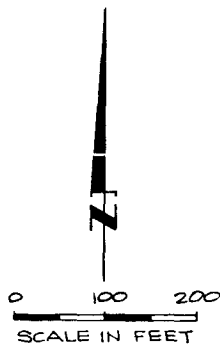

PURPOSE:
SOURCE OF SUPPLY FOR RURAL WATER
WATER SYSTEM.

DATUM PLANE :
USGS, a) HIGH WATER EL = 1620
d) NORMAL WATER EL = 1608

PROPERTY OWNED BY USA

APPLICATION FOR AMENDED WATER RIGHT PERMIT

IN MISSOURI RIVER (LAKE OAHÉ) 12 MILES
SOUTHEAST OF MOBRIDGE, WALWORTH
COUNTY, SD.



APPLICATION BY:
WEB WATER DEVELOPMENT ASSOCIATION, INC.

DATE : 14 MARCH 1983 (AMENDED)

SHEET 1 OF 2 SHEETS

PUMPING STATION

- HORSEPOWER = 1200 (ELECT.)
- PUMPING CAPACITY = 12 CFS
- NUMBER OF UNITS = 4 TO 6

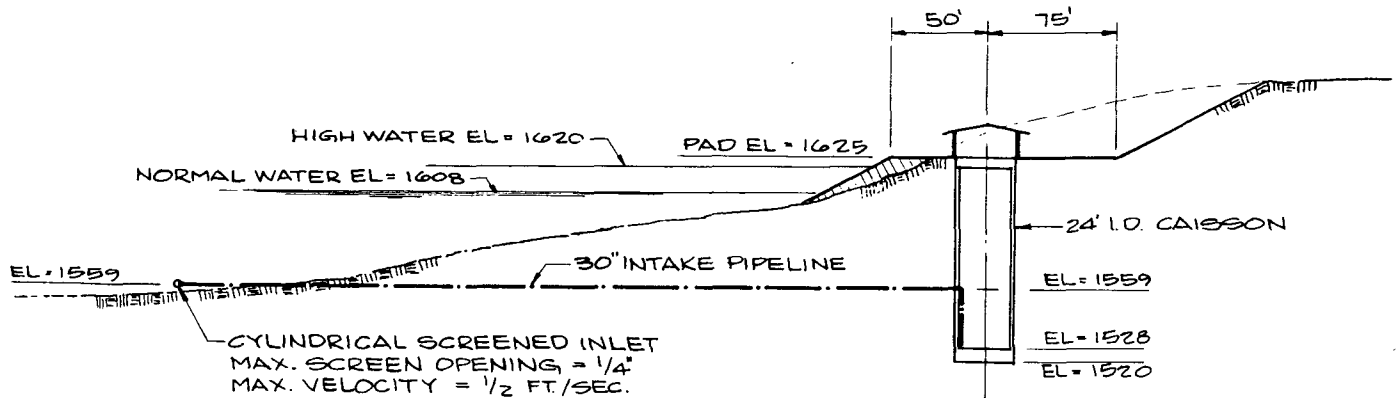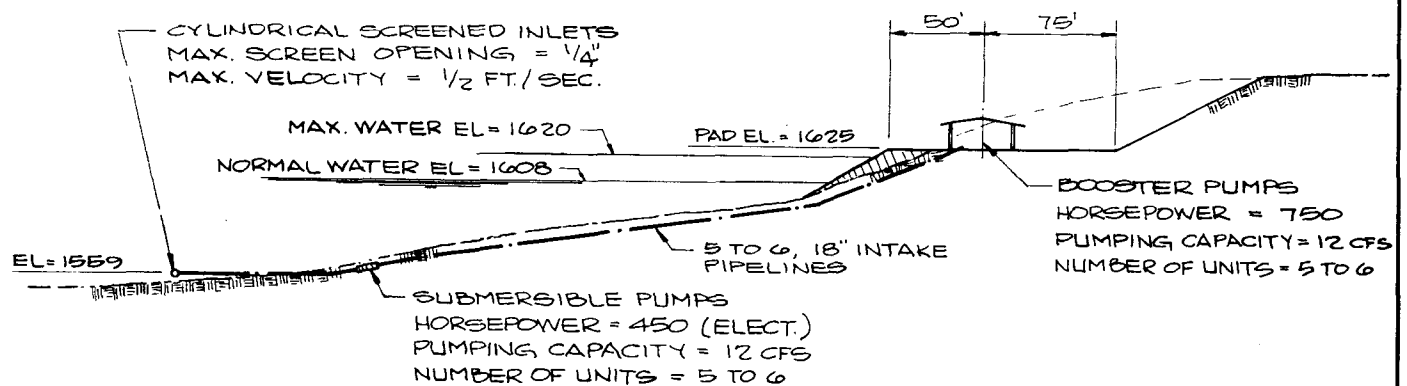ALTERNATE 1ALTERNATE 2NOTE

CUT AND FILL SLOPES, 2:1
FILL SLOPES TO BE RIP-RAPPED

SCALE:
HORIZ. 1" = 100'
VERT. 1" = 100'

PREPARED BY JOINT VENTURE OF

BW | BARTLETT & WEST, CONSULTING ENGINEERS
BEC | BOYLE ENGINEERING CORPORATION

BY *Lonnie D. Schardt*
LONNIE D. SCHARDT, P.E.
S.D. REG. NO. 3184


APPLICATION FOR AMENDED WATER RIGHT PERMIT

IN MISSOURI RIVER (LAKE OAHE) 12 MILES
SOUTHEAST OF MOBRIDGE, WALWORTH
COUNTY, SD.

APPLICATION BY:
WEB WATER DEVELOPMENT ASSOCIATION, INC.

DATE: 14 MARCH 1983 (AMENDED)

SHEET 2 OF 2 SHEETS

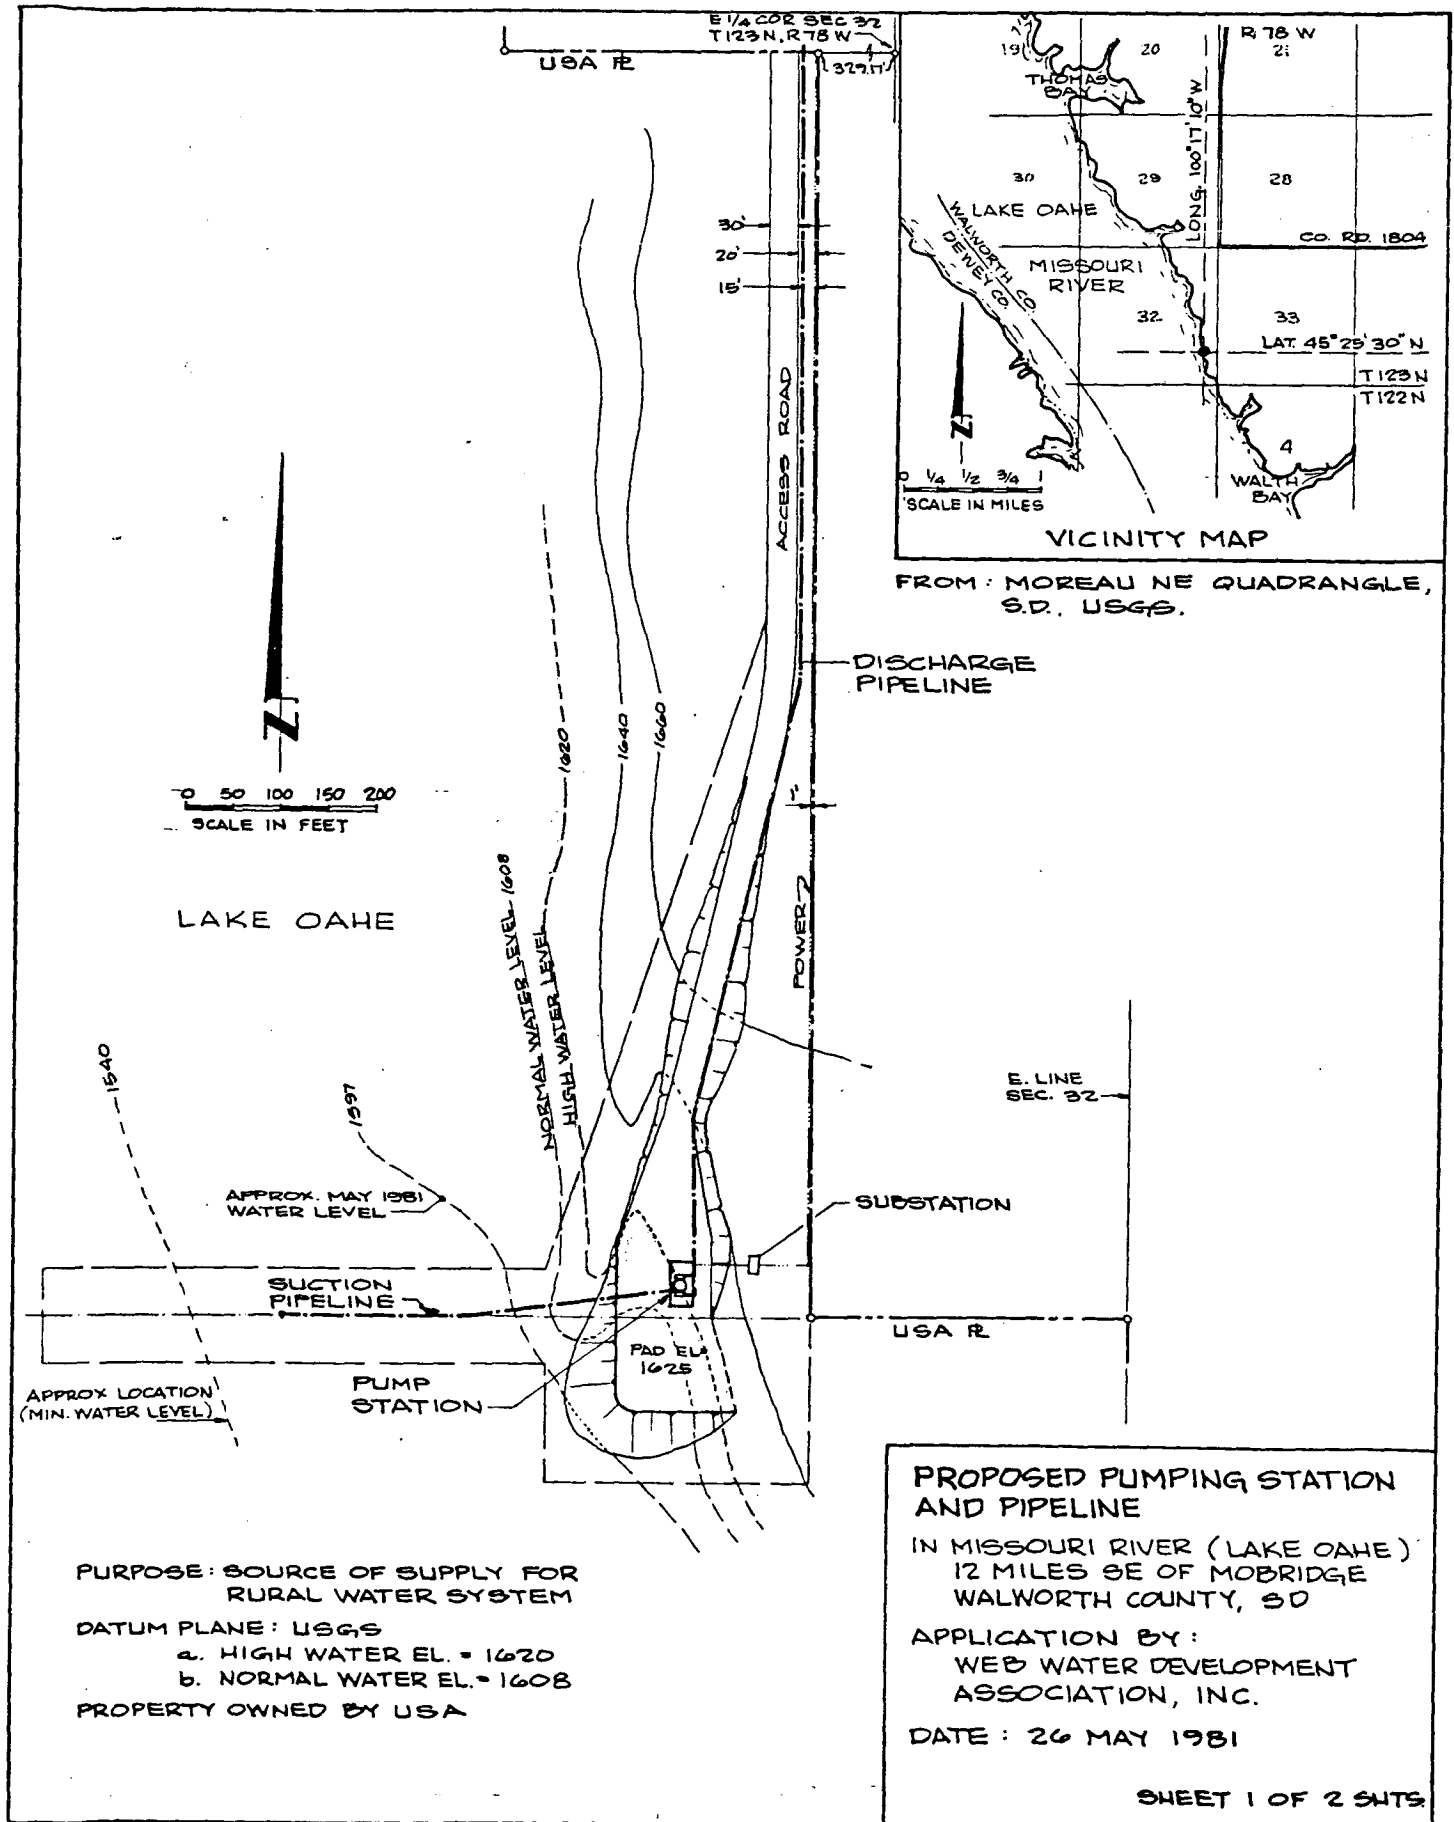

SHEET 2 OF 2 SLITS.

PROPOSED PUMPING STATION
AND PIPELINE

IN MISSOURI RIVER (LAKE OAHÉ)
12 MILES SE OF MORRIDGE
WALWORTH COUNTY, SD.


APPLICATION BY :
WEB WATER DEVELOPMENT

ASSOCIATION, INC.

DATE: 26 MAY 1981

NOTE
CYLINDRICAL SCREENED INTAKE
MAX. SCREEN OPENING = $1/4$ "
MAX. VELOCITY = $1/2$ FT./SEC.


PROFILE

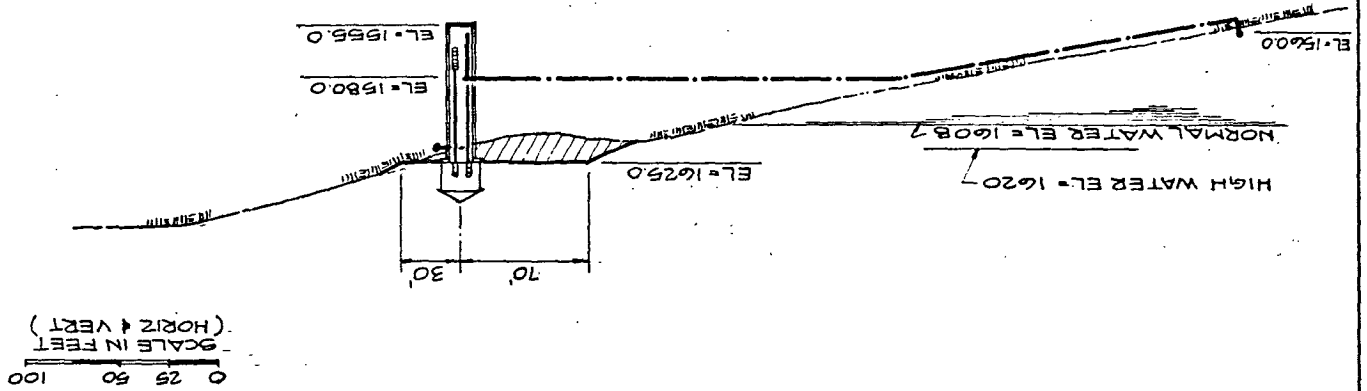

PUMPING STATION PLAN


NOTE:

- PUMPING STATION
- HORSEPOWER = 800 TO 1000 (ELECT.)
- PUMPING CAPACITY = 10 TO 12 CFS
- NUMBER OF UNITS = 3 TO 5

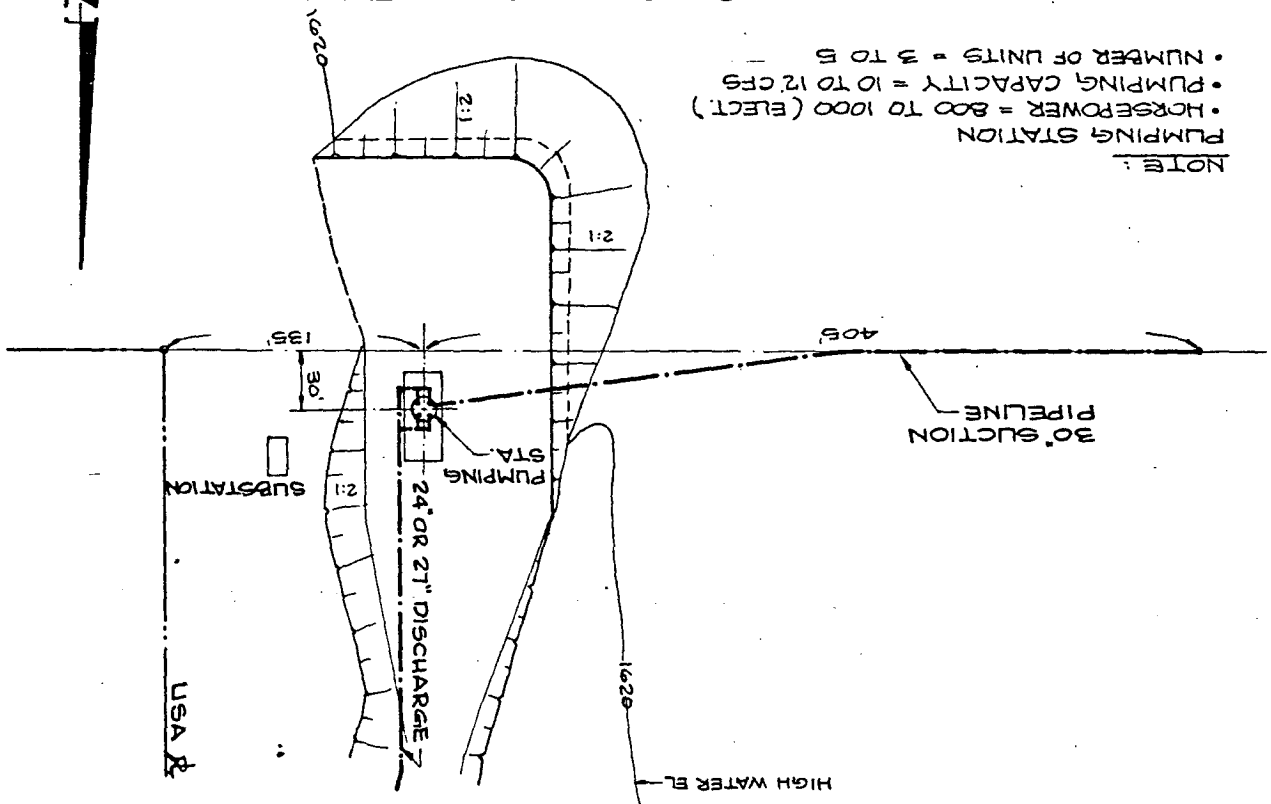


PUMPING STATION

- HORSEPOWER = 1200 (ELECT.)
- PUMPING CAPACITY = 12 CFS
- NUMBER OF UNITS = 4 TO 6

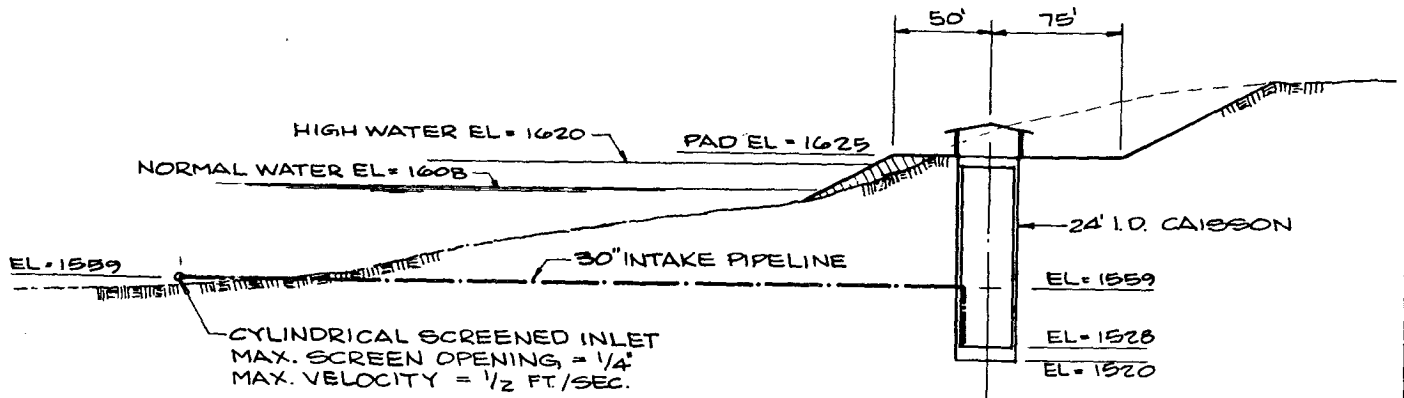

ALTERNATE 1

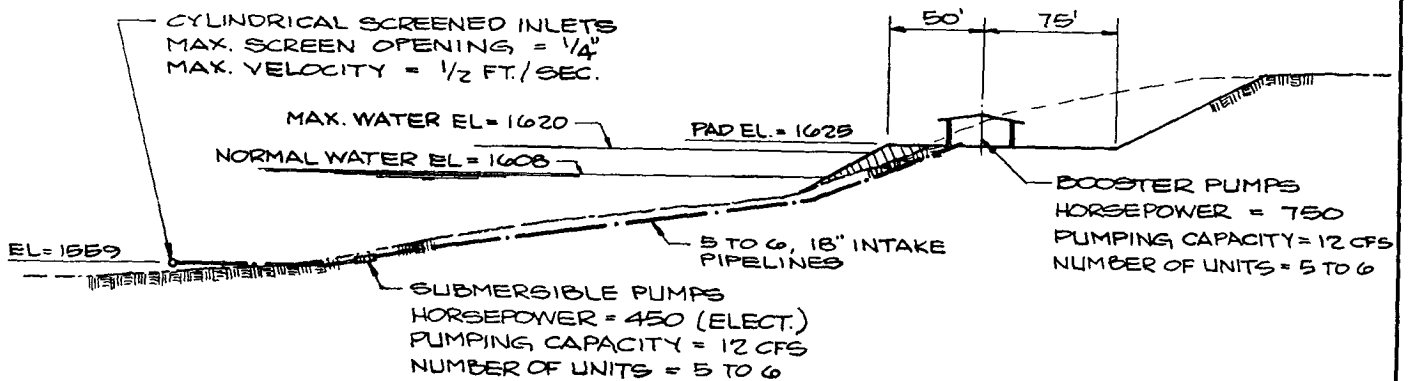

ALTERNATE 2

NOTE

CUT AND FILL SLOPES, 2:1
FILL SLOPES TO BE RIP-RAPPED

SCALE:
HORIZ. 1" = 100'
VERT. 1" = 100'

PROPOSED PUMPING STATION AND PIPELINE

IN MISSOURI RIVER (LAKE OAH) 12 MILES
SOUTHEAST OF MOBRIDGE, WALWORTH
COUNTY, SD.

APPLICATION BY:
WEB WATER DEVELOPMENT ASSOCIATION, INC.

DATE: 14 MARCH 1983 (AMENDED)


SHEET 2 OF 2 SHEETS

**DEPARTMENT OF THE ARMY
U. S. ARMY ENGINEER DISTRICT, OMAHA
CORPS OF ENGINEERS**

**8014 U. S. POST OFFICE AND COURTHOUSE
OMAHA, NEBRASKA 68102**

**OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE \$300**


MR00P-N-1

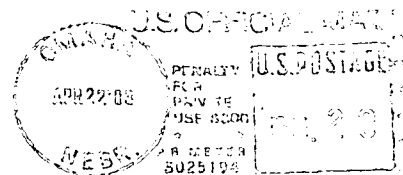

PUBLIC NOTICE

John Hatch, Chief Engineer
Division of Water Rights
Dept. of Water and Natural Resources
Foss Building
Pierre, SD 57501

NOT TO SCALE

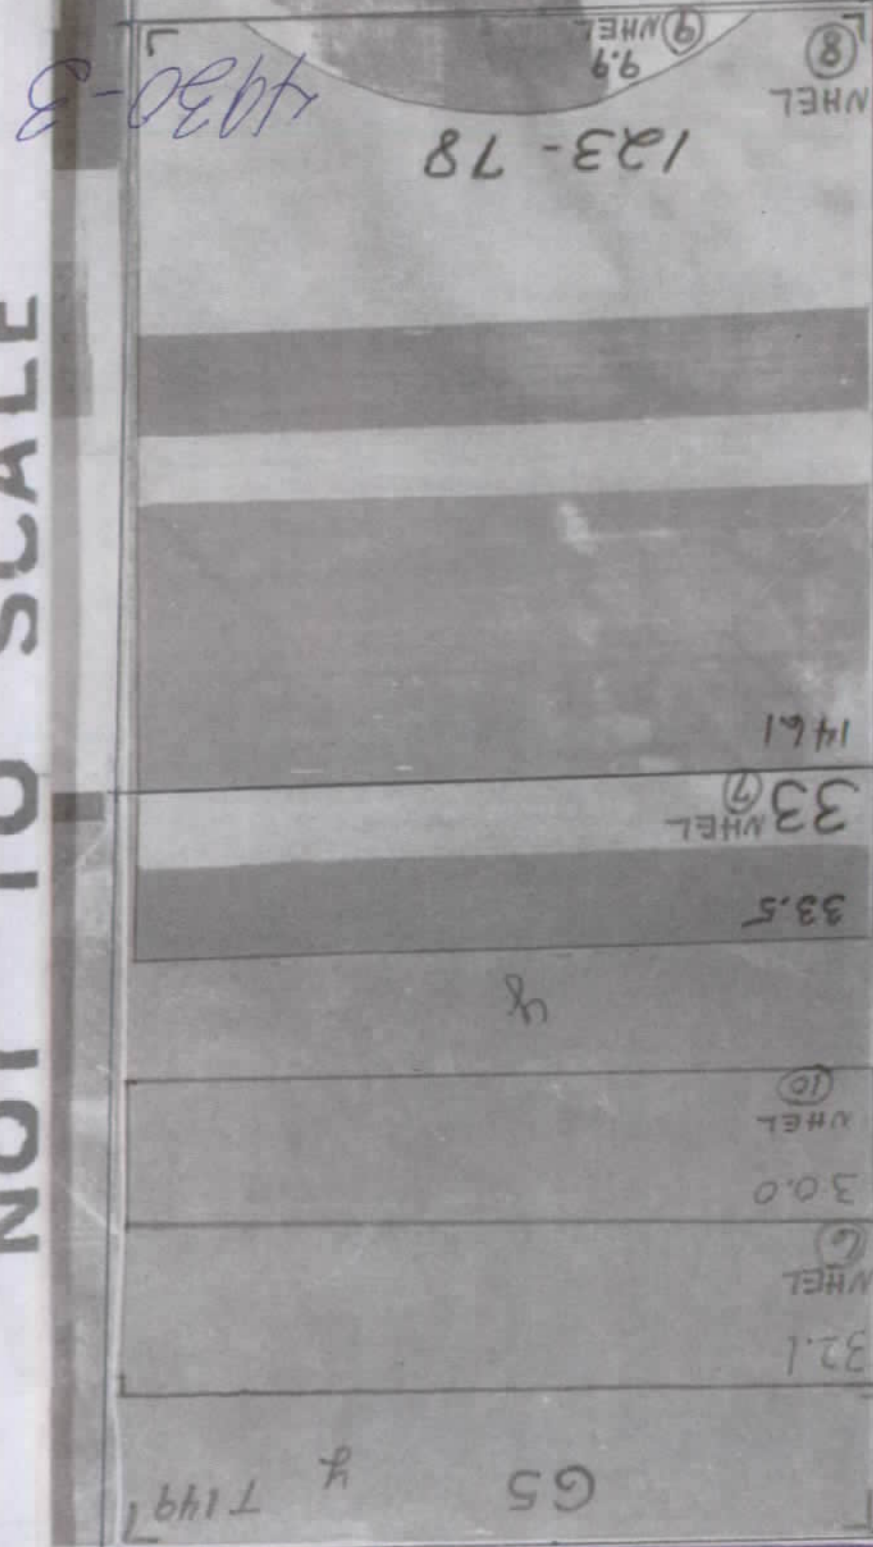

WEB List of Publications for Notice of Intent to Appropriate Water

- 12/16/82 ~~11-15-82~~ Brown County - Aberdeen American News, P.O. Box 4430, Aberdeen, SD 57401 *daily* ^{11/5}
- 11-15-82 ~~11-15-82~~ Beadle County - Huron Daily Plainsman, 49 3rd S.E., Huron, SD 57350 *daily* ^{11/5}
- 11-15-82 ~~11-15-82~~ Clark County - Clark County Courier, ^{117 1E} Clark, SD 57225 *Wed* ^{11/3}
- 11-29-82 Campbell County - Prairie Pioneer, Pollock, SD 57648 ~~Box 218~~ *Thurs* ^{11/4}
- 11-8-82 Hand County - Miller Press, ^{Box 196} Miller, SD 57362 *Thurs* ^{11/4}
- 12/16/82 ~~11-15-82~~ Potter County - Potter County News, ^{Box G} 110 S. Exene, Gettysburg, SD 57442 *Thurs* ^{11/4}
- 10-29-82 ~~11-15-82~~ Faulk County - Faulk County Record, ^{Box 68} Faulkton, SD 57438 *Thurs* ^{11/4}
- 11-15-82 ~~11-15-82~~ Edmunds County - Ipswich Tribune, ^{POB 7} 107 Main, Ipswich, SD 57451 *Wed* ^{11/3}
- 12/16/82 ~~11-15-82~~ McPherson County - McPherson County Herald, ^{Box 170} Leola, SD 57456 *Thurs* ^{11/4}
- 12/1/82 Walworth County - Mobridge Tribune, 111 W. 3rd, Mobridge, SD 57601 *Thurs* ^{11/4}
- 10/04/82 ~~11-15-82~~ Day County - Reporter and Farmer, 624 Main, Webster, SD 57274 *Wed* ^{11/3}
- 11/04/82 ~~11-15-82~~ Spink County - Redfield Press, ^{POB 440} 16 East 7th Ave., Redfield, SD 57469 ~~Wed~~ ^{11/3}



Department of Water & Natural Resources

Joe Foss Building
Pierre, South Dakota 57501

Water Rights Division
(605) 733-3352

October 19, 1982

NOTE: TO BE SURE OF PUBLICATION ON
THE CORRECT DATES, CONTACT THE
NEWSPAPER RIGHT AWAY.

WEBB Water Development Association
Box 1911
Aberdeen, South Dakota 57401

Gentlemen:

You are hereby notified that your Application No. 4930-3 for a permit to

appropriate water for Rural Water System use, has been examined and found to comply with the water laws of South Dakota and the regulations thereunder. A notice of your intent to appropriate water has been sent to the

Publisher of the papers on enclosed notices printed at various locations. South Dakota. For your information, a copy of this notice is enclosed.

BE SURE TO CONTACT THE LEGAL AD DEPARTMENT OF THE ABOVE NEWSPAPER TO AUTHORIZE PUBLICATION OF YOUR NOTICE OF INTENT TO APPROPRIATE WATER AND TO ARRANGE FOR PAYMENT. EARLY CONTACT WITH THE PAPER CAN ELIMINATE DELAYS IN PRINTING THE NOTICE AND TRANSMITTAL OF PUBLICATION NOTICES TO THIS OFFICE. THE PUBLISHER HAS BEEN INSTRUCTED ON WHAT DATES HE IS TO PUBLISH THE NOTICE OF YOUR APPROPRIATION OF WATER ONCE EACH WEEK FOR TWO CONSECUTIVE WEEKS PRIOR TO THE WATER MANAGEMENT BOARD MEETING WITH THE LAST PUBLICATION TO OCCUR AT LEAST FOUR LEGAL BUSINESS DAYS BEFORE THE BOARD MEETING. ANY INTERMEDIATE SATURDAY, SUNDAY OR LEGAL HOLIDAY DOES NOT COUNT AS A LEGAL BUSINESS DAY. AT LEAST THE FIRST PUBLICATION NOTICE MUST BE RECEIVED PRIOR TO THE WATER MANAGEMENT BOARD MEETING FOR THE HEARING TO BE CONDUCTED.

You should know that the Publisher is to furnish proof of publication to the Water Management Board within 60 days of the date of this letter, otherwise South Dakota Statute requires that your application lose its priority until proof of publication is received in proper form.

For the Water Management Board

BETTY WESTLUND
Water Rights Specialist

BW:ms

Encl. Forms 6 & 7

No. 4930-3

Publish first publication, on or before November 3, 1982

NOTICE OF HEARING ON
APPLICATION TO APPROPRIATE WATER

Pierre, South Dakota 57501

October 19, 1982

Notice is hereby given the WEB Water Development Assoc., Inc. whose post office address is Box 1911, Aberdeen, South Dakota, has made an application in accordance with the provisions of SDCL 46-1-1 thru 46-1-9; 46-1-12 thru 46-1-14; 46-2-9 thru 46-2-11, 46-2-13; 46-5-1 thru 46-5-8, 46-5-10 thru 46-5-22, 46-5-25, 46-5-41 ~~(ground) 46-6-3 thru 46-6-5, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14,~~ ~~(future use) 46-5-38, (transfer lands) 46-5-33 thru 46-5-35~~ and Board Rules ARSD 74:02:01:01 thru 74:02:01:15, ~~(future use) 74:02:01:23 thru 74:02:01:26 (10,000 AFA)~~ ~~74:02:07:01 thru 74:02:07:03,~~ for a permit to appropriate for beneficial use from a Future use (7500 acre feet annually) 15.00 (peak) cubic feet of water per second of time/ from the Missouri River through the WEB Rural Water Development Project, the point ~~(s)~~ of diversion which is ~~(are)~~ to be located in the SE $\frac{1}{4}$ SE $\frac{1}{4}$

of Section 32, Twp. 123N, Range 78W. Said water to be used for purpose of providing ~~irrigation on portions of the following described land:~~
water supplies for a Rural Water System

This Application No. 4930-3 will be considered by the Water Management Board at the Sheraton Inn, Dakota Room, Aberdeen SD upon the 9th day of December, 1982

at 10 A.M. The Board is authorized to make a determination on this application at the hearing. All interested persons may appear and be heard. Any person who may be affected by a Board decision who desires to present evidence or cross-examine witnesses according to SDCL 1-26 may notify the Board in writing prior to the hearing or orally at the hearing.

This hearing is an adversary proceeding. Any person has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any handicapped person wishing to attend this hearing can contact the Water Rights Division, DWNr, Joe Foss Building, Pierre SD, prior to the hearing date for assistance to assure access to the hearing.

For the Water Management Board

cc: applicant

BETTY WESTLUND, Water Rights Specialist

WNR-806-2/82

No. 4930-3

Publish first publication, on or before November 4, 1982

NOTICE OF HEARING ON
APPLICATION TO APPROPRIATE WATER

Pierre, South Dakota 57501

October 19, 1982

Notice is hereby given the WEB Water Development Assoc., Inc. whose post office

address is Box 1911, Aberdeen, South Dakota, has made an application in accordance with the provisions of SDCL 46-1-1 thru 46-1-9; 46-1-12 thru 46-1-14; 46-2-9 thru 46-2-11, 46-2-13; 46-5-1 thru 46-5-8, 46-5-10 thru 46-5-22, 46-5-25, 46-5-41 ~~(ground) 46-6-3 thru 46-6-5, 46-6-6, 46-6-10, 46-6-13, 46-6-14, (future use) 46-5-38, (transfer lands) 46-5-33 thru 46-5-35~~ and Board Rules ARSD 74:02:01:01 thru 74:02:01:15, ~~(future use) 74:02:01:23 thru 74:02:01:26 (10,000 AFA) 74:02:07:01 thru 74:02:07:03~~, for a permit to appropriate for beneficial use from a Future use 15.00 (peak) cubic feet of water per second of time/ (7500 acre feet annually) from the Missouri River

through the WEB Rural Water Development Project, the point ~~(s)~~ of diversion which is ~~(are)~~ to be located in the SE $\frac{1}{4}$ SE $\frac{1}{4}$

of Section 32, Twp. 123N, Range 78W. Said water to be used for purpose of providing ~~irrigation on portions of the following described land:~~

water supplies for a Rural Water System

This Application No. 4930-3 will be considered by the Water Management Board at the Sheraton Inn, Dakota Room, Aberdeen SD upon the 9th day of December, 1982

at 10 A.M. The Board is authorized to make a determination on this application at the hearing. All interested persons may appear and be heard. Any person who may be affected by a Board decision who desires to present evidence or cross-examine witnesses according to SDCL 1-26 may notify the Board in writing prior to the hearing or orally at the hearing.

This hearing is an adversary proceeding. Any person has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any handicapped person wishing to attend this hearing can contact the Water Rights Division, DWRN, Joe Foss Building, Pierre SD, prior to the hearing date for assistance to assure access to the hearing.

For the Water Management Board

cc: applicant

BETTY WESTLUND, Water Rights Specialist

WNR-806-2/82

No. 4930-3

Publish first publication, on or before November 5, 1982

NOTICE OF HEARING ON
APPLICATION TO APPROPRIATE WATER

Pierre, South Dakota 57501

October 19, 1982

Notice is hereby given the WEB Water Development Assoc., Inc. whose post office

address is Box 1911, Aberdeen, South Dakota, has made an application in accordance with the provisions of SDCL 46-1-1 thru 46-1-9; 46-1-12 thru 46-1-14; 46-2-9 thru 46-2-11, 46-2-13; 46-5-1 thru 46-5-8, 46-5-10 thru 46-5-22, 46-5-25, 46-5-41 ~~(ground) 46-6-3 thru 46-6-5, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14, (future use) 46-5-38; (transfer lands) 46-5-33 thru 46-5-35 and Board Rules ARSD 74:02:01:01 thru 74:02:01:15, (future use) 74:02:01:23 thru 74:02:01:26 (10,000 AFA) 74:02:07:01 thru 74:02:07:03, for a permit to appropriate for beneficial use from a future use~~
15.00 (peak) cubic feet of water per second of time from the Missouri River (7500 acre feet annually)

through the WEB Rural Water Development Project, the point ~~(s)~~ of diversion which is ~~(are)~~ to be located in the SE $\frac{1}{4}$ SE $\frac{1}{4}$

of Section 32, Twp. 123N, Range 78W. Said water to be used for purpose of providing ~~irrigation on portions of the following described land:~~

water supplies for a Rural Water System

This Application No. 4930-3 will be considered by the Water Management Board at the Sheraton Inn, Dakota Room, Aberdeen SD upon the 9th day of December, 1982

at 10 A.M. The Board is authorized to make a determination on this application at the hearing. All interested persons may appear and be heard. Any person who may be affected by a Board decision who desires to present evidence or cross-examine witnesses according to SDCL 1-26 may notify the Board in writing prior to the hearing or orally at the hearing.

This hearing is an adversary proceeding. Any person has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any handicapped person wishing to attend this hearing can contact the Water Rights Division, DWNR, Joe Foss Building, Pierre SD, prior to the hearing date for assistance to assure access to the hearing.

For the Water Management Board

cc: applicant
WNR-806-2/82

BETTY WESTLUND, Water Rights Specialist

No. 4930-3

Publish first publication, on or before _____

NOTICE OF HEARING ON
APPLICATION TO APPROPRIATE WATER

Pierre, South Dakota 57501

October 19, 1982Notice is hereby given the WEB Water Development Assoc., Inc. whose post office

address is Box 1911, Aberdeen, South Dakota, has made an application in accordance with the provisions of SDCL 46-1-1 thru 46-1-9; 46-1-12 thru 46-1-14; 46-2-9 thru 46-2-11, 46-2-13; 46-5-1 thru 46-5-8, 46-5-10 thru 46-5-22, 46-5-25, 46-5-41 ~~(ground) 46-6-3 thru 46-6-5, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14, (future use) 46-5-38; (transfer lands) 46-5-33 thru 46-5-35 and Board Rules ARSD 74:02:01:01 thru 74:02:01:15, (future use) 74:02:01:23 thru 74:02:01:26 (10,000 AFA) 74:02:07:01 thru 74:02:07:03, for a permit to appropriate for beneficial use~~
15.00 (peak) (7500 acre feet annually)
cubic feet of water per second of time/from the Missouri River

through the WEB Rural Water Development Project, the point ~~(s)~~ of diversion which is ~~(are)~~ to be located in the SE $\frac{1}{4}$ SE $\frac{1}{4}$

of Section 32, Twp. 123N, Range 78W. Said water to be used for purpose of providing ~~irrigation on portions of the following described land:~~

water supplies for a Rural Water System

This Application No. 4930-3 will be considered by the Water Management Board at the Sheraton Inn, Dakota Room, Aberdeen SD upon the 9th day of December, 1982

at 10 A.M. The Board is authorized to make a determination on this application at the hearing. All interested persons may appear and be heard. Any person who may be affected by a Board decision who desires to present evidence or cross-examine witnesses according to SDCL 1-26 may notify the Board in writing prior to the hearing or orally at the hearing.

This hearing is an adversary proceeding. Any person has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any handicapped person wishing to attend this hearing can contact the Water Rights Division, DWR, Joe Foss Building, Pierre SD, prior to the hearing date for assistance to assure access to the hearing.

For the Water Management Board

cc: applicant

BETTY WESTLUND, Water Rights Specialist

WNR-806-2/82

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County of Faulk) ss.

I, Jody Moritz hereby

certify that the annexed printed copy of Notice of Intent to Appropriate
Water was taken from the Faulk County Record

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the _____

town of Faulkton

County of Faulk and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

Thursday, Oct. 28, 1982

Thursday, Nov. 4, 1982

Jody Moritz
(Signature)

Publisher
(Title)

10-28-82
(Date Signed)

Cost of Printing: \$21.78

No. 393, Oct. 28 Nov. 4, 1982

**Notice of Hearing
on Application to
Appropriate
Water**

Pierre, South Dakota 57501
October 19, 1982


Notice is hereby given the WEB
Water Development Assoc., Inc.
whose post office address is Box 1911,
Aberdeen, South Dakota, has made an
application in accordance with the
provisions of SDCL 46-1-1 thru 46-1-9;
46-1-12 thru 46-1-14; 46-2-9 thru
46-2-11, 46-2-13; 46-5-1 thru 46-5-8,
46-5-10 thru 46-4-22, 46-5-25, 46-5-41
and Board Rules ARSD 74:02:01 thru
74:02:01:15, from a Future use permit
to appropriate for beneficial use 15.00
(peak) cubic feet of water per second of
time (7500 acre feet annually) from the
Missouri River through the WEB Rural
Water Development Project, the point
of diversion which is to be located in
the SE 1/4 SE 1/4 of Section 32, Twp.
123N, Range 78W. Said water to be
used for purpose of providing water
supplies for a Rural Water System.

This Application No. 4930-3 will be
considered by the Water Management
Board at the Sheraton Inn, Dakota
Room, Aberdeen, S.D. upon the 9th
day of December, 1982 at 10 a.m. The
Board is authorized to make a deter-
mination on this application at the
hearing. All interested persons may
appear and be heard. Any person who
may be affected by a Board decision
who desires to present evidence or
cross-examine witnesses according to
SDCL 1-26 may notify the Board in
writing prior to the hearing or orally at
the hearing.

This hearing is an adversary procee-
ding. Any person has the right to be
present or to be represented by a
lawyer. These and other due process
rights will be forfeited if they are not
exercised at the hearing. Decisions of
the Board may be appealed to the
Circuit Court and the State Supreme
Court as provided by law.

Any handicapped person wishing to
attend this hearing can contact the
Water Rights Division, DWNR, Joe
Foss Building, Pierre, S.D., prior to
the hearing date for assistance to assure
access to the hearing.

For the Water Management Board
Betty Westlund
Water Rights Specialist



PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County EDMUNDS) ss.

I, J.A. MORLOCK hereby

certify that the annexed printed copy of Notice of Intent to Appropriate

Water was taken from the IPSWICH TRIBUNE

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the

Ipswich Tribune of Ipswich, SD

County of EDMUNDS and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

October 27, 1982

November 2, 1982



(Signature)

Publisher

(Title)

Nov. 2, 1982

(Date Signed)

Cost of Printing: 26.52

Twenty Six dollars and fifty two cents.

PUBLIC NOTICE

NOTICE OF HEARING ON
APPLICATION TO
APPROPRIATE WATER

Pierre, South Dakota 57501
October 19, 1982

Notice is hereby given the WEB Water Development Assoc., Inc. whose post office address is Box 1911, Aberdeen, South Dakota, has made an application in accordance with the provisions of SDCL 46-1-1 through 46-1-9; 46-1-12 through 46-1-14; 46-2-9 through 46-2-11, 46-2-13; 46-5-1 through 46-5-8, 46-5-10 through 46-5-22, 46-5-25, 46-5-41 and Board Rules ARSD 74:02:01:01 through 74:02:01:15, from a Future use permit to appropriate for beneficial use 15.00 (peak) cubic feet of water per second of time (7500 acre feet annually) from the Missouri River through the WEB Rural Water Development Project, the point of diversion which is to be located in the SE $\frac{1}{4}$ SE $\frac{1}{4}$ of Section 32, Twp. 123N, Range 78W. Said water to be used for purpose of providing water supplies for a Rural Water System.


This Application No. 4930-3 will be considered by the Water Management Board at the Sheraton Inn, Dakota Room, Aberdeen, S.D. upon the 9th day of December, 1982 at 10 a.m. The Board is authorized to make a determination of this application at the hearing. All interested persons may appear and be heard. Any person who may be affected by a Board decision who desires to present evidence or cross-examine witnesses according to SDCL 1-26 may notify the Board in writing prior to the hearing or orally at the hearing.

This hearing is an adversary proceeding. Any person has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any handicapped person wishing to attend this hearing can contact the Water Rights Division, DWNr, Joe Foss Building, Pierre, S.D., prior to the hearing date for assistance to assure access to the hearing.

For the Water Management Board
Betty Westlund,
Water Rights Specialist

T-43



PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County Spink) ss.

I, Roger Matz hereby

certify that the annexed printed copy of Notice of Intent to Appropriate

Water was taken from the Redfield Press

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the _____

City of Redfield

County of Redfield and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

October 27 & November 3

Roger Matz
(Signature)

publisher
(Title)

11-3-82
(Date Signed)

Cost of Printing: 21.72

No. 21

**NOTICE OF HEARING
ON APPLICATION TO
APPROPRIATE WATER**
Pierre, South Dakota 57501


Notice is hereby given that the WEB
Water Development, Inc., whose
post office address is Box 1911, Aber-
deen, South Dakota, has made an ap-
plication in accordance with the
provisions of SDCL 46-1-1 thru 46-1-9;
46-1-12 thru 46-1-13; 46-2-9 thru 46-2-11,
46-2-13; 46-5-1 thru 46-5-3, 46-5-10 thru 46-
5-22, 46-5-25, 46-5-26 and Board Rules
ARSD 74:02:01 thru 74:02:01:15,
from a Future permit to ap-
propriate for beneficial use 15.00 (peak)
cubic feet of water per second of time
(7500 acre feet annually) from the
Missouri River through the Web Rural
Water Development project, the point
of diversion which is located in the
SE $\frac{1}{4}$ SE $\frac{1}{4}$ of Section 32, Twp. 123N,
Range 78W. Said water to be used for
purpose of providing water supplies for
a Rural Water System.

This application No. 4930-3 will be
considered by the Water Management
Board at the Statton Inn, Dakota
Room, Aberdeen upon the 9th day
of December, 1982 at 10 A.M. The Board
is authorized to make a determination
on this application at the hearing. All
interested persons may appear and be
heard. Any person who may be affected
by a Board decision who desires to
present evidence or cross-examine wit-
nesses according to SDCL 1-26 may
notify the Board in writing prior to the
hearing or orally at the hearing.

This hearing is an adversary
proceeding. Any person has the right to
be present or to be represented by a
lawyer. These and other due process
rights will be forfeited if they are not
exercised at the hearing. Decisions of
the Board may be appealed to the Cir-
cuit Court and then to the Supreme Court
as provided by law.

Any handicapped person wishing to
attend this hearing can contact the
Water Rights Division, DWNR, Joe
Foss Building, Pierre, SD., prior to the
hearing date for assistance to assure
access to the hearing.

For the Water Management Board
Betty Westlund
Water Rights Specialist
(Oct. 27, Nov. 3)



AFFIDAVIT OF PUBLICATION

County of Day
State of South Dakota,


ss.

Larry Ingalls, of said county and state being duly sworn on oath, says: That the Reporter and Farmer is a legal weekly newspaper of general circulation, and an official newspaper as required by Session Laws of 1893, printed and published in Webster, in said county and state, by the Day County Printing Company and has been such newspaper during the time hereinafter mentioned, that I, Larry Ingalls, the undersigned, am editor of said newspaper, and have personal knowledge of all facts stated in this affidavit and that the advertisement headed

Notice of hearing on application
to appropriate water

a printed copy of which is hereunto attached, was printed and published in the said newspaper two successive and complete issues as follows:

First Publication	<u>October 27</u>	<u>19 82</u>
Second Publication	<u>November 3</u>	<u>19 82</u>
Third Publication		<u>19</u>
Fourth Publication		<u>19</u>
Fifth Publication		<u>19</u>
Sixth Publication		<u>19</u>
Seventh Publication		<u>19</u>



That the full amount of fees for publication of the annexed notice is \$ 21.78 and inures solely to the Reporter and Farmer, published by the Day County Printing Company, that no arrangement or understanding for a division thereof has been made with any other person, and that no part thereof has been agreed to be paid any person whomsoever.

Larry Ingalls

Subscribed and sworn to before me this 3rd
day of November 19 82

Orvilla Syverson
Notary Public, Day County, South Dakota.

ORVILLA SYVERSON
Notary Public, Day County, S. Dak.
My Commission expires May 1, 1988

Application

(First Oct. 27)
NOTICE OF HEARING
ON APPLICATION TO
APPROPRIATE WATER

Pierre, South Dakota 57501
October 19, 1982

Notice is hereby given the WEB Water Development Assoc., Inc. whose post office address is Box 1911, Aberdeen, South Dakota, has made an application in accordance with the provisions of SDCL 46-1-1 thru 46-1-9; 46-1-12 thru 46-1-14; 46-2-9 thru 46-2-11, 46-2-13; 46-5-1 thru 46-5-8, 46-5-10 thru 46-5-22, 46-5-25, 46-5-41 and Board Rules ARSD 74:02:01:01 thru 74:02:01:15, from a future use permit to appropriate for beneficial use 15.00 (peak) cubic feet of water per second of time (7,500 acre feet annually) from the Missouri River through the WEB Rural Water Development Project, the point of diversion which is to be located in the SESE 1/4 of Section 32, Twp. 123N, Range 78W. Said water to be used for purpose of providing water supplies for a Rural Water System.

This Application No. 4930-3 will be considered by the Water Management Board at the Sheraton Inn, Dakota Room, Aberdeen, S.D. upon the 9th day of December, 1982 at 10 A.M. The Board is authorized to make a determination on this application at the hearing. All interested persons may appear and be heard. Any person who may be affected by a Board decision who desires to present evidence or cross-examine witnesses according to SDCL 1-26 may

notify the Board in writing prior to the hearing or orally at the hearing.

This hearing is an adversary proceeding. Any person has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing. Decision of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any handicapped person wishing to attend this hearing can contact the Water Rights Division, DWNR, Joe Foss Building, Pierre, S.D., prior to the hearing date for assistance to assure access to the hearing.

For the Water Management Board

Betty Westlund,
Water Rights Specialist
(Last Nov. 8)

In Court
Day County, S. D.

Affidavit of Publication

Filed in the Office of

on the day of

Attorney for



No. 4930-3

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County Hand) ss.

I, Robert H. McFarlane hereby

certify that the annexed printed copy of Notice of Intent to Appropriate

Water was taken from the The Miller Press

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the _____

Miller Press of Miller

County of _____ and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

October 28, 1982

November 4, 1982

Robert H. McFarlane
(Signature)

Publisher
(Title)

November 4, 1982
(Date Signed)

Cost of Printing: 72 lines
@ .165

First insertion 11.88

Second insertion 9.50

Total -- \$21.38

No. 4930-3

**NOTICE OF HEARING ON
APPLICATION TO
APPROPRIATE WATER**
Pierre, South Dakota 57501
October 19, 1982


Notice is hereby given the
WEB Water Development
Assoc., Inc., whose post office
address is Box 1911, Aberdeen,
South Dakota, has made an ap-
plication in accordance with the
provisions of SDCL 46-1-1 thru
46-1-9; 46-1-12 thru 46-1-14; 46-2-9
thru 46-2-11, 46-2-13; 46-5-1 thru
46-5-8, 46-5-10 thru 46-5-22, 46-5-
25, 46-5-41 and Board Rules
ARSD 74:02:01:01 thru
74:02:01:15, from a Future use
permit to appropriate for
beneficial use 15.00 (peak)
cubic feet of water per second of
time (7500 acre feet annually)
from the Missouri River
through the WEB Rural Water
Development Project, the point
of diversion which is to be
located in the SE $\frac{1}{4}$ SE $\frac{1}{4}$ of Sec-
tion 32, Twp. 123N, Range 78W.
Said water to be used for pur-
pose of providing water sup-
plies for a Rural Water System.

This Application No. 4930-3
will be considered by the Water
Management Board at the
Sheraton Inn, Dakota Room,
Aberdeen, SD upon the 9th day
of December, 1982 at 10 A.M.
The Board is authorized to
make a determination on this
application at the hearing. All
interested persons may appear
and be heard. Any person who
may be affected by a Board
decision who desires to present
evidence or cross-examine wit-
nesses according to SDCL 1-26
may notify the Board in writing
prior to the hearing or orally at
the hearing.

This hearing is an adversary
proceeding. Any person has the
right to be present or to be
represented by a lawyer. These
and other due process rights
will be forfeited if they are not
exercised at the hearing. Deci-
sions of the Board may be ap-
pealed to the Circuit Court and
the State Supreme Court as
provided by law.

Any handicapped person
wishing to attend this hearing
can contact the Water Rights
Division, DWNr, Joe Foss
Building, Pierre, SD, prior to
the hearing date for assistance
to assure access to the hearing.


For the Water Management
Board
BETTY WESTLUND,
Water Rights Specialist



Affidavit of Publication

STATE OF SOUTH DAKOTA
COUNTY OF WALWORTH

ss:



I, Cindi K. Volk,
being first duly sworn under oath say: The Mobridge Trib-
une is a legal weekly newspaper of general circulation as
required by South Dakota Code of Nineteen Hundred
Thirty-Nine, and any acts amendatory thereto, printed
and published by the Bridge City Publishing Co., in Mo-
bridge, in said county and state, and has been such legal
newspaper during the time hereinafter mentioned; that
during all of said time as an employee of said
newspaper I have had
stated in this affidavit;

Notice of hearing
appropriate water

SD Dept of Natur
a printed copy of which

and published in said r

successive weeks upon th

October 27, 1982

November 3, 1982

that the full amount of t

the same to-wit: the sum
inures solely to the bene
newspaper; that no agree
division of this sum has be
and that no part of said s
to any person whomsoever

WEB water use application to be considered Dec. 9

NOTICE OF HEARING ON APPLICATION TO APPROPRIATE WATER

Pierre, South Dakota 57501
October 19, 1982

Notice is hereby given the WEB Water
Development Assoc., Inc. whose post office
address is Box 1911, Aberdeen, South
Dakota, has made an application in
accordance with the provisions of SDCL
46-1-1 thru 46-1-9; 46-1-12 thru 46-1-14; 46-2-9
thru 46-2-11, 46-2-13; 46-5-1 thru 46-5-8, 46-5-10
thru 46-5-22, 46-5-25, 46-5-41 and Board Rules
ARSD 74:02:01:01 thru 74:02:01:15, from a
Future use permit to appropriate for
beneficial use 15.00 (peak) cubic feet of
water by second of time (7500 acre feet
annually) from the Missouri River through
the WEB Rural Water Development Project,
the point of diversion which is to be located in
the SE 1/4 SE 1/4 of Section 32, Twp. 123N,
Range 78W. Said water to be used for
purpose of providing water supplies for a
Rural Water System.

This Application No. 4930-3 will be
considered by the Water Management Board
at the Sheraton Inn, Dakota Room,

Aberdeen, SD, on the 9th day of
December, 1982, at 10 A.M. The Board is
authorized to make a determination on this
application. All interested
persons may appear and be heard. Any
person who may be affected by a Board
decision who desires to present evidence or
cross-examine witnesses according to SDCL
1-26 may notify the Board in writing prior to
the hearing or on the day of the hearing.

This hearing is an adversarial proceeding.
Any person has the right to present or to
be represented by a lawyer. These and other
due process rights will be forfeited if they are
not exercised at the hearing. Decisions of the
Board may be appealed to the Circuit Court
and the State Supreme Court as provided by
law.

Any handicapped person wishing to attend
this hearing can contact the Water Rights
Division, DWNR, Pierre, SD, for assistance
to assure access to the hearing.


For the Water Management Board
Betty Westlund,
Water Rights Specialist

-1027-113

Subscribed and sworn to before me this 4
day of Nov., 1982

(Seal)

52/lines @ 23.59 first week
80% for following week
8 point, 15 pica



Form 8 - Proof of Publication - Notice of
Intent to Appropriate Water

No. _____

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County Clark) ss.

I, Bert Moritz hereby

certify that the annexed printed copy of Notice of Intent to Appropriate

Water was taken from the Clark County Courier

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the _____

Clark Town of Clark

County of Clark and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

October 28, 1982

November 4, 1982


Bert Moritz
(Signature)

publisher
(Title)

11/12/82
(Date Signed)

Cost of Printing: \$21.40

2 times
58 lines



NOTICE OF HEARING ON
APPLICATION TO APPROPRIATE
WATER

Pierre, South Dakota 57501

October 19, 1982

Notice is hereby given the WEB Water Development Assoc., Inc. whose post office address is Box 1911, Aberdeen, South Dakota, has made an application in accordance with the provisions of SDCL 46-1-1 thru 46-1-9; 46-1-12 thru 46-1-14; 46-2-9 thru 46-2-11; 46-2-13; 46-5-1 thru 46-5-8, 46-5-10 thru 46-5-22, 46-5-25, 46-5-41 and Board Rules ARSD 74:02:01:01 thru 74:02:01:15, from a Future use permit to appropriate for beneficial use 15.00 (peak) cubic feet of water per second of time (7500 acre feet annually) from the Missouri River through the WEB Rural Water Development Project, the point of diversion which is to be located in the SE 1/4 SE 1/4 of Section 32, Twp. 123N, Range 78W. Said water to be used for purpose of providing water supplies for a Rural Water System.

This Application No. 4930-3 will be considered by the Water Management Board at the Sheraton Inn, Dakota Room, Aberdeen, SD upon the 9th day of December, 1982 at 10 a.m. The Board is authorized to make a determination on this application at the hearing. All interested persons may appear and be heard. Any person who may be affected by a Board decision who desires to present evidence or cross-examine witnesses according to SDCL 1-26 may notify the Board in writing prior to the hearing or orally at the hearing.

This hearing is an adversary proceeding. Any person has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any handicapped person wishing to attend this hearing can contact the Water Rights Division, DWNr, Joe Foss Building, Pierre SD, prior to the hearing date for assistance to assure access to the hearing.

For the Water Management Board
Betty Westlund,
Water Rights Specialist

10/28/82

AFFIDAVIT OF PUBLICATION

STATE OF SOUTH DAKOTA

COUNTY OF BROWN

SS.

Lori Moltner BEING DULY SWORN, ON HIS OATH SAYS:

That the ABERDEEN AMERICAN NEWS is a DAILY newspaper of general circulation, printed and published in Aberdeen, Brown County, South Dakota, by the Aberdeen News Company, a corporation, and has been such a newspaper during the times hereinafter mentioned, that affiant is an employee and principal clerk of said publisher and has personal knowledge of all the facts stated in this affidavit; that the advertisement headed Notice of appropriate Water

a printed copy of which is hereunto attached, was printed and published in the regular and entire issue of said newspaper, and not in a supplement thereof, once each week for 2 successive weeks.
The first publication being made on the 12th day of Nov 1982
The second publication being made on the day of
The third publication being made on the day of
The fourth publication being made on the day of
The fifth publication being made on the day of
The sixth publication being made on the day of
The seventh publication being made on the day of
The eighth publication being made on the day of
The ninth publication being made on the day of

That said newspaper is a legal newspaper, being published five days or more each week, having a bona fide circulation of more than two hundred copies daily, having been published in the English language within the said County of Brown for more than one year next prior to the first publication of said notice, and is printed in whole in an office maintained at the place of publication of said newspaper. That the whole amount of the fee paid for the publication of the annexed notice is \$ 33.50, which inures solely to the benefit of said publisher; that no agreement or understanding for a division thereof has been made with any other person, and that no part thereof has been agreed to be paid to any person whomsoever.

Lori Moltner

Subscribed and sworn to before me this 12th day of

Nov 19 82

Ella Jaaska

Notary Public, Brown County, S. D.

My commission expires 7-13-87

daily circulation 21,005

(No. 532—Nov. 5, 12—2T)
NOTICE OF HEARING
ON APPLICATION TO
APPROPRIATE WATER
Pierre, South Dakota 57501
October 19, 1982

Notice is hereby given the WEB Water Development Assoc., Inc. whose post office address is Box 1911, Aberdeen, South Dakota, has made an application in accordance with the provisions of SDCL 46-1-1 thru 46-1-9; 46-1-12 thru 46-1-14; 46-2-1 thru 46-2-11; 46-2-13; 46-5-1 thru 46-5-8; 46-5-10 thru 46-5-22; 46-5-25; 46-5-41 and Board Rules ARSD 74:02:01:01 thru 74:02:01:15, from a future use permit to appropriate for beneficial use 15.00 (peak) cubic feet of water per second of time (7500 acre feet annually) from the Missouri River through the WEB Rural Water Development Project, the point of diversion which is to be located in the SE¼ SE¼ of Section 32, Twp. 123N, Range 78W. Said water to be used for purpose of providing water supplies for a Rural Water System.

This Application No. 4930-3 will be considered by the Water Management Board at the Sheraton Inn, Dakota Room, Aberdeen, SD upon the 9th day of December, 1982 at 10 A.M. The Board is authorized to make a determination on this application at the hearing. All interested persons may appear and be heard. Any person who may be affected by a Board decision who desires to present evidence or cross-examine witnesses according to SDCL 1-26 may notify the Board in writing prior to the hearing or orally at the hearing.

This hearing is an adversary proceeding. Any person has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any handicapped person wishing to attend this hearing can contact the Water Rights Division, DWNR, Joe Foss Building, Pierre SD, prior to the hearing date for assistance to assure access to the hearing.


For the Water Management Board
BETTY WESTLUND, Water Rights Specialist

Pub

Received Payment,

Aberdeen News Co.

By



STATE OF SOUTH DAKOTA
COUNTY OF BROWN

IN _____ COURT

Affidavit of Publication

Filed in the office of _____

on the _____ day of _____

19_____

Attorney for _____

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County Beadle) ss.

I, June La Fee hereby

certify that the annexed printed copy of Notice of Intent to Appropriate

Water was taken from the Huron Daily Plainsman

A newspaper which during the whole time of publication of said notice herein after stated, has been and is printed and published in the _____

City of Huron

County of Beadle and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

November 5, 1982

November 12, 1982

Jane LaFee.
(Signature)

Bookkeeper.
(Title)

11-12-82.
(Date Signed)

Cost of Printing: \$ 41.30.

7-10-82 42-95-41-30
11-12-82
**NOTICE OF HEARING
ON APPLICATION TO
APPROPRIATE WATER**
Pierre, South Dakota 57501
October 19, 1982

Notice is hereby given the
WEB Water Development
Assoc., Inc., whose post office
address is Box 1911, Aberdeen,
South Dakota, has made an
application in accordance with
the provisions of SDCL 46-1-1
thru 46-1-12 thru 46-1-14;
46-2-9 thru 46-2-11, 46-2-13; 46-5-1
thru 46-5-8, 46-5-10 thru 46-5-22,
46-5-24, 46-5-41 and Board Rules
ARSD 74-02:01:01 thru
74-02:01:15, from a future use
permit to appropriate for bene-
ficial use 15.00 (peak) cubic feet
of water per second of time
(7500 acre feet annually) from
the Missouri River through the
WEB Rural Water Development
Project, the point of diversion
which is to be located in the
SE 1/4 SE 1/4 of Section 32, Twp.
123N, Range 78W. Said water to
be used for purpose of providing
water supplies for a Rural
Water System.

This Application No. 4930-3
will be considered by the Water
Management Board at the
Sheraton Inn, Dakota Room,
Aberdeen SD upon the 9th day of
December, 1982, at 10 A.M. The
Board is authorized to make a
determination on this appli-
cation at the hearing. All inter-
ested persons may appear
and be heard. Any person who
may be affected by a Board
decision who desires to present
evidence or cross-examine wit-
nesses according to SDCL 1-26
may notify the Board in writing
prior to the hearing or orally at
the hearing.

This hearing is an adversary
proceeding. Any person has the
right to be present or to be rep-
resented by a lawyer. These and
other due process rights will be
forfeited if they are not exer-
cised at the hearing. Decisions
of the Board may be appealed to
the Circuit Court and the State
Supreme Court as provided by
law.

Any handicapped person
wishing to attend this hearing
can contact the Water Rights
Division, DWNRR, Joe Foss
Building, Pierre SD, prior to the
hearing date for assistance to
assure access to the hearing.

For the
Water Management Board
Betty Westlund
Water Rights Specialist
No. 468 (adv.)



No. 4930-3

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County Campbell) ss.

I, James E Mackay hereby

certify that the annexed printed copy of Notice of Intent to Appropriate

Water was taken from the Prairie Pioneer

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the

Town of Pollock

County of Campbell and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

Nov. 4, 1982

Nov. 11, 1982

James E Mackay
(Signature)

Publisher
(Title)

11/16/82

(Date Signed)

Cost of Printing: 1 1/2 Pica line

66 lines @ .181 = 11.95/1st week

6.15 x 80% = 4.92 2nd week

TOTAL

21.51

No. 4930-3

Notice of Hearing on
Application to Appropriate Water
Pierre, South Dakota 57501
October 19, 1982

Notice is hereby given the WEB
Water Development Assoc., Inc.,
whose post office address is Box
1911, Aberdeen, South Dakota, has
made an application in accordance
with the provisions of SDCL 46-1-1
thru 46-1-9; 46-1-12 thru 46-1-14; 46-
2-9 thru 46-2-11, 46-2-13; 46-5-1 thru
46-5-8, 46-5-10 thru 46-5-22, 46-5-25,
46-5-41 and Board Rules ARSD
74:02:01:01 thru 74:02:01:15, from a
Future use permit to appropriate for
beneficial use 15.00 (peak) cubic
feet of water per second of time
(7500 acre feet annually) from the
Missouri River through the WEB
Rural Water Development Project,
the point of diversion which is to be
located in the SE 1/4 SE 1/4 of Section
32, Twp. 123N, Range 78W. Said
water to be used for purpose of
providing water supplies for a Rural
Water System.

This Application No. 4930-3 will
be considered by the Water
Management Board at the Sheraton
Inn, Dakota Room, Aberdeen, SD,
upon the 9th day of December,
1982, at 10 a.m. The board is
authorized to make a determination
on this application at the hearing.
All interested persons may appear
and be heard. Any person who may
be affected by a Board decision
who desires to present evidence or
cross-examine witnesses according
to SDCL 1-26 may notify the Board
in writing prior to the hearing or
orally at the hearing.

This hearing is an adversary
proceeding. Any person has the
right to be present or to be
represented by a lawyer. These and
other due process rights will be for-
feited if they are not exercised at
the hearing. Decisions of the Board
may be appealed to the Circuit
Court and the State Supreme Court
as provided by law.

Any handicapped person wishing
to attend this hearing can contact
the Water Rights Division, DWNR,
Joe Foss Building, Pierre, SD, prior
to the hearing date for assistance
to assure access to the hearing.

For the Water Management Board
/s/ Betty Westlund
Betty Westlund, Water Rights
Specialist

cc: applicant
WNR-806-2/82

44-45



No. _____

PROOF OF PUBLICATION

Notice of Hearing

STATE OF SOUTH DAKOTA)
) ss.
County McPherson)

ON APPLICATION TO
APPROPRIATE WATER
Pierre, South Dakota 57501
October 19, 1982

I, Monte J. J. J. hereby
certify that the annexed printed copy of Notice of Intent to Appropriate
Water was taken from the McPherson County Herald

Notice is hereby given the
WEB Water Development
Assoc., Inc. whose post office
address is Box 1911, Aberdeen,
South Dakota, has made an
application in accordance with
the provisions of SDCL 46-1-1
thru 46-1-9; 46-1-12 thru
46-1-14; 46-2-9 thru 46-2-11,
46-2-13; 46-5-1 thru 46-5-8,
46-5-10 thru 46-5-22, 46-5-25,
46-5-41 and Board Rules
ARSD 74:02:01:01 thru
74:02:01:15, from a future use
permit to appropriate for
beneficial use 15.00 (peak)
cubic feet of water per second
of time from the Missouri River
(7500 acre feet annually)
through the WEB Rural Water
Development Project, the point
of diversion which is to be
located in the SE 1/4 SE 1/4 of
Section 32, Twp. 123N, Range
18W. Said water to be used for
purpose of providing water
supplies for a Rural Water
System.

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the McPherson County Herald of McPherson

County of Leola, S.D. and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

November 4, 1982

November 11, 1982

This Application No. 4930-3
will be considered by the Water
Management Board at the
Sheraton Inn, Dakota Room,
Aberdeen South Dakota upon
the 9th day of December, 1982,
at 10 a.m. The Board is
authorized to make a determin-
ation on this application at the
hearing. All interested persons
may appear and be heard. Any
person who may be affected by
a Board decision who desires to
present evidence or cross-
examine witnesses according to
SDCL 1-26 may notify the
Board in writing prior to the
hearing or orally at the hearing.


This hearing is an adversary
proceedings. Any person has
the right to be present or to be
represented by a lawyer. These
and other due process rights
will be forfeited if they are not
exercised at the hearing. Deci-
sions of the Board may be
appealed to the Circuit Court
and the State Supreme Court as
provided by law.

Any handicapped person
wishing to attend this hearing
can contact the Water Rights
Division, DWNr, Joe Foss
Building, Pierre, SD, prior to
the hearing date for assistance
to assure access to the hearing.

For the Water
Management Board
Betty Westlund,
Water Rights Specialist
11*4,11

Cost of Printing: \$22.48

for 2 publications



No. 4930-3

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County Potter) ss.

I, Jack L. Stoner hereby

certify that the annexed printed copy of Notice of Intent to Appropriate

Water was taken from the Potter County News

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the _____

_____ city _____ of Hutchinson

County of Potter and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

October 28, 1982
November 4, 1982

Jack L. Stoner
(Signature)

Publisher
(Title)

Dec. 10, 1982
(Date Signed)

Cost of Printing: 22.26

Any handicapped person
wishing to attend this
hearing can contact the
Water Rights Division,
DWNR, Joe Foss Building,
Pierre, S.D., prior to the
hearing date for assistance
to assure access to the
hearing.

For the Water
Management Board
BETTY WESTLUND,
Water Rights
Specialist

(Published in the Potter County
News, October 28 and November 4,
1982.)

NOTICE OF
HEARING ON
APPLICATION TO
APPROPRIATE WATER
Pierre, South Dakota 57501
October 19, 1982

Notice is hereby given the
WEB Water Development
Assoc., Inc. whose post
office address is Box 1911,
Aberdeen, South Dakota,
has made an application in
accordance with the
provisions of SDCL 46-1-1
thru 46-1-9; 46-1-12 thru 46-1-
14; 46-2-9 thru 46-2-11, 46-2-
13; 46-5-1 thru 46-5-8, 46-5-10
thru 46-5-22, 46-5-25, 46-5-41
and Board Rules ARSD
74:02:01:01 thru 74:02:01:15,
from a Future use permit to
appropriate for beneficial
use 15.00 (peak) cubic feet
of the water per second of
time (7500 acre feet annu-
ally)—from the Missouri
River through the WEB
Rural Water Development
Project, the point of the
diversion which is to be
located in the SE $\frac{1}{4}$ SE $\frac{1}{4}$ of
Section 32, Twp. 123N,
Range 78W. Said water to
be used for purpose of
providing: water supplies
for a Rural Water System.

This Application No. 4930-
3 will be considered by the
Water Management Board
at the Sheraton Inn, Dakota
Room, Aberdeen, S.D. upon
the 9th day of December,
1982 at 10 A.M. The Board is
authorized to make a
determination on this ap-
plication at the hearing. All
interested persons may
appear and be heard. Any
person who may be affected
by a Board decision who
desires to present evidence
or cross-examine witnesses
according to SDCL 1-26 may
notify the Board in writing
prior to the hearing or
orally at the hearing.

This hearing is an ad-
versary proceeding. Any
person has the right to be
present or to be represented
by a lawyer. These and
other due process rights will
be forfeited if they are not
exercised at the hearing.
Decisions of the Board may
be appealed to the Circuit
Court and the State
Supreme Court as provided
by law.



Conversation or File Documentation

NAME OF PERSON OR FILE: Web - Bruce McCullom

ADDRESS: COUNTY

DATE: December 3, 1982 TELEPHONE

RE: Web diversion point

COMMENTS:

B McCullom called is the engineer on Web, said the diversion point for the WEB project may be moved due to the footings not being solid enough at the present site. WMB should be informed so they can make allowance on the approval.....

Chief Engineer John Hatch was informed of this

~~need Brown Co & M/Pherson Co (Indians) notices~~

Send notices back 12/13/82 Called Web office informed
Sec. needed affidavits from Brown Co, Potluc,
and M/Pherson Co. papers they will send, will
return their copies when receive affidavits

File in Permit or other file as necessary. Use to document conversations and what the other party was told; why action or decision was made.

NAME: Betty Westlund

4/82 12/14/82

received just copies of Newell's adv. wrote ltr on 15th



Department of Water & Natural Resources

Joe Foss Building
Pierre, South Dakota 57501

Water Rights Division

(605) 773-3352

December 21, 1982

Webb Water Development
Box 1911
Aberdeen, South Dakota 57401

Gentlemen:

Enclosed herewith is your Water Right Permit No. 4930-3 as approved by the Water Management Board authorizing you to construct your water diversion system and apply the water to beneficial use, not exceeding the limits as specified in said Water Right Permit No. 4930-3.


Also enclosed is FORM 10, Notice of Completion of Works and Application of Water to Beneficial Use, which you are to complete and submit to the Water Management Board when you have completed the system and/or have put the water to beneficial use. The Board can then schedule an inspection so that your Certificate of Construction and/or Water License may be issued to you, thus completing your acquisition of a Water Right.

Very truly yours,

JOHN HATCH, Chief Engineer
Water Rights Division

JH:ms

enclosure

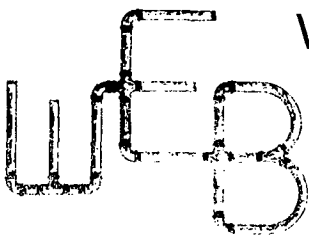

WATER DEVELOPMENT ASSOCIATION INC.

WALWORTH • EDMUNDS • BROWN • DAY • SPINK
CAMPBELL • FAULK • POTTER • McPHERSON

P.O. Box 1911 — 405 South Washington
Aberdeen, South Dakota 57401 — Phone (605) 229-4749

CHAIRMAN

Morris Kurle
Bowdle, SD 57428

VICE-CHAIRMAN

Marland Eldredge
Ashton, SD 57424

SECRETARY

Herb Brandner
Ipswich, SD 57451

TREASURER

Robert Yoder
Aberdeen, SD 57401

DIRECTORS:

Merle Kosters
Selby, SD 57472

Kenneth Brockel
Java, SD 57452

Ed Blank
Roslyn, SD 5761

Orville Baer
Roscoe, SD 57471

Dean Lemburg
Selby, SD 57472

STAFF:

Curt Hohn
Project Coordinator

April 7, 1983

Water Management Board-Water Rights
Department of Water and Natural Resources
Joe Foss Building
Pierre, South Dakota 57501

RE: Water Right Permit 4930-3
Application to Change Diversion Point

Dear Sirs,

Enclosed find our application for change in diversion point for water right permit number 4930-3 for the WEB Pipeline Project. Enclosed also find our check #1129 in the amount of \$50.00 payable to the Department of Water and Natural Resources for processing costs.

If there are any questions with the application please contact us. We would also appreciate being notified of the date the application will be considered. Thank you.


Sincerely,

A handwritten signature in cursive script, appearing to read 'Curt Hohn'.

Curt Hohn, Project Coordinator



cc: Dave Hardan, Boyle Engineering

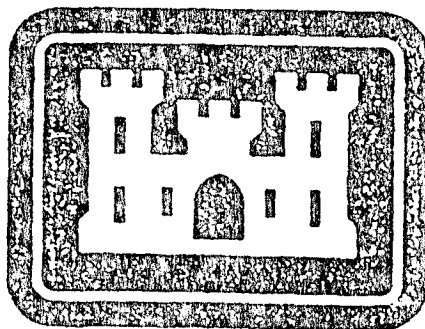

U.S. ARMY ENGINEER DISTRICT, OMAHA
CORPS OF ENGINEERS

THIS STRUCTURE WAS AUTHORIZED BY
PERMIT NO. SD-3-04939



This notice of authorization must be
conspicuously displayed at the site of work.

United States Army Corps of Engineers
Omaha District

September 14, 19 83

A permit to construct a permanent water intake facility in Lake Oahe

at Missouri River Mile 1185.60

has been issued to WEB Water Development
Association, Inc. on Sept. 14, 1983

Address of Permittee PO Box 1911, 422 Fifth Avenue, SE, Aberdeen, SD
57401

Permit Number



SD 2SB OXT 3 004939

District Commander
William R. Andrews, Jr.
Colonel, Corps of Engineers

(BEFORE EXTENSION)

PUMPING STATION

- HORSEPOWER = 1200 (ELECT.)
- PUMPING CAPACITY = 12 CFS
- NUMBER OF UNITS = 4 TO 6

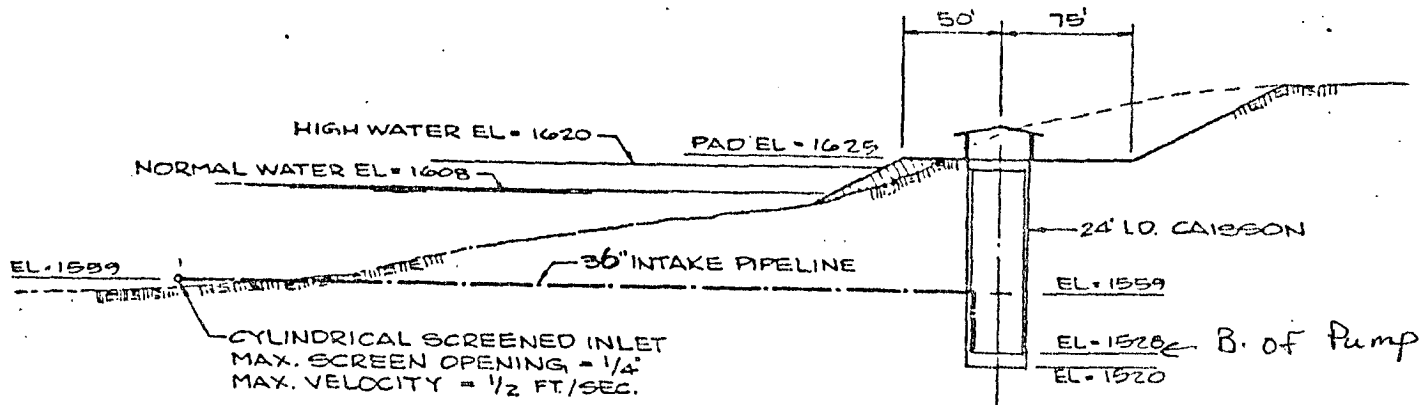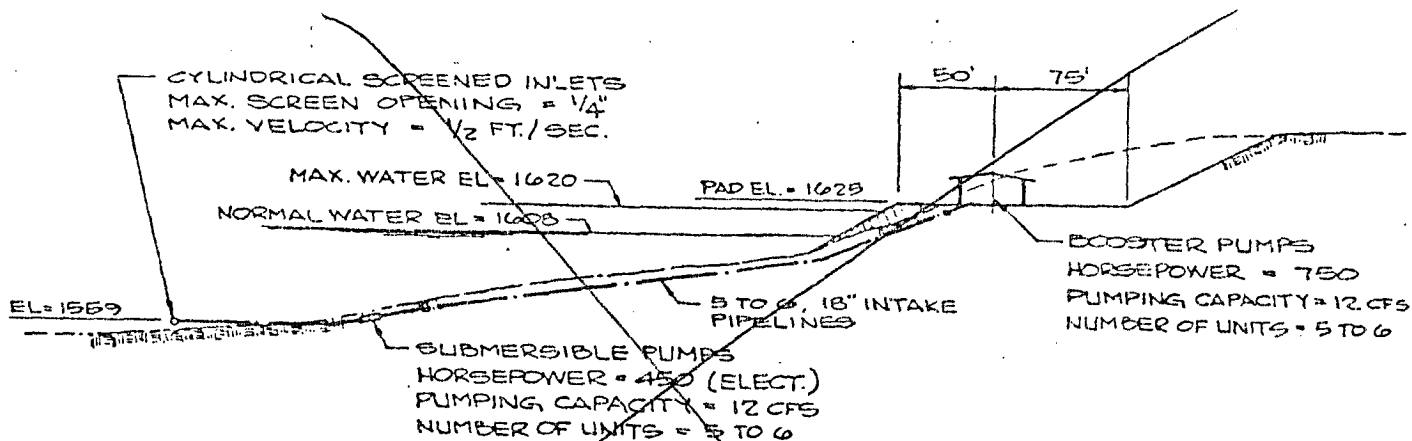ALTERNATE 1ALTERNATE 2NOTE

CUT AND FILL SLOPES, 2:1
FILL SLOPES TO BE RIP-RAPPED

SCALE:
HORIZ. 1" = 100'
VERT. 1" = 100'

**PROPOSED PUMPING STATION
AND PIPELINE**

IN MISSOURI RIVER (LAKE OAKE) 12 MILES
SOUTHEAST OF MOBRIDGE, WALWORTH
COUNTY, SD.

APPLICATION BY:
WEB WATER DEVELOPMENT ASSOCIATION, INC.

DATE: 14 MARCH 1983 (AMENDED)

SHEET 2 OF 2 SHEETS

First 3 pumps MOTOR DATA FOR PUMPS AT INTAKE

PRODUCT



SECTION: 505

PAGE: 4

CUSTOMER NAME Layne & Bowler, Inc.

CUSTOMER ORDER NO. 12027

U.S.E.M. ORDER NO. K1210769 QUANTITY 3 H.P. 200

FRAME 445TP TYPE RU PHASE 3 HERTZ 60

R.P.M. 1800 VOLTS 460 ASSY. POS 3

MARKS: LAKE OAHU RAW WATER PUMPS

FEATURES: 1.15 SF, SRC, GRD LUG IN CD BOX, 130V SPACE HEATING
DESIGN B, CODE G PRIMER ONLY

16 1/2" BD 189774

7322 Upper Bearing

1-11/16" BX 132578

6215 Lower Bearing

Submittal review by Bartlett & Warr Engineering Corporation. Approval is intended to represent only that the submittal has been reviewed for general conformance with the design concept of the project and general compliance with the plans and specifications and shall not be construed as relieving the Contractor of the full responsibility for providing materials, equipment, and work required by the Contract; the proper fitting and execution of the work; accuracy and completeness of the submittal; selecting fabrication processes & techniques of construction; and performing the work in a satisfactory manner.

EXCEPTIONS & CLARIFICATIONS (IF ANY):

[Handwritten signature]

Please correct & resubmit.

Approved, resubmission not required.

Comments, if any, are noted.

BW/BECC, a Joint Venture

By Cab Date 8/18/84

Attn: Ronnie Haynes

**THE MOTOR DRIVE SHAFT
WILL BE 1 1/16" O.D. THREADED
ON BOTTOM END 1 1/2" TO
FIT PUMP SHAFT.**

*C.D. MacDonald
4/12/85*

IF PROPERLY ENDORSED THIS PRINT IS CORRECT
FOR FRAME & ASSEMBLY POSITION INDICATED
BY TWS DATE 6-15-84



VERTICAL MOTORS



DIMENSIONS
L+B 12027

FRAMES 444TP THRU 445TPA -- RU (DRIPPROOF) -- WEATHER PROTECTED TYPE I

PUMP SHAFT, ADJUSTING NUT,
LOCKING SCREWS ARE NOT
FURNISHED WITH MOTOR

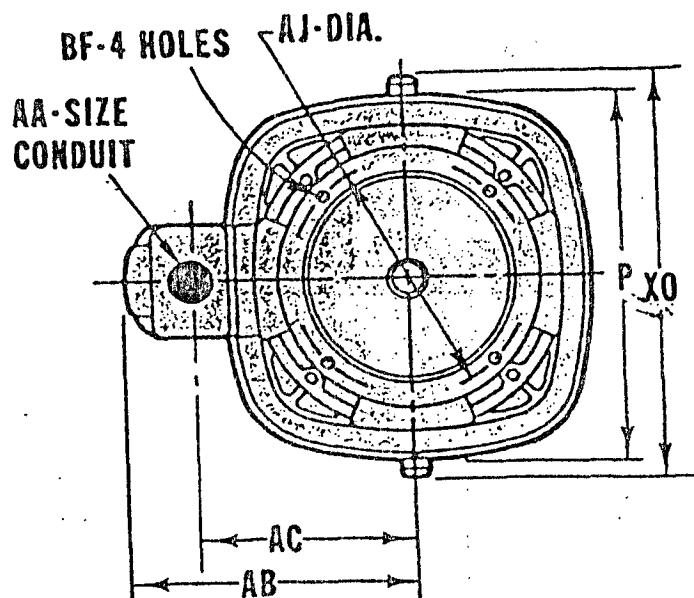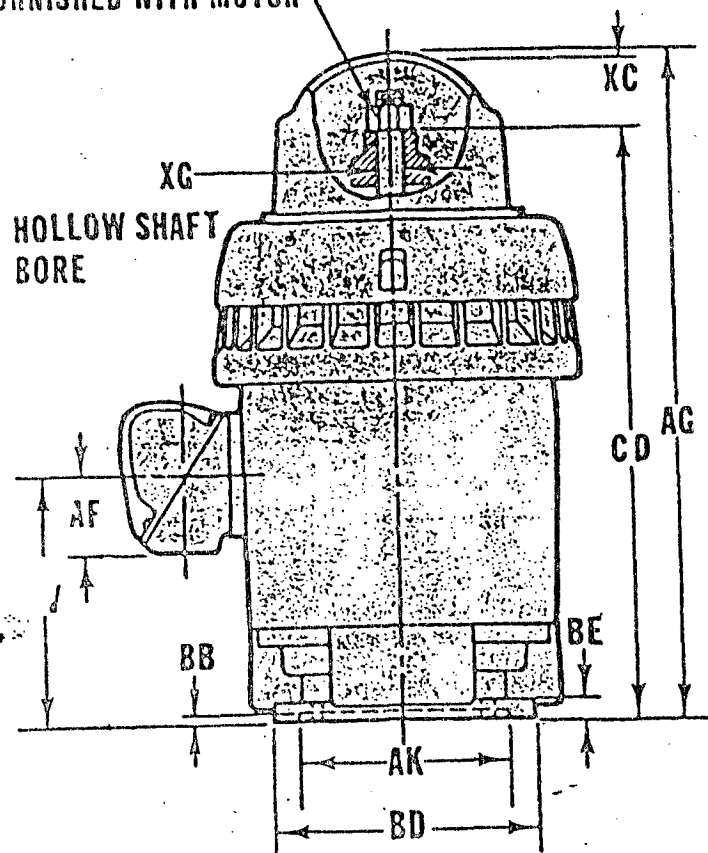

ALL DIMENSIONS ARE IN INCHES

P*	AA	AB	AC	AF	AG	AJ	AK +.005	BB	BE	BF	BV	CD	XC	XG	XO
23-1/8	3	18-1/8	13-7/8	4-7/8	47-23/32	14-3/4	13-1/2	1/4	3/4	11/16	21-5/32	42-21/32	5	2-5/16	25-7/8

FRAME	BD MAX.	BRACKET PART NO.
444, 445TP	16-1/2	189774
444, 445TPA	20	189775

* Largest motor width.

box opening may be located in steps of 90 degrees. Standard as shown with
opening down.

All rough casting dimensions may vary by 1/4" due to casting variations.



TOLERANCES	
Face runout	.007 F.I.R.
Permissible eccentricity of mounting rabbet	.007 F.I.R.

VERTICAL MOTORS



DIMENSIONS
L+B 12027

DRIVE COUPLINGS FOR FRAMES 444 THRU 6810 HOLLOSHAFT MOTORS

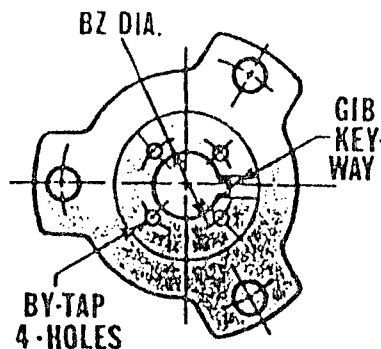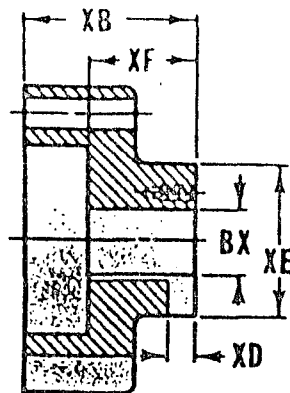

ALL DIMENSIONS ARE IN INCHES

	TYPE	FRAME	PART NUMBER	BX BORE		BY	BZ	XB	XD	XE	XF	SQ. KEY
				NOMINAL	ACTUAL							
	LU	444, 445	118298	1-3/4	1.751	1/4-20	2-1/2	3-13/16	17/32	3-5/8	2-3/4	3/8
	TU	447TP, TPA	118299	1-15/16	1.938	1/4-20	2-1/2	3-13/16	11/16	3-5/8	2-3/4	1/2
	RU	444, 445 TP, TPA	132576	1-7/16	1.437	1/4-20	2-1/8	4	11/16	3-11/16	2-7/8	3/8
			132577	1-1/2	1.501	1/4-20	2-1/8	4	17/32	3-11/16	2-7/8	3/8
			132578	1-11/16	1.687	1/4-20	2-1/2	4	17/32	3-11/16	2-7/8	3/8
			132579	1-15/16	1.937	1/4-20	2-1/2	4	11/16	3-11/16	2-7/8	1/2
			136874	2-3/16	2.188	3/8-16	3-1/4	4	11/16	4	2-7/8	—
			136875	2-1/4	2.250	3/8-16	3-1/4	4	11/16	4	2-7/8	—
			131805	BLANK	.751	—	—	4	—	3-11/16	2-7/8	—
			136876	BLANK	7.51	—	—	4	—	4	2-7/8	—
			129679	1-11/16	1.688	1/4-20	2-1/2	4-3/8	17/32	4-3/4	3-1/16	—
			113288	1-15/16	1.938	1/4-20	2-1/2	4-3/8	11/16	4-3/4	3-1/16	1/2
	EU HU JU	1504, 1505, 1507, A1507, 5005, 5008, 5009, 5108, 5109 P, PH	113287	2-1/8	2.126	3/8-16	3-1/4	4-3/8	11/16	4-3/4	3-1/16	1/2
			113289	2-3/16	2.188	3/8-16	3-1/4	4-3/8	25/32	4-3/4	3-1/16	5/8
			113313	2-3/8	2.376	3/8-16	3-1/4	4-3/8	25/32	4-3/4	3-1/16	5/8
			113290	2-7/16	2.438	3/8-16	3-1/4	4-3/8	25/32	4-3/4	3-1/16	5/8
			113314	2-1/2	2.501	3/8-16	3-1/4	4-3/8	25/32	4-3/4	3-1/16	5/8
			113285	BLANK	.000	—	—	4-3/8	—	4-3/4	3-1/16	—
			143112	2-3/16	2.188	3/8-16	3-1/4	5-1/8	1/2	5	3-5/8	1/2
	EU JU	5805 P	128009	2-3/16	2.188	3/8-16	3-1/4	4-3/8	11/16	4-3/4	3-1/16	1/2
			127376	2-7/16	2.438	3/8-16	3-1/4	4-3/8	25/32	4-3/4	3-1/16	5/8
	EU JU	5807 P	113289	2-3/16	2.188	3/8-16	3-1/4	4-3/8	11/16	4-3/4	3-1/16	1/2
			113290	2-7/16	2.438	3/8-16	3-1/4	4-3/8	25/32	4-3/4	3-1/16	5/8
	HU	1689, 6808, 6809 P, PH	116467	2-11/16	2.688	3/8-16	3-3/4	6-7/16	11/16	8-3/4	4-15/16	5/8
			120592	2-3/4	2.751	3/8-16	3-3/4	6-7/16	11/16	8-3/4	4-15/16	5/8
	HU	6810 P, PA	255753	3-3/16	3.187	3/8-16	5	7-7/8	1	7-5/8	6	7/8
			255609	3-7/16	3.437	3/8-16	5	7-7/8	1	7-5/8	6	7/8
			178611	BLANK	.000	—	—	7-7/8	—	7-5/8	6	—

SPECIAL COUPLING DIMENSIONS

PART NO.	BX BORE		BY	BZ	SQ. KEY SIZE	XB	XD	XE	XF
	NOMINAL	ACTUAL							
	1 11/16								

All tapped holes are unified national coarse, right hand thread.

All rough casting dimensions may vary by 1/4" due to casting variations.

Coupling bore dimension "BX" is machined with a tolerance of $-.000$ " to $+1/12$ " bore inclusive. Larger bores $-.000$ " to $+.002$ ".



U.S. ELECTRICAL MOTORS DIVISION EMERSON ELECTRIC CO.

Printed in U.S.A.



EFFECTIVE: APRIL 24, 1983
SUPERSEDES: Pages 8, 11, 2, 14, and 15

SECTION : 505 TWS 6-15-84
PAGE : 15

DO NOT USE FOR CONSTRUCTION

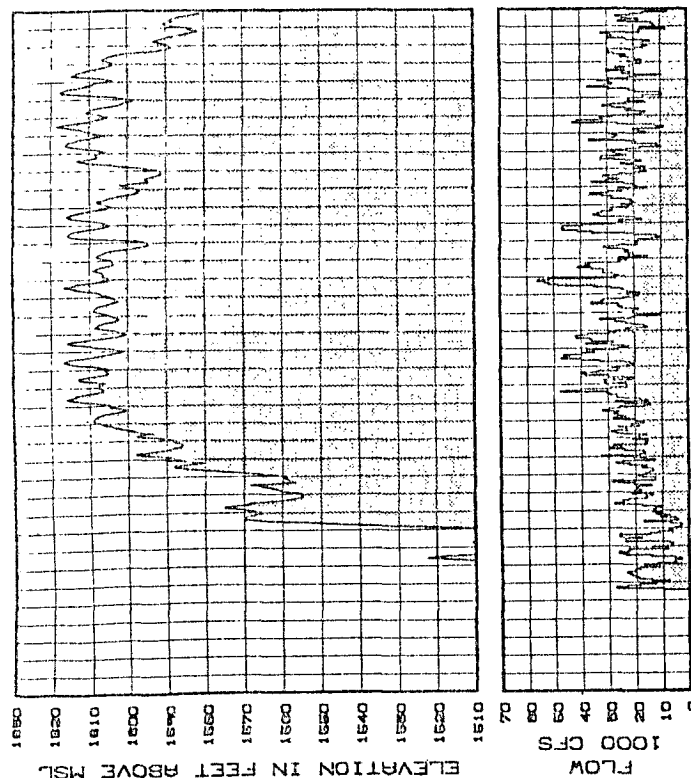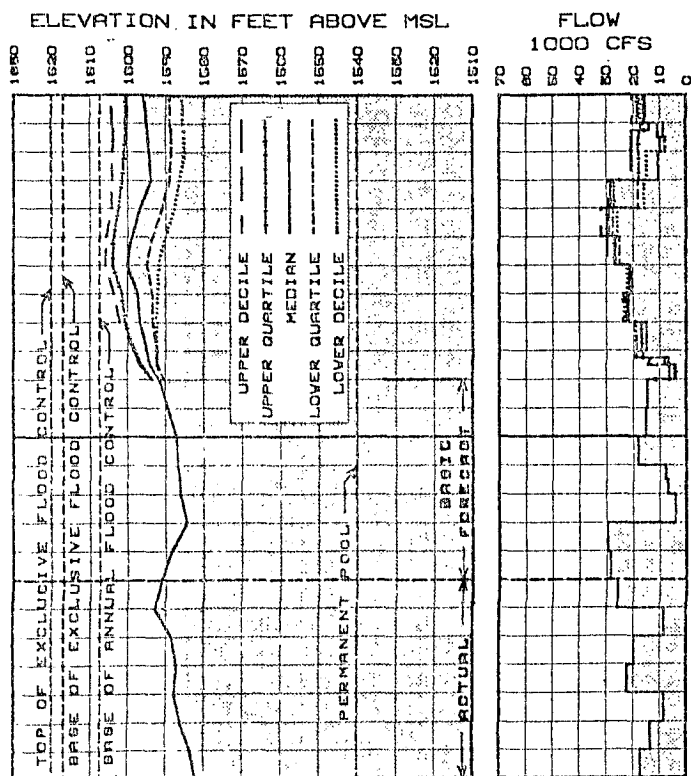

GAH

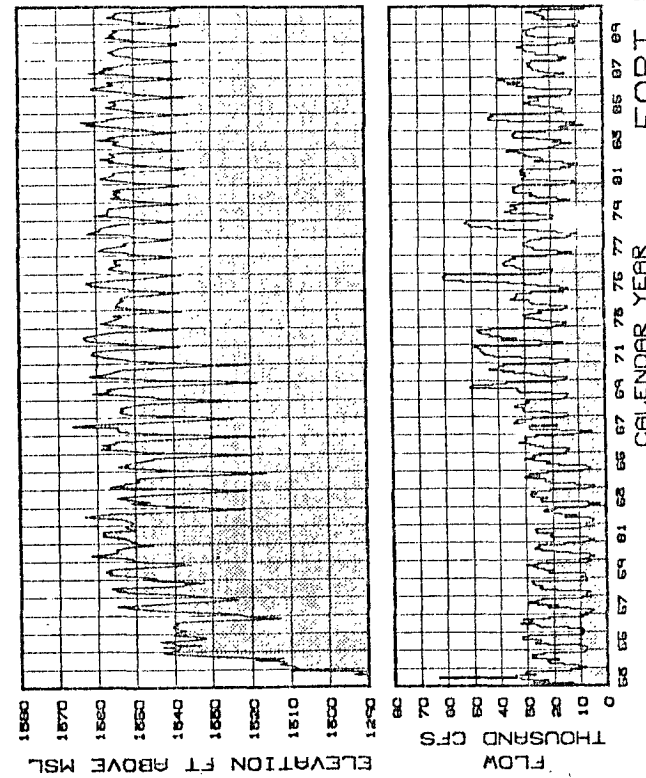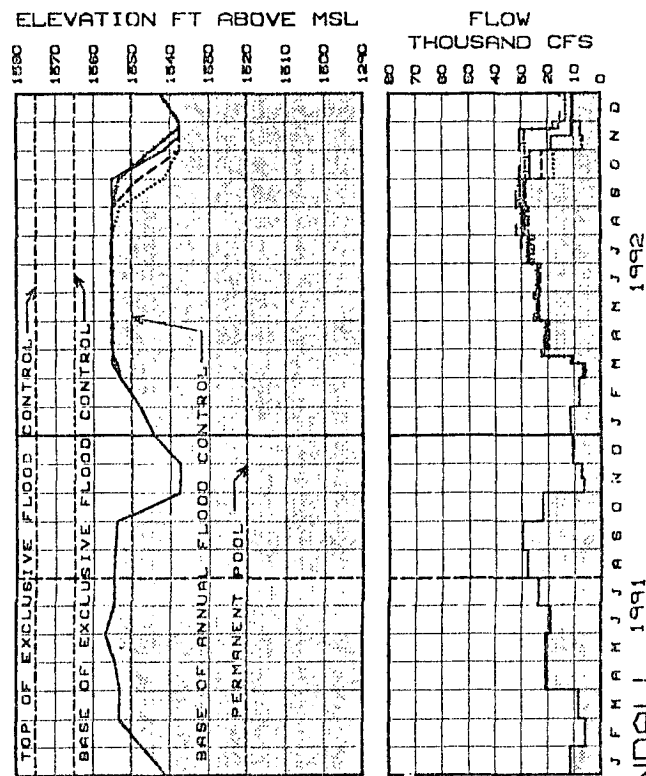

Newer 3 pumps

PERFORMANCE DATA

Customer Layne & Bowler
Quote Number A000-43-47304
P.O. Number 10629
Model No. SK4450P6000
Rating

Horsepower 200
Synchronous RPM 1200
Voltage 460
Phase 3
Frequency 60
Enclosure WP1
Service Factor 1.15
Frame L445

Data

Current	FL Amps	226.0
	LR	1380.9
Code		G
Insulation		B
Temp Rise		90 Degree C @ 1.15
Torque (Ft-Lb)	Rated	883.9
(% FL)	Start	110%
(% FL)	Max	200%
Efficiency	F/L (Nom. /	
	Min. Guar.)	94.5/93.1
	3/4	94.7
	1/2	94.9
Power Factor	F/L	87.5
	3/4	87.9
	1/2	84.3
Full Load RPM		1190
Starts (Cold/Hot)		2/1
Bearings Type		Air
Lubrication		Oil
Water Cool		No
Max. KVAR		39.9

PROVIDE THERMAL PROTECTION
PER SPEC, SECTION 16150.

4930-3

WATER RIGHTS DIVISION
(605) 773-3352

April 8, 1983

WEB Water Development Association
Box 1911
905 South Washington
Aberdeen, South Dakota 57401

ATTENTION: Curt Hohn

Dear Mr. Hohn:

Enclosed please find your check for \$50.00 and your application for a change in diversion point for the WEB project. After I spoke with Boyle Engineering about the change I discovered that permit 4930-3 was approved with the qualification that the diversion point may be moved up to one mile to obtain a suitable location for proper footings and intake structure. Through an oversight in this office this qualification was not put on the final water right approval. I am keeping one copy of the map for our file. I'm sorry if this has been an inconvenience. If you have any further questions please contact this office.

Sincerely,

Kevin C. Larson
Water Resources Engineer

KCL:ms
Enc.

South Dakota Department of
Water & Natural Resources

Joe Foss Building
523 East Capitol
Pierre, South Dakota 57501-3181

March 2, 1989

Willis Nelson
WEB Water Development Assoc., Inc.
Box 51
Aberdeen, SD 57402

Dear Mr. Nelson:

This letter is in reference to our telephone conversation yesterday concerning the water rights permits currently held by WEB Water Development Association.


Upon reviewing our files, it appears you currently hold the following water rights permits:

- (1) # 2671-3 - This is a future use permit, approved on May 20, 1976. It reserves 10,000 acre-feet of water for future use.
- (2) # 3429-3 - This is a future use permit, approved on July 28, 1977. It reserves 20,000 acre-feet of water for future use.
- (3) # 4930-3 - This water right permit was approved on December 9, 1982, for an annual withdrawal of 7500 acre-feet of water. It was deducted from the 10,000 acre-feet of water reserved by Future Use Permit No. 2671-3, leaving 2500 acre-feet of reserved water remaining under this permit.

I am enclosing copies of these permits for your information as well as application forms as you requested.


Feel free to contact us if you have any more questions.

Sincerely,



Susan A. Bowar
Natural Resources Engineer
Water Rights Division
(605) 773-3352

enclosures

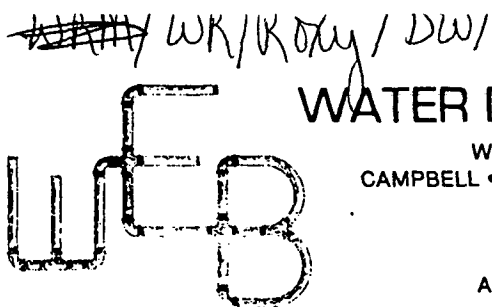

4930-3

WATER DEVELOPMENT ASSOCIATION INC.

WALWORTH • EDMUNDS • BROWN • DAY • SPINK • HAND
CAMPBELL • FAULK • POTTER • McPHERSON • BEADLE • CLARK • MARSHALL
AND EMMONS & DICKEY COUNTY, N.D.

P.O. Box 51 — 806 No. Drive - Auto Plaza
Aberdeen, South Dakota 57402-0051 — Phone (605) 229-4749
TOLL FREE PHONE NUMBER 1-800-233-7832 IN SD

CHAIRMAN

Edwin Fischbach
HCR 1 - Box 43
Mellette, SD 57461
887-3726

VICE-CHAIRMAN

Robert Knickrehm
Rt. 2 - Box 85
Groton, SD 57445
397-8312.

SECRETARY

William D. Johnson
Rt. 1 - Box 26
Stratford, SD 57474
395-6668

TREASURER

Oscar E. Jeschke
HCR 1 - Box 4A
Roscoe, SD 57471
287-4330

DIRECTORS:

Jerome Fuhrmann
RR 2 - Box 273
Onaka, SD 57466
447-5842

Kenneth R. Brockel
RR 1 - Box 18
Java, SD 57452
955-3597

Dean W. Lemburg
RR 1 - Box 16
Selby, SD 57472
649-7804

Oren Ausland
RR 2 - Box 30
Andover, SD 57422
492-3397

Howard "Bill" Thomas
PO Box 117
Conde, SD 57434
382-5936

STAFF:

Arden Wallum
Manager

Les Simon
Accountant

Lyle Schumack
Const. & Operations
Superintendent

Jeff Bonn
Plant Operator

May 22, 1990

Dept. of Water & Nat. Resources
523 East Capitol
Foss Building
Pierre, SD 57501

To Whom it May Concern:

Recent correspondence from your office was sent to the attention of Willis Nelson as Manager of WEB. As of January 17, 1990 Willis Nelson is longer employed by WEB. Please begin sending correspondence to Arden Wallum as the new Manager of WEB Water Development Association, Inc.

Thank you.

Sincerely,

Valerie Simon
WEB Water Development Association, Inc.





Department of Water & Natural Resources

Joe Foss Building
523 East Capitol
Pierre, South Dakota 57501-3181

October 15, 1990

4930-3

Vern Meyer
WEB Water Development Assoc
Box 51
Aberdeen, SD 57402

Dear Mr. Meyer:

Enclosed, as you requested, is a copy of Water Permit No. 4930-3.

During our phone conversation, we discussed the dates specified in the permit for completion of construction and putting the water to beneficial use. SDCL 46-2A-8 states that any construction necessary to put the water to beneficial use shall be completed within five years of approval of the permit and the water shall be put to beneficial use within an additional four years.

The permit states that construction was to be completed on or before December 9, 1987. We realize that a rural water system will always be adding individual users to their system. We would not consider individual hookups to be limited by the December, 1987 completion date.

If you have any questions, please contact me.

Sincerely,

A handwritten signature in cursive script that reads "Genny McMath". The signature is written in dark ink and is positioned above the printed name.

Genny McMath
Natural Resources Analyst
(605) 773-3352

enclosure

Permit No. 4930-3

Missouri River Water District

Report Of Examination Of Works And/Or Application of Water To Beneficial Use

TO: Chief Engineer, Division of Water Rights, DENR, Foss Bldg., Pierre, SD 57501

I have this day made a thorough examination of the water use system constructed by WEB Water Development Association, Inc. of Box 51, Aberdeen, SD 57401 holder of Permit No. 4930-3, bearing the priority of April 6, 1976 authorizing the diversion of 15 cu. ft. per second of the waters of Missouri River for rural water system purposes, in several (div. pt. in Walworth) County.

I have to report on the conditions of the same as follows:

A. Works used to divert the water:

A 100' reinforced concrete wet well 15' in diameter; 1400' of 36" steel intake pipe; 6 Layne Bowler pumps with a 1300 gpm capacity each; 3 US Electric motors, model no. K12110769, 200 hp each and 3 General Electric motors, model no. 5K4450P6006, 200 hp each.

B. Works used to transport water to place of use:

120 miles of mainline transmission lines, 24" and 30" ductile steel. A 15 acre-feet main storage tank and 23 other smaller storage tanks.

C. Works used to apply water to beneficial use:

5200 miles of 12" to 1.5" PVC distribution lines.

The system is in the following condition good. The point of diversion is located 960' S and 1450' W of the NE corner Sec. 32-T123N-R78. The works are capable of diverting and conveying to the place of use 12 cu. ft. per second of water which is to be used for rural water system. Water has been put to beneficial use to the maximum extent as follows:

Rural Water System in the following counties:

Brown, Campbell, Day, Edmunds, Faulk, Hand, Marshall, McPherson, Potter, Spink, Walworth Counties in South Dakota. Dickey and Emons Counties in North Dakota.

The license should be issued for 12 cfs, not to exceed 7500 acre feet annually.

Application permit qualifications have been complied with Y Yes No

Exceptions to compliance are: none Date 5-26-93

Lynn Beck
Natural Resources Engineer III
DENR, Water Rights Division

REPORT ON INSPECTION OF PERMIT NUMBER 4930-3

DATE 5-26-93

Other permit(s) associated with the project none

DIVERSION POINT LEGAL LOCATION: 960' S and 1450' W of the NE corner Sec. 32-123-78 at the Missouri River.

WELL INFORMATION: Well Drilling Firm

No. of Wells 1 Depth(s) wet well 100'

- a) Casing: 1) diameter 15 feet b) Screen: 1) type
2) length 100 feet 2) length feet
3) type reinforced concrete c) Pump 1) make 6-Layne Bowler
d) Static Water Level feet 2) model
e) Motor: 3) size inches
1) make 3-US Electric; 3-Gen. Elec. 4) capacity 1300 each GPM
2) model No. K12110769; 5K4450P6006 5) turbine pump - No. of stages
3) horsepower rating 200 each hp 6) operating pressure PSI

DISTRIBUTION LINES OR CANALS: ~~Intake Pipe~~

- a) type steel b) size 36 inches c) length 1400 feet
a) type steel b) size 30 & 24 inches c) length 120 miles
a) type PVC b) size 12 to 1.5 inches c) length 5200 miles

PERMIT QUALIFICATIONS AND REGULATIONS:

- a) Soil and water permit lands agree with lands being irrigated and lands listed on permit N/A (Y/N)
b) Special qualifications to permit being abided by Y (Y/N)
c) All structures, wells and lands on map Y (Y/N)
d) Irrigation Questionnaires checked to determine if permit owner started irrigation by the end of construction period N/A (Y/N)



DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

June 4, 1993

Jeff Bonn
Web Water Plant
RR 1, Box 60
Selby, SD 57472

Dear Mr. Bonn:

This letter is in reference to our telephone conversation yesterday concerning the water rights permits currently held by WEB Water Development Association.

Upon reviewing our files, it appears you currently hold the following water rights:

- 1.) 2671-3. This is a Future Use Permit, approved on May 20, 1976, with a priority date of April 6, 1976. It reserves 10,000 acre-feet of water for future use.
- 2.) 3429-3. This is a Future Use Permit, approved on July 28, 1977, with a priority date of December 3, 1976. It reserves 20,000 acre-feet of water for future use.
- 3.) 4930-3. This Water Right Permit was approved on December 9, 1982, for an annual withdrawal of 7500 acre-feet of water. It was deducted from the 10,000 acre-feet of water reserved by Future Use Permit No. 2671-3, leaving 2500 acre-feet of reserved water remaining under Permit No. 2671-3.

Copies of these permits are enclosed for your information, as well as application forms should WEB decide to expand their operation.

If you have any questions, please feel free to contact me.

Sincerely,

Lynn Beck
Natural Resource Engineer
Water Rights Division
(605) 773-3352

enclosures



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

July 7, 1993

4930-3

Arden Wallum, Manager
WEB Water Development Association, Inc.
Box 51
Aberdeen, SD 57401

Dear Mr. Wallum:

The inspection of your water use system and the inspection of the extent of application of water to beneficial use, as developed under Water Permit No. 4930-3, has been completed. Your final water right document, the Water License, can now be issued.

Statutes require that we charge a \$50.00 fee for the inspection and issuance of the Water License. Upon receipt of the \$50.00 fee from you, we will begin processing your Water License.

South Dakota Water Law 46-5-30.1 requires that a permit holder may not divert water until the \$50.00 license fee has been paid. Please contact us if you have any questions.

Sincerely,

Cheryl F. Frost
Secretary
Water Rights Division
(605) 773-3352

NOTE: On check or money order, please specify your permit number. This will insure proper handling of the fee.

RECEIPT

413830

Division of Water Rights

South Dakota Department of Environment and Natural Resources

Pierre, _____ July 16, 19 93

RECEIVED OF WEB Water Development Association, Inc., PO Box 51, Aberdeen, SD 57402-0051
the following amount in fees for services rendered as provided for by law:

Fee for Application for Permit No. _____ to Appropriate Water, to construct and to put water to beneficial use _____		
Fee for Application for Permit No. _____ to Appropriate Water, for Future Use _____		
Fee to retain Future Use Permit No. _____ after period of seven years.		
Fee for Inspecting Constructed Works, confirming beneficial use and issuing Water License No. <u>4930-3</u>	50	00
Fee for Filing Transfer Form _____		
Fee for Filing Extension Request _____		
Fee for _____		

(Any Other Work Provided by Law)	Total	50 00

By

Chief Engineer

John Hatfield

Conversation or File Documentation

NAME OF PERSON OR FILE: WEBADDRESS: P.O. Box 51, Aberdeen, SD 57402 COUNTY CO51DATE: 1-7-94 TELEPHONE (605) 229-4749

RE: _____

COMMENTS:

Spoke w/ office personnel, they will send a list of cities and wholesale users to Water Rights.

File in Permit or other file as necessary. Use to document conversations and what the other party was told; why action or decision was made.

NAME: S.B.



Water Development Association Inc

P.O. Box 51 • 806 North Dr. - Auto Plaza
Aberdeen, South Dakota 57402-0051
(605) 229-4749 / 4647

LETTER OF TRANSMITTAL


DATE	JOB NO.
ATTENTION <u>Lyhn Beck</u>	
RE:	

TO Div. of Water Rights

WE ARE SENDING YOU ☐ Attached ☐ Under separate cover via _____ the following items:

- ☐ Shop drawings ☐ Prints ☐ Plans ☐ Samples ☐ Specifications
- ☐ Copy of letter ☐ Change order ☐ _____

COPIES	DATE	NO.	DESCRIPTION
1			List of Bulk Users for WEB

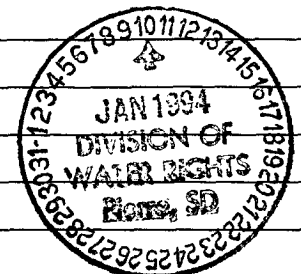

THESE ARE TRANSMITTED as checked below:

- ☐ For approval ☒ As requested ☐ For review and comment
- ☐ For your use ☐ _____

REMARKS If you have any questions please feel
free to call

COPY TO _____

SIGNED: Jerry Blomeke

If enclosures are not as noted, kindly notify us at once.

																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																					</
--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	----

[illegible]

Name	Remote Meter	Meter No.	Test Date	Connect Date	Water Rate	Phone #	Specia. Minimum	County Code	Service Area	Account Location
CA FOLLOCK		12368360	8902 8	86/08	71	F	843.18	001	1	1-5A 6-21B-28-78-01
CA RURAL WATER		3	8908 8	86/08	71	F		001	1	1-5A 7-04D-28-77-01
CA LEOLA		36155486	8608 7	86/08	73	F	122.00	001	1	1-5A 15-17A-26-78-01
WL GLENHAM		34403514	8607 8	86/08	73	F	543.75	001	1	1-5A 28-28A-24-78-01
WL SELBY		1236837	8707 8	86/09	71	F	898.00	001	1	1-5B 30-33C-24-76-01
CO HOSMER		42214407	8908 8	87/01	71	F	202.00	001	1	2-2A 14-12B-24-72-01
CO BOWDLE		1396724	9304 8	93/04	71	F	605-285-6350	001	1	2-2A 26-28A-23-73-03
CO ROSCOE		36310690	9209 8	86/11	71	F	183.00	001	1	2-2A 29-19C-23-70-01
FA DNACA	692503	1257391	8709 8	87/10	73	F	605-447-5809	001	1	2-2B 45-24C-20-72-01
FA WECOTA		36155480	8610 7	86/10	73	F	94.00	001	1	2-2B 53-35B-20-69-01
FA TOWN OF	40273	42378743	9202 7	92/02	71	F	605-436-6791	001	1	2-2B 59-03C-18-72-01
FA FAULKTON		125080610	9103 8	86/10	71	F	605-598-6515	001	1	2-2B 63-14B-18-69-01
EL HUTTERIAN	39987	434720410	9207 7	91/10	71	F	605-426-6518	001	1	3-2A 8-14C-22-68-01
LA CRESBARD		35826374	9309 8	87/01	71	F	293.00	001	1	3-2A 22-31A-20-67-01
LA CHELSEA	3565150	36369524	9106 7	87/02	73	F	605-887-3244	001	1	3-2A 24-35A-20-66-01
LA COLONY	365169	43471882	9205 7	87/12	71	F	605-358-8621	001	1	3-2B 3-14B-28-67-01
LA LEOLA		1171675	8711 8	87/11	71	F	935.00	001	1	3-2B 17-17D-26-67-02
ED COLONY	641898	68971228	8711 7	87/12	71	F	605-439-3455	001	1	3-2B 27-03B-24-67-01
ED WETONKA	899919	45468369	9309 7	87/12	73	F	53.00	001	1	3-2B 28-22D-25-66-01
ED IPSWICH		12258370	9206 8	86/12	71	F	605-426-6961	001	1	3-2B 35-27B-23-68-01
ED FORBES	139977	43471880	9108 7	91/08	71	F	701-357-7771	001	1	3-2B 41-35D-29-65-01
ED GROTON		1275693	9002 9	88/12	71	F	2548.00	001	1	4-2C 3-19C-23-60-01
ED YOUNG	35300	392412060	9005 7	88/11	71	F	605-887-3243	001	1	4-2D 6-27D-21-63-01
ED MELLETTE		45256144	592 8	88/12	71	F	238.00	001	1	4-2D 11-02A-19-64-01
SCHOOL	880836	392413100	9005 7	88/12	71	F	92.00	001	1	4-2D 11-02A-19-64-02
NORTHVILLE	880846	43992150	9103 7	88/12	71	F	605-887-3471	001	1	4-2D 11-06A-19-64-01
BN VALLEY ESTATES	692454	1257513	8910 8	88/03	73	F	362.50	001	1	4-2E 11-30D-24-64-02
BN HEIGHTS	6892059	36155483	8803 8	88/03	73	F	234.00	001	1	4-2E 12-32D-24-64-07
ED PARTNERS	4598498	45468366	9205 8	93/12	71	F	701-222-0232	001	1	4-2E 12-34C-24-64-01
ED MEADOWS ASSOC.		519100010	8806 8	88/06	73	F	605-225-4941	001	1	4-2E 13-01B-23-64-02
BN HOMEOWNERS		1310792	8908 8	88/04	73	F	605-226-2569	001	1	4-2E 13-33A-24-63-03
ED SANITARY DIST.	692472	1271689	8901 8	87/12	73	F	337.50	001	1	4-2E 16-13C-23-66-01
BN GRAIN FUELS, LP		519120120	9211 8	92/11	71	F	1374.75	001	1	4-2E 20-21A-23-64-09
BN HOMEOWNERS	649698	36155481	8805 8	88/05	73	F	90.63	001	1	4-2E 20-27B-23-64-08
ESTATES	649692	36155479	8805 8	88/05	73	F	50.00	001	1	4-2E 23-20D-23-63-03
BN MANUFACTURING	649706	36155482	8805 8	88/05	73	F	40.63	001	1	4-2E 23-22B-23-63-02
BN ASSOCIATION	692506	519100040	8805 8	88/06	73	F	605-226-0138	001	1	4-2E 23-27A-23-63-02
BN DEVELOPMENT	3918207	82324453	8805 7	88/06	71	F	36.66	001	1	4-2E 24-18D-23-62-02
BN ESTATE		1334220	9209 8	92/06	71	F	605-229-4248	001	1	4-2E 27-26C-23-64-02
ED FREDERICK		1257195	8904 8	88/07	71	F	477.00	001	1	4-2F 12-11B-27-64-01
ED WESTPORT	935344	15208	8807 7	88/07	73	F	381.50	001	1	4-2F 25-11C-25-64-01
ED SANITARY DIST.		12571960	8812 8	88/11	71	F	381.26	001	1	42AB 10-01B-21-64-02
BN STRATFORD	353086	45468367	9307 7	88/12	73	F	187.00	001	1	42AB 11-04C-21-62-01
BN FARMS, INC.	881064	45343227	9109 7	88/11	71	F	605-225-4897	001	1	42AB 14-12C-21-64-01
ED BRISTOL		822451590	9304 8	89/07	71	F	623.00	001	1	5-2A 24-25C-22-58-01
DA HOME OWNERS	370311	45468354	9112 7	91/12	73	F	605-345-3122	001	1	5-2B 25-26D-22-56-02
ED WEBSTER		127539000	9202 8	89/10	71	F	3812.64	001	1	5-2B 25-35B-22-56-01
ED ROSLYN		1310913	8911 8	89/11	71	F	249.00	001	1	5-2C 12-06B-23-55-01
ED GRENVILLE		1310528	8911 8	89/11	73	F	312.50	001	1	5-2C 12-14A-23-55-01
DA BIBLE CAMP	610996	45224685	7	92/06	71	F	605-947-4440	001	1	5-2C 13-15B-23-53-04
ED BRENTFORD		13109120	9201 8	89/10	73	F	284.00	001	1	6-2A 6-32C-20-62-01
ED CONDE		13109110	8912 8	89/12	71	F	348.00	001	1	6-2A 8-31C-20-60-01
ED DOLAND		1306982	8912 8	89/12	71	F	440.00	001	1	6-2B 38-31C-17-60-01
ED COLONY	847860	43167467	9002 7	90/02	71	F	605-532-3142	001	1	6-2B 53-12A-15-60-01
ED COLONY	847566	43167729	8912 7	90/01	71	F	73.32	001	1	6-2B 55-28D-15-60-01

Name	Remove Meter	meter No.	Test Date	A L	Connect Date	Water Rate	F U	Phone #	Special Minimum	County Code	Service Area	C T R	Account Location
SP CENTER		131116300	9305	7	91/05	71	F	605-472-2400	366.60	001		1	6-2C 34-04D-16-64-01
SP REDFIELD		1313868	9012	9	90/12	71	F		6360.51	001		1	6-2C 34-09A-16-64-01
SP GARMAN	987544	38157497	9012	8	90/12	73	F		156.00	001		1	6-2C 43-16B-16-64-02



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

SEP 5 1995

4930-3

Arden Wallum, Manager
WEB Water Development Association, Inc.
P.O. Box 51
Aberdeen, SD 57402-0051

Dear Mr. Wallum:

Enclosed is Water License No. 4930-3 and Receipt No. 413830 for \$50.00 which was assessed for an inspection and issuance of the license. Water License No. 4930-3 is the final document which completes the process of obtaining a water right.

As long as you use the water beneficially, as stated in the Water License, State Water Laws provide that you have a continuing right to use the water.

Very truly yours,

JOHN HATCH, Chief Engineer
Water Rights Division
(605) 773-3352

gm
enclosures

STATE OF SOUTH DAKOTA

WATER LICENSE NO. 4930-3

(1) W E B Water Development Association, Inc., of PO Box 51, Aberdeen, SD 57402-0051 made Application No. 4930-3, October 12, 1982 for a water permit to appropriate 15.0 cubic feet of water per second (not to exceed 7500 acre feet annually) from the Missouri River, Walworth County, South Dakota for rural water system purposes. Permit No. 4930-3, with a priority date of April 6, 1976 (established under Future Use Permit No. 2671-3) was approved December 9, 1982 and issued to the applicant(s) for diversion of water with construction of the described water supply system to be completed on or before December 9, 1987 and for the application to beneficial use of said water on or before December 9, 1991.

(2) It is certified that the applicant has complied with the provisions of South Dakota State Law relating to completion of the construction of the water supply system and is entitled to divert 12.0 cubic feet of water per second (not to exceed 7500 acre feet annually) for beneficial use. The location of the diversion point is 960'S and 1450'W of the NE corner of Section 32, T123N, R78W (NW 1/4 NE 1/4).

(3) The applicant has complied with the provisions of South Dakota State Law relating to the application of water to beneficial use.

The rural water system supplies water to individual users in Brown, Campbell, Day, Edmunds, Faulk, Hand, Marshall, McPherson, Potter, Spink and Walworth Counties in South Dakota and Dickey and Emons Counties in North Dakota.

Bulk users in Brown Co. include: City of Groton, James Young, Pleasant Valley Estates, Richmond Heights, Dakota Partners, Rolling Meadows Assoc., Prairiewood Homeowners, Heartland Grain Fuels LP, Rural Homeowners, Melgaard Estates, Farm Power Manufacturing, Jobee Acres Assoc., Green Acres Developments, Lakeside Estate, City of Frederick, City of Westport, Warner Sanitary District, City of Stratford, Braun Farms, Inc.

Bulk users in Campbell Co. include: Town of Pollock, State Line Rural Water, Little Leola.

Bulk users in Day Co. include: Town of Bristol, Gaiowski Home Owners, City of Webster, Town of Roslyn, Town of Grenville, NE-SO-DAK Bible Camp.

Bulk users in Edmunds Co include: City of Hosmer, City of Bowdle, Town of Roscoe, Pembroke Hutterian, Deerfield Colony, City of Ipswich, Mina Lake Sanitary District.

Bulk users in Faulk Co. include: City of Onaka, Town of Wecota, Town of Seneca, Town of Faulkton, City of Cresbard, City of Chelsea.

Water License No. 4930-3

WEB Water Development Association, Inc.


Page 2

Bulk users in McPherson Co. include: Spring Creek Colony, City of Leola, City of Wetonka.

Bulk users in Spink Co. include: City of Mellette, Northwestern School, City of Northville, Town of Brentford, Town of Conde, Town of Doland, Clark Colony, Hillside Colony, SD Developmental Center, City of Redfield, Maurice Garman.

Bulk users in Walworth Co. include: Town of Glenham, Town of Selby

(4) Pursuant to South Dakota Water Law 46-5-30.1 W E B Water Development Association, Inc., of PO Box 51, Aberdeen, SD 57402-0051 the holder and/or owner of Water Permit No. 4930-3 is issued a license to appropriate water, the right to use 12.0 cubic feet of water per second (not to exceed 7500 acre feet annually) from the Missouri River with a priority date of April 6, 1976 from the location specified in (2) of this license. The water is utilized for rural water system purposes. This license is subject to any limitations or qualifications listed in Water Permit No. 4930-3 and subject to South Dakota State Law.

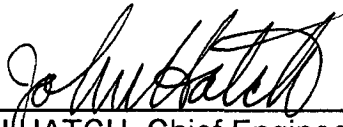

JOHN HATCH, Chief Engineer
Water Rights Division
Department of Environment and Natural Resources

SEP 5 1995

date



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3181
www.state.sd.us/denr

May 20, 1999

4930-3

Curt Hohn, Manager
WEB Water Development Assoc., Inc
PO Box 51
Aberdeen, SD 57402-0051

Dear Mr. Hohn:


Each year, our program contacts rural water systems and municipalities in South Dakota to request annual water use records.

Please send me water use data for the amount of water diverted from the Missouri River in 1998 by the rural water system. The information can be submitted by phone, regular mail, fax or email. Our phone number is (605) 773-3352; our fax number is (605) 773-4068 and my email address is genny.mcmath@state.sd.us.

A request for the 1999 water use data will be mailed out in January 2000. I appreciate any help you could offer and look forward to hearing from you. If you have any questions, please get in touch with me.

Sincerely,

Genny McMath
Environmental Scientist
Water Rights Program
(605) 773-3352



Water Development Association, Inc.

P.O. Box 51 — 38462 US Hwy 12

Aberdeen, SD 57402-0051

(605) 229-4749 • Toll Free: 1-800-658-3957 • FAX: (605) 229-4492

Emergency/After Hours: (605) 229-4749 or 1-800-658-3957

January 5, 2000

Ron Duvall

Department of Environment & Natural Resources

Joe Foss Building

523 East Capitol

Pierre, South Dakota 57501-3181



CHAIRMAN

Arnold Schurr
34671 129th Street
Roscoe, SD 57471
287-4282
(Edmunds & Faulk)

VICE CHAIRMAN

Gary Gilbert
18807 406th Avenue
Carpenter, SD 57322
352-7374
(Spink, Beadle & Hand)

SECRETARY

Brett Anderson
P.O. Box 166
Groton, SD 57445
397-4458
(Municipal at Large)

TREASURER

Milbert Neuharth
503 G Avenue
P.O. Box 576
Eureka, SD 57437
284-2893
(Municipal at Large)

DIRECTORS

James Hendrickson
Rt 1 Box 16
Roslyn, SD 57261
486-4528
(Day, Clark & Marshall)

Jim Moehring
1319 E. 2nd Street
Redfield, SD 57469
472-1250
(Municipal at Large)

Orland Geigle
11350 296th Avenue
Pollock, SD 57648
889-2438
(Campbell, McPherson,
Emmons & Dickey)

Sheila Frey
12558 290th Avenue
Mobridge, SD 57601
762-3280
(Walworth & Potter)

Donna Seaton
13985 391st Avenue
Aberdeen, SD 57401
225-3192
(Brown)

STAFF:

Curt M. Hohn
General Manager

Tom Tollefson
*Water Treatment Plant
& Main Line Supt.*

Dennis Arend
*Rural System Operations
& Construction Supt.*

Dear Mr. Duvall,

This will respond to your letter of December 29, 1999 in which you requested the total amount of water WEB diverted from the Missouri River during calendar years 1999 and 1998. The information you request is shown below as measured by a metering device at the WEB Water Treatment Plant located along the Missouri River near New Evarts;


1998	1,423,400,000 gallons	
1999	1,482,800,000 gallons	- 4,550.6 acft



If additional information is needed, please contact me.

Sincerely,

Curt Hohn

WEB General Manager

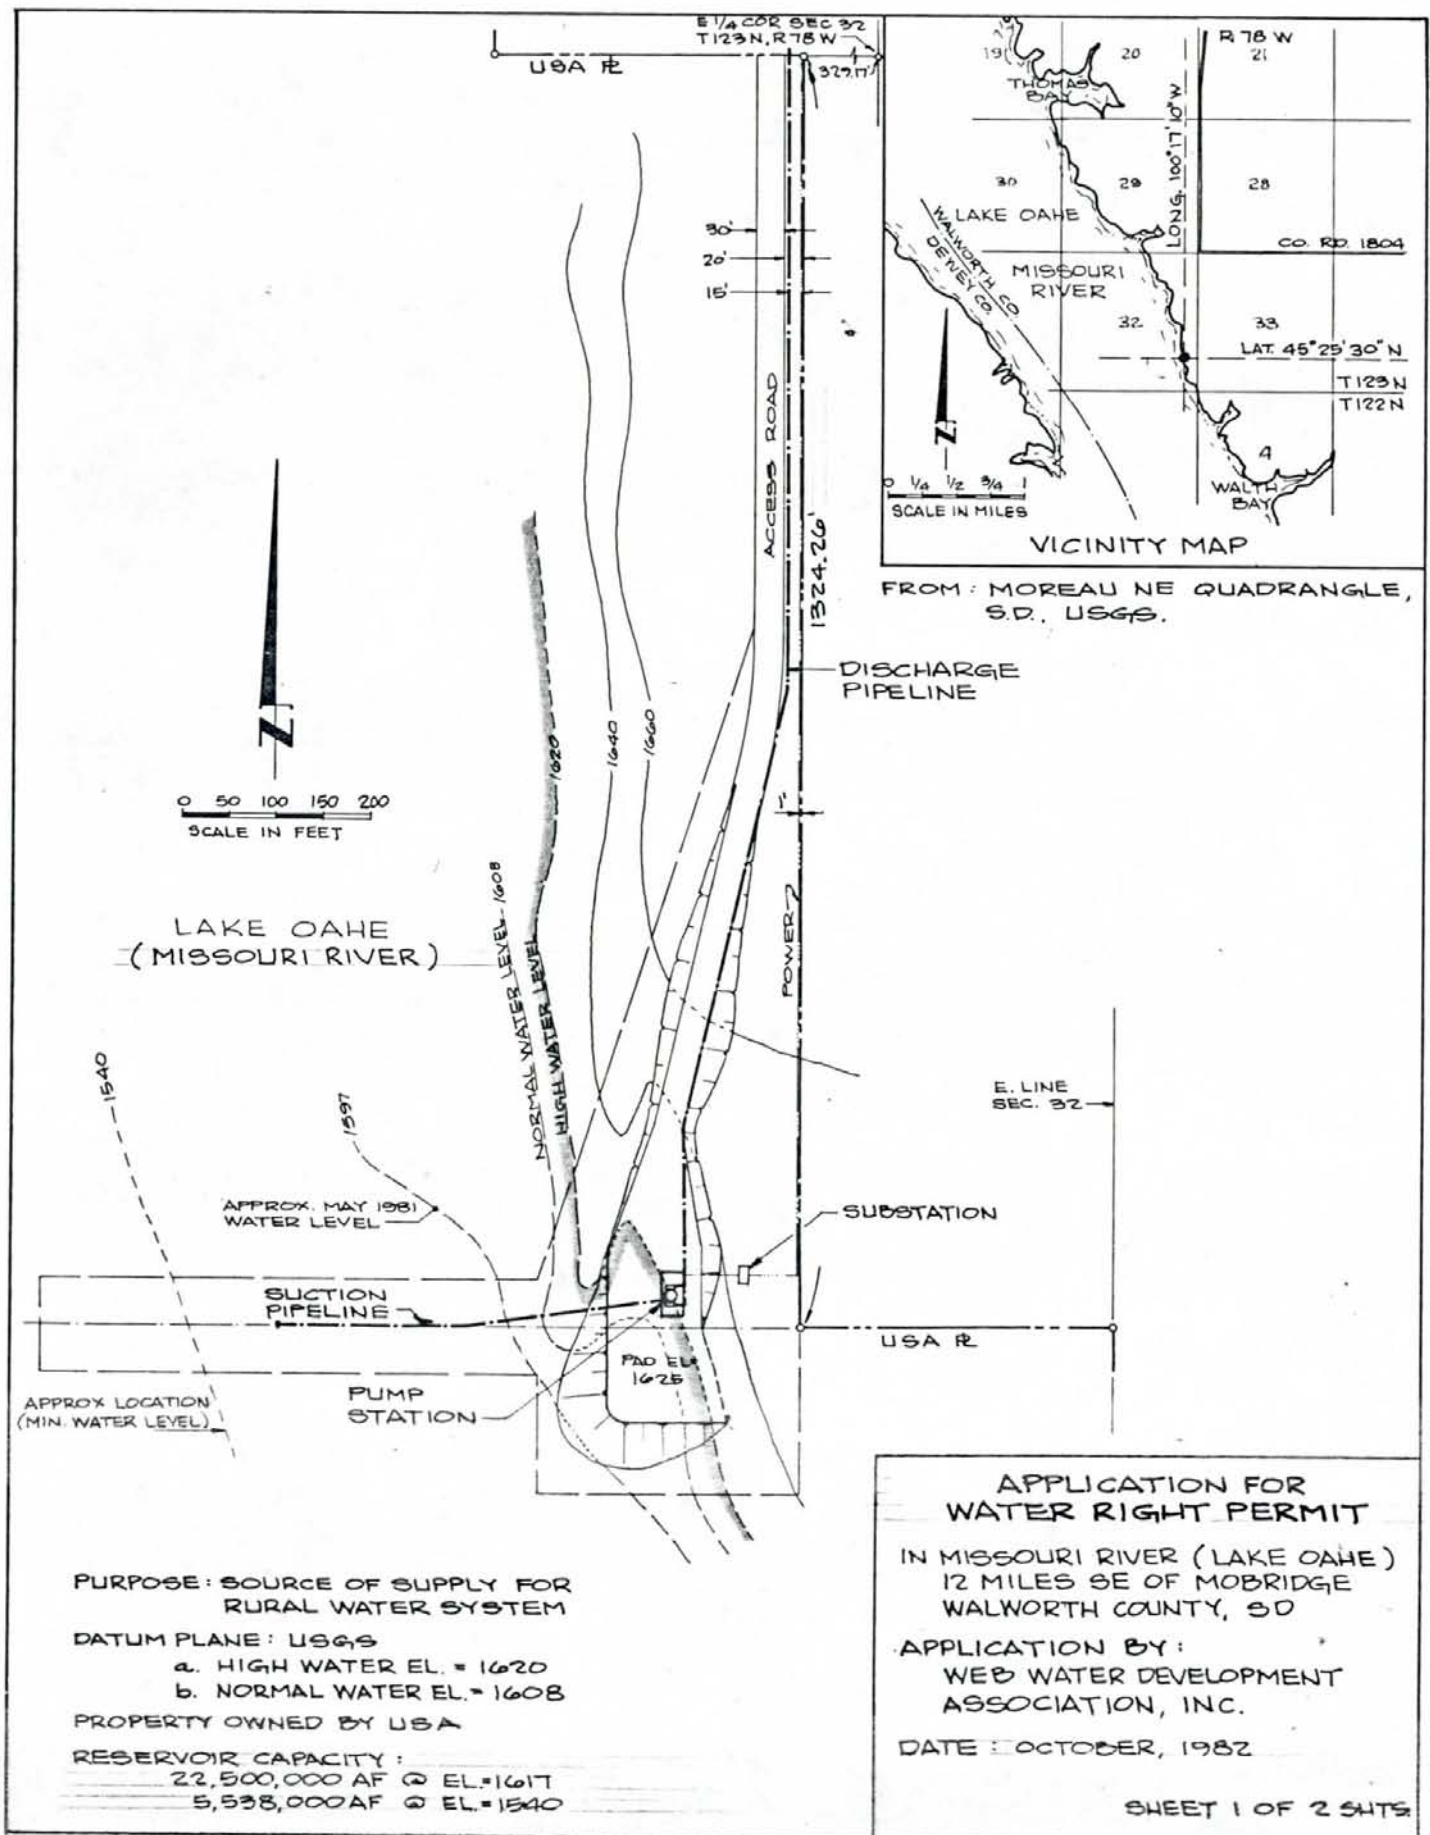

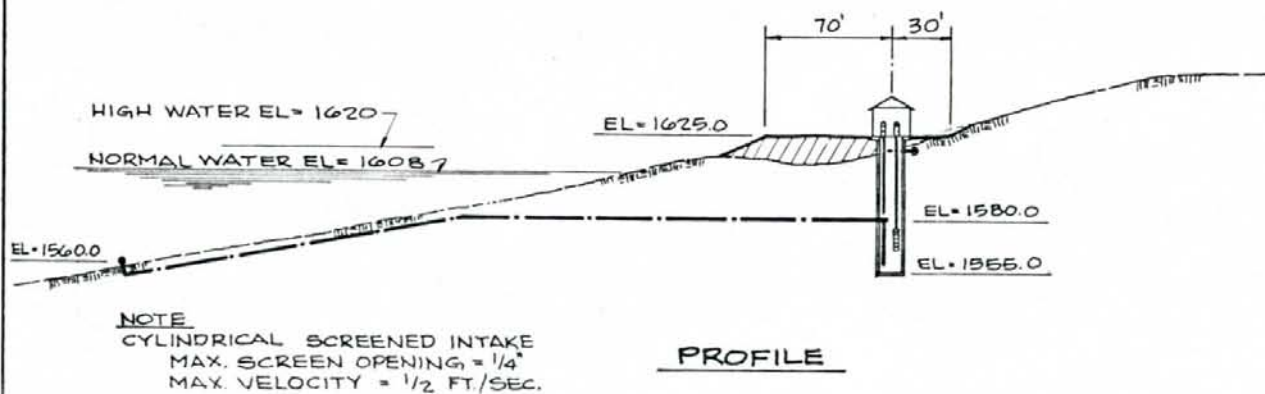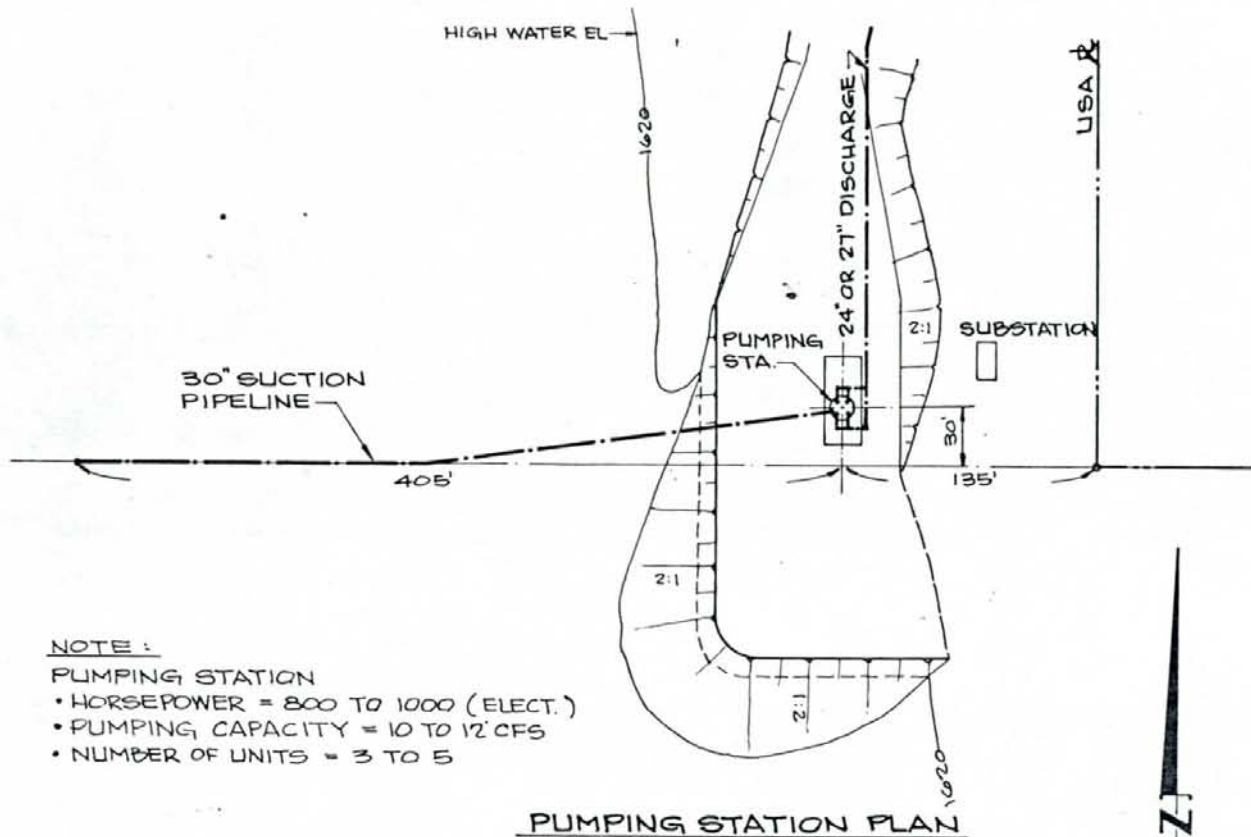

PREPARED BY JOINT VENTURE OF

BW | BARTLETT & WEST, CONSULTING ENGINEERS
 BEC | BOYLE ENGINEERING CORPORATION

BY *Lonnie D. Schardt*
 LONNIE D. SCHARDT, PE
 S.D. REG. NO. 3184

APPLICATION FOR WATER RIGHT PERMIT


IN MISSOURI RIVER (LAKE OAHE)
 12 MILES SE OF MOBRIDGE
 WALWORTH COUNTY, SD.

APPLICATION BY:
 WEB WATER DEVELOPMENT
 ASSOCIATION, INC.



DATE: OCTOBER, 1982

SHEET 2 OF 2 SHTS.

Map # 4130-3 Appl 7930-3

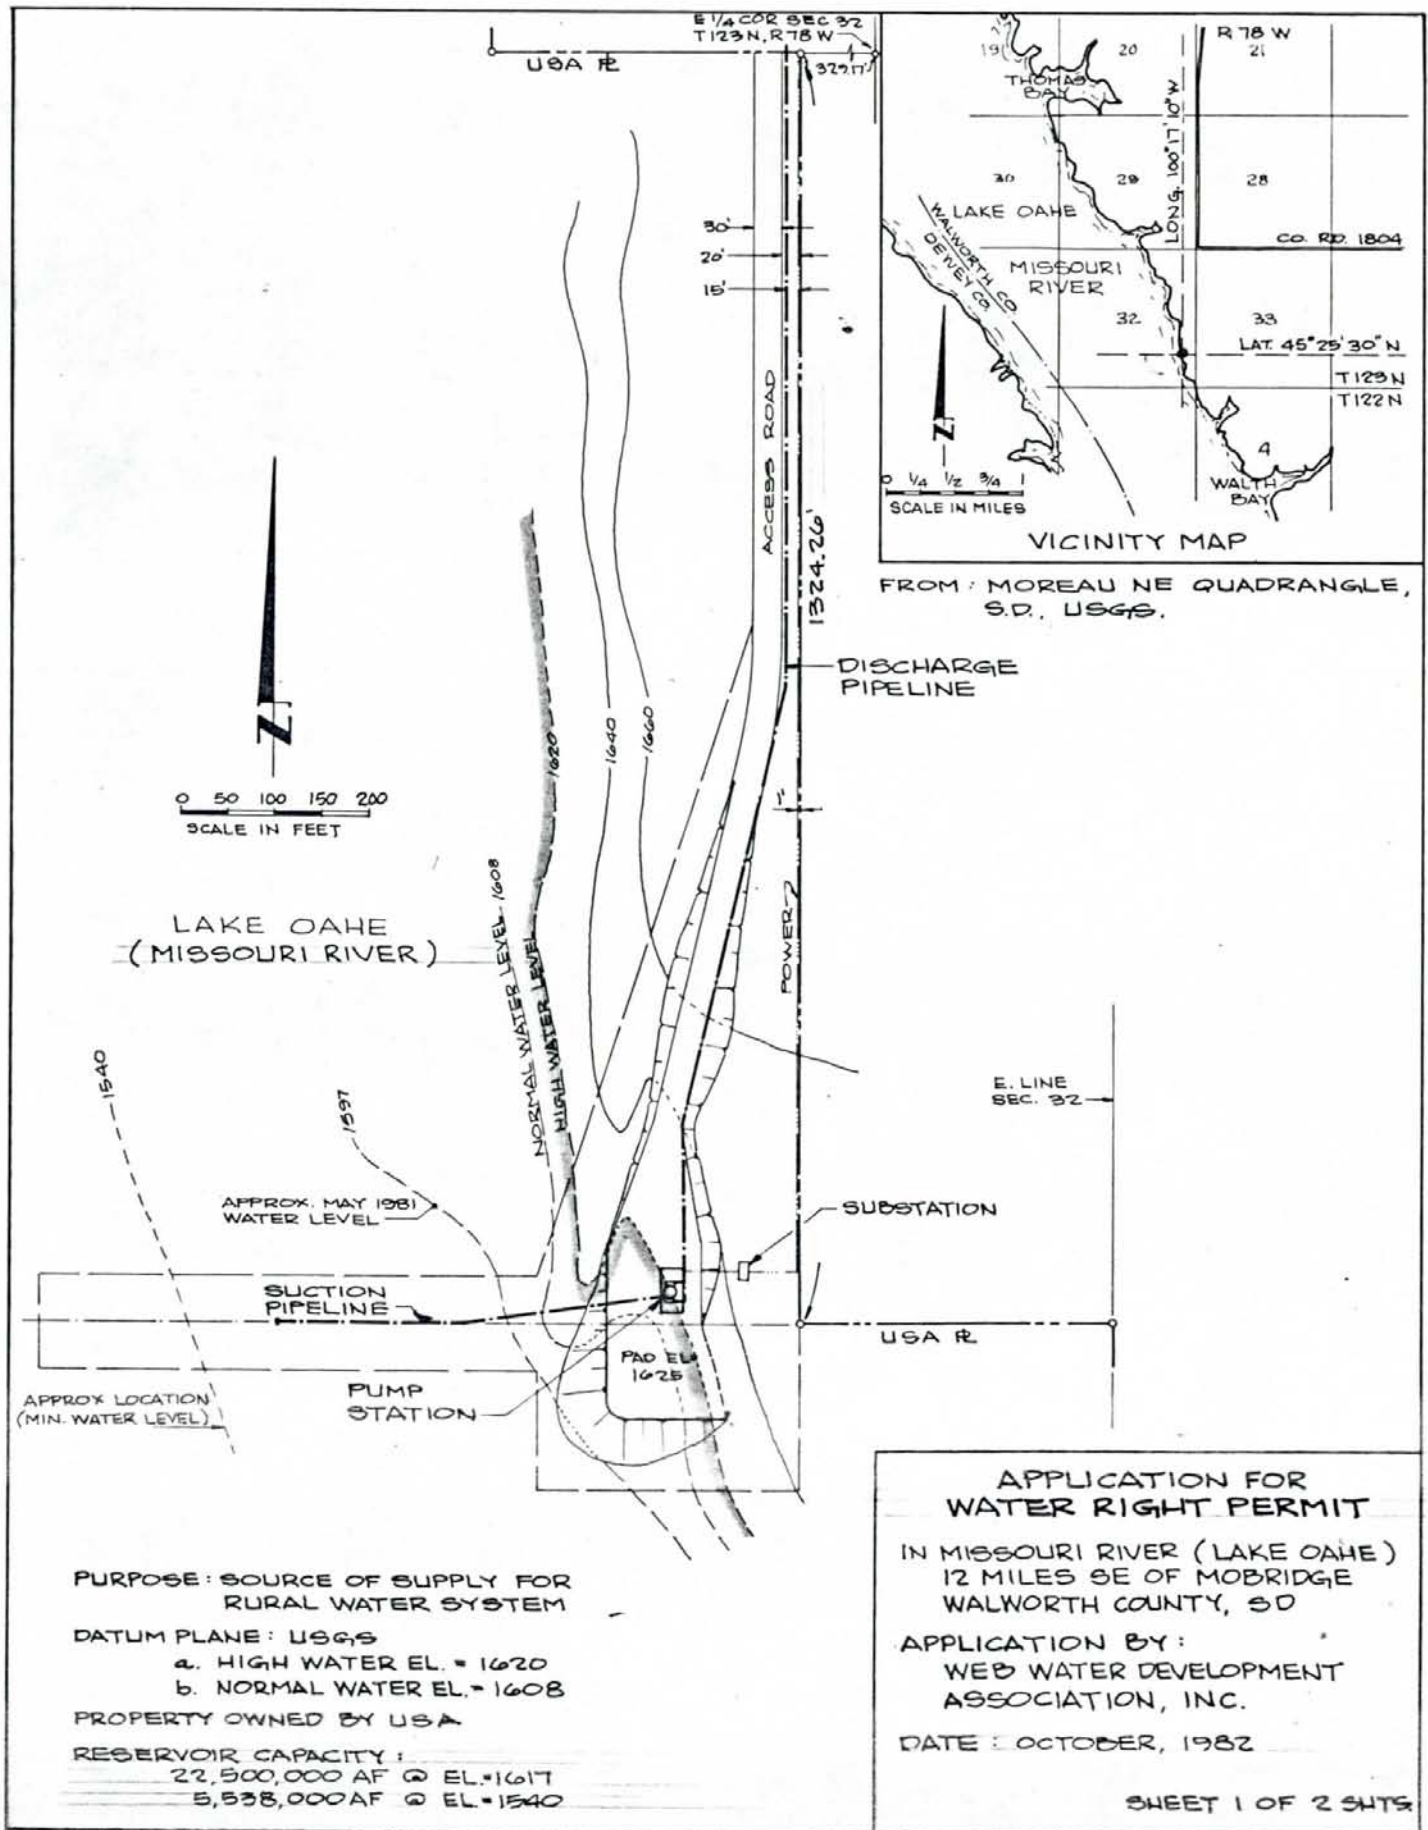

~~Map # 4930-3~~ Appl. 4930-3

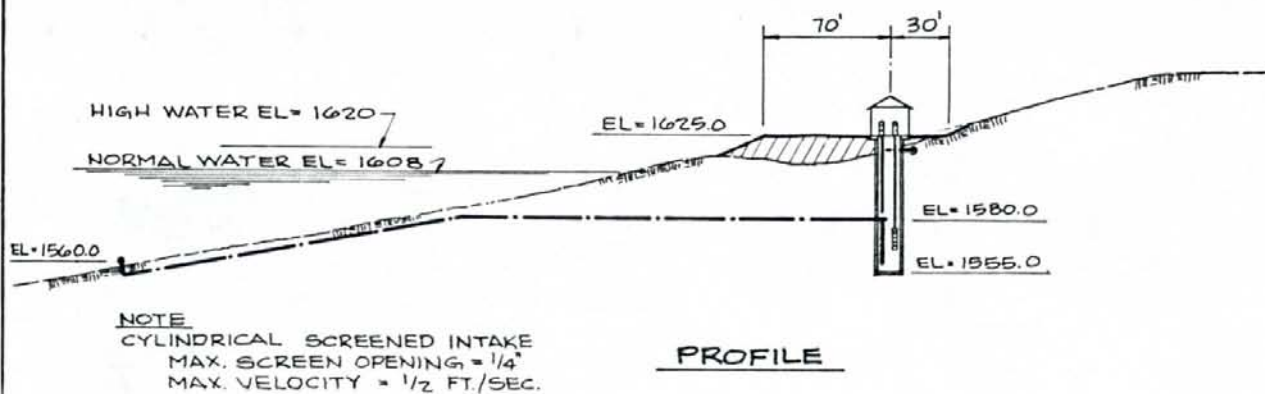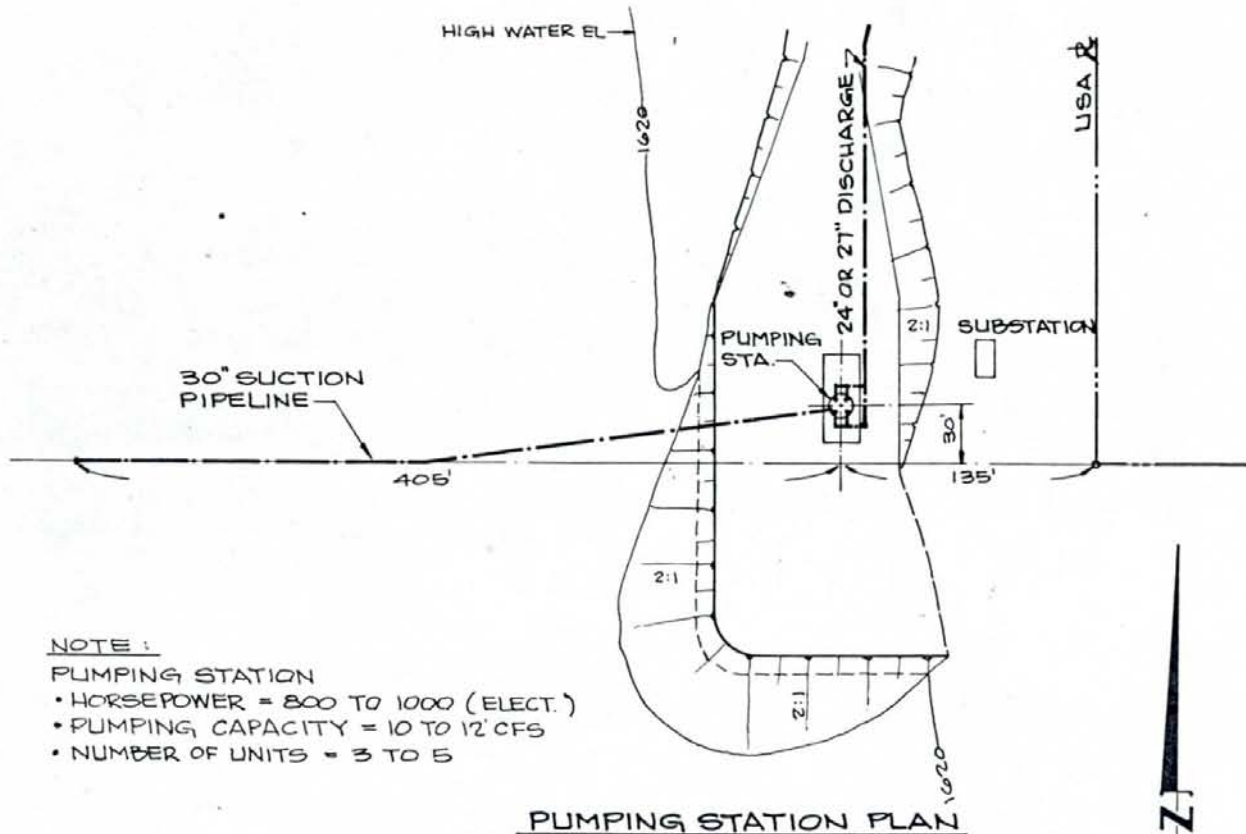

PREPARED BY JOINT VENTURE OF

BW | BARTLETT & WEST, CONSULTING ENGINEERS
 BEC | BOYLE ENGINEERING CORPORATION

BY *Lonnie D. Schardt*
 LONNIE D. SCHARDT, PE
 S.D. REG. NO. 3184

APPLICATION FOR WATER RIGHT PERMIT

IN MISSOURI RIVER (LAKE OAHE)
 12 MILES SE OF MOBRIDGE
 WALWORTH COUNTY, SD.

APPLICATION BY:
 WEB WATER DEVELOPMENT
 ASSOCIATION, INC.

DATE: OCTOBER, 1982

SHEET 2 OF 2 SHTS.

~~Map # 4130-3~~ Appl. 4930-3

WEB WATER - TOWNS AND BULK USER LISTING - as provided by Curt Hohn on March 21, 2007

1	Aberdeen Estates, Aberdeen	45	Ipswich
2	Aman Estates - Richmond Lake	46	James Valley Ethanol, Groton
3	Baumgartner Farms, Pollock	47	Java
4	Basin Peaking Plant, Groton	48	Jobee Acres Subdiv., Aberdeen
5	Beadle Foral, Aberdeen	49	Lake Traverse Utility, Enemy Swim
6	Beales Resort, Pickeral Lake	50	Leola
7	Bowdle	51	Little Leola Resort, Herried
8	Braun Farms, Warner	52	Long Lake
9	Braun Feedlot, Warner	53	Mallard Pass Subdiv., Bath
10	Brentford	54	Melgaard Estates, Aberdeen
11	Bristol	55	Mellette
12	Camby Pass, Roscoe	56	Mina Lake RWS, Mina
13	Chelsea	57	Missouri River Sport Resort, Mobridge
14	Clark Colony, Raymond	58	Nelson Resort, Pickeral Lake
15	Conde	59	NeSoDak Camp, Pickeral Lake
16	Country Village, Aberdeen	60	Nilson Feedlot, Warner
17	Cresbard	61	Northville
18	Deerfield Colony, Ipswich	62	Northwestern School, Mellette
19	DeVaun Villa, Aberdeen	63	Northwood Park Subdiv., Aberdeen
20	Doland	64	Onaka
21	Eden	65	Pembroke Colony, Ipswich
22	Eilers Addition, Aberdeen	66	Pietz Feedlot, Roscoe
23	Elm Lake Assoc., Frederick	67	Pleasant Valley Subdiv., Aberdeen
24	Elm Lake Resort, Frederick	68	Pollock
25	Enemy Swim School, Waubay	69	Prairie Hills Resort, Mound City
26	Enemy Swim Water Users, Waubay	70	Prairewood Subdiv., Aberdeen
27	Eureka	71	Redfield
28	Farm Power Industry, Aberdeen	72	Richmond Heights Subdiv., Aberdeen
29	Farmers Union Coop, Chelsea	73	River Horse Estates, Aberdeen
30	Faulton	74	Rolling Meadows Subdiv., Aberdeen
31	Forbes, ND	75	Roscoe
32	Frederick	76	Roslyn
33	Gaikowski Subdiv., Webster	77	Rural Homeowners Subdiv., Aberdeen
34	Green Dairy, Aberdeen	54	Melgaard Estates, Aberdeen
35	Green Acres, Bath	55	Mellette
36	Green Acres Court, Redfield	56	Mina Lake RWS, Mina
37	Grenville	57	Missouri River Sport Resort, Mobridge
38	Groton	58	Nelson Resort, Pickeral Lake
39	Heartland Grain Fuels I, Aberdeen	59	NeSoDak Camp, Pickeral Lake
40	Heilman Dairy, Warner	60	Nilson Feedlot, Warner
41	Herried	61	Northville
42	Highview Homeowners, Waubay Lake	62	Northwestern School, Mellette
43	Hillside Colony, Doland	63	Northwood Park Subdiv., Aberdeen
44	Hosmer	64	Onaka

- 65 Pembroke Colony, Ipswich
- 66 Pietz Feedlot, Roscoe
- 78 Schuring Dairy, Andover
- 79 Selby
- 80 Seneca
- 81 Sharp's Dairy, Bath
- 82 Sieh Feedlot, Leola
- 83 SD Development Center, Redfield
- 84 SD GF&P Camp Ground, Pollock
- 85 Spring Creek Colony, Forbes
- 86 Stratford
- 87 State Line RWS, Strausburg, ND
- 88 Thorpe's Elm Lake Assoc, Frederick
- 89 Thunderbird Colony, Onaka
- 90 Vilhauer Farms, Leola
- 91 Warner
- 92 Webster
- 93 Wecota
- 94 Westport
- 78 Schuring Dairy, Andover
- 79 Selby
- 80 Seneca
- 81 Sharp's Dairy, Bath
- 95 Wetonka
- 96 Young Farms, Warner
- 97 Zeeland, ND
- 98 Casa Playa Subdiv., Richmond Lake
- 99 Coteau Hills Soy Processing, Webster
- 100 Blackstone Point, Pickeral Lake
- 101 Redfield Energy, Redfield
- 102 Coteau Hills Soybean Plant, Webster
- 103 Blackstone Point, Pickeral Lake
- 104 Heartland Grainfuels II, Aberdeen
- 105 Aberdeen Energy, Mina
- 106 Pig Improvement Corp, Java
- 107 Huttenville Colony, Stratford

WEB Service Area - Counties Served

South Dakota

Walworth

Edmunds

Brown

Campbell

Potter

McPherson

Faulk

Spink

Day

Marshall

Hand

Hyde

Clark


Beadle

North Dakota

Emmons

McIntosh

Dickey

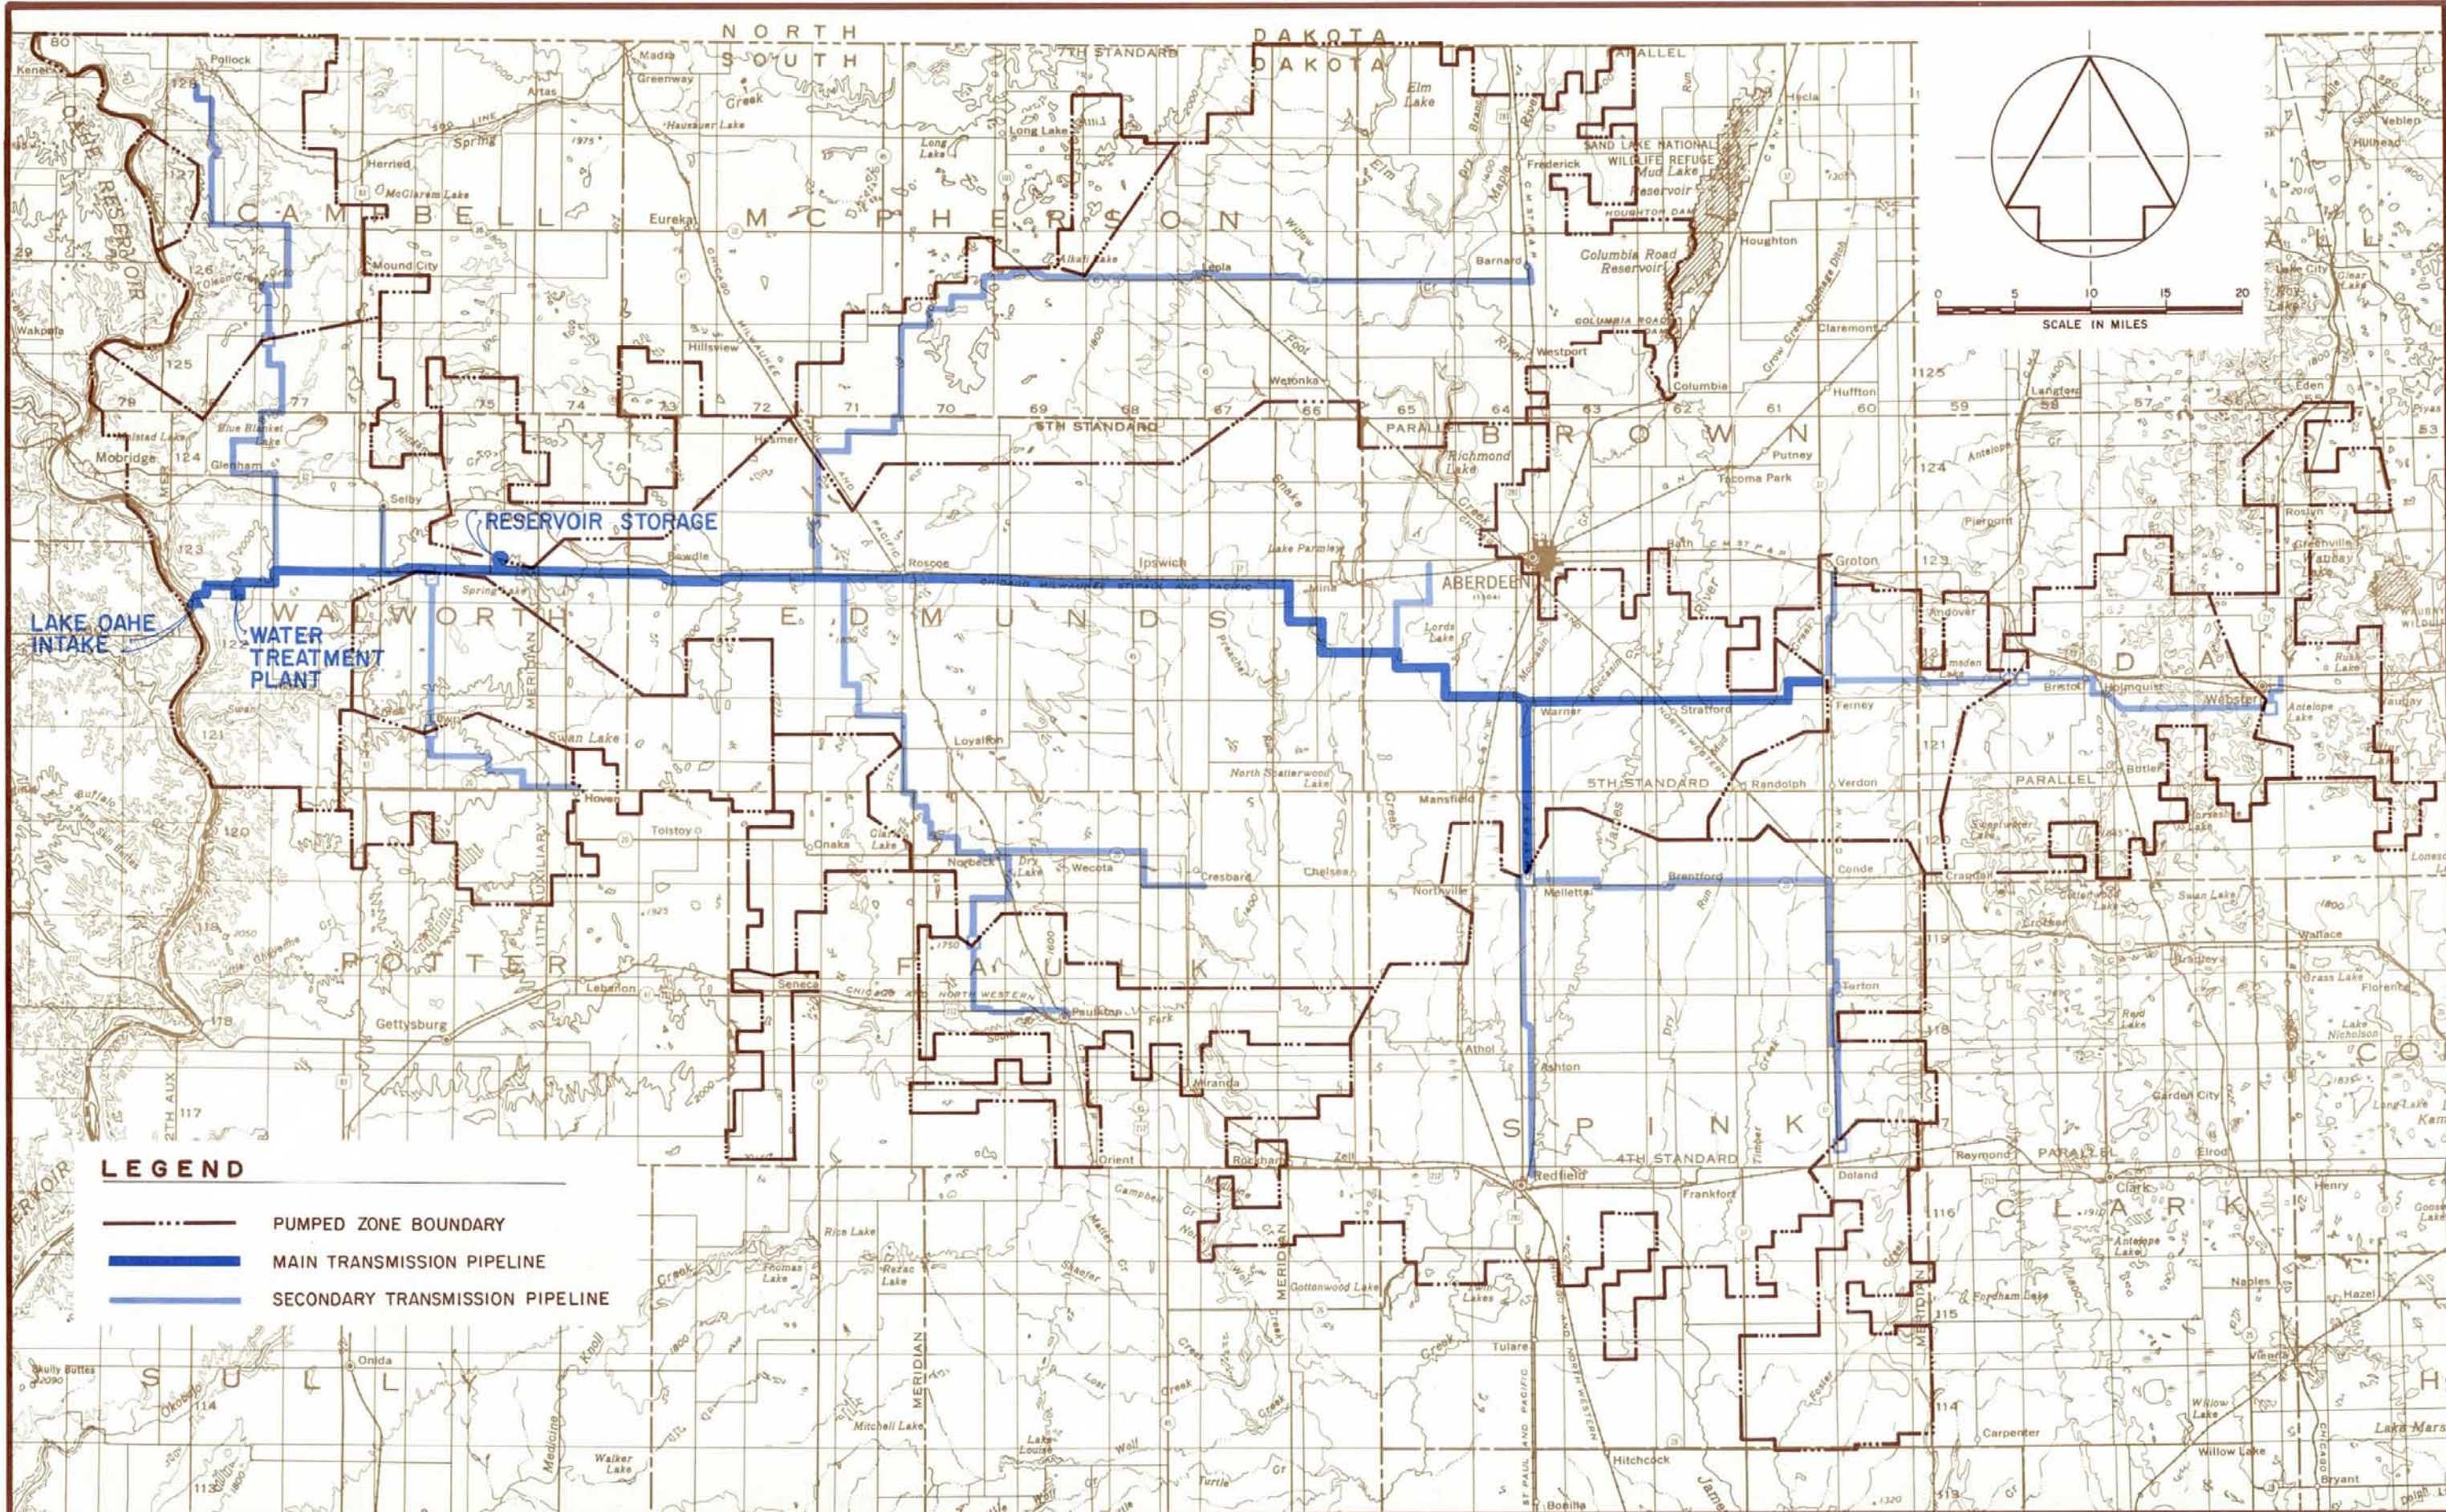

LEGEND

- PUMPED ZONE BOUNDARY
- MAIN TRANSMISSION PIPELINE
- SECONDARY TRANSMISSION PIPELINE

WEB WATER DEVELOPMENT ASSOCIATION, INC.

Boyle Engineering Corporation
consulting engineers / architects


Bartlett & West
Consulting Engineers, P.A.

WEB RURAL WATER
DEVELOPMENT PROJECT

**TRANSMISSION
SYSTEM PLAN**

PLATE:
A
DATE:
JAN. 1980

~~APP. 4930-3~~ *App. 4930-3*

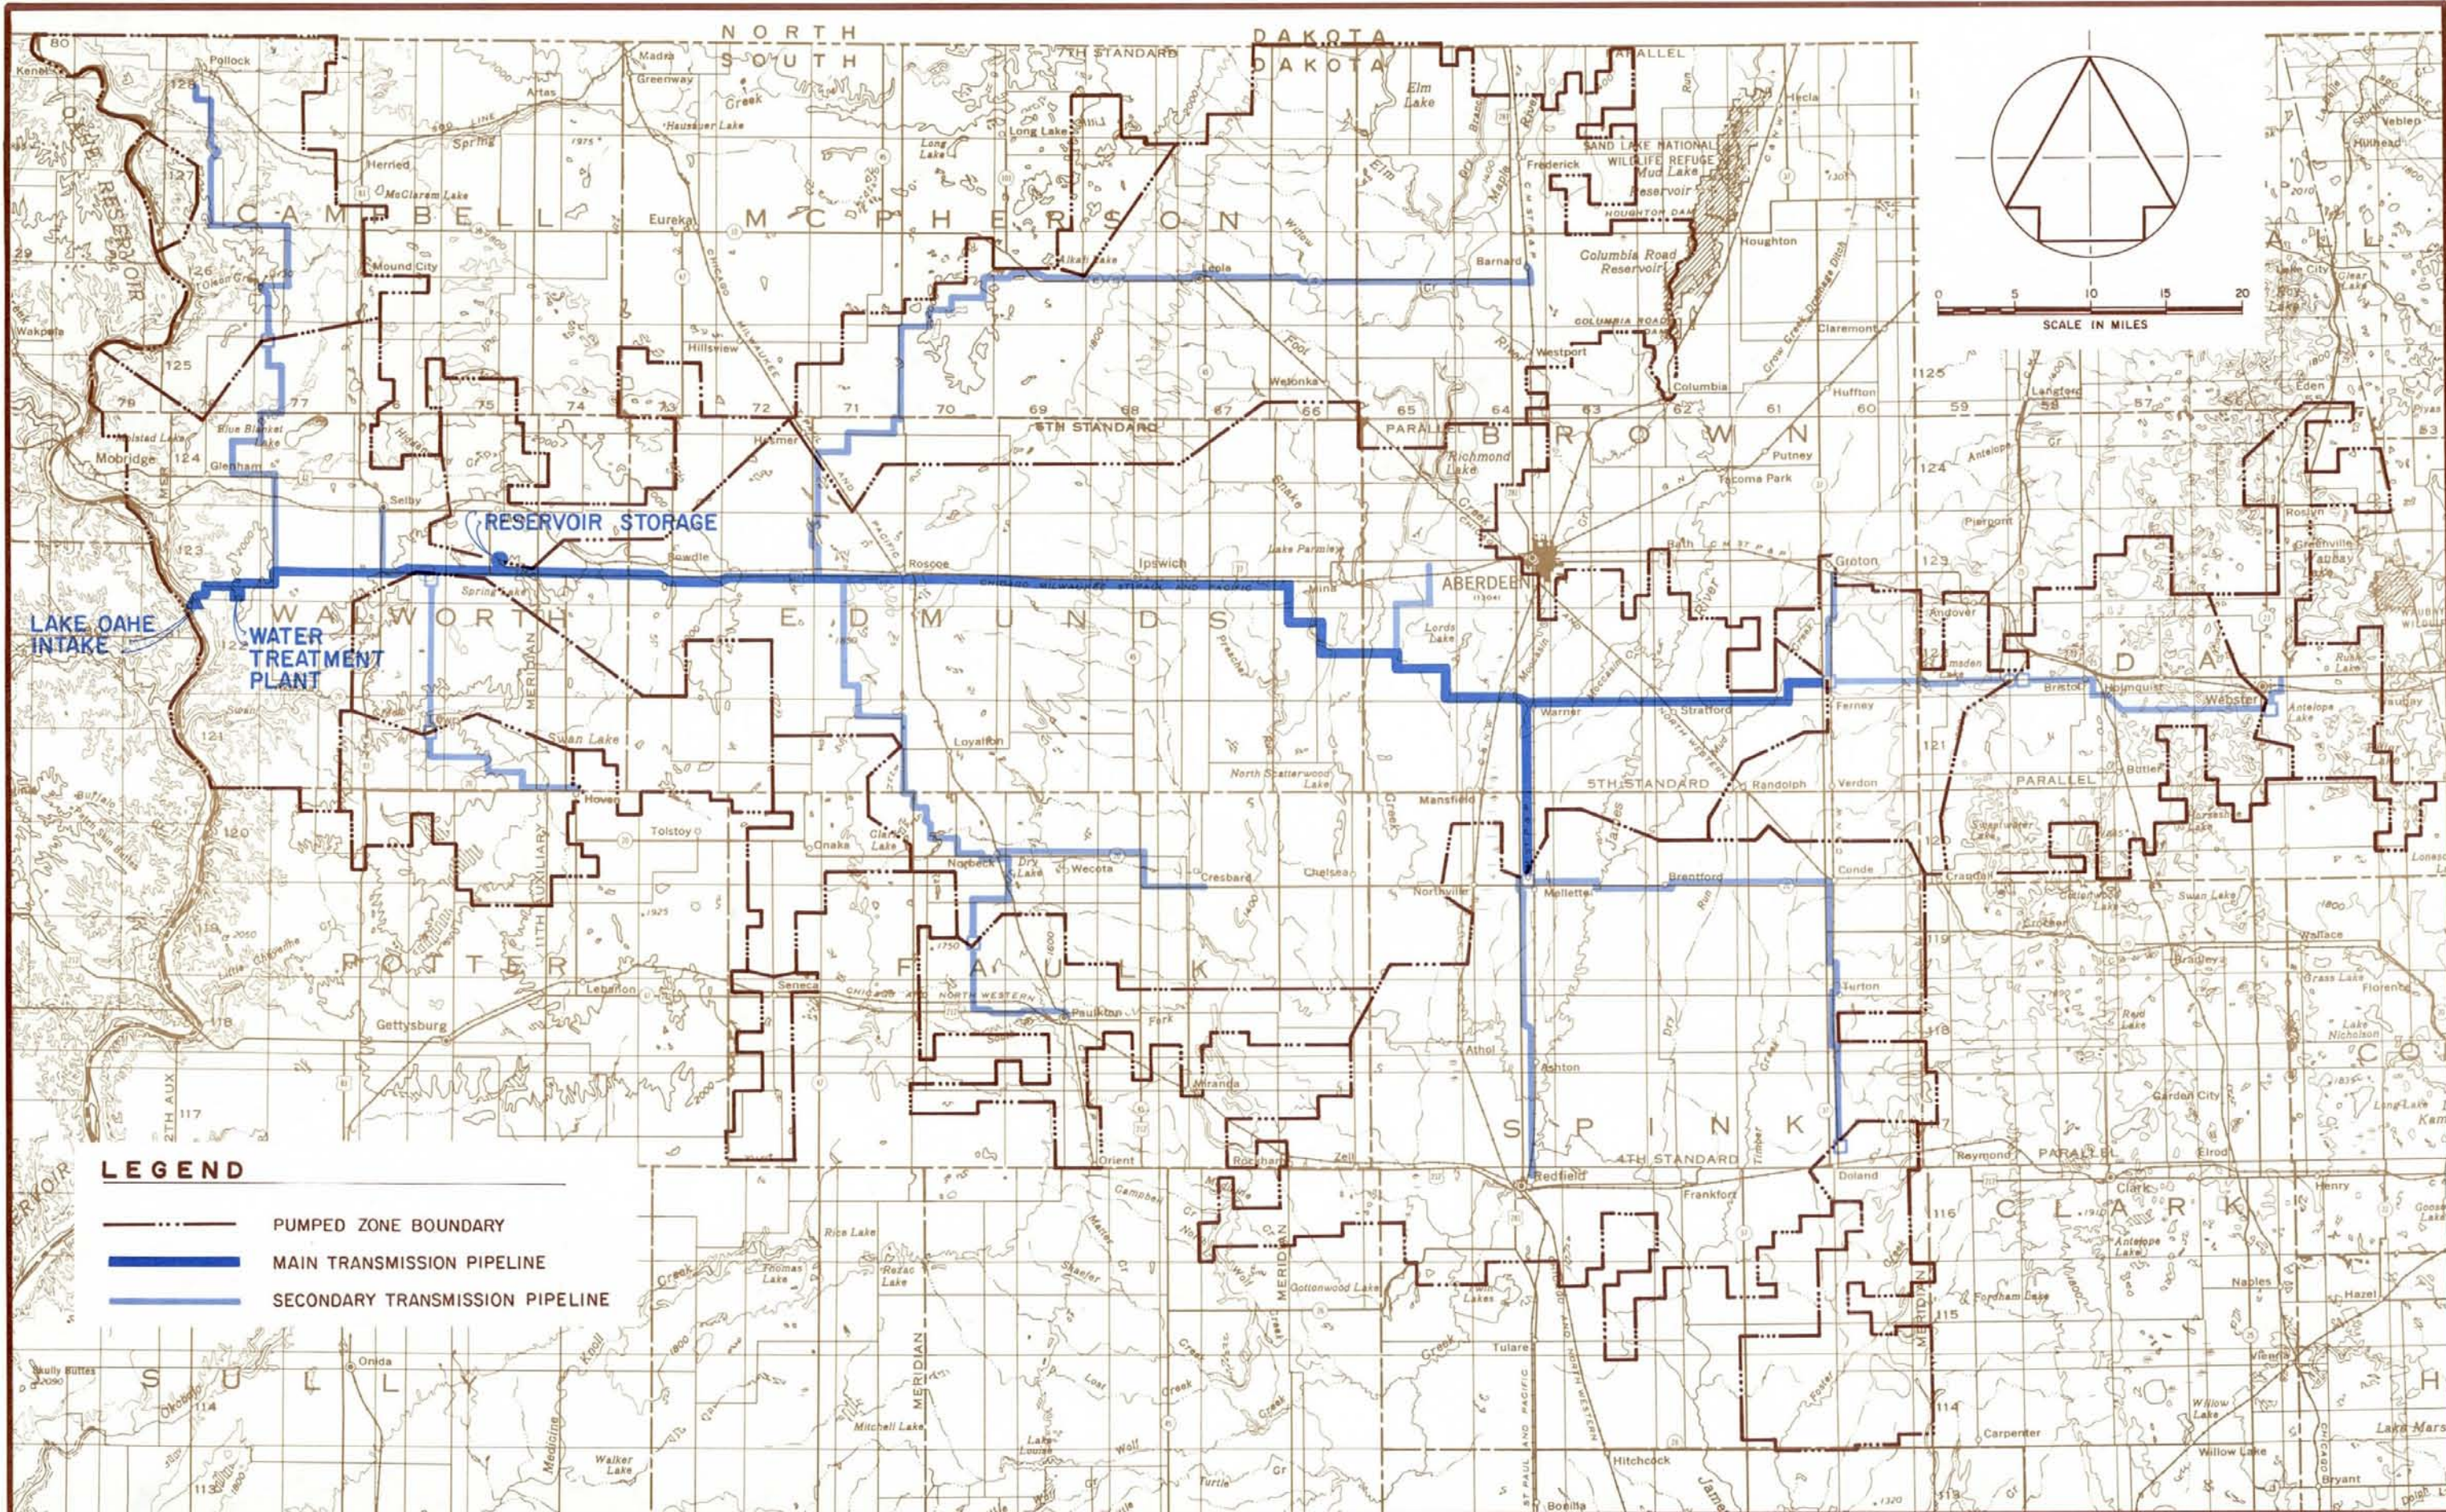

LEGEND

- PUMPED ZONE BOUNDARY
- MAIN TRANSMISSION PIPELINE
- SECONDARY TRANSMISSION PIPELINE

WEB WATER DEVELOPMENT ASSOCIATION, INC.

Boyle Engineering Corporation
consulting engineers / architects


Bartlett & West
Consulting Engineers, P.A.

WEB RURAL WATER
DEVELOPMENT PROJECT

**TRANSMISSION
SYSTEM PLAN**

PLATE:
A
DATE:
JAN. 1980

Map H-30-3 Appl 4930-3

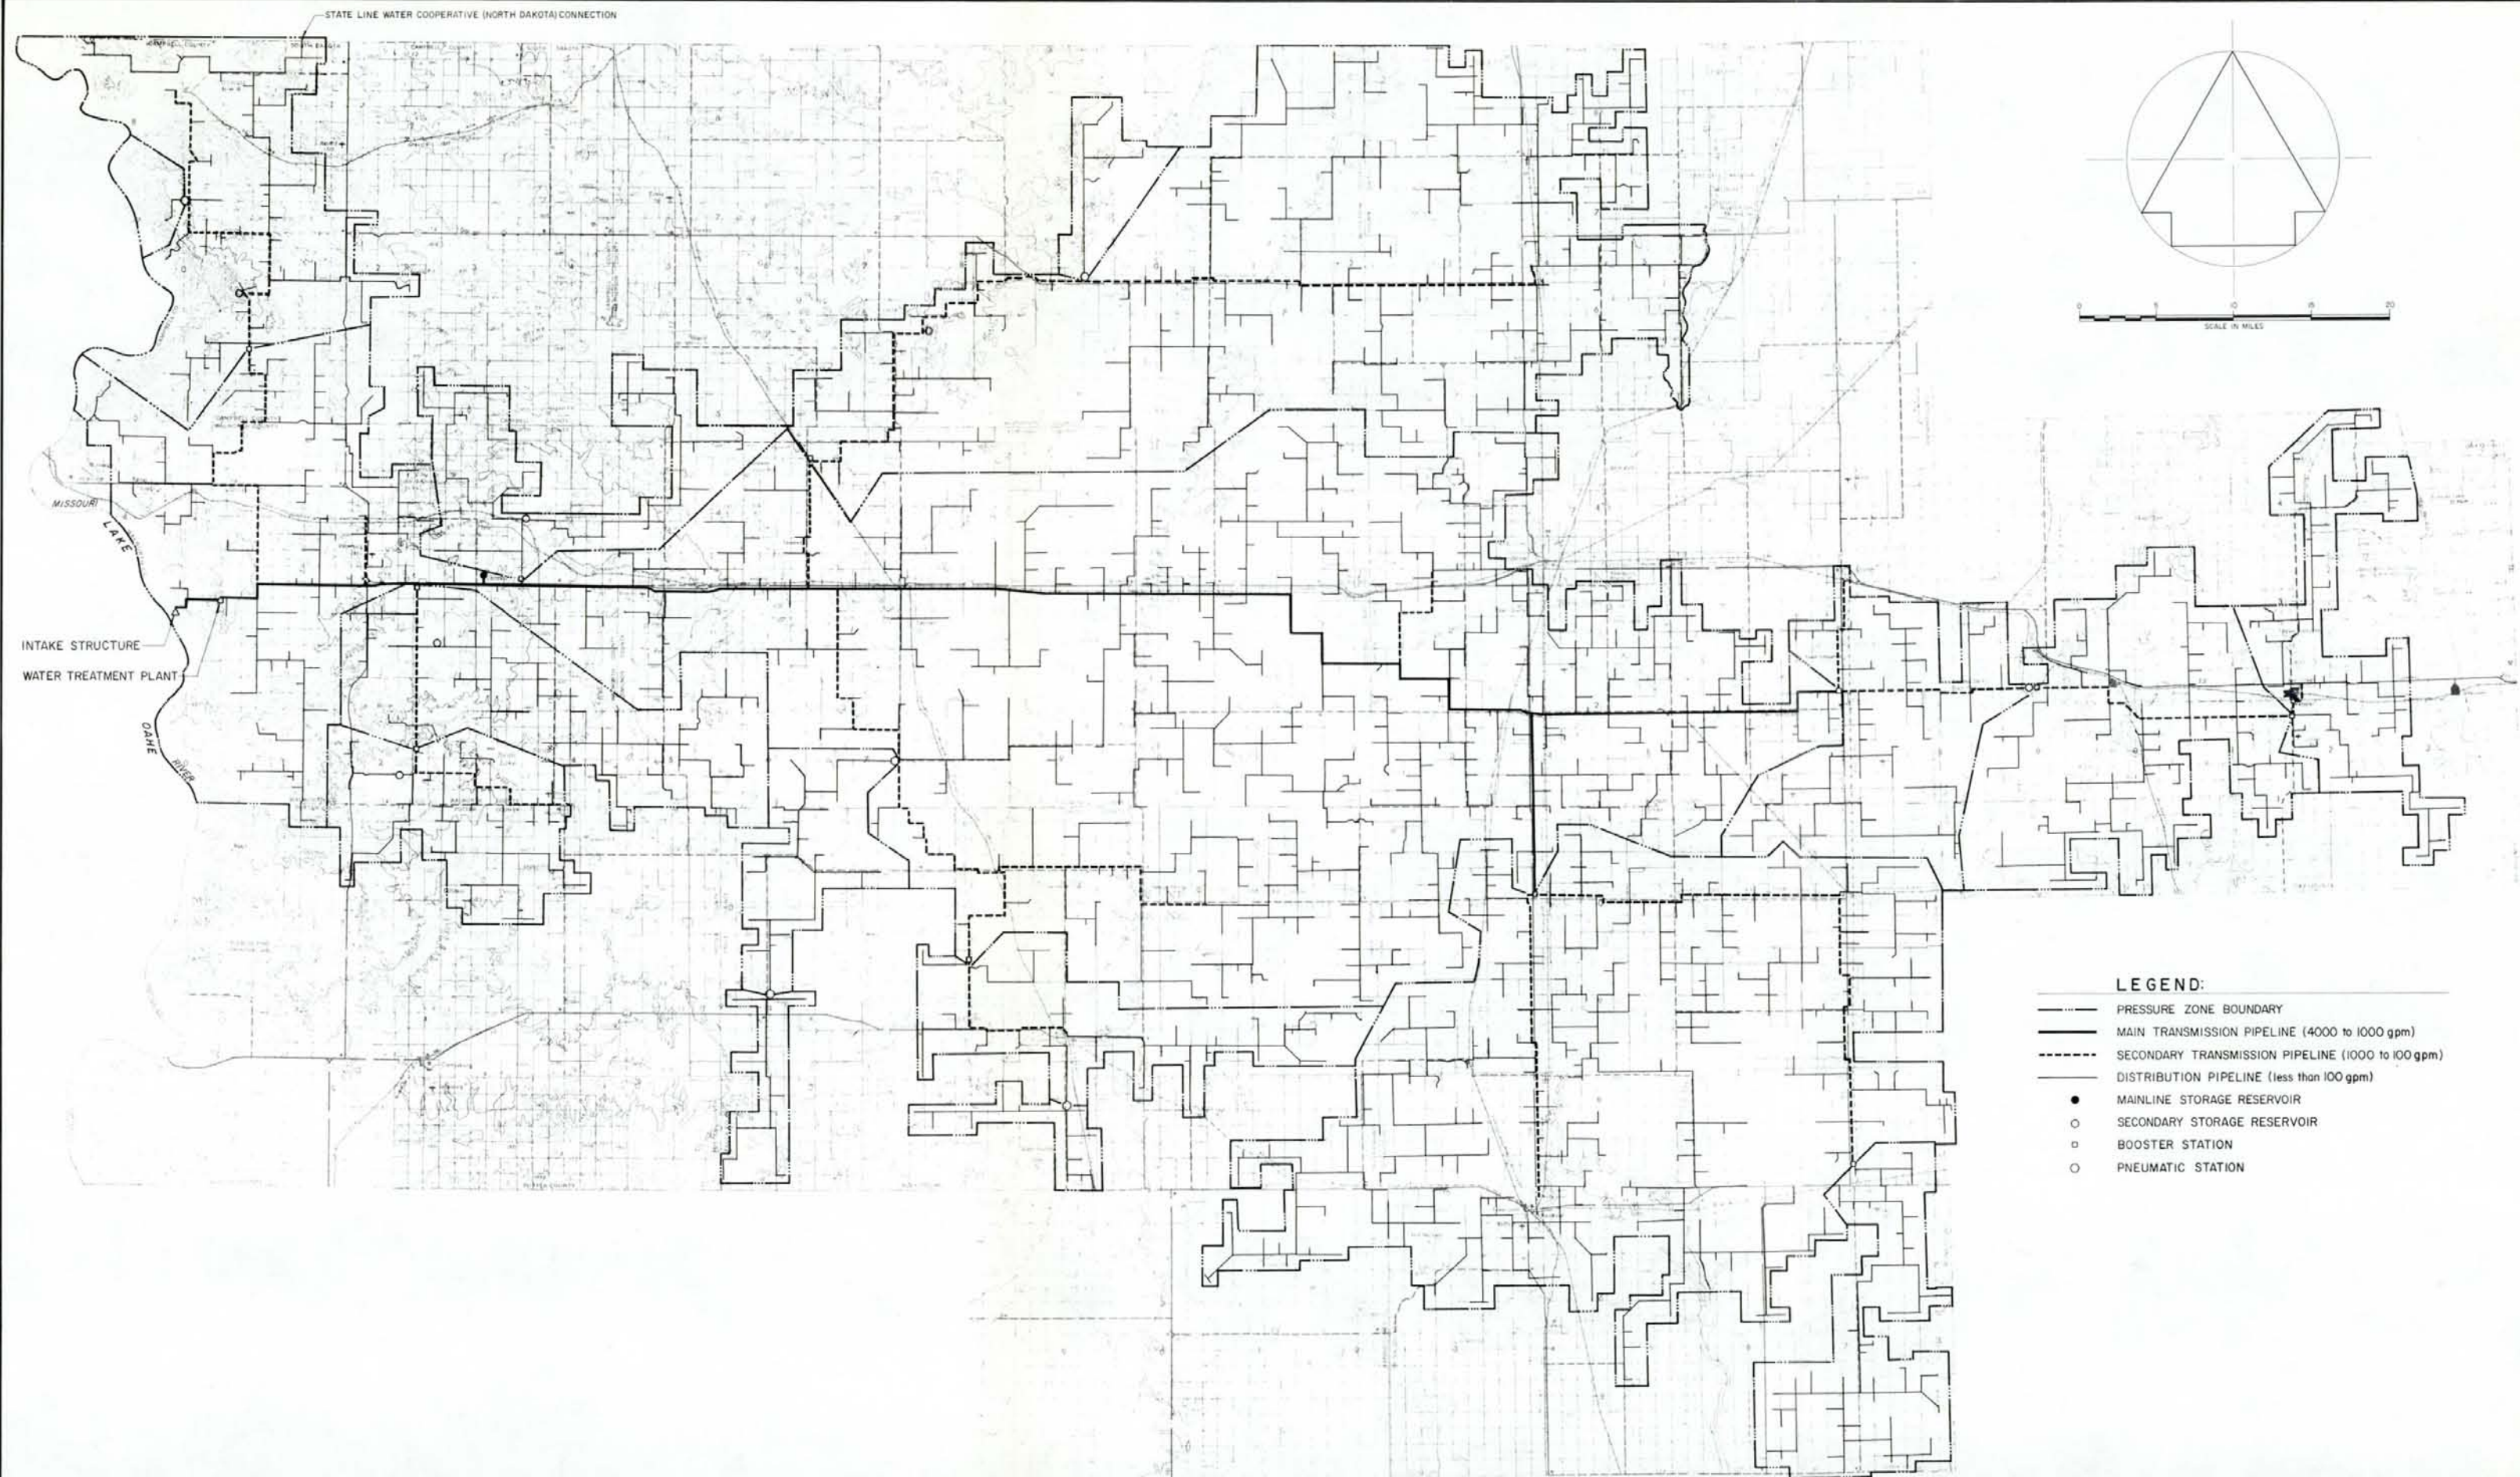

WEB WATER DEVELOPMENT ASSOCIATION, INC.

B Boyle Engineering Corporation
consulting engineers / architects


BW Bartlett & West
Consulting Engineers, P.A.

WEB RURAL WATER
DEVELOPMENT PROJECT

TRANSMISSION AND DISTRIBUTION
PIPELINE SYSTEM PLAN

PLATE
C
DATE: JAN. 1980

Revised 12/20/83 appl. 4930-3

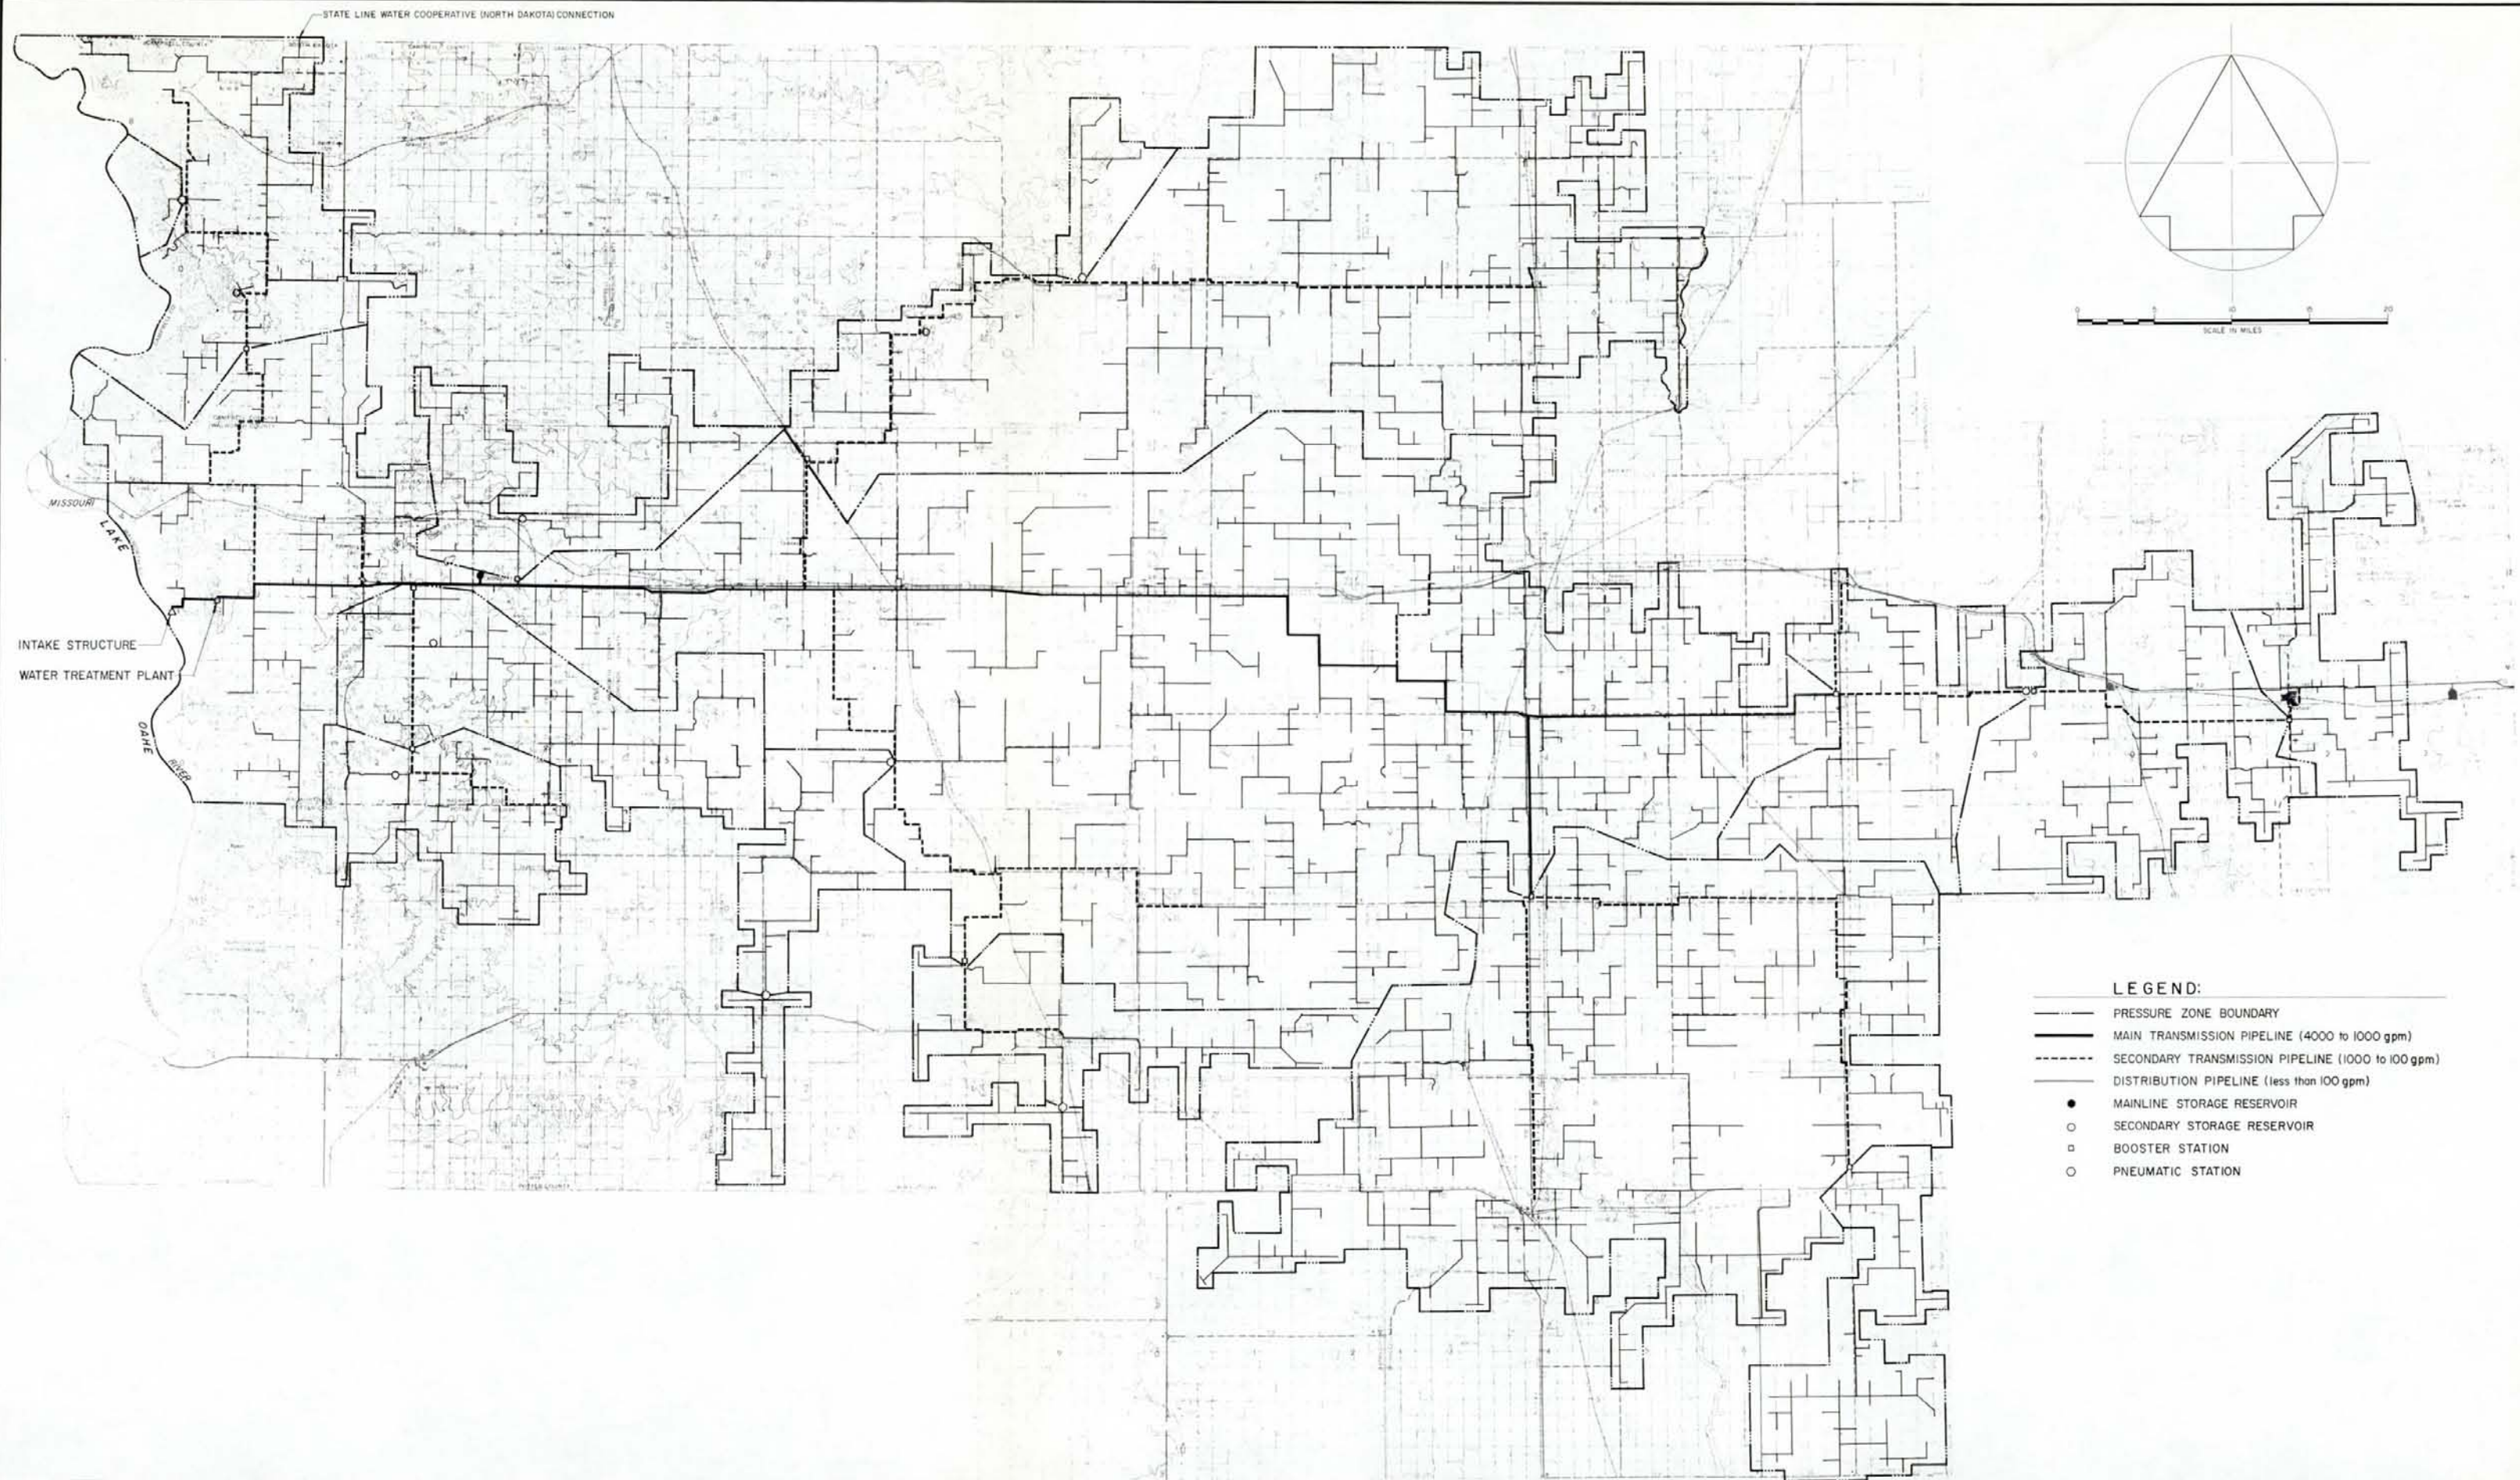

WEB WATER DEVELOPMENT ASSOCIATION, INC.

B Boyle Engineering Corporation
consulting engineers / architects

BW Bartlett & West
Consulting Engineers, P.A.

WEB RURAL WATER
DEVELOPMENT PROJECT

TRANSMISSION AND DISTRIBUTION
PIPELINE SYSTEM PLAN

PLATE
C
DATE: JAN. 1980

APP 4930-3 *APP 4930-3*

4930-3



DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182

denr.sd.gov

SEP 29 2015

4930-3
6824-3

WEB Water Development Association Inc
PO Box 51
Aberdeen SD 57402-0051

Dear Sir:

Enclosed is Water License No. 6824-3. This is the final water right document completing your process of obtaining a Water Right. Included with your license is a map prepared by the staff engineer who conducted the field investigation.

As long as you use the water beneficially, as stated in the Water License, State Water Laws provide that you have a continuing right to use the water.

Sincerely,

Jeanne Goodman, Chief Engineer
Water Rights Program
(605) 773-3352

enclosures

Note: The applicable portions of Water Right No. 4930-3 were incorporated into Water License No. 6824-3.