

Considered: _____

WATER PERMIT NO. 5098-3

MAP No. same

Name of Applicant Sioux Rural Water System, Inc.

Post Office Address RR 4, Box 162, Watertown SD 57201

Amount of Water Claimed 1.33 cfs Total Acres NA

Source of Water Supply groundwater - Big Sioux Aquifer

Water to be used for rural water system County Hamlin Deuel Codington Clark

About 1 1/2 miles W of Castlewood

PROOF OF PUBLICATION: Received 8/8/86 Not Received _____

APPLICATION: Approved Sept 3, 1986 Subject to domestic well qualification

F.F. & C.L. Adopted _____ Not Approved _____ Deferred _____

PRIORITY _____ Date Received June 1, 1986 Fee 375⁰⁰ Remarks _____

6/1/86

Corrected Application Received July 7, 1986 Period of Annual Use Jan 1 - Dec 31


WATER QUALITY APPROVAL RECEIVED NA APPROVED/CONDITIONAL (Circle one)

WI-1 Description same as Application YES _____ NO _____ REMARKS _____

Diversion Point SW 1/4, section 34 - T115N -

R52W 2 wells

Land to be Irrigated NA

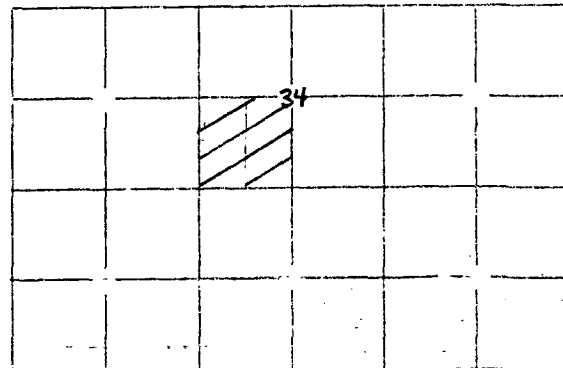

Well Log: Driller Lacey well drilling Licensed YES ☒ NO _____

Depth of Well 43 ft REMARKS test well logs

Type of Map Topo & plat PREPARED BY Bruce Jennings Reviewed and the Number


assigned on July 8, 1986 By Ron Duvall

No. 5098-3 Hydrologic Unit 10170202
 Map No. same Basin Big Sioux River
 Newspaper Hamlin Co. Herald Enterprise, Box 207, Hayti (Thurs)
Watertown Public Opinion, Box 10 (Daily)
Clear Lake Courier, Box 277 (Thurs)
Clark Co. Courier, Box 189 (Wed)

Application For Permit To Appropriate Water Within The State Of South Dakota

Check use of water: Industrial ☐ Commercial ☐ Municipal ☐ Other Common Distribution System ☐
 Rural Water System ☒ Suburban Housing ☐ Geothermal Heat ☐ Institutional ☐ Recreational ☐
 Domestic ☐ (above 18gpm) Other ☐

Type of Application: Check one or more of the following

New ☒ Vested Right ☐ Future Use ☐ Change Use ☐☐ Amend Permit No. _____ with old priority date retainedChange diversion point(s) ☐ Add diversion point(s) ☐ Other ☐ _____☐ Application to: Change diversion point(s) ☐ Add diversion point(s) ☐ on Permit No. _____☐ Construction to use water reserved by Future Use Permit No. _____1. Name of Applicant Sioux Rural Water System, Inc. Phone No. 882-1321Post Office Address R.R. 4, Box 162 Watertown State SD Zip Code 57201
(Street, RR or Box)2. Amount of water claimed (c.f.s) 1.333. Source of water supply Groundwater - Big Sioux Aquifer4. Location of point of diversion SW 1/4, Sec. 34, T115N, R52WCounty Hamlin5. Counties where water will be used Hamlin, Codington, Deuel, Clark6. Annual period during which water is to be used January 1 - December 31

7. Give a brief description of proposed project. When available include any preliminary engineering report or other reports or information that will help explain the project. (Attach sheet if more space is needed)

Rural water system water supply for area rural residents. Two new wells are planned to operate concurrently with one existing well (Permit 4990-3).

Attachments: Attach Form 2A if diversion from a well or dugout, or if storage of water, is proposed. Attach map (see instruction)

STATE OF SOUTH DAKOTA)^{ss}
 County of _____

I, Ronald D Timmons chm. Sioux Rural Water the applicant, certify that I have read the foregoing application, have examined the attached map and that the matters therein stated are true and that I intend, and am able to complete the necessary construction.

Signed Ronald D TimmonsSubscribed and sworn to before me this 27th day of MAY 1986

[Signature]
 Notary Public (or other qualified officer)

WATER PERMIT

The Water Management Board hereby approves Water Permit Application No. 5098-3
Sioux Rural Water System, Inc. RR4, Box 162, Watertown
(Applicant) (Post Office Address)
SD 57201 With the following qualifications.
(State) (Zip Code)


The wells approved under this Permit will be located near domestic wells and other wells which may obtain water from the same aquifer. The well owner, under this Permit shall control his withdrawals so there is not a reduction of needed water supplies in adequate domestic wells or in adequate wells having prior water rights.

Date of first receipt of application June 1, 1986.
 Date of return to applicant for correction, amendments or changes required June 11, 1986.
 Date of receipt of corrected application July 7, 1986. Approved September 3, 1986.

The Water Management Board hereby approves this Water Permit No. 5098-3 authorizing the construction of the water use system and the placing of water to beneficial use as stated in the Application and as qualified in the Water Permit approval, subject, however, to the following limitations and conditions:

1. The date from which applicant may claim right is June 1, 1986.
2. The equivalent of at least one-fifth of the specified work is to be completed on or before February 3, 1989.
3. The whole of said work is to be completed on or before September 3, 1991.
4. The limit of time from proof of beneficial use of water appropriated in accordance herewith is September 3, 1995.
5. The water appropriated shall be used for the purpose of supplying the rural water system.
6. The prior right of all persons who, by compliance with the laws of the State of South Dakota, have acquired a right to the use of water must not be unlawfully impaired by this appropriation.
7. The amount of the appropriation herein granted shall not exceed 1.33 cubic feet per second; neither shall it exceed the capacity of the above described water supply system nor shall it exceed the amount of water needed for beneficial uses served and to which water is actually and beneficially applied for RWS use on or before September 3, 1995; said water to be used during the following described annual period: Jan 1 - Dec 31

WATER MANAGEMENT BOARD
 By: *John H. Bateh*
Chief Engineer
 Division of Water Rights
 Dept. of Water and Natural Resources
NOV 14 1986



Supplemental Information

(type or print in ink)

1. Well Information - Proposed construction See test hole logs of Permit No. 4990-3

- a) Drill Hole Diameter 20" Depth 43ft.
- b) Casing Type Steel Diameter 12" Thickness 0.375"
Slot
XXXXXXX
- c) Screen Type Stainless Steel Diameter 12" Thickness No. 80
- d) Gravel Pack Thickness 4" Length of Gravel Pack 30
- e) Depth to Top of Water Bearing Material 11 ft.
- f) Depth of Water (ground surface to water level) 6 ft.
- g) Distance to nearest existing domestic well:
On applicants property 500-1500 ft. On property owned by others 300' +

2. Dugout Information Estimates

- a) Surface Dimensions _____ Depth _____
- b) Depth to water (ground surface to water level) _____

3. Water Storage Dams

If the proposed water use system contains one or more storage dams, please furnish the information requested below. The locations of each dam should be shown on the map submitted with the application.

- a) If a private engineering firm or government agency was involved in the design of this dam please give their name and address

b) Freeboard _____

c) Crest Width _____

Crest Length _____

d) Height _____

e) Outlet Dimensions:
Pipe diameter _____

Spillway width _____


f) X & Y Slope
Upstream _____

Downstream _____

Surface Area of Impoundment _____

Storage _____ acre feet

Drainage area above dam _____

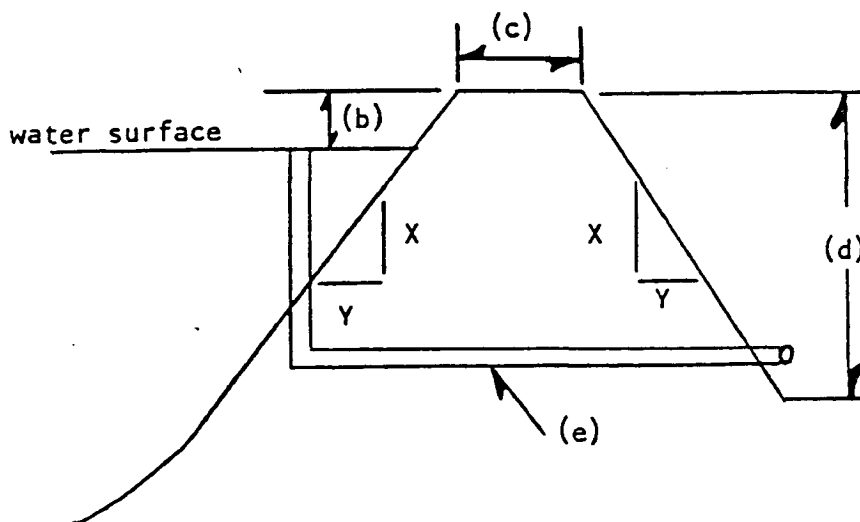

X Ronald D. Zimmerman
Signature of Applicant

SUMMARIZED TEST HOLE LOGS
DRILLED BY LACEY WELL DRILLING
MAY 1984

Section 34-T115N R52W (SW 1/4)

<u>34-1</u>	0-3	Topsoil
	3-6	Gravel & Clay
	6-15	Rusty Sand
	15-16	Blue Clay
	WL=6'	
<u>34-2</u>	0-3	Topsoil
	3-5	Yellow Clay
	5-15	Brown Sand
	15-21	Blue Clay
	WL=6'	
<u>34-3</u>	0-6	Topsoil
	6-10	Mud
	10-22	Brown Sand & Gravel
	22-23	Clay
	23-43	Brown/Rusty Gravel-Coarse
	43-	Blue Clay
	WL=10'	
<u>34-4</u>	0-10	Topsoil
	10-12	Brown Gravel
	12-14	Hard Clay
	14-18	Mud
	18-30	Gravel-Coal Flecks
	30-33	Blue Clay
	WL=6'	
<u>34-5</u>	0-2	Topsoil
	2-4	Yellow Sand & Gravel
	4-15	Yellow Clay
	15-38	Fine Silty Sand
	38-48	Medium Sand & Gravel - Silty Streaks
	48-	Blue Clay
	WL=7'	No Sample
<u>34-6</u>	0-2	Topsoil
	2-4	Yellow Clay
	4-10	Brown Sand & Fine Gravel
	10-43	Sand - Good - Fine to Medium
	43-44	Blue Clay
	WL=6'	

34-7 0-2 Topsoil
 2-20 Brown Sand & Fine Gravel
 20-43 Gray Sand & Gravel - Good - Rocky @ 34'±
 43- Blue Clay


WL=5'

34-8 0-2 Topsoil
 2-4 Mud
 4-18 Sand
 18-20 Mud-Clay
 20-25 Fine Sand
 25-28 Clay
 28-35 Silty Sand
 35- Blue Clay


No Sample

34-9 0-2 Topsoil
 2-5 Clay & Mud
 5-19 Brown Sand
 19-20 Clay
 20-43 Gray Sand & Gravel
 43- Blue Clay

WL=5'

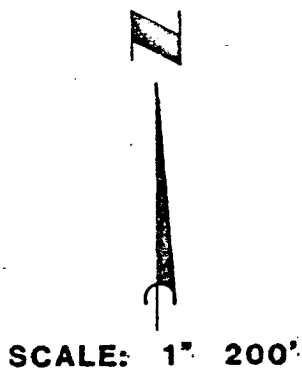

SE1/4 SW1/4 SECTION 34
T115N R52W

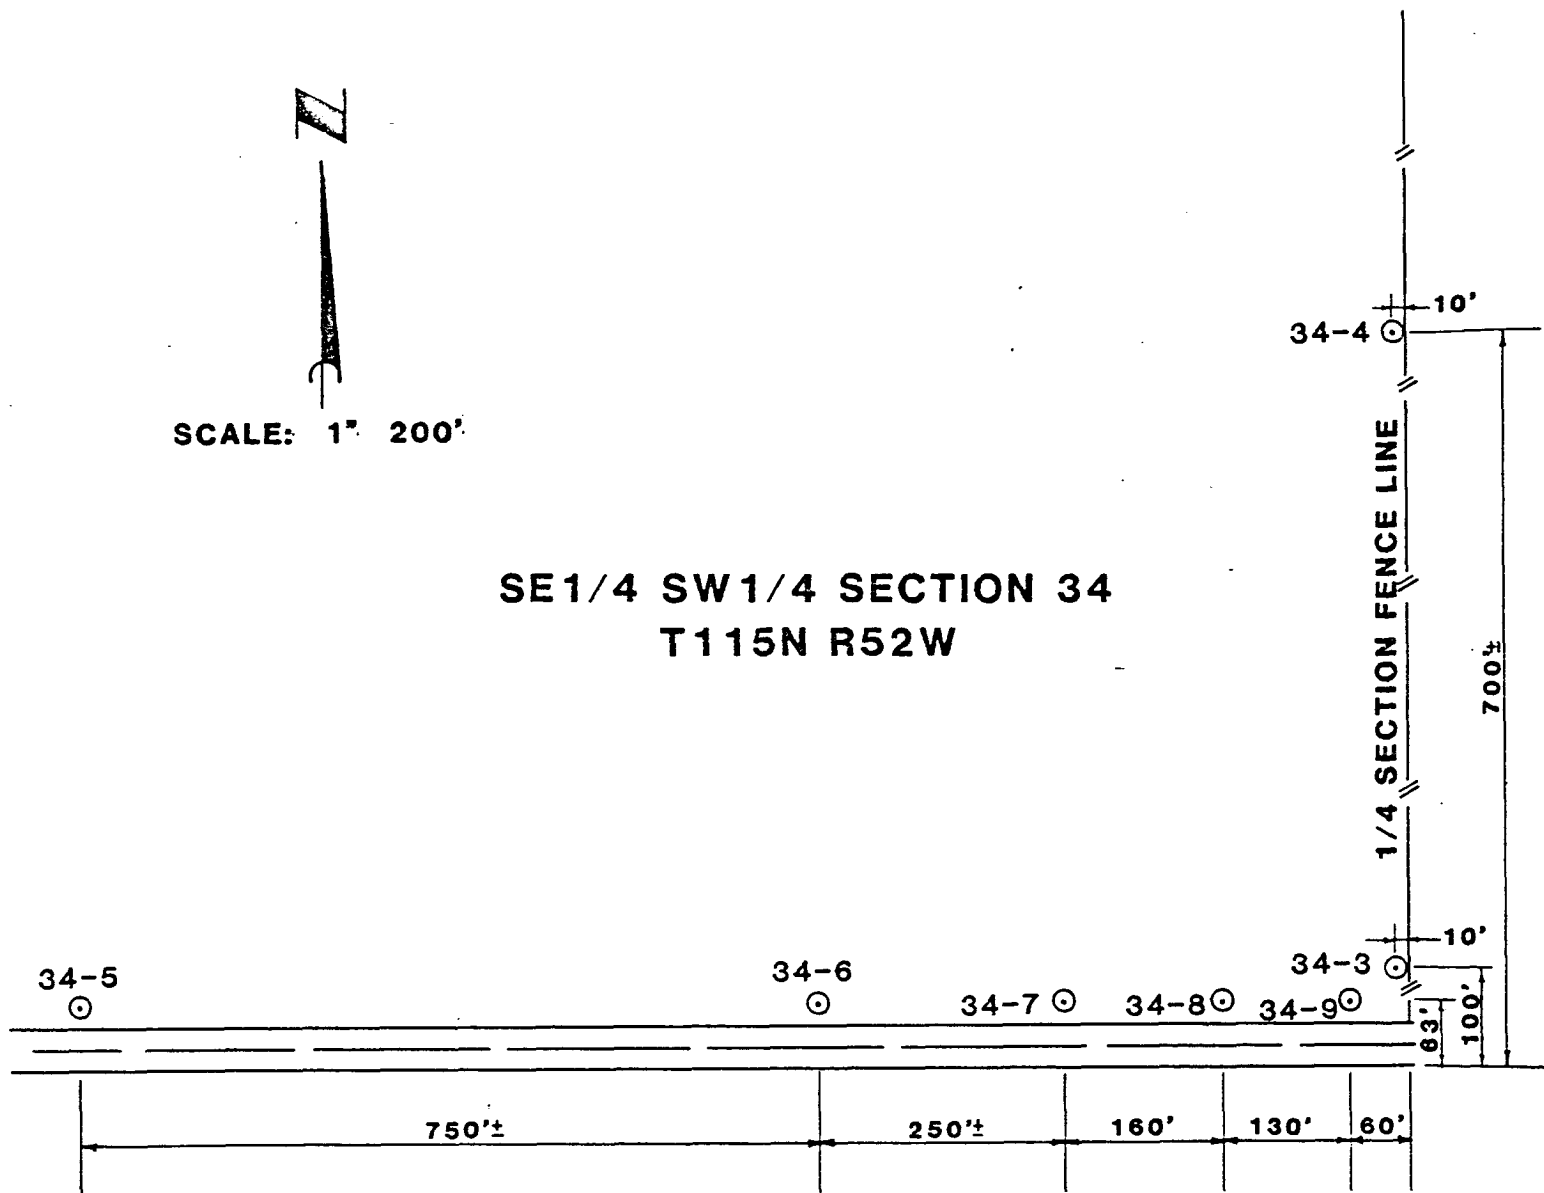

TEST HOLE LOCATION MAP
CASTLEWOOD WELL FIELD




DeWild Grant Rectort & Associates Co.
Denver, Colorado
Rock Rapids, Iowa
Sioux City, Iowa
Sioux Falls, South Dakota

Date
Drawn By
Approved
Revised

SIoux RURAL WATER SYSTEM
WATERTOWN, SOUTH DAKOTA

Aug 1985 98-5

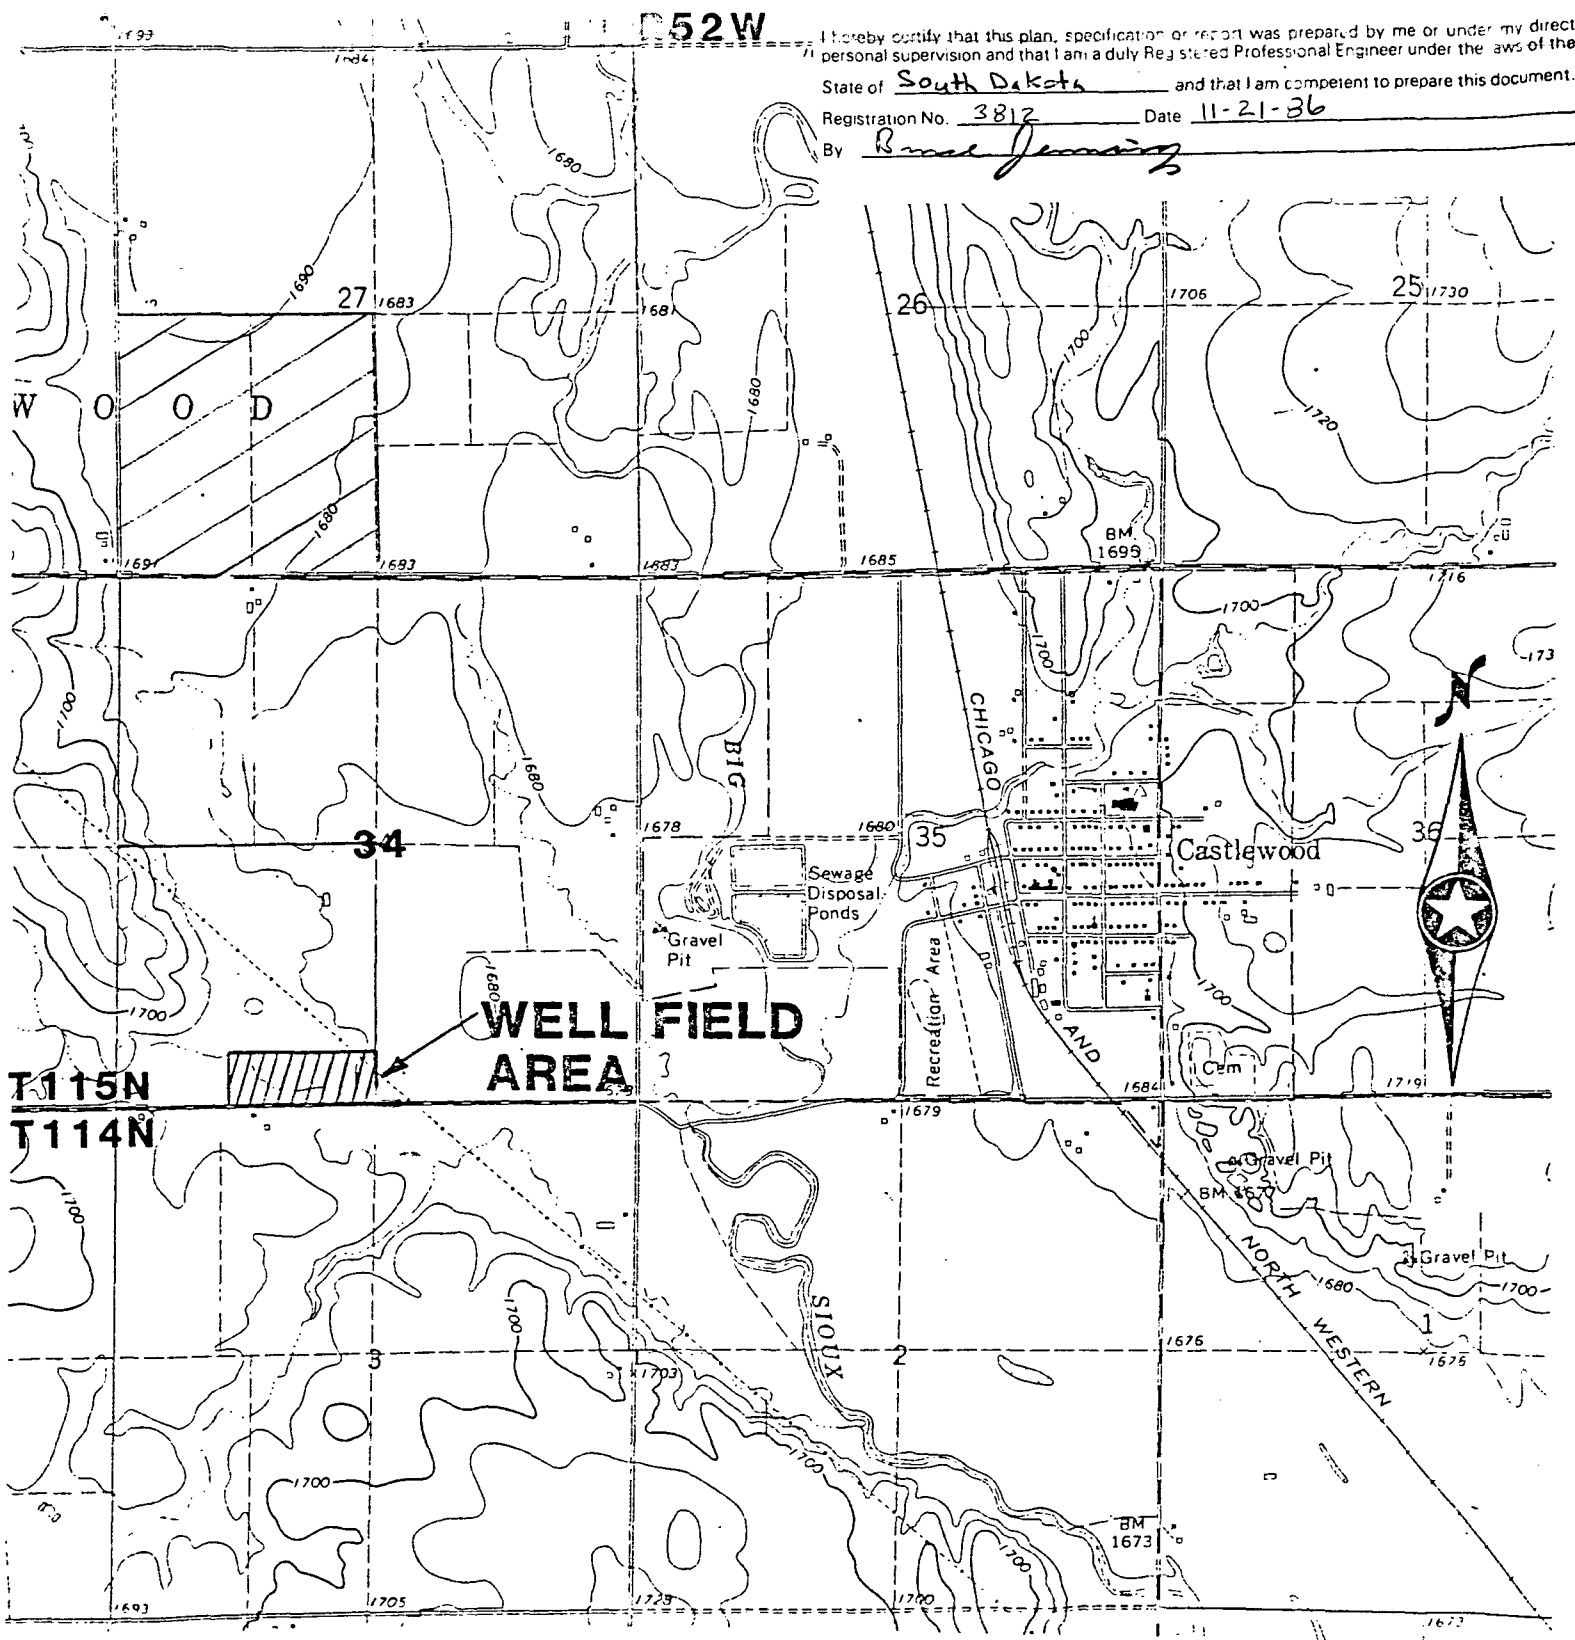

I hereby certify that this plan, specification or report was prepared by me or under my direct personal supervision and that I am a duly Registered Professional Engineer under the laws of the State of South Dakota and that I am competent to prepare this document.
 Registration No. 3812 Date 11-21-36
 By Russ Jennings

GENERAL LOCATION PLAN CASTLEWOOD WELL FIELD




DeWitt Grant Reckert & Associates Co.
 Architecture Engineering Planning
 Rock Rapids, Iowa
 Sioux City, Iowa
 Sioux Falls, South Dakota

Date
 Drawn By
 Approved
 Revised

**SIOUX RURAL WATER SYSTEM
 WATERTOWN, SOUTH DAKOTA**

D1

Russ Jennings

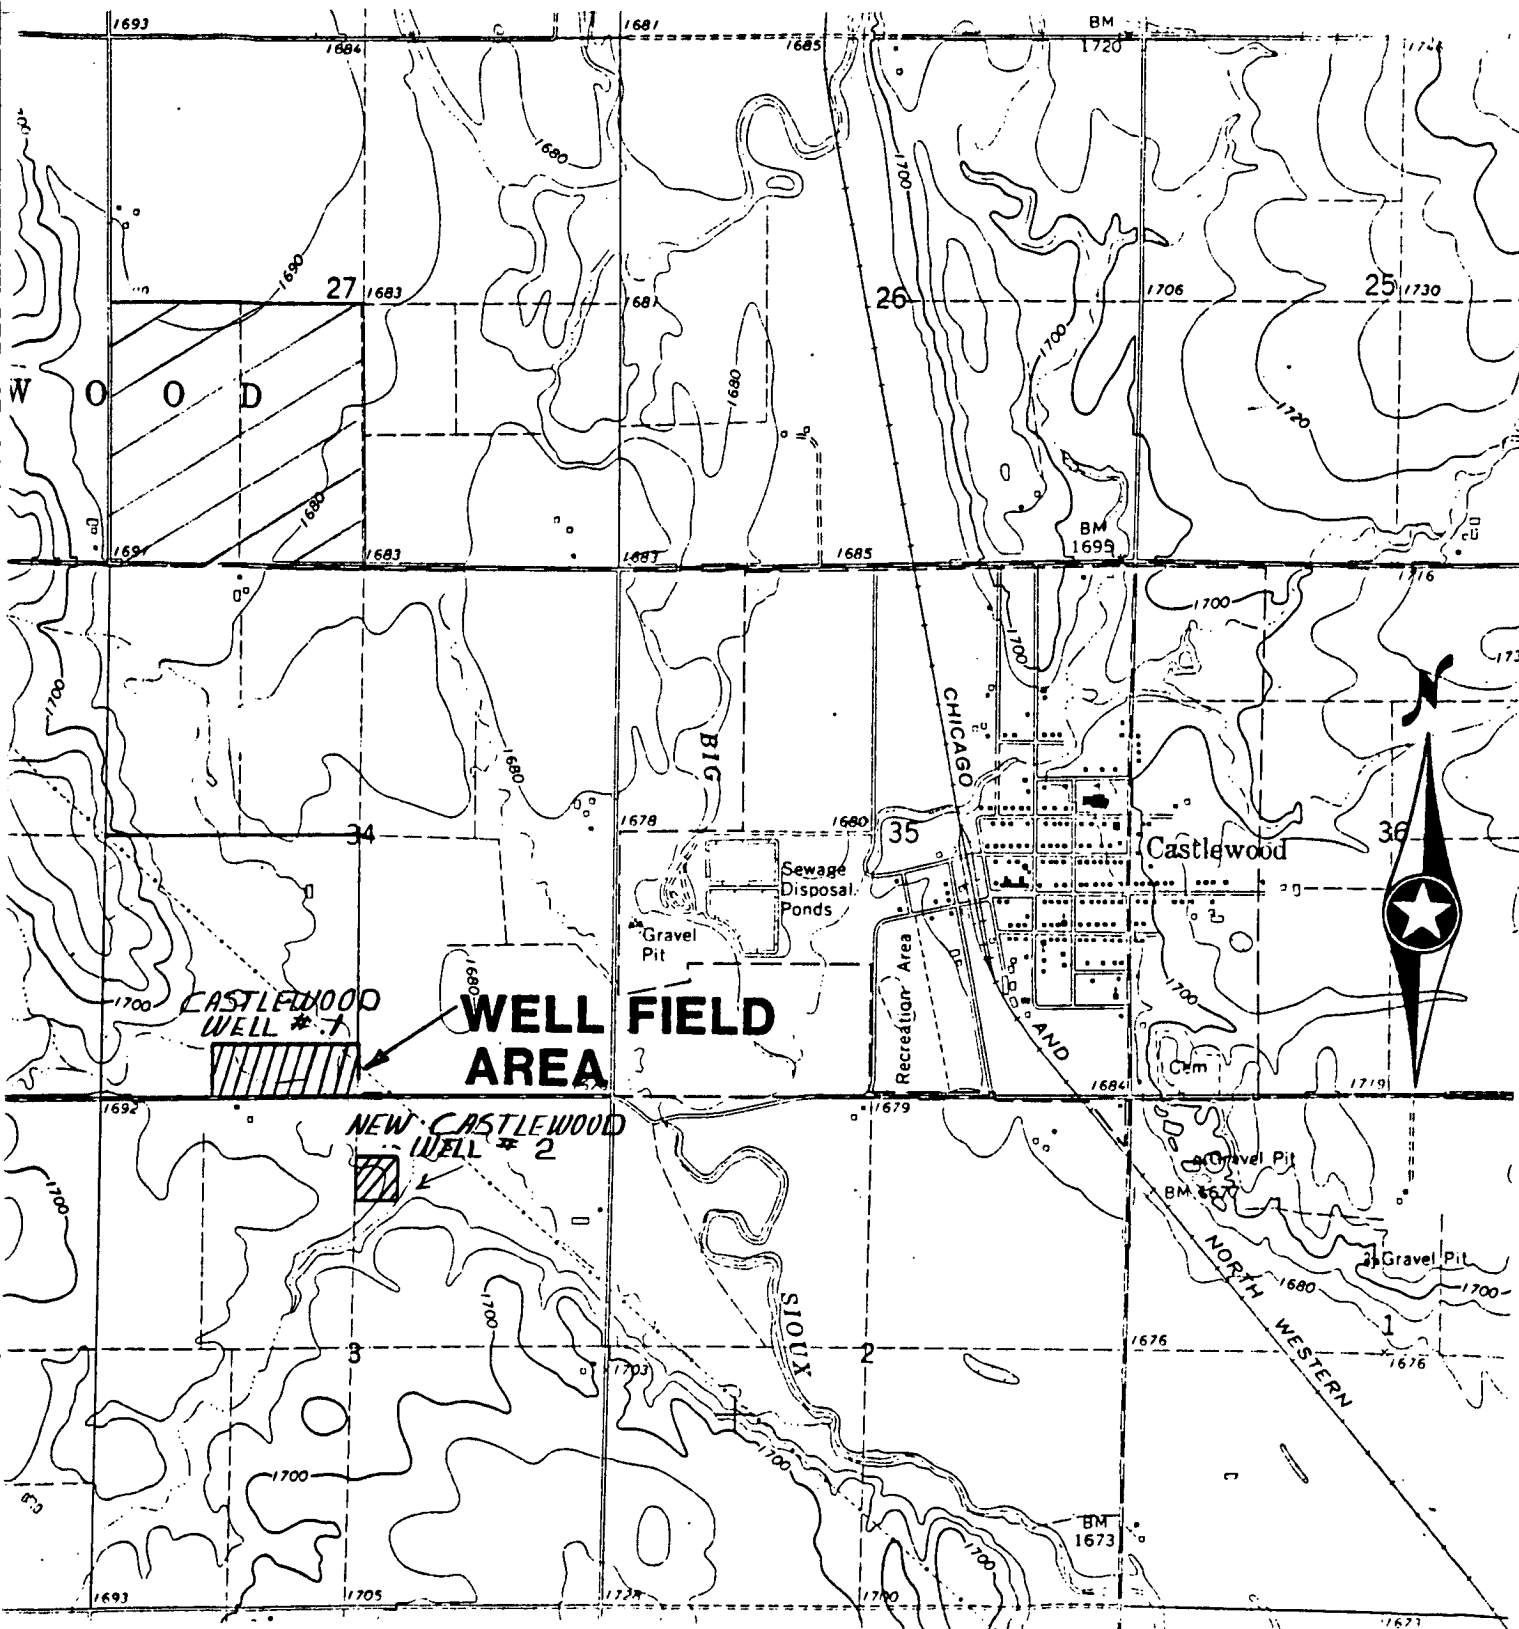

GENERAL LOCATION PLAN CASTLEWOOD WELL FIELD



DeWild Grant Reckert & Associates Co.
Architecture Engineering Planning

Rock Rapids, Iowa
Sioux City, Iowa
Sioux Falls, South Dakota

Date
Drawn By
Approved
Revised

SIoux RURAL WATER SYSTEM
WATERTOWN, SOUTH DAKOTA


STATE OF SOUTH DAKOTA WELL DRILLERS REPORT

Location SE 1/4 SW 1/4 Sec. 34 Twp. 15N Rg. 52W

County

HAMLIN

Please mark well location with an "X"

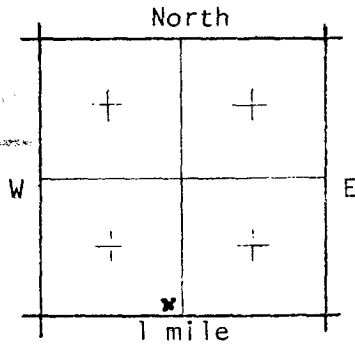Well Completion Date 7-17-84

PROPOSED USE:

☒ Domestic ☐ Municipal ☐ Test Holes
☐ Irrigation ☐ Industrial ☐ Stock

Method of Drilling:

False casing

WELL CONSTRUCTION:

Diameter of hole 20 inches Depth 38 feetCasing: ☒ Steel ☐ Plastic ☐ OtherSpecify 12" std pipePipe Weight _____ Diameter _____ From _____ To _____
 _____ lb/ft _____ inches +2 feet 26 feet

_____ lb/ft _____ inches _____ feet _____ feet

Was a well screen used? ☒ Yes ☐ No

If Not Specify _____

Screen Type SS Slot Size .100Length 12' Diameter 12"Was Casing left open end? ☐ Yes ☐ NoWas a Packer or seal used? ☐ Yes ☐ No

If so what material? _____

Was well gravel packed? ☒ Yes ☐ NoWas well grouted? ☒ Yes ☐ NoDescribe grouting procedure CEMENTEDup last 5'To what depth? 5' Feet

What was grouting material? _____

If cement, how many sacks? 18

Location of packer(s) and screen or perforated pipe _____

WAS WELL PLUGGED OR ABANDONED ☐ Yes ☐ No

If so how and with what material? _____

Well Owner

Name SIOUX RIMSAddress Box 810, Brookings, SD

Well Log:

Depth

Formation

From

To

Gumbo	0	4'
CLAY	4	5
COARSE GRAVEL	5	19
CLAY LENS	19	20
COARSE BROWN GRAVEL	20	36
GRAVEL & ROOTS	36	38

STATIC WATER LEVEL 3 Feet

If flowing: closed in pressure _____ PSI

GPM flow _____ through _____ inch pipe

Controlled by ☐ Valve ☐ Reducers ☐ Other

If other; specify _____

Can well be completely shut off? _____

WELL TEST DATA:

☒ Pumped☐ Bailed☐ Other

Describe: _____

Pumping Level Below Land Surface

_____ ft. After _____ Hrs. pumped _____ GPM

_____ ft. After _____ Hrs. pumped _____ GPM

_____ ft. After _____ Hrs. pumped _____ GPM

Remarks:

pumped around 500
 gpm for 2 days -
 & stay'd ABOVE SCREEN

This well was drilled under license # 111

and this report is true and accurate.

LACEY Well Drilling, Inc.
 Drilling Firm signed by _____
5-15-85

Date

RECEIPT

Division of Water Rights

South Dakota Department of Water and Natural Resources

410456

Pierre, June 2, 19 86

RECEIVED OF Sioux Rural Water System, RR#4, Box 162, Watertown, SD 57201

the following amount in fees for services rendered as provided for by law:

Fee for Application for Permit No. <u>5098-3</u> to Appropriate Water, to construct works and to put water to beneficial use _____	375	00
Fee for Application for Permit No. _____ to Appropriate Water for Future Use _____		
Fee to retain Future Use Permit No. _____ after period of seven years.		
Fee for Inspecting Constructed Works, confirming beneficial use and issuing Water License No. _____		
Fee for Filing Transfer Form _____		
Fee for Filing Extension Request _____		
Fee for Certified Copy of _____		
Fee for Print Copy of Map _____		
Fee for Certifying _____		
Fee for _____		
(Any Other Work Provided by Law)	Total	375 00

By John Hatch
Chief Engineer

JOHN HATCH 



Department of Water & Natural Resources

Joe Foss Building
523 East Capitol
Pierre, South Dakota 57501-3181

Water Rights Division
605 773-3352

April 15, 1986

Bruce Jennings
315 1st Ave
Rock Rapids IA 51246

Dear Mr. Jennings:

This letter is in response to our telephone conversation on April 11, 1986. The Sioux Rural Water System wants to drill a second well with a pumping capacity similiar to the first well which is about 350 gpm. You wanted to know what action was necessary on the part of the rural water system to drill a second well.

Water Permit No. 4990-3 specifies a pumping rate of 1 cfs (450 gpm) which is 720 acre-feet per year. You stated that the combined diversions would not exceed 720 acre feet/year; however the combined pumping capacity of both wells would be about 1.55 cfs (700 gpm). The 1 cfs diversion rate specified on Permit No. 4990-3 would be exceeded, which requires a new permit. A new permit would not be required if total diversions from both wells did not exceed 1 cfs and the well is constructed prior to February 15, 1989.

Enclosed are the necessary forms to apply for a water permit. The forms must be completed and returned with the application fee if the rural water system plans to increase the pumping capacity over 1 cfs.

If I can answer any other questions, please contact me.

Sincerely,

A handwritten signature in dark ink, appearing to read "Ron Duvall". The signature is written in a cursive, flowing style.

RON DUVAL
Natural Resources Engineer

RD:ks

enclosures

Equal Opportunity Employer

SOUTH Dakota Department of
Water & Natural Resources

Joe Foss Building
523 East Capitol
Pierre, South Dakota 57501-3181

Water Rights Division
605 773-3352

June 10, 1986



Ronald D Timmons, Chairman
Sioux Rural Water System
RR 4, Box 162
Watertown SD 57201

Dear Mr. Timmons:

This letter is in response to the Sioux Rural Water System permit application received on June 1, 1986. The enclosed Form 2A's need to be signed and returned before the application can be processed.

Please contact us if you have any questions.

Sincerely,

RON DUVALL
Natural Resources Engineer

RD:ks

enclosures

REPORT ON APPLICATION NO. 5098-3
Sioux Rural Water System, Inc.
July 18, 1986

Water Permit Application No. 5098-3 requests 1.33 cubic feet of water per second from two wells located in the SW1/4 of Section 34, T115N, R52W. The source of water is the Big Sioux - North Aquifer. The water will supply the rural water system.

DISCUSSION

The Big Sioux - North Aquifer is a glacial deposit and is primarily under water table conditions. It underlies approximately 83,500 acres and has 151,430 acre feet of recoverable water in Codington, Hamlin, Grant, and Roberts Counties (Hedges et. al., 1982). Division of Water Rights observation well records of four observation wells indicate that the water table in this area fluctuates periodically but has risen in recent years. Recharge to this aquifer exceeds annual withdrawals according to the observation well readings.

EXISTING WATER RIGHTS

There are total of 36 permits which use water from the Big Sioux - North Aquifer for a total appropriation of 19,659 acre feet. The withdrawal of 19,659 acre feet of water would result in lowering the water level of the aquifer 2.8 inches assuming a constant drawdown over the entire surface area of the aquifer. The annual recharge to this aquifer is 3.2 inches (Hedges et al, 1983).

There are three permits in the immediate area which use water from the Big Sioux - North Aquifer. Water Right No. 588-3 diverts 0.89 cfs for municipal use for the town of Castlewood. Water Right No. 2036-3 diverts 1.89 cfs for the irrigation of 235 acres in section 26. Water Permit No. 2792-3 diverts 2.0 cfs for the irrigation of 143 acres in section 34.

CONCLUSIONS

1. There is unappropriated water available in the Big Sioux - North Aquifer.
2. There should be no adverse impacts on existing water rights in the area.
3. This application should be approved with the well interference qualification.



Tim Tollefsrud
Natural Resource Engineer

References:

Hedges, Lynn S. et al, 1982. Evaluation of Ground-Water Resources Eastern South Dakota and Upper Big Sioux River South Dakota and Iowa. Ground Water Recharge. Contract DACW 45-80-C-0185.

Hedges, Lynn s. et al, 1983. Evaluation of Ground-Water Resources Eastern South Dakota and Upper Big Sioux River South Dakota and Iowa. Ground Water Recharge. Contract DACW 45-80-C-0185.

RECOMMENDATION OF CHIEF ENGINEER FOR WATER PERMIT
APPLICATION NO. 5098-3

Pursuant to SDCL 46-2A-2, the following is the recommendation of the Chief Engineer, Water Rights Division, Department of Water and Natural Resources concerning Water Permit Application No. 5098-3, Sioux Rural Water System, Inc., RR 4, Box 162, Watertown SD.

The Chief Engineer is recommending APPROVAL of Application No. 5098-3 because 1) there is reasonable probability that there is unappropriated water available for the applicant's proposed use, 2) the proposed diversion can be developed without unlawful impairment of existing rights, 3) the proposed use is a beneficial use and 4) in the public interest with the following qualifications:

The wells approved under this Permit will be located near domestic wells and other wells which may obtain water from the same aquifer. The well owner, under this Permit shall control his withdrawals so there is not a reduction of needed water supplies in adequate domestic wells or in adequate wells having prior water rights.

See the attached report for additional information.



JOHN HATCH, Chief Engineer
July 28, 1986



Department of Water & Natural Resources

Joe Foss Building
523 East Capitol
Pierre, South Dakota 57501-3181

Water Rights Division
605 773-3352

July 28, 1986

NOTE:

TO BE SURE OF PUBLICATION ON
THE CORRECT DATES, CONTACT THE
NEWSPAPER RIGHT AWAY.

Sioux Rural Water System, Inc.
RR 4, Box 162
Watertown, South Dakota 57201

Dear Sir:

Your Application No. 5098-3 for a permit to appropriate water for

rural water use, has been examined and found to
comply with the South Dakota Water Laws and applicable rules. A notice of
your intent to appropriate water has been sent to the Publisher of the
~~Hamlin County Herald Enterprise~~ ----- printed at ~~Hayti, South Dakota~~
~~Watertown Public Opinion~~ ----- printed at ~~Watertown, South Dakota~~
~~Clear Lake Courier~~ ----- printed at ~~Clear Lake, South Dakota~~
~~Clark County Courier~~ ----- printed ~~Clark,~~
South Dakota. For your information, a copy of this notice, the recommendation
of the Chief Engineer and a report on the application are enclosed. Please
review this notice prior to publication and notify this office, if you have
any corrections or questions.

Be sure to contact the above newspaper to authorize publication of your notice
of intent to appropriate water and to arrange for payment. Early contact with
the paper can eliminate delays. The publisher has been instructed to publish
your notice once each week for two consecutive weeks with the last publication
to occur at least thirty days before the board meeting. We must receive
Proof of Publication before the application can be considered by the Water
Management Board.

Sincerely,

RON DUVALL
Natural Resources Engineer

enclosures

No. 5098-3

Instruction to Newspaper - Publish first publication of the following Notice on or before July 31, 1986 with 2nd publication 1 week later. The applicant is responsible for payment.

NOTICE OF HEARING on Application No. 5098-3 to Appropriate Water
~~and/or to Amend Water Permit or Water Right No. _____~~

Notice is hereby given that the Sioux Rural Water System, Inc. whose mailing address is RR 4, Box 162, Watertown,, South Dakota has made an application for a permit

to appropriate 1.33 cubic feet of water per second from two wells (Big Sioux Aquifer) 43 feet deep to be located in the SW $\frac{1}{4}$ of Section 34-T115N-R52W. The water will supply the rural water system.

Pursuant to SDCL 46-2A-2 the Chief Engineer of the Water Rights Division recommends APPROVAL of Application No. 5098-3 because 1) unappropriated water is available, 2) will be no unlawful impairment of existing rights, 3) is beneficial use of water and 4) is in the public interest.

This application will be considered by the Water Management Board at room 216, Joe Foss Building, 523 E. Capitol, Pierre, SD, September 3 1986 at 10:00 am.

The recommendation of the Chief Engineer is not final or binding upon the Board and the Board is authorized to 1) approve, 2) approve with qualifications, 3) defer, or 4) deny this application after it reaches a conclusion based upon facts presented at the public hearing. Any interested person who may be affected by a Board decision and who intends to participate in the hearing before the Board and present evidence or cross-examine witnesses according to SDCL 1-26, must file a written petition with BOTH the applicant and the Chief Engineer by August 22, 1986. The petition may be informal, but it must include a statement describing the petitioners interest in the application, the reasons for the petitioner's opposition to or support of the application, and the signature and mailing address of the petitioner or his legal counsel if legal counsel is obtained. The applicant need not file a petition.

This application is made pursuant to the provisions of SDCL 46-1-1 thru 46-1-9, 46-1-12 thru 46-1-15; 46-2-3.1, 46-2-9, 46-2-11, 46-2-13, 46-2-17; 46-2A-1 thru 46-2A-10, 46-2A-12, 46-2A-14, 46-2A-15; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-24, 46-5-25, 46-5-30.2 46-5-30.4, 46-5-31; ~~(ground)~~ 46-6-3, 46-6-3.1, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14; ~~(future use)~~ 46-5-38 thru 46-5-40; ~~(transfer lands)~~ 46-5-30.4, 46-5-33 thru 46-5-35; ~~(10,000 AFA)~~ 46-5-20.1, 46-5-8.1; and Board Rules ARSD 74:02:01:01 thru 74:02:01:15; ~~(future use)~~ 74:02:01:24 thru 74:02:01:25; ~~(10,000 AFA)~~ 74:02:01:15:02 thru 74:02:01:15:05.

This hearing is an adversary proceeding. The applicant or any person, after filing a petition, has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any person wishing a copy of the Chief Engineer's recommendation, further information on this application or to assure access to the hearing by the handicapped can contact the Water Rights Division, DWNR, Joe Foss Bldg, Pierre SD (605 773-3352) for assistance prior to the hearing date. The time of the hearing will be automatically extended for at least twenty days upon written request of the applicant or any person who has filed a petition to oppose or support the application. The request for extension must be filed with the Chief Engineer by August 22, 1986.

Form 8 - Proof of Publication - Notice of
Intent to Appropriate Water

No. 5098

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County DEUEL) ss.

I, Gary DeJong hereby

certify that the annexed printed copy of Notice of Intent to Appropriate

Water was taken from the Clear Lake Courier

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the _____

City of Clear Lake

County of Deuel and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

July 31, 1986

Aug. 7, 1986

Gary DeJong
(Signature)

Publisher
(Title)

August 7, 1986
(Date Signed)

Cost of Printing: 43.96

NOTICE OF HEARING
ON APPLICATION NO. 5098-3
TO APPROPRIATE WATER

Notice is hereby given that the Sioux Rural Water System, Inc. whose mailing address is RR 4, Box 162, Watertown, South Dakota has made an application for a permit to appropriate 1.33 cubic feet of water per second from two wells (Big Sioux Aquifer) 43 feet deep to be located in the SW 1/4 of Section 34-T115N-R52W. The water will supply the rural water system.

Pursuant to SDCL 46-2A-2 the Chief Engineer of the Water Rights Division recommends APPROVAL of Application No. 5098-3 because 1) unappropriated water is available, 2) will be no unlawful impairment of existing rights, 3) is beneficial use of water and 4) is in the public interest.


This application may be considered by the Water Management Board at room 216, Joe Foss Bldg., 523 E. Capitol, Pierre, SD, September 3, 1986 at 10:00 a.m.

The recommendation of the Chief Engineer is not final. The Board is authorized to 1) approve, 2) apply conditions, 3) defer, or 4) deny the application after it reaches a conclusion based upon facts presented at the hearing. Any interested person may be affected by a Board decision who intends to participate in the hearing before the Board and must file evidence or cross-examine witnesses according to SDCL 1-26, must file a written petition with BOTH the applicant and the Chief Engineer by August 22, 1986. The petition may be original, but it must include a statement describing the petitioner's interest in the application, the reasons for the petitioner's opposition to the support of the application, and the signature and mailing address of the petitioner or his legal counsel if the petitioner is not the applicant. The applicant must file a petition.

This application was made pursuant to the provisions of SDCL 46-1-1 thru 46-1-9, 46-1-12 thru 46-1-15; 46-2-3.1, 46-2-9, 46-2-11, 46-2-13, 46-2-17; 46-2A-1 thru 46-2A-10, 46-2A-12, 46-2A-14, 46-2A-15; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-22, 46-5-25, 46-5-30.2, 46-5-30.4, 46-5-31, 46-6-3, 46-6-3.1, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14; and Board Rules ARSD 74:02:01:01 thru 74:02:01:15.

This hearing is an adversary proceeding. The applicant or any person, after filing a petition, has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any person wishing a copy of the Chief Engineer's recommendation, further information on this application or to assure access to the hearing by the handicapped can contact the Water Rights Division, DWRN, Joe Foss Bldg., Pierre SD (605 773-3352) for assistance prior to the hearing date. The time of the hearing will be automatically extended for at least twenty days upon written request of the applicant or any person who has filed a petition to oppose or support the application. The request for extension must be filed with the Chief Engineer by August 22, 1986. July 31 & Aug. 7



No. 5098-3

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
County Hamlin) ss.

Public Notices

Notice of Hearing

NOTICE OF HEARING on Application No. 5098-3 to Appropriate Water

I, Lois K. Latt

certify that the annexed printed copy of Notice of

Water was taken from the Herald Ex

A newspaper which during the whole time of pub
herein after stated, has been and is printed and pul

Town of Hamlin

County of Hamlin and St
that the said notice was published in said newspa
two dates:

July 31, 1986

August 7, 1986

Notice is hereby given that the
Sioux Rural Water System, Inc.,
whose mailing address is RR4, Box
162, Watertown, South Dakota, has
made an application for a permit to
appropriate 1.33 cubic feet of water
per second from two wells (Big Sioux
Aquifer) 43 feet deep to be located in
the SW 1/4 of Section 34-T115N-
R52W. The Water will supply the
rural water system.

Pursuant to SDCL 46-2A-2 the
Chief Engineer of the Water Rights
Division recommends APPROVAL of
Application No. 5098-3 because 1)
unappropriated water is available, 2)
will be no unlawful impairment of
existing rights, 3) is beneficial use of
water and 4) is in the public interest.

This application will be considered
by the Water Management Board at
room 216, Joe Foss Building, 523 E.
Capitol, Pierre, SD, September 3,
1986 at 10:00 a.m.

The recommendation of the Chief
Engineer is not final or binding upon
the Board and the Board is authorized
to 1) approve, 2) approve with quali-
fications, 3) defer, or 4) deny this
application after is reaches a conclu-
sion based upon facts presented at
the public hearing. Any interested
person who may be affected by a
Board decision and who intends to
participate in the hearing before the
Board and present evidence or cross-
examine witnesses according to
SDCL 1-26, must file a written
petition with BOTH the applicant and
the Chief Engineer by August 22,
1986. The petition may be informal,

but it must include a statement de-
scribing the petitioner's interest in the
application, the reasons for the pe-
titioner's opposition to or support of
the application, and the signature and
mailing address of the petitioner or
his legal counsel if legal counsel is
obtained. The applicant need not file
a petition.


This application is made pursuant
to the provisions of SDCL 46-1-1 thru
46-1-9, 46-1-12 thru 46-1-15; 46-2-
3.1, 46-2-9, 46-2-11, 46-2-13, 46-
2-17; 46-2A-1 thru 46-2A-10, 46-2A-
12, 46-2A-14, 46-2A-15; 46-5-1 thru
46-5-11, 46-5-13 thru 46-5-15, 46-
5-24, 46-5-25, 46-5-30.2, 46-5-
30.4, 46-5-31; 46-6-3, 46-6-3.1,
46-6-6.1, 46-6-10, 46-6-13, 46-6-
14; and Board Rules ARSD
74:02:01:01 thru 74:02:01:15;

This hearing is an adversary pro-
ceeding. The applicant or any person,
after filing a petition, has the right to
be present or to be represented by a
lawyer. These and other due process
rights will be forfeited if they are not
exercised. Decisions of the Board
may be appealed to the Circuit Court
and the State Supreme Court as pro-
vided by law.

Any person wishing a copy of the
Chief Engineer's recommendation,
further information on this application
or to assure access to the hearing by
the handicapped can contact the
Water Rights Division, DWNR, Joe
Foss Bldg., Pierre SD (605 773-
3352) for assistance prior to the
hearing date. The time of the hearing
will be automatically extended for at
least twenty days upon written
request of the applicant or any person
who has filed a petition to oppose or
support the application. The request
for extension must be filed with the
Chief Engineer by August 22,
1986.

31-32

Cost of Printing: 41.72



Form 8 - Proof of Publication - Notice of
Intent to Appropriate Water

No. 5098-3

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)
) ss.
County Codington)

I, Monica A. Saathoff hereby

certify that the annexed printed copy of Notice of Intent to Appropriate

Water was taken from the Watertown Public Opinion

A newspaper which during the whole time of publication of said notice
herein after stated, has been and is printed and published in the _____

_____ city _____ of _____ Watertown _____

County of Codington and State of South Dakota;
that the said notice was published in said newspaper on the following
two dates:

July 31st, 1986

August 7th, 1986

Monica A. Saathoff
(Signature)

Bookkeeper
(Title)

August 7th, 1986
(Date Signed)

Cost of Printing: 69.70

WNR-808-7/79
Proof of Publication



WATERTOWN

NOTICE OF HEARING
on Application

No. 5098-3

to Appropriate Water

Notice is hereby given that the
Sioux Rural Water System, Inc.
whose mailing address is RR4,
Box 162, Watertown, South
Dakota has made an application
for a permit to appropriate 1.33
cubic feet of water per second
from two wells (Big Sioux
Aquifer) 43 feet deep to be
located in the SW1/4 of Section
34-T115N-R52W. The water will
supply the rural water system.

Pursuant to SDCL 46-2A-2 the
Chief Engineer of the Water
Rights Division recommends
APPROVAL of Application No.
5098-3 because 1) unappropriated
water is available, 2) will be no
unlawful impairment of existing
rights, 3) is beneficial use of
water and 4) is in the public in-
terest.

This application will be con-
sidered by the Water Manage-
ment Board at room 216, Joe
Foss Building, 523 E. Capitol,
Pierre, SD, September 3, 1986 at
10:00 a.m.

The recommendation of the
Chief Engineer is not final or
binding upon the Board and the
Board is authorized to 1) ap-
prove, 2) approve with qualifica-
tions, 3) defer, or 4) deny this
application after it reaches a
conclusion based upon facts
presented at the public hearing.
Any interested person who may
be affected by a Board decision
and who intends to participate in
the hearing before the Board and
present evidence or cross-ex-
amine witnesses according to
SDCL 1-26, must file a written
petition with BOTH the applicant
and the Chief Engineer by
August 22, 1986. The petition may
be informal, but it must include a
statement describing the peti-
tioners interest in the applica-
tion, the reasons for the peti-
tioner's opposition to or support
of the application, and the

signature and mailing address of
the petitioner or his legal counsel
if legal counsel is obtained. The
applicant need not file a petition.

This application is made pur-
suant to the provisions of SDCL
46-1-1 thru 46-1-9, 46-1-12 thru 46-
1-15; 46-2-3.1, 46-2-9, 46-2-11, 46-2-
13, 46-2-17; 46-2A-1 thru 46-2A-10,
46-2A-12, 46-2A-14, 46-2A-15; 46-5-1
thru 46-5-11, 46-5-13 thru 46-5-15,
46-5-24, 46-5-25, 46-5-30.2, 46-5-30.4,
46-5-31; 46-6-3, 46-6-3.1, 46-6-6.1,
46-6-10, 46-6-13, 46-6-14; and Board
Rules ARSD 74:02:01:01 thru
74:02:01:15;

This hearing is an adversary
proceeding. The applicant or any
person, after filing a petition, has
the right to be present or to be
represented by a lawyer. These
and other due process rights will
be forfeited if they are not exer-
cised. Decisions of the Board
may be appealed to the Circuit
Court and the State Supreme
Court as provided by law.

Any person wishing a copy of
the Chief Engineer's recommen-
dation, further information on
this application or to assure ac-
cess to the hearing by the handi-
capped can contact the Water
Rights Division, SWNR, Joe Foss
Bldg, Pierre, SD (605 773-3352)
for assistance prior to the hear-
ing date. The time of the hearing
will be automatically extended
for at least twenty days upon
written request of the applicant
or any person who has filed a
petition to oppose or support the
application. The request for ex-
tension must be filed with the
Chief Engineer by August 22,
1986.

(July 31; August 7, 1986)

10/14 @ 3.40X23 69.70


STATE OF SOUTH DAKOTA)
) ss.
County Clark)

46-A-15; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-24, 46-5-25, 46-5-30.2, 46-5-30.4, 46-5-31; 46-6-3, 46-6-3.1, 46-6-6.1, 46-6-10, 46-6-13, 46-6-14; and Board Rules ARSD 74:02:01:01 thru 74:02:01:15.

This hearing is an adversary proceeding. The applicant or any person, after filing a petition, has the right to be present or to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised. Decisions of the Board may be appealed to the Circuit Court and the State Supreme Court as provided by law.

Any person wishing a copy of the Chief Engineer's recommendation, further information on this application or to assure access to the hearing by the handicapped can contact the Water Rights Division, DWNR, Joe Foss Bldg., Pierre, SD (605 773-3352) for assistance prior to the hearing date. The time of the hearing will be automatically extended for at least twenty days upon written request of the applicant or any person who has filed a petition to oppose or support the application. The request for extension must be filed with the Chief Engineer by August 22, 1986.

7-30-2t

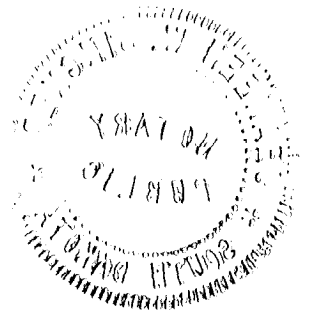



Department of Water & Natural Resources

Joe Foss Building
523 East Capitol
Pierre, South Dakota 57501

Water Rights Division
605 773-3352

NOV 14 1986

Ronald D. Timmons
Sioux Rural Water System
RR 4, Box 162
Watertown SD 57201

Dear Mr. Timmons:

Enclosed herewith is your Water Permit No. 5098-3 as approved by the Water Management Board authorizing you to construct your water diversion system and the water to beneficial use, not exceeding the limits as specified in said Water Permit No. 5098-3.

Also enclosed is Form 10; Notice of Completion of Works and Application of Water to Beneficial Use, which you are to complete and submit to the Chief Engineer when you have completed the system and/or have put the water to beneficial use. An inspection can then be scheduled so that your Water License may be issued to you, thus completing your acquisition of a Water Right.

Very truly yours,

JOHN HATCH, Chief Engineer
Water Rights Division

JH: ks

enclosure

PLEASE NOTE: Certain changes can be made in your permit within the five year construction period, usually without affecting the priority date provided an application to amend your permit is made within the five year period-i.e. changes in location or number of diversion points (wells) or location of land to be irrigated. Well locations for wells into the same aquifer can be moved up to 660 feet without application.

Applications to amend a permit after the five year construction period will be assigned a new priority date. Applications to change water sources, to add lands or increase original diversion rates, if approved will usually receive the date of the new application as a priority date regardless of the five year construction period.

WNR-809-5/83



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

July 9, 1992

Permit No. 5098-3

Sioux Rural Water System
RR 4, Box 162
Watertown, SD 57201

Dear Sirs:

The inspection of your water use system and the inspection of the extent of application of water to beneficial use, as developed under Water Permit Nos. 4990-3 and 5098-3, has been completed. Your final water right document, the Water License, can now be issued. Upon licensing, the applicable portions of Water Permit No. 4990-3 will be incorporated into 5098-3.

Statutes require that we charge a \$50.00 fee for the inspection and issuance of the Water License. Upon receipt of the \$50.00 fee from you, we will begin processing your Water License.

South Dakota Water Law 46-5-30.1 requires that a permit holder may not divert water until the \$50.00 license fee has been paid. Please contact us if you have any questions.

Sincerely,

Cheryl F. Frost
Secretary
Water Rights Division
(605) 773-3352

NOTE: On check or money order, please specify your permit number. This will insure proper handling of the fee.

Big Sioux River Water District**Report Of Examination Of Works And/Or Application Of Water To Beneficial Use**

TO: Chief Engineer, Division of Water Rights, DWRN, Foss Bldg., Pierre, SD 57501

I have this day made a thorough examination of the water use system constructed by Sioux Rural Water
System RR4 Box 162 of Watertown SD 57201 holder of
 Permit No. 4990-3 5098-3, bearing the priority of December 19 83
June 1 86 authorizing
 the diversion of 1.33 cu. ft. per second of the waters of groundwater
 for Rural Water System purposes, in Hamlin County.

I have to report on the conditions of the same as follows:

A. Works used to divert the water:

#1 Layne 6"-15HP Pump No. 103236 with a GE Energy Saver Vertical Motor
Model No. SK8254 GNN3022 Frame L2S4TP10 capable of 450gpm

#2 Layne 6"-20HP No. 7CLV with a Franklin motor capable of 450gpm
submersible

B. Works used to transport water to place of use:

#1 6" PVC 100'
 #2 6" PVC 800'

C. Works used to apply water to beneficial use:

Supply the Rural Water System in the Sioux district.

The system is in the following condition good

The point of diversion is located CW#1 230' N and 277.0' W of the SE Corner Sec 34-T115N-R52W
CW#2 500' S and 2740' E of the NW corner Sec 3-T114N-R52W

The works are capable of diverting and conveying to the place of use 2cu. ft. per second of water which is to be used for Rural Water System Use

Water has been put to beneficial use to the maximum extent as follows:

Hamlin Co, Codington Co., Deuel Co., Clark Co.

comprising a total of NA acres of land and the license should be issued for 2 cfs *Applicable permit qualifications have been complied with X Yes NoExceptions to compliance are: Date 8/6/1991* CW#1 - 1 cfsCW#2 - 1 cfs

Norma C. Sob
 (signature)

LICENSE FOR PERMIT NUMBER 4990-3
5098-3

1. Legal location of wells: CW#1 - SE 1/4 SW 1/4 Sec 34-T115N-R52W
CW#2 - NW 1/4 NE 1/4 Sec 3-T114N-R52W

dams & structures: _____

2. Well Information: Well Drilling Firm Lacey Well Drilling

CW#1 CW#2

Completion Report Yes _____ No _____ No. of Wells 2 Depth 38' 34'

Casing a) diameter 12" 14" Screen a) type Stainless Steel

b) length 33' 26' b) length 10' 8'

c) type Steel Steel Static Water Level 3' 6'1"

a) make Layne Layne Motor a) make GE Energy Saver Franklin

b) model 103236 7CLV b) model No. 5K8254ANN3022

c) size 6" 6" c) horsepower rating 15 20

d) capacity 450 450 gpm Frame L2S4TP10

e) turbine pump - no. of stages 2

f) operating PSI 25-30 10

3. Distribution lines or canals

a) size 6" 6"

b) type PVC PVC

c) length 100' 800'

4. Dam Information:

a) height to crest _____ m) Outlet tubes:

b) height to primary spillway _____ 1) diameter _____

c) height to secondary spillway _____ 2) type _____

d) crest width _____ 3) valved (Y/N) _____

e) crest length _____ 4) valve type _____

f) spillway length _____ 5) location on structure _____

g) spillway width _____

h) approx. storage _____ n) Category of Dam _____

i) approx. storage to crest _____

j) date constructed _____

k) inspection sheet completed (Y/N) _____

l) Name of Contractor _____

#2 is a submersible pump

5. System Type a) sideroll:

- 1) length _____ feet
- 2) diameter of pipe _____
- 3) make, model & number of
sprinklers _____
- 4) spacing of sprinklers _____
- 5) nozzle size _____

c) gun

- 1) make _____
- 2) nozzle size _____
- 3) capacity (GPM) _____
- 4) hose size _____
- 5) hose length _____

e) gated pipe

- 1) length _____
- 2) diameter _____
- 3) spacing of gates _____

f) portable boom

- 1) make _____
- 2) nozzle size _____
- 3) capacity (GPM) _____

b) towline:

- 1) length _____ feet
- 2) make, model & number of
sprinklers _____
- 3) spacing of sprinklers _____
- 4) nozzle size _____

d) center pivot

- 1) make _____
- 2) number of towers _____
- 3) distance between towers _____
- 4) overall length _____
- 5) end gun (Y/N) _____
- 6) high or low pressure _____
- 7) make & size of nozzles _____
- 8) capacity (GPM) _____

g) siphons

- 1) size _____
- 2) number _____

NOTE: For Permits with additional wells or changes in well locations, record the following for each well: pumping capacity, date constructed, well driller and if a well log is available.

Indicate any other permit(s) which are associated with project _____

Yes	No	Check Items
___	___	1. Soil and water permit lands agree with lands being irrigated and lands listed on permit?
___	___	2. Special qualifications to permit being abided by?
___	___	3. All structures, wells and lands on map?
___	___	4. Irrigation Questionnaires checked to determine if permit owner started irrigation by end of construction period?
___	___	5. Is chemigation used?
___	___	6. If yes, does equipment comply with chemigation rules?

REMARKS:



GREAT FACES. GREAT PLACES.

**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

August 22, 1991

Lacey Well Drilling
Attn: Jim/Joan Lacey
P.O. Box 796
Trent, SD 57065

Dear Mr./Mrs. Lacey:

Currently, I am in the process of licensing some water permits. The final step is to obtain some well logs that your company may have drilled for these permits. The wells for these permits are located:

Permit No. 4990-3 SW 1/4 SE 1/4 Section 34-T115N-R52W Well for Sioux RWS.
NE 1/4 NW 1/4 Section 27-T116N-R52W Well for Sioux RWS.


If you have drilled these wells, please send the well log as soon as possible so that I can continue the process of licensing the water permits.

If you have any questions, feel free to contact me at (605) 773-3352.

Sincerely,

Norma C. Job
Natural Resources Engineer
Division of Water Rights

NOT TO SCALE

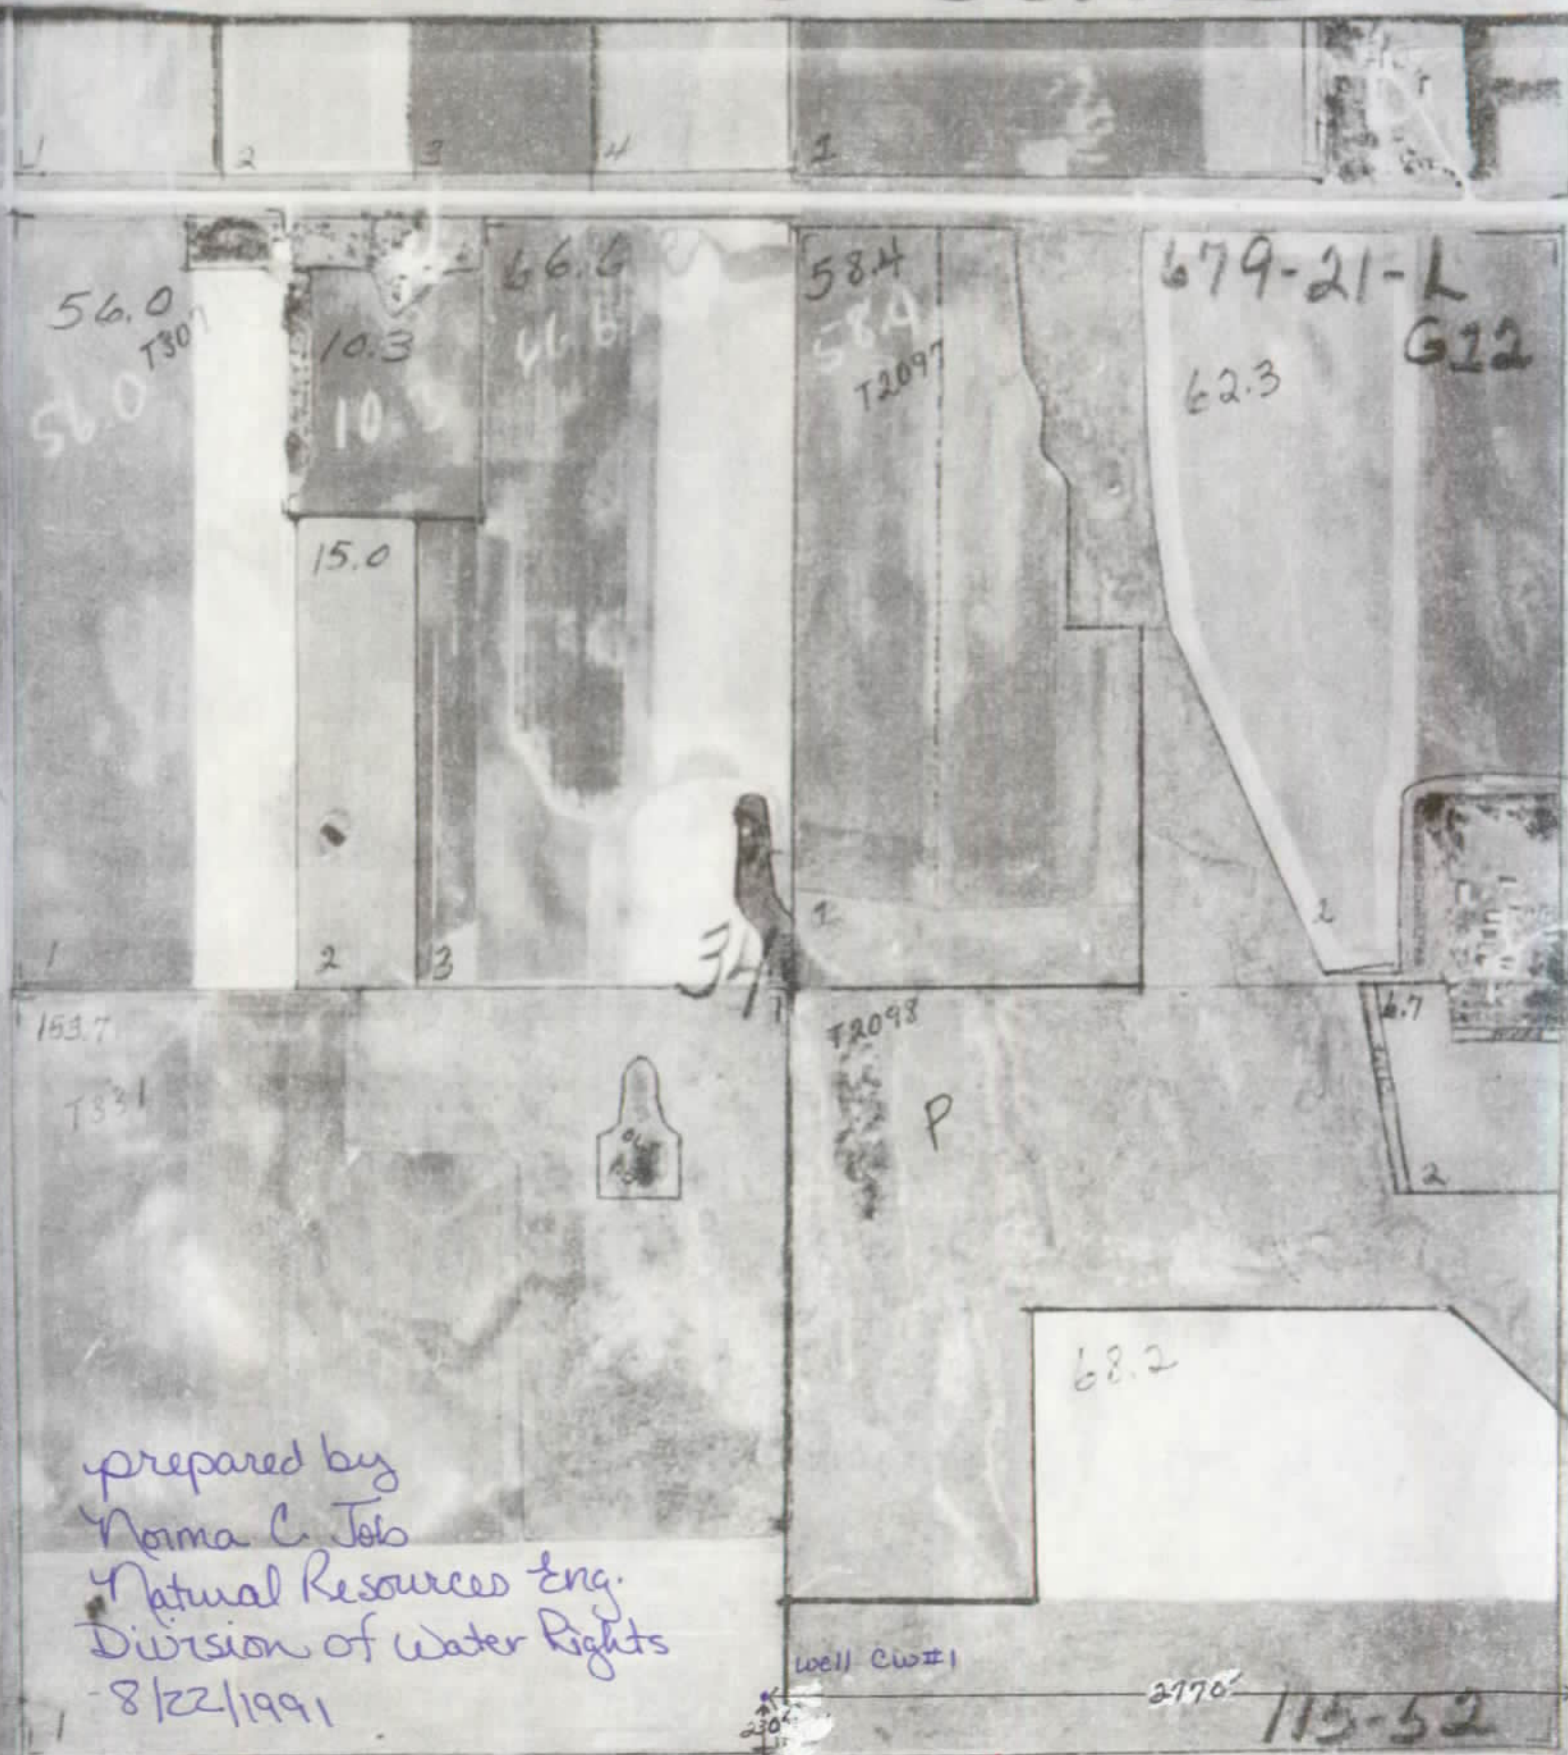

RECEIPT

413353

Division of Water Rights

South Dakota Department of Environment and Natural Resources

Pierre, _____, July 29, 19 92

RECEIVED OF Sioux Rural Water System, Inc., RR 4 Box 162, Watertown, SD 57201

the following amount in fees for services rendered as provided for by law:

Fee for Application for Permit No. _____ to Appropriate Water, to construct and to put water to beneficial use _____		
Fee for Application for Permit No. _____ to Appropriate Water, for Future Use _____		
Fee to retain Future Use Permit No. _____ after period of seven years.		
Fee for Inspecting Constructed Works, confirming beneficial use and issuing Water License No. <u>5098-3</u>	50	00
Fee for Filing Transfer Form _____		
Fee for Filing Extension Request _____		
Fee for _____		

(Any Other Work Provided by Law)	Total	50 00

By John Hatch
Chief Engineer



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3181

AUG 18 1992

5098-3

Sioux Rural Water System, Inc.
RR 4, Box 162
Watertown, SD 57201


Dear Sirs:

Enclosed is Water License No. 5098-3. This is the final water right document completing your process of obtaining a Water Right. Enclosed is Receipt No. 413353 in the amount of \$50.00 which you paid for the inspection and issuance of the Water License.

For your information SDCL 46-6-27 requires that if the owner of an existing well, such as the well authorized by Water Right No. 5098-3, constructs a replacement well and does not plan to use the old well, the old well is considered abandoned and must be plugged. Also, any well that is being used or is not considered abandoned must be valved and controlled, if flowing, or sealed and capped so that no leaking occurs either underground or at the surface.

As long as you use the water beneficially, as stated in the Water License, the State Water Laws provide that you have a continuing right to use the water. If you have any questions, please contact our office.

Very truly yours,


JOHN HATCH, Chief Engineer
Water Rights Division
(605) 773-3352

enclosures

NOTE: The applicable portions of Water Permit No. 4990-3 are incorporated into this Water License No. 5098-3.

STATE OF SOUTH DAKOTA

WATER LICENSE NO. 5098-3

(1) Sioux Rural Water System, Inc. of RR 4, Box 162, Watertown, SD 57201 made Application No. 5098-3, June 1, 1986 for a water permit to appropriate 1.33 cubic feet of water per second from groundwater (two wells), Hamlin County, South Dakota for rural water system purposes. Permit No. 5098-3 with a priority date of June 1, 1986 was approved September 3, 1986 and issued to applicant(s) for diversion of water with construction of the described water supply system to be completed on or before September 3, 1991 and for the application to beneficial use of said water on or before September 3, 1995.


The two new wells authorized under Water Permit No. 5098-3 were to operate concurrently with the existing well permitted under Water Permit No. 4990-3. Only one of the wells authorized under No. 5098-3 was constructed.

The applicable portions of Water Permit No. 4990-3 are incorporated into this Water License No. 5098-3. Well #1 carries a priority date of December 19, 1983 and Well #2 carries a priority date of June 1, 1986.

(2) It is certified that the applicant has complied with the provisions of South Dakota State Law relating to completion of the construction of the water supply system and is entitled to divert 2.00 cubic feet of water per second for beneficial use. The location of the diversion points are: Well #1 - 230'N and 2770'W of the SE corner Section 34, T115N, R52W and Well #2 - 500'S and 2740'E of the NW corner of Section 3, T114N, R52W, (Well #2 is within 660 feet of the authorized area).

(3) The applicant has complied with the provisions of South Dakota State Law relating to the application of water to beneficial use. The water utilized from the two wells serves rural residents in Hamlin, Codington, Deuel and Clark Counties in South Dakota.

(4) Pursuant to Section 46-5-30.1 Sioux Rural Water System, Inc. of RR 4, Box 162, Watertown, SD 57201 the holder(s) and/or owner(s) of Incorporated Water Permit No. 5098-3 is issued a license to appropriate water, the right to use 2.00 cubic feet of water per second from groundwater (two wells) with priority dates of December 19, 1983 (Well #1 & 1.00 cfs) and June 1, 1986 (Well #2 & 1.00 cfs) from the location specified in (2) of this license. The water will be used for rural water system purposes. This license is subject to any limitations or qualifications listed in Incorporated Water Permit No. 5098-3 and subject to South Dakota State Law.

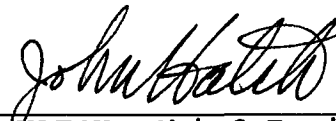

AUG 18 1992

JOHN HATCH, Chief Engineer
Water Rights Division
Department of Environment and
Natural Resources