

WATER PERMIT NO. 6210-3

Name of Applicant: City of Sioux Falls

Address: 224 W 9th St, Sioux Falls SD 57104

Phone: 605 367-7025

Amount of Water Claimed: 55.8 cfs (10,000 AF)

Total Acres: NA

Source of Water Supply: Big Sioux River

Water to be used for: municipal

County: Minnehaha

Type of Waste Disposal System:

Location: north of Sioux Falls

PRIORITY Date Received: 5-10-2000

Fee: \$2,325

Corrected Application Received: 5-23-2000

Period of Annual Use: January 1 – December 31

Remarks: Withdrawals are from Future Use Permit No. 3981A-3

Diversion Point: W ½ Section 33 and N ½ Section 32; all in T102N-R49W

	⊗				
32		33		34	
5		4		3	

Land to be Irrigated: NA

Depth of Well: NA

Well Driller: : NA

Remarks:

Type of Map: plat

Prepared by: Gary Meyer, Utilities Engr.

Reviewed and the Number Assigned on: 5-30-2000

By: Karen Schlaak

Notice of Hearing - date to intervene: _____

**SOUTH DAKOTA
WATER PERMIT NO. 6210-3**

Date of first receipt of application May 10, 2000.

Date of return to applicant for corrections, amendments or changes May 17, 2000.

Date of receipt of corrected application May 23, 2000.

The Water Management Board approved Water Permit Application No. 6210-3 on September 28, 2000 for the City of Sioux Falls, 224 West 9th St, Sioux Falls SD 57104 authorizing the construction of the water use system and the placing of water to beneficial use subject to the following limitations, conditions and qualifications:

1. Water Permit No. 6210-3 authorizes placing to beneficial use 10,000 acre-feet annually from the Big Sioux River reserved under Future Use Permit No. 3981A-3. The point of diversion is at the city's Big Sioux River pump station located in the NW¼ NE¼ Section 32; all in T102N-R49W. Currently, the city is authorized by Water Permit No. 5334-3 to divert up to 13.8 cubic feet of water per second (cfs) with a maximum annual volume of 10,000 acre feet from the pump station. Since the pump station is capable of diverting water at a maximum rate of 69.6cfs, the city is authorized to increase the diversion rate from 13.8 cfs to 69.6 cfs (55.8 cfs additional).
2. The water appropriated shall be used for the purpose of supplying water for municipal use and may not exceed the amount of water needed for beneficial use.
3. The water is to be used during the following described annual period: January 1 – December 31.
4. The date from which applicant may claim right is June 6, 1977 (established by Future Use Permit No. 3981A-3).
5. One-fifth of the construction is to be completed on or before March 28, 2003.
6. All construction is to be completed on or before September 28, 2005.
7. Water is to be put to beneficial use on or before September 28, 2009.
8. Water rights obtained in compliance with the laws of the State of South Dakota may not be unlawfully impaired by this appropriation.

QUALIFICATIONS

1. Low flows as needed for downstream domestic use, including livestock water and prior water rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River unless at least 20cfs is being by-passed, when pumping at the Cliff Avenue USGS gauging station, or unless written orders have been issued by the Chief Engineer.
2. The City of Sioux Falls shall report to the Chief Engineer annually the amount of water withdrawn from the Big Sioux River.

WATER MANAGEMENT BOARD

By: Garland Erbele
Garland Erbele, Chief Engineer
Water Rights Program
Department of Environment and Natural Resources

NOV 15 2000

date



FORM 2: Application for uses other than irrigation
(type or print)

Mail to: Water Rights Program Joe Foss Building 523 E. Capitol Pierre, SD 57501-3181 (605) 773-3352	No. <u>6210-3</u>	(office use only) Hydrologic Unit <u>10170203</u>
	Basin <u>Sioux River</u>	
	Newspaper <u>Argus Leader & Sioux Valley News</u>	



Application For Permit To Appropriate Water Within The State Of South Dakota

Check use(s) of water:

☒ Municipal	☐ Suburban Housing	☐ Recreational	☐ Institutional
☐ Rural Water System	☐ Commercial	☐ Fish & Wildlife	☐ Geothermal Heat
☐ Domestic (over 18 gpm)	☐ Industrial	☐ Other	

Type of Application: 3981-3 New Vested Right (Use predates Mar 2, 1955) Future Use Reservation
(check one) Place to Beneficial Use Water Reserved by Future Use Permit No.
Amendment/Correction to Permit No.

Description of amendment/correction: (i.e. change diversion point(s), add diversion point(s), change use, etc.)

- Name of Applicant City of Sioux Falls SD Phone 605-367-7025
(check one) Owner Tenant/lessee
Mailing Address 224 West 9th Street, Sioux Falls State SD 57104
(Street, RR, or Box and City) (Zip Code)
55.8
- Amount of water claimed 13.8 *CFS or 6,194 **GPM 10,000/yr ***AF
(*Cubic Feet per Second) (**Gallons per Minute) (**Acre Feet - storage capacity of dam/dugout or annual use if applicable)
- Source of water supply Big Sioux River
- Location of point of diversion (example - 3 wells in SW1/4 NE1/4 section 12-T104N-R53W) At confluence of Big Sioux River
Diversion channel north of City. Intake located at W1/2 section 33, N 1/2 section 32, T102N-R49W
County Minnehaha
- County or counties where water will be used Minnehaha and Lincoln
- Annual period during which water is to be used January 1 - December 31
- Give a description of the project. When available include any preliminary engineering report or other reports or information that will help explain the project. (Attach sheet if more space is needed) **Request for additional water for municipal use for City of Sioux Falls, SD. Requesting permit for an additional 10,000 acre-feet at 13.8 cfs annually from existing future use permit no.'s 3981-3 and 3981A-3.** 69.6

STATE OF SOUTH DAKOTA)
County of Minnehaha SS

Attachments: Attach Form 2A if diversion is from a well or dugout, or if storage of water is proposed. Attach map and any other technical information. (see instructions)

I, Randy Janssen, the applicant, certify that I have read this application, have examined the attached map and that the matters stated are true and that I intend, and am able to complete the necessary construction.


Applicant's signature Randy Janssen

Subscribed and sworn to before me this 5th day of May 2000

Darla Cottrill My Commission Expires: 9/5/05

Supplemental Information

(type or print in ink)

**1. Well Information - Proposed Construction**

- a) Drill Hole Diameter _____ Depth _____
- b) Casing Type _____ Diameter _____ Thickness _____
- c) Screen Type _____ Diameter _____ Thickness _____
- d) Gravel Pack _____ Length of Gravel Pack _____
- e) Depth to Top of Water Bearing Material _____
- f) Depth to Water (ground surface to water level) _____
- g) Distance to nearest existing domestic well:
- On applicants property _____ On property owned by others _____

2. Wastewater Disposal System Information

- a) Type of System (i.e. septic tank, drain field) _____
- b) System Capacity (gallons) _____ Year Constructed _____
- c) Connected to the City of _____ Sanitary System _____


3. Dugout Information

- a) Surface Dimensions _____ Depth _____
- b) Depth to water (ground surface to water level) _____


4. Water Storage Dams

If the proposed water use system contains one or more storage dams, please furnish the information requested below for each dam. The locations of the dams need to be shown on the map submitted with the application.

- a) If a private engineering firm or government agency was involved in the design of this dam, please give their name and address:

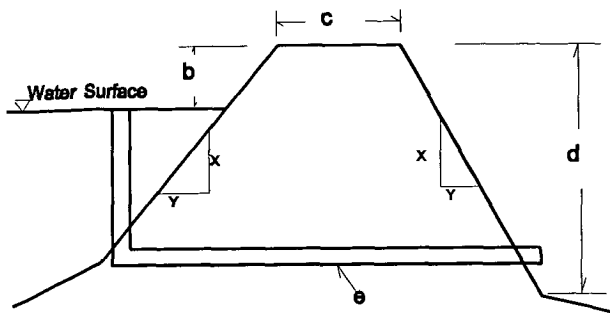

- b) Freeboard _____
- c) Crest Width _____
 Crest Length _____
- d) Height _____
- e) Primary Outlet Capacity _____
 If pipe, diameter _____
- f) Secondary Spillway Capacity _____
 Spillway Width _____
- g) X & Y Slope _____
 Upstream _____
 Downstream _____
- h) Surface Area of Impoundment _____
- i) Storage _____ Acre Feet
- j) Drainage Area Above Dam _____ Acres

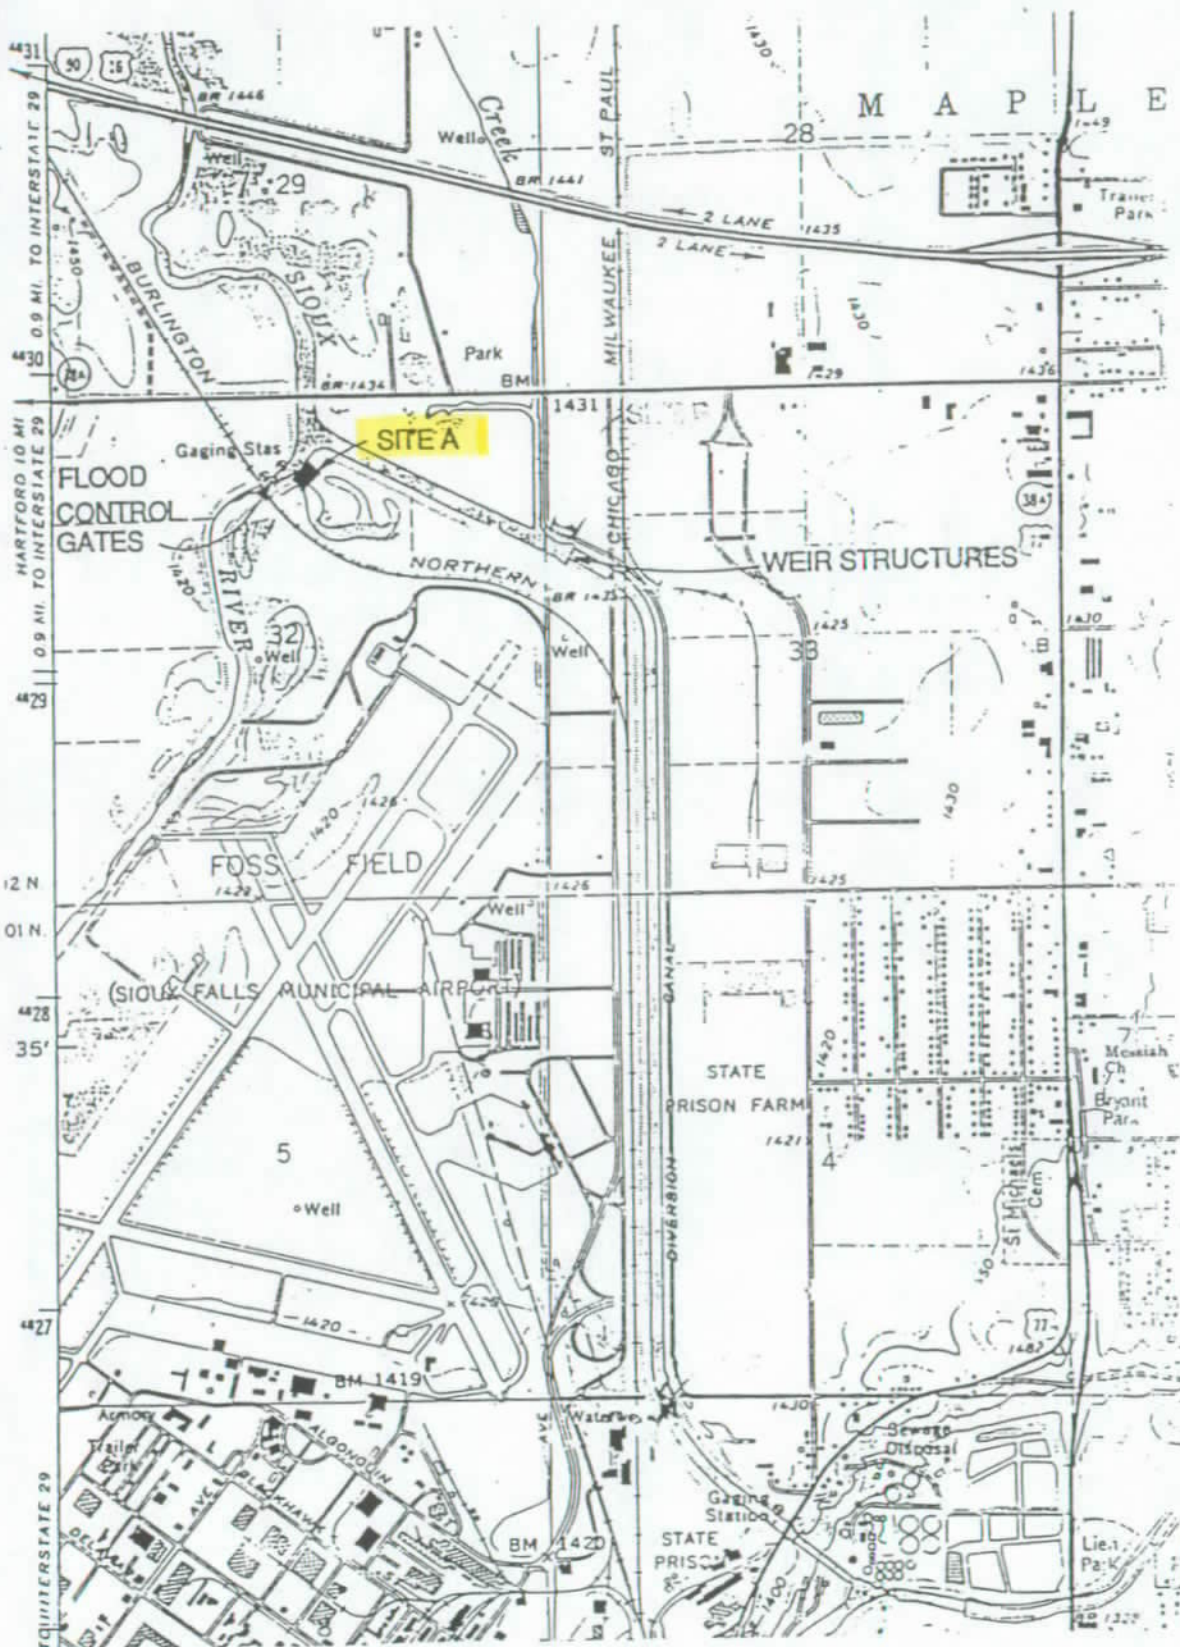


David M. Meyer
Utility Eng'r.



SIOUX FALLS
 RAW WATER PUMPING STATIC
 SITE ALTERNATIVES

FIGURE 5.1

6210-3



PUBLIC WORKS

CITY OF SIOUX FALLS

AN EQUAL OPPORTUNITY EMPLOYER

224 West Ninth Street, Sioux Falls, SD 57104-6407

Hearing Impaired (605) 367-7039

Web Site: www.siuox-falls.org

May 3, 2000

Ron Duvall
Natural Resource Engineer
Water Rights Program
Department of Environment and Natural Resources
Joe Foss Building
523 East Capital
Pierre, SD 57501-3181



Dear Mr. Duvall:


Subject: Request for additional Water Rights

The City of Sioux Falls is interested in making application for an additional water right permit. Please review the requests and brief description noted below.

Increase water usage from Big Sioux River from 10,000 annual acre-feet, by an additional 10,000-acre feet, for a total of 20,000 annual acre-feet. The City currently has a water permit no. 5334-3 which appropriates 13.8 cfs from the Big Sioux River with an annual volume limit of 10,000 acre feet (3.25 billion gallons per year). The City has in reserve 40,000 acre-feet from the Big Sioux River as specified in Future use Permit nos. 3981-3 and 3981A-3. The City has utilized its surface water supply pushing the permit limits the last two years due to treatment enhancements at the water purification plant. In 1998 and 1999 surface water usage was 3.07 billion gallon per year. To ensure that City can meet future demands we are requesting additional 10,000 acre-feet.

I have enclosed an application for Permit to Appropriate Water within the State of South Dakota. Please review application and let me know if more information is needed.

Sincerely,

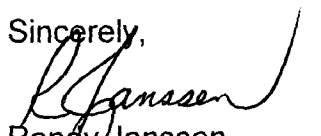
Randy Janssen
Water Superintendent

Public Works Administration

(605) 367-7143
FAX (605) 367-4605

Water Reclamation

(605) 367-7088
FAX (605) 367-8484

Lights

(605) 367-7150
FAX (605) 367-8306

Streets

(605) 367-7051 or 367-7008
FAX (605) 367-7010

Billing

(605) 367-7031
FAX (605) 367-7341

Engineering

(605) 367-7048
FAX (605) 367-4310

Water Purification

(605) 367-7025
FAX (605) 367-8475

Water Meters/Utility Maintenance

(605) 367-7020
FAX (605) 367-7883





**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3181
www.state.sd.us/denr

May 17, 2000

Randy Janssen, Water Superintendent
City of Sioux Falls
224 W 9th St
Sioux Falls SD 57104

Dear Mr. Janssen:

Thank you for submitting the *Application for a Permit to Appropriate Water* for the City of Sioux Falls. In order to complete the application the following is required.

As we discussed on the phone yesterday, the city also needs to be permitted for the maximum pump rate that will be used from the Big Sioux River pump station. Currently, the city is allowed to divert at a maximum rate of 13.8 cubic feet of water per second ($\approx 6,200$ gpm) under Water Right Permit No. 5334-3. You indicated that each of the three pump stations are capable of diverting 15 million gallons of water per day (mgd) which equates to an approximate pump rate of 10,400 gpm (23.2 cfs). Therefore the total pump rate from all three pumps is 69.6 cfs. We also discussed that your ability to treat surface water (35 mgd) is a limiting factor but this amount can be exceeded if necessary. Please advise us what you want to apply for in terms of a maximum pump rate. Any pump rate (gpm) in excess of the maximum permitted diversion rate would be a violation of your water right permit. Specifying the maximum pump rate can be completed as part of this application to increase your annual diversion volume by 10,000 acre feet.


The application filing fee will be \$2,275.00. In addition to the application filing fee, the Water Rights Program now collects the \$50 licensing fee at the time of filing. Please submit a total of \$2,325.00. Enclosed is an invoice for this amount.

If you have any questions, please contact me.

Sincerely,

Ron Duvall
Water Rights Program
605 773-3352

enclosure



PUBLIC WORKS

CITY OF SIOUX FALLS

AN EQUAL OPPORTUNITY EMPLOYER

224 West Ninth Street, Sioux Falls, SD 57104-6407
Hearing Impaired (605) 367-7039
Web Site: www.siuux-falls.org

May 19, 2000

Ron Duvall
Natural Resource Engineer
Water Rights Program
Department of Environment and Natural Resources
Joe Foss Building
523 East Capital
Pierre, SD 57501-3181




Dear Mr. Duvall:

In response to your letter dated May 17, 2000, the City of Sioux Falls would like to apply for the maximum pumping rate of 69.6 cfs from our surface water pumping station, located on the Big Sioux River. This is in conjunction with the additional 10,000 acre-feet diversion volume requested previously. The invoice was received and payment is being processed. Once the permit fee is received by your office, what is the next step in the permitting process?

Thank you for your attention to this application.

Sincerely,


Randy Janssen
Water Superintendent

Public Works Administration

(605) 367-7143
FAX (605) 367-4605

Water Reclamation

(605) 367-7088
FAX (605) 367-8484

Lights

(605) 367-7150
FAX (605) 367-8306

Streets

(605) 367-7051 or 367-7008
FAX (605) 367-7010

Billing

(605) 367-7031
FAX (605) 367-7341

Engineering

(605) 367-7048
FAX (605) 367-7310

Water Purification

(605) 367-7025
FAX (605) 367-8475

Water Meters/Utility Maintenance

(605) 367-7020
FAX (605) 367-7883



RECEIPT

Water Rights Program

South Dakota Department of Environment and Natural Resources

N2 416539

Pierre, June 6J, 2000

RECEIVED OF City of Sioux Falls, 224 W. 9th St., Sioux Falls, SD 57104
the following amount in fees for services rendered as provided for by law:

Fee for Application for Permit No. <u>6210-3</u> to Appropriate Water, to construct and to put water to beneficial use _____	2,275	00
Fee for Application for Permit No. _____ to Appropriate Water, for Future Use _____		
Fee to retain Future Use Permit No. _____ after period of seven years.		
Fee for Inspecting Constructed Works, confirming beneficial use and issuing Water License No. <u>6210-3</u>	50	00
Fee for Filing Transfer Form _____		
Fee for Filing Extension Request _____		
Fee for _____		

(Any Other Work Provided by Law)	Total	2,325 00

By *Harold Schuler*
Chief Engineer



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3181
www.state.sd.us/denr

**RECOMMENDATION OF CHIEF ENGINEER FOR WATER PERMIT
APPLICATION NO. 6210-3, City of Sioux Falls**

Pursuant to SDCL 46-2A-2, the following is the recommendation of the Chief Engineer, Water Rights Program, Department of Environment and Natural Resources concerning Water Permit Application No. 6210-3, City of Sioux Falls, c/o Randy Janssen, 224 West 9th Street, Sioux Falls, SD 57104.

The Chief Engineer is recommending APPROVAL of Application No. 6210-3 because 1) there is reasonable probability that there is unappropriated water available for the applicant's proposed use, 2) the proposed diversion can be developed without unlawful impairment of existing rights, 3) the proposed use is a beneficial use and 4) it is in the public interest with the following qualifications:

1. Low flows as needed for downstream domestic use, including livestock water and prior water rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River unless at least 20 cfs is being by-passed, when pumping at the Cliff Avenue USGS gauging station, or unless written orders have been issued by the Chief Engineer.
2. The City of Sioux Falls shall report to the Chief Engineer annually the amount of water withdrawn from the Big Sioux River.

See report on application for additional information.

Garland Erbele, Chief Engineer
August 16, 2000

REPORT ON WATER PERMIT APPLICATION NO. 6210-3
City of Sioux Falls
July 24, 2000

Water Permit Application No. 6210-3, City of Sioux Falls, SD, proposes to construct and place to beneficial use an additional 55.8 cubic feet of water per second (cfs) (25044.7 gpm) [10,000 acre feet annually] from the Big Sioux River, reserved under Future Use Permit No. 3981A-3 with a priority date of June 6, 1977. The City of Sioux Falls is presently authorized by Permit No. 5334-3 to divert 13.8 cfs at the same June 6, 1977 priority date. To ensure future municipal demands can be met, the city is proposing to increase the diversion rate to the 69.6 cfs, the maximum amount reserved under Permit No. 3981A-3. The total annual withdrawal volume is to be increased to 20,000 acre-feet. The proposed diversion point will be at the pump station located near the start of the Sioux Falls Diversion Canal in the NW¼ NE¼ Section 32 T102N R49W (Attachment 2).

Review of Water Source

The water source for the proposed project is the Big Sioux River in Minnehaha County, SD. The Big Sioux River flows south from its origin north of Watertown, SD to the Missouri River near Sioux City, IA (Attachment 1). Just south of Sioux Falls, SD the Big Sioux River forms part of the border between South Dakota and Iowa. In 1960 a flood control system consisting of gates, diversion canal, and weir was completed to divert flood level flows of the Big Sioux River away from the city of Sioux Falls, SD (Attachment 2). Except for the river reach from Sioux Falls to Brandon, the Big Sioux River is progressively gaining or effluent from Watertown to the Missouri River.

Table 1 shows the average gain or loss in normal (50 percentile) and lower median flows for selected Big Sioux River reaches during the period of highest use, March through October. Attachment 3 contains the 10, 25, 50, 75, and 90 percentile monthly median flows for U.S. Geological Survey (USGS) gauge stations on the Big Sioux River. Hydrograph Attachments 6 through 10 graphically illustrate the monthly flows and gains/losses by river reach.

Table 1. Big Sioux River Average March through October Gain/Loss by Reach

Reach	50 Percentile Flow (cfs)	25 Percentile Flow (cfs)	10 Percentile Flow (cfs)
Watertown to Brookings	+124.13	+44.50	+32.88
Brookings to Dell Rapids	+62.63	+24.50	+12.88
Dell Rapids to Sioux Falls	+185.50	+49.88	+18.13
Sioux Falls to Brandon	-163.75	+3.25	+28.88
Sioux Falls to Akron, IA	+320.75	+162.50	+96.00

USGS data for Watertown (Attachment 3) indicate a non-reliable source of water at normal and lower flows during a July to October interval of any given year. Data from 1945 to 1998 show there is a 50 percent probability the flow in the Big Sioux River will be in the range of 1 to 60 cfs or greater at Watertown during a March through October interval. There is a 90 percent probability the flow will be in the 0 to 4 cfs range or greater during the same period.

Downstream of Brookings at normal and greater flows, non-appropriated water should be available for the existing water rights/permits during a March through October interval. USGS data show there is a 50 percent probability the flow in the Big Sioux River will be in the range of 36 to 297 cfs or greater at Brookings and 64 to 449 cfs or greater at Dell Rapids during a March through October interval (Attachment 3). During the same interval there is a 90 percent probability the flow will be in the 4 to 68 cfs range or greater at Brookings and 10 to 97 cfs or greater at Dell Rapids.

From 1971 to 1998 the USGS's Sioux Falls, SD Cliff Avenue stream flow gauge, downstream of the Diversion Canal discharge (Attachment 2), registered Big Sioux River flows with a median of 203 cfs, a maximum of 20,700 cfs, and a low of 0.8 cfs. The Sioux Falls wastewater treatment plant returns 12 to 13 million gallons per day (19-20 cfs) to the Big Sioux River downstream from the Cliff Avenue gauge that does not appear in the data used in the following calculations. Monthly median data (Attachment 3) show there is a 50 percent probability the flow in the Big Sioux River will be in the 102 to 760 cfs range or greater at Sioux Falls during a March through October interval. There is a 75 percent probability the flow in the Big Sioux River will be in the 41 to 258 cfs range or greater at Sioux Falls during the same interval. At the 90 percent probability, the flow could be in the 20 to 117 cfs range or greater during the same interval.

As indicated in Table 1 and the Sioux Falls-Brandon hydrograph (Attachment 9), the Big Sioux River between Sioux Falls and Brandon appears to be losing or influent at normal or greater flows. A stream that is normally gaining during its base flow may temporarily become losing during higher flows. If the crest depth in the channel is greater than the local water table elevation, the hydraulic gradient in the aquifer next to the stream is reversed and the flow is from the stream into the ground. The result is a temporary storage of water in the aquifer next to the stream. When the crest passes the hydraulic gradient reverses and again the stream becomes gaining. This could explain the loss at higher flow levels in the Sioux Falls to Brandon reach.

Downstream from Brandon the flow in the Big Sioux River is augmented by several streams to include; Beaver Creek (West), Beaver Creek (East), Rock River, and Brule Creek. Data from Table 1 and Attachment 10 indicate a substantial increase in the river's flow from Sioux Falls to Akron, IA at normal and greater flows. There is a 50 percent probability the flow in the Big Sioux River will be in the range of 232 to 1225 cfs or greater at Akron, IA during a March through October interval. At the 90 percent probability, the flow could be in the 67 to 312 cfs range or greater during the same interval.

Review of Existing Water Rights/Permits

From the Watertown area to Brookings there are 6 allocations senior to this application with total withdrawals of 6.03 cfs (Attachment 1). One allocation has a bypass qualification of 5 cfs. There are no water rights/permits along this river reach junior to this application. In Codington and Hamlin Counties the Big Sioux River can not be considered a reliable source of water from July through March at normal (50 percentile) or lower flow conditions.

From Brookings to Dell Rapids Gauging Station there are 12 senior and 3 junior allocations with 25.53 and 2.07 cfs total withdrawals respectively. Junior permit No. 6042-3, Raymond D.

Jensen, has a bypass qualification of 41 cfs and is subject to revision in the event the City of Sioux Falls develops water reserved by Future Use Permit No. 3981A-3. Junior water right No. 4093-3 and Permit No. 6124-3, Dell Rapids Golf and Recreation, have bypass qualifications of 50 cfs and reference the City of Sioux Falls' prior right under future use permit No. 3981A-3. Six of the senior allocations have bypass qualifications ranging from 20 to 45 cfs. Tributaries increase the river's flow in Brookings County downstream to Dell Rapids, and except for low flow conditions non-appropriated water should be available for these water rights/permits.

From the Dell Rapids Gauging Station to this application's diversion point there is one junior water permit No. 5431-3, held by the City of Sioux Falls, for 17.8 cfs for recharge of the Big Sioux Aquifer (Attachments 1 & 2). This permit has a 20 cfs bypass qualification. Withdrawals for aquifer recharge are normally made during low demand periods throughout the year. Non-appropriated water should be available for this allocation during normal and higher flow conditions along this river reach during a March to October interval.


Along the course of the Big Sioux River through Sioux Falls and downstream of the Diversion Canal floodgates there is one 2.2 cfs allocation senior to this application held by Morrell & Company. Eighty-two (82) percent (1.8 cfs) of this withdrawal is returned to the river 250 feet downstream of the company's plant and 18 percent (0.4 cfs) is returned through the Sioux Falls wastewater system. Along this reach of the river there are two permitted allocations junior to this application upstream of Morrell & Company. The City of Sioux Falls' Parks & Recreation Department holds these junior permits with withdrawals totaling 3.63 cfs for irrigation purposes. Both of these junior allocations have 20 cfs bypass qualifications. Skunk Creek enters the Big Sioux River upstream of the Parks & Recreation and the Morrell & Company diversion points. USGS Skunk Creek gauging station data (Attachment 5) indicate there is a 50 percent probability the flow in Skunk Creek will be in the range of 4 to 47 cfs or greater for a March to October interval. There is a 75 percent probability the flow in Skunk Creek will be in the range of 1 to 20 cfs or greater for the same interval. Except for low flow conditions, water should be available for the Morrell & Company and the Parks & Recreation Department allocations.

From the Cliff Avenue gauging station downstream of the Diversion Canal to Brandon, SD there are three water rights/permits senior to this application with diversions totaling 11.67 cfs, of which approximately 3.5 cfs is returned to the river by Northern States Power. These three allocations do not have bypass qualifications. There are no allocations junior to this application along this reach of the river. Except for low flow conditions, non-appropriated water should be available for these three senior water rights/permits.


Downstream from Brandon, SD to the Big Sioux River's confluence with the Missouri River there are 10 senior and 8 junior allocations with 17.46 and 8.09 cfs withdrawals respectively. Except during extreme low flow conditions, accretions from Big Sioux River tributaries along this river reach should supply enough water for these senior and junior water rights/permits.

Conclusions


1. Water Permit Application No. 6210-3, City of Sioux Falls, SD, proposes to place to beneficial use an additional 55.8 cubic feet of water per second (cfs) (25045 gpm) [10,000 acre feet annually] from the Big Sioux River reserved under Future Use Permit No. 3981A-3 with a priority date of June 6, 1977. The City is proposing to increase the diversion rate at their pump station to the 69.6 cfs maximum capability and the maximum reserved under Permit No. 3981A-3. The total annual withdrawal volume is to be increased to 20,000 acre feet.
2. Probabilities calculated from USGS data indicate non-appropriated water is available in the Big Sioux River to satisfy water rights/permits and this application's allotments during normal and higher flows. During periods of low flows, the Big Sioux River should not be considered a reliable source of water for this application's allotment or water rights/permits north of Lincoln County. Shut off orders may need to be issued to junior water right/permit holders north of Lincoln County when the flow in the Big Sioux River is low and senior water rights and domestic use is being adversely impacted.
3. At least 20 cfs should be bypassed for downstream domestic use and prior water rights/permits while pumping under this permit.
4. If this Application is approved, bypass qualifications for junior water rights/permits diversions from the Big Sioux River should be reviewed and the qualifications may need to be adjusted ~~and~~ before issuing any future water rights/permits for withdrawals from the river.


Donald E. Stroup
Natural Resources Engineer I
Water Rights Program

Reviewed by:



Mark D. Rath
Natural Resources Engineer III
Water Rights Program

- Hydrology
- Pre 06/06/1977 Allocation
- Post 06/06/1977 Allocation
- County
- USGS Gauging Station

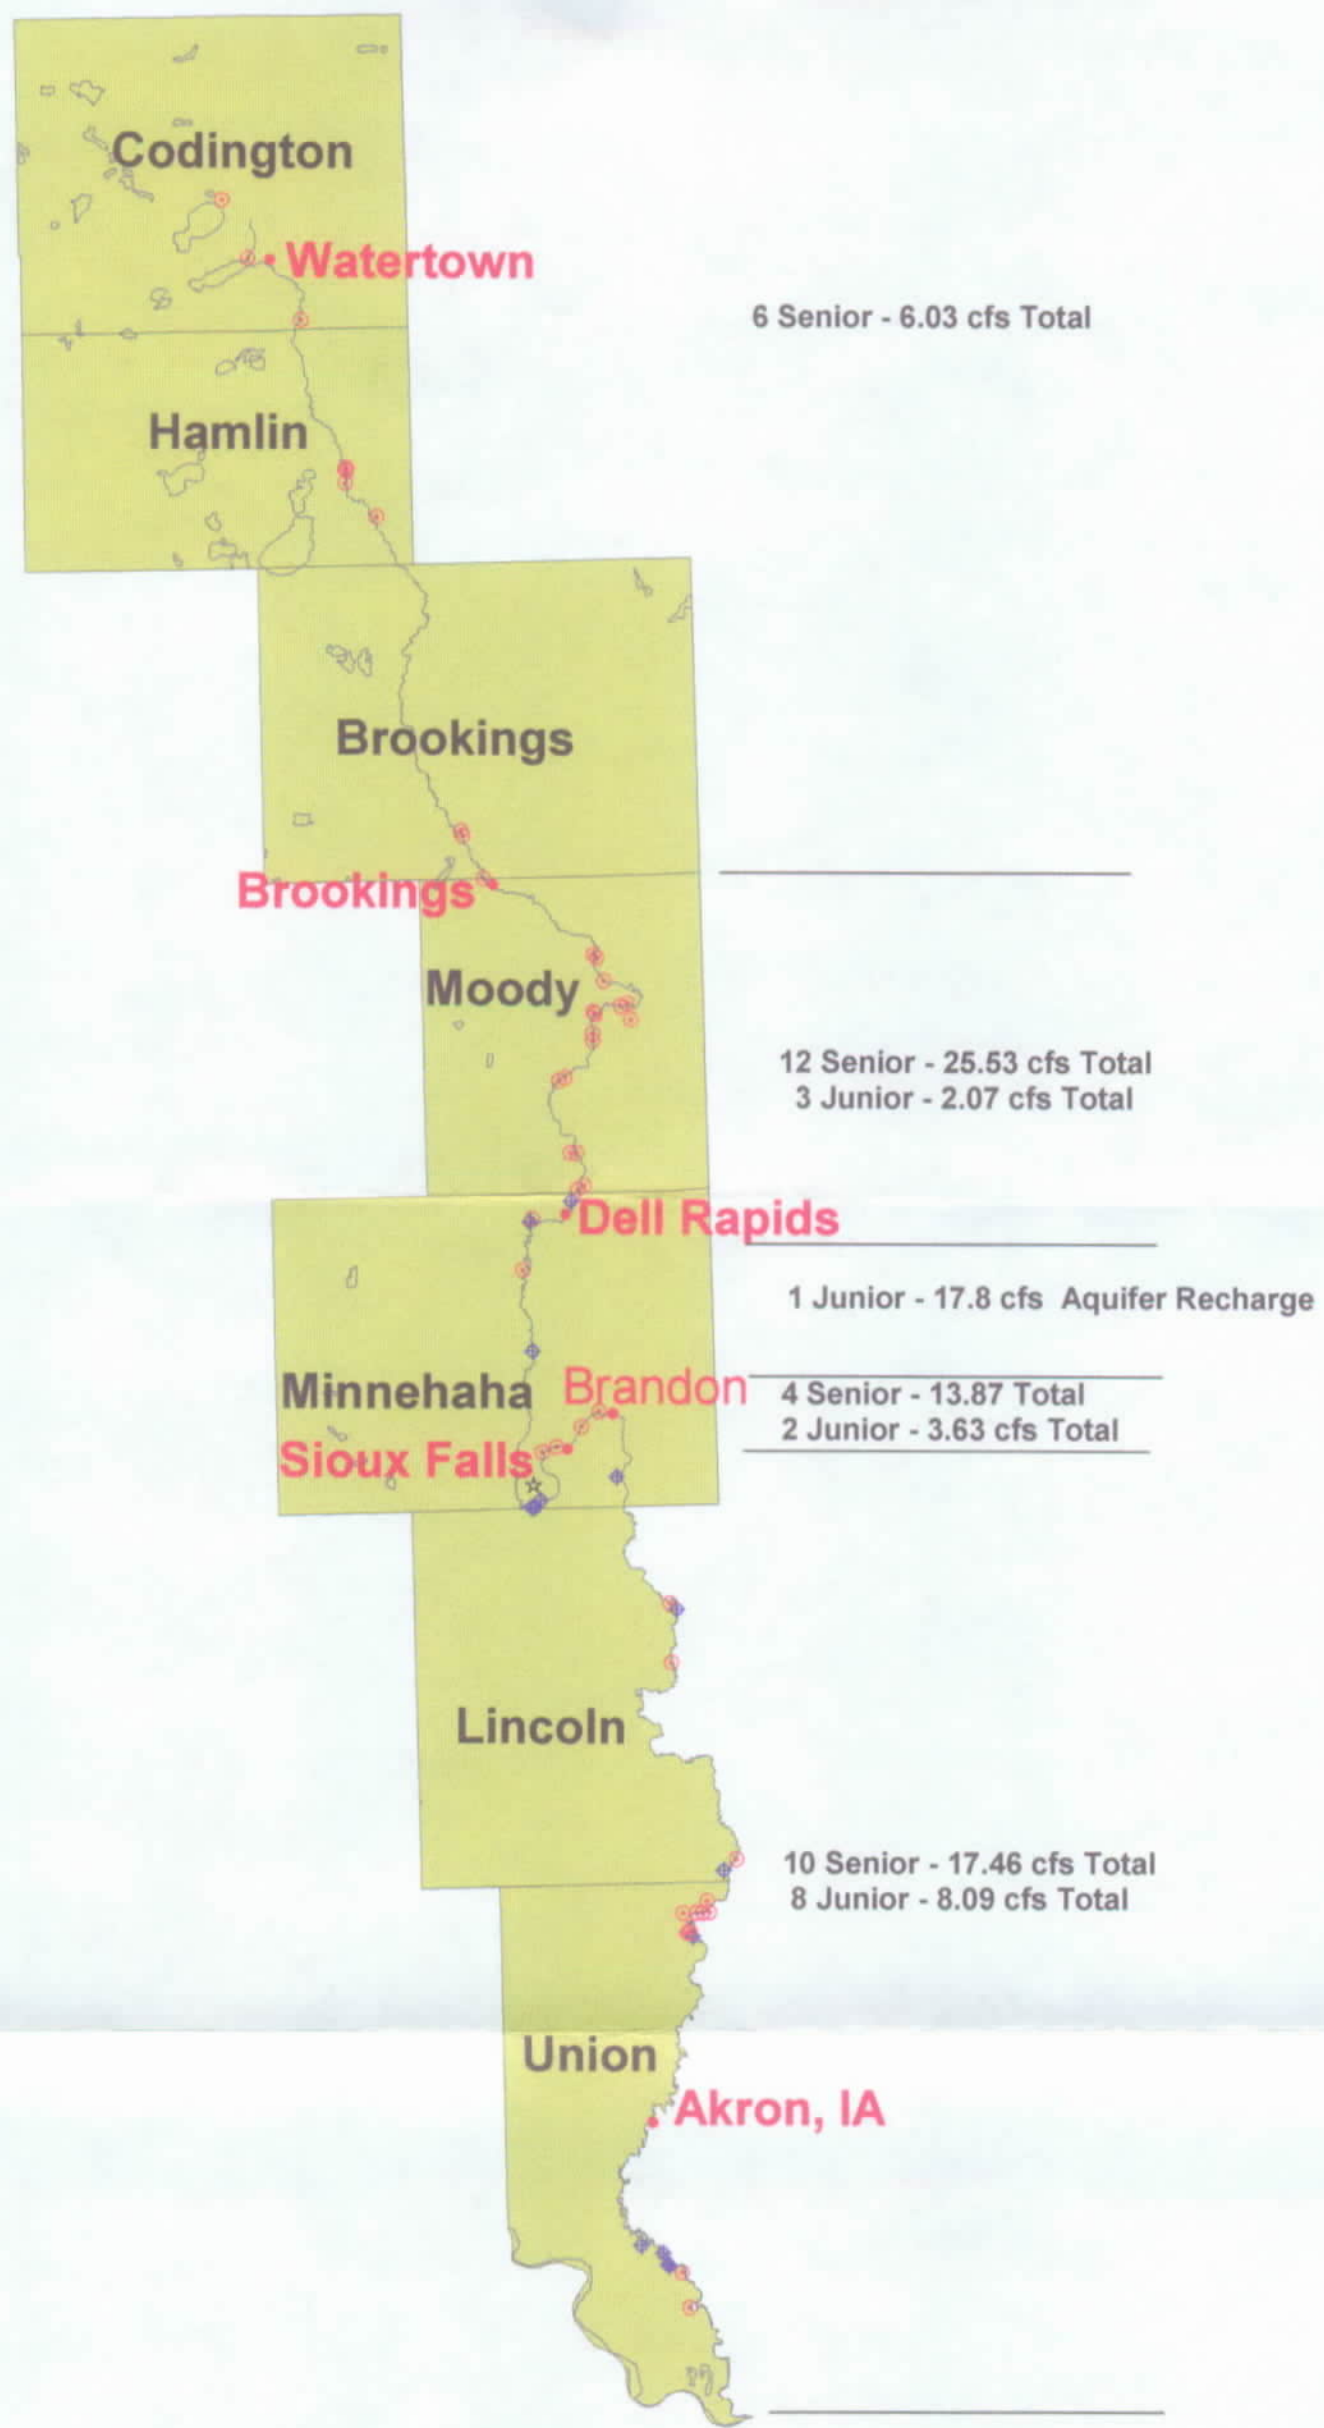

Big Sioux River

Diversion Point:
NW1/4 NE1/4
Section 32
T102N R49W

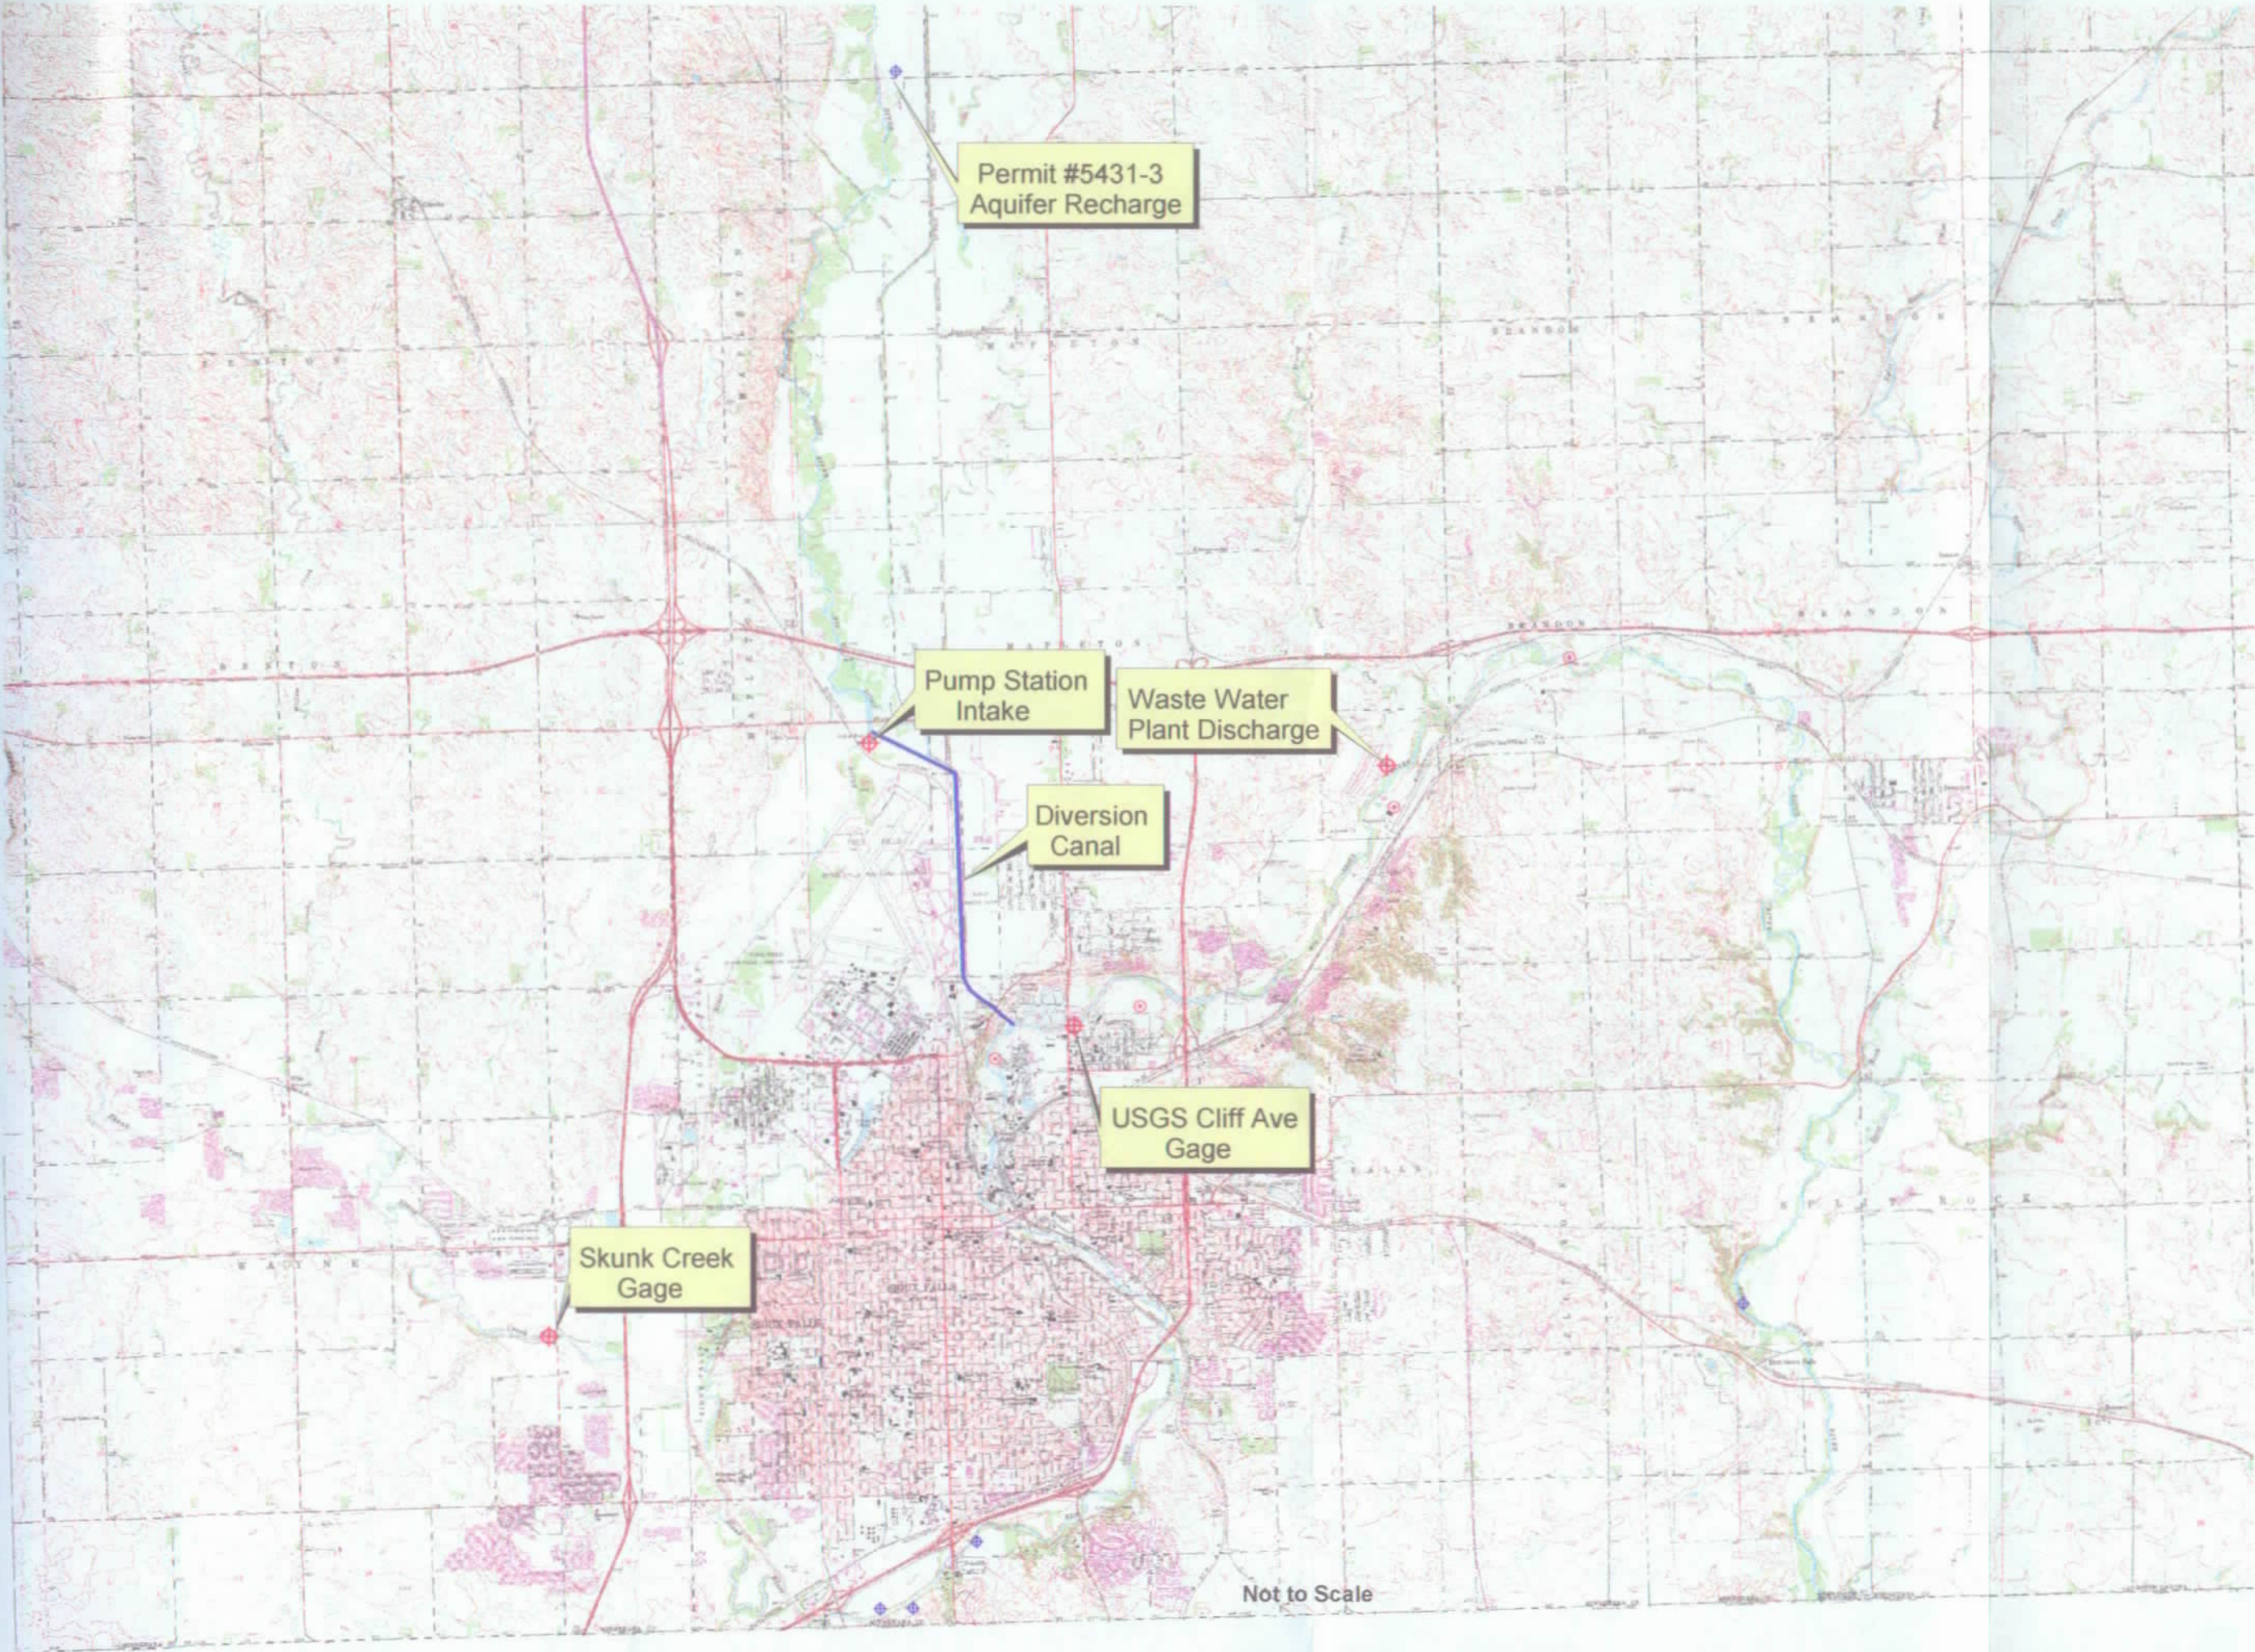


◆ Post 06/06/1977 Allocation
● Pre 06/06/1977 Allocation

Not to Scale


Big Sioux River
Monthly Median Percentiles

Watertown	01-Jan	01-Feb	01-Mar	01-Apr	01-May	01-Jun	01-Jul	01-Aug	01-Sep	01-Oct	01-Nov	01-Dec
10 Percentile	0	0	0	4	3	1	0	0	0	0	0	0
25 Percentile	0	0	1	20	10	4	1	0	0	0	1	0
50 Percentile	0	0	7	60	35	19	8	2	1	1	2	1
75 Percentile	2	2	29	150	79	55	31	19	6	5	8	3
90 Percentile	7	7	174	284	183	174	116	68	27	26	20	14
Brookings	01-Jan	01-Feb	01-Mar	01-Apr	01-May	01-Jun	01-Jul	01-Aug	01-Sep	01-Oct	01-Nov	01-Dec
10 Percentile	1	1	6	68	46	28	6	6	4	7	12	3
25 Percentile	4	3	30	126	91	60	38	17	15	15	18	9
50 Percentile	9	8	189	297	214	172	123	55	36	40	45	22
75 Percentile	37	50	550	1060	664	646	347	220	120	99	134	54
90 Percentile	108	100	1170	2377	1314	1258	848	522	464	394	304	192
Dell Rapids	01-Jan	01-Feb	01-Mar	01-Apr	01-May	01-Jun	01-Jul	01-Aug	01-Sep	01-Oct	01-Nov	01-Dec
10 Percentile	4	4	15	97	67	42	15	15	10	13	16	9
25 Percentile	9	9	55	175	125	100	57	28	26	25	33	19
50 Percentile	19	17	250	449	293	245	182	81	63	64	62	35
75 Percentile	56	75	811	1225	821	671	511	289	176	160	150	89
90 Percentile	104	163	1627	4066	1648	1569	1167	693	543	538	453	304
Sioux Falls	01-Jan	01-Feb	01-Mar	01-Apr	01-May	01-Jun	01-Jul	01-Aug	01-Sep	01-Oct	01-Nov	01-Dec
10 Percentile	11	15	72	117	90	44	27	27	24	20	28	23
25 Percentile	23	23	217	243	174	145	83	56	41	45	56	43
50 Percentile	65	74	492	749	491	517	439	202	140	101	143	120
75 Percentile	134	144	1315	2520	1565	1433	992	593	422	445	426	230
90 Percentile	207	218	2674	5281	3240	2668	1752	1176	912	840	670	410
Brandon	01-Jan	01-Feb	01-Mar	01-Apr	01-May	01-Jun	01-Jul	01-Aug	01-Sep	01-Oct	01-Nov	01-Dec
10 Percentile	16	14	26	178	134	112	31	31	32	27	29	25
25 Percentile	18	18	53	261	244	160	112	49	39	34	41	31
50 Percentile	25	28	234	534	380	273	176	69	70	65	74	44
75 Percentile	35	38	516	1030	718	827	308	164	127	106	98	52
90 Percentile	39	50	1252	2346	1325	1364	741	417	235	143	110	72
Akron, IA	01-Jan	01-Feb	01-Mar	01-Apr	01-May	01-Jun	01-Jul	01-Aug	01-Sep	01-Oct	01-Nov	01-Dec
10 Percentile	36	35	123	312	244	192	87	87	67	69	75	54
25 Percentile	55	67	286	610	400	408	251	165	138	122	132	95
50 Percentile	100	130	1225	1145	858	928	670	352	268	231	235	160
75 Percentile	187	400	3120	3010	2180	2280	1525	882	708	536	476	263
90 Percentile	556	786	6136	8956	4496	5009	3173	1684	1536	1176	1398	900
Skunk Creek	01-Jan	01-Feb	01-Mar	01-Apr	01-May	01-Jun	01-Jul	01-Aug	01-Sep	01-Oct	01-Nov	01-Dec
10 Percentile	0	0	2	6	4	2	0	0	0	0	1	1
25 Percentile	1	1	6	20	12	5	2	1	1	1	2	2
50 Percentile	2	3	45	47	37	23	11	6	4	5	6	4
75 Percentile	7	14	133	273	117	86	79	36	19	19	20	10
90 Percentile	20	41	326	719	408	263	255	121	75	78	53	32


**Big Sioux River
Sioux Falls Cliff Ave
1971-1998**

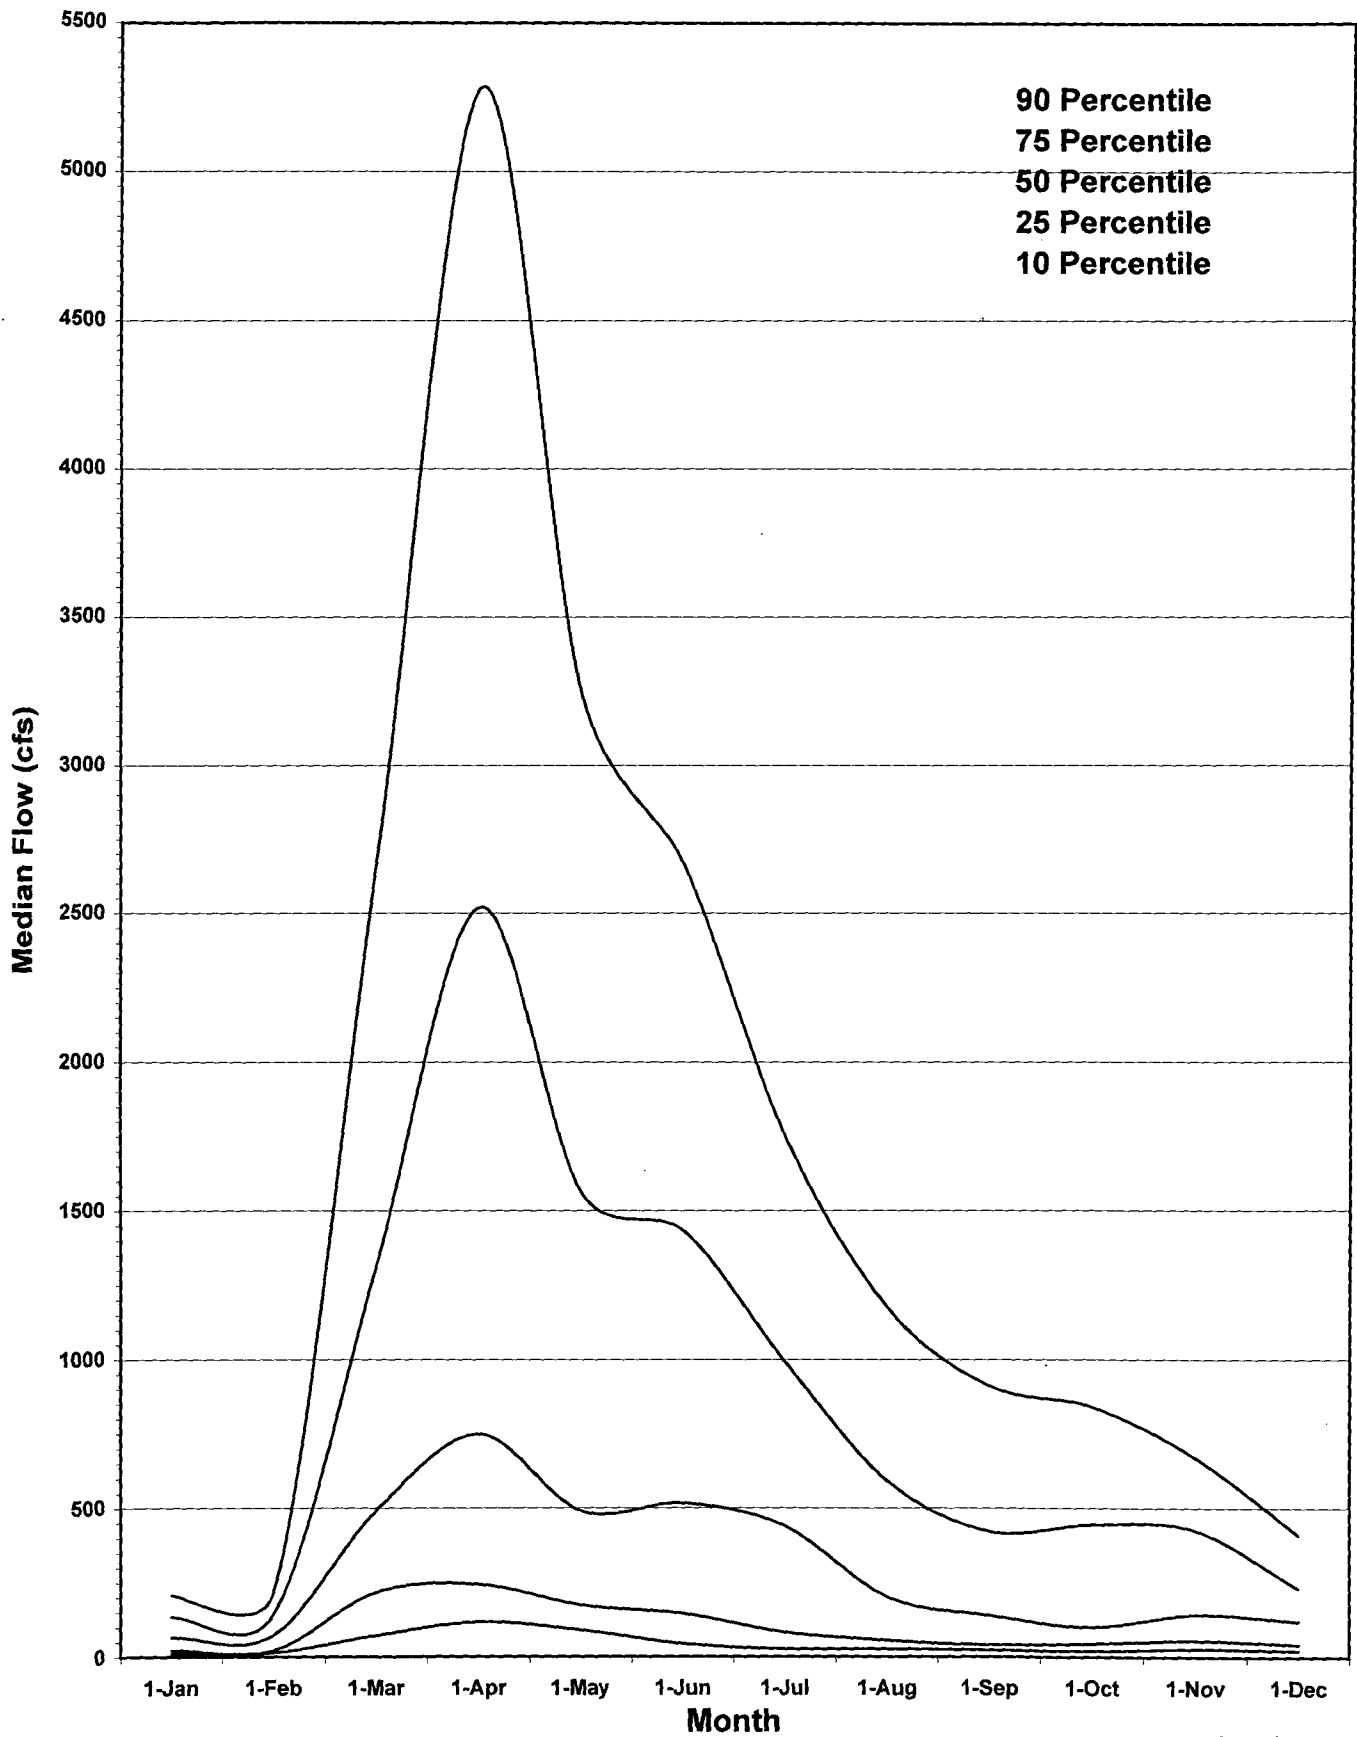


**Skunk Creek
Sioux Falls 1948-1998**

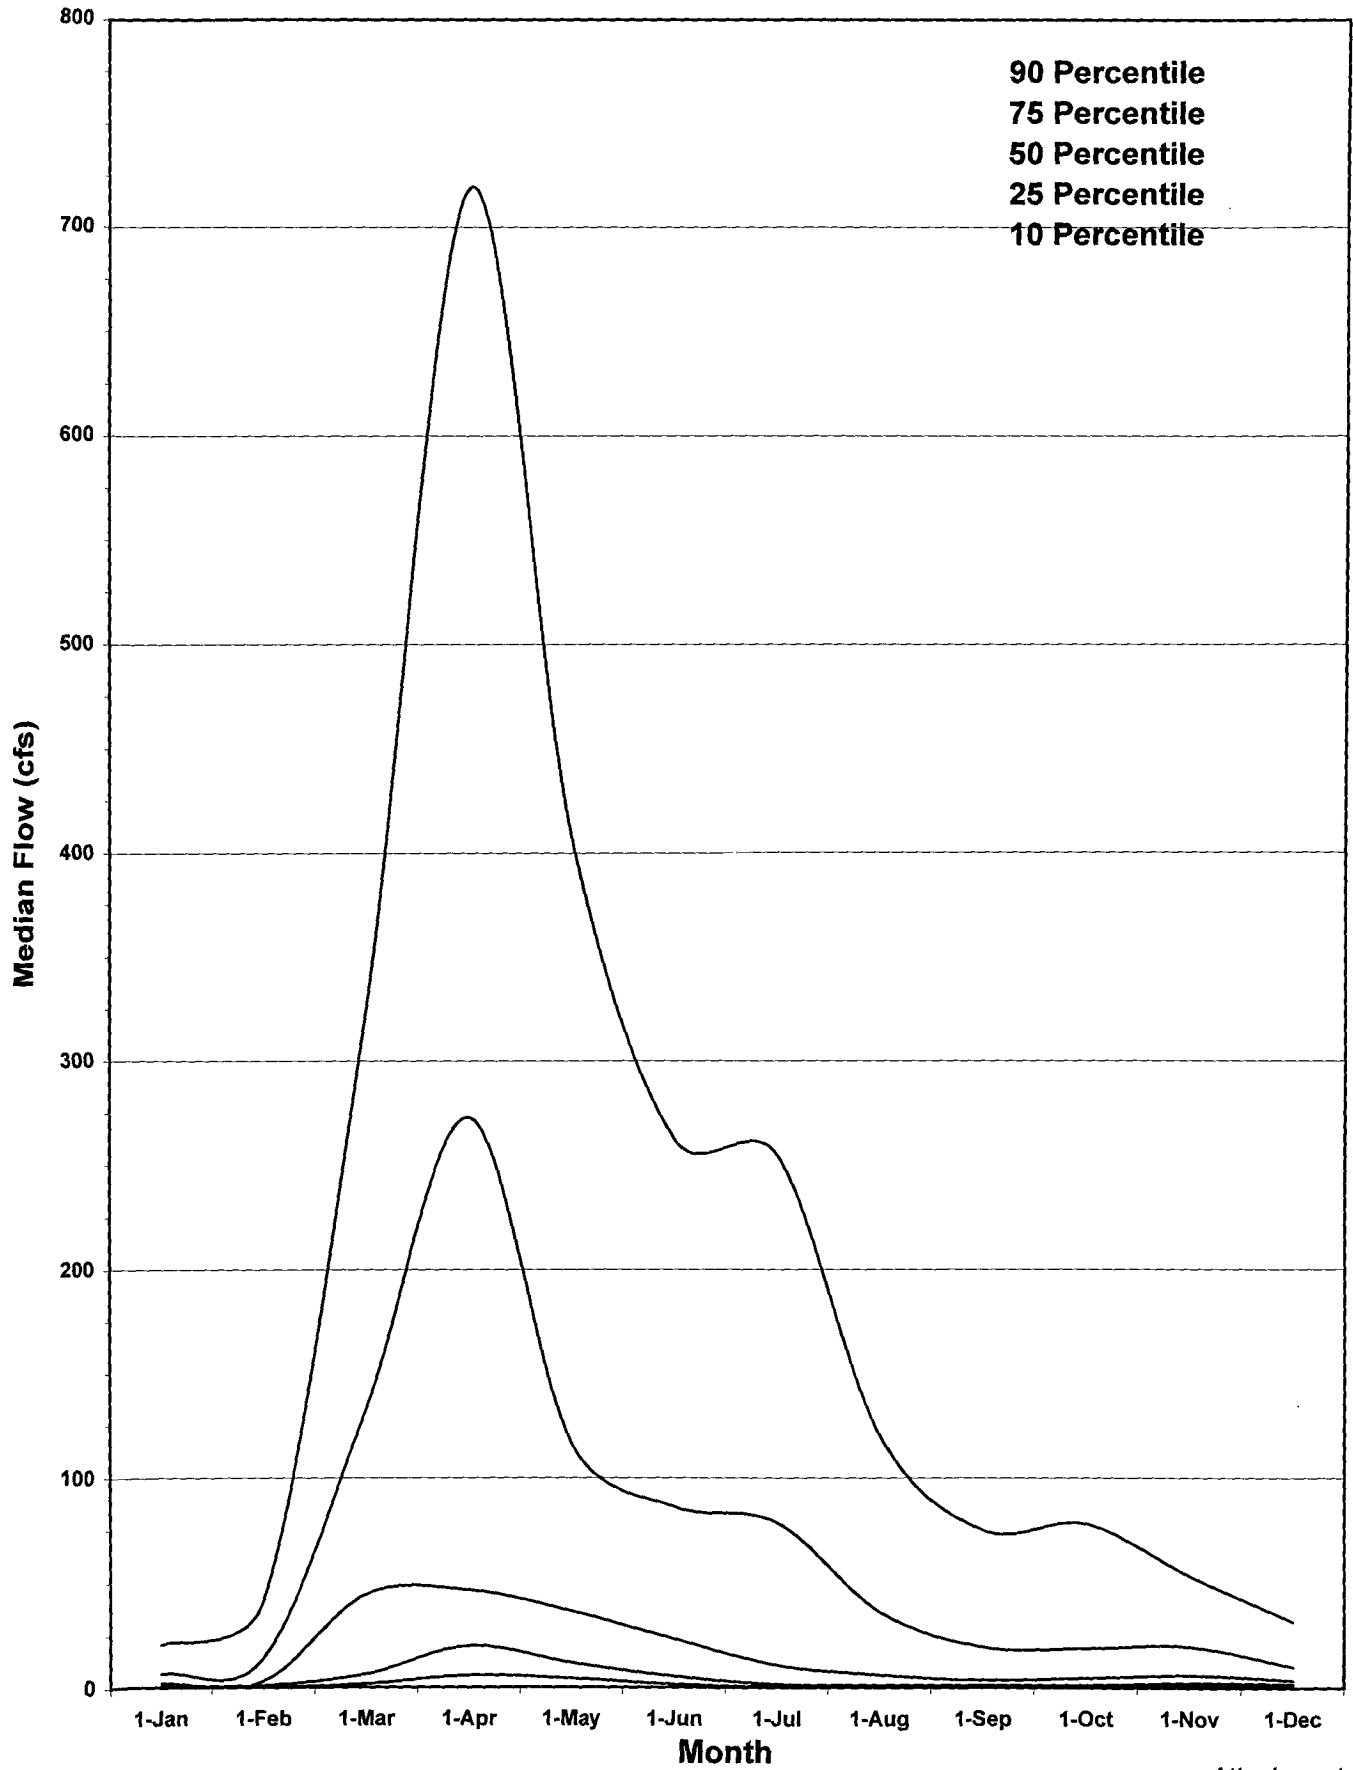


**Big Sioux River
Watertown 1945-1998
Brookings 1953-1998**

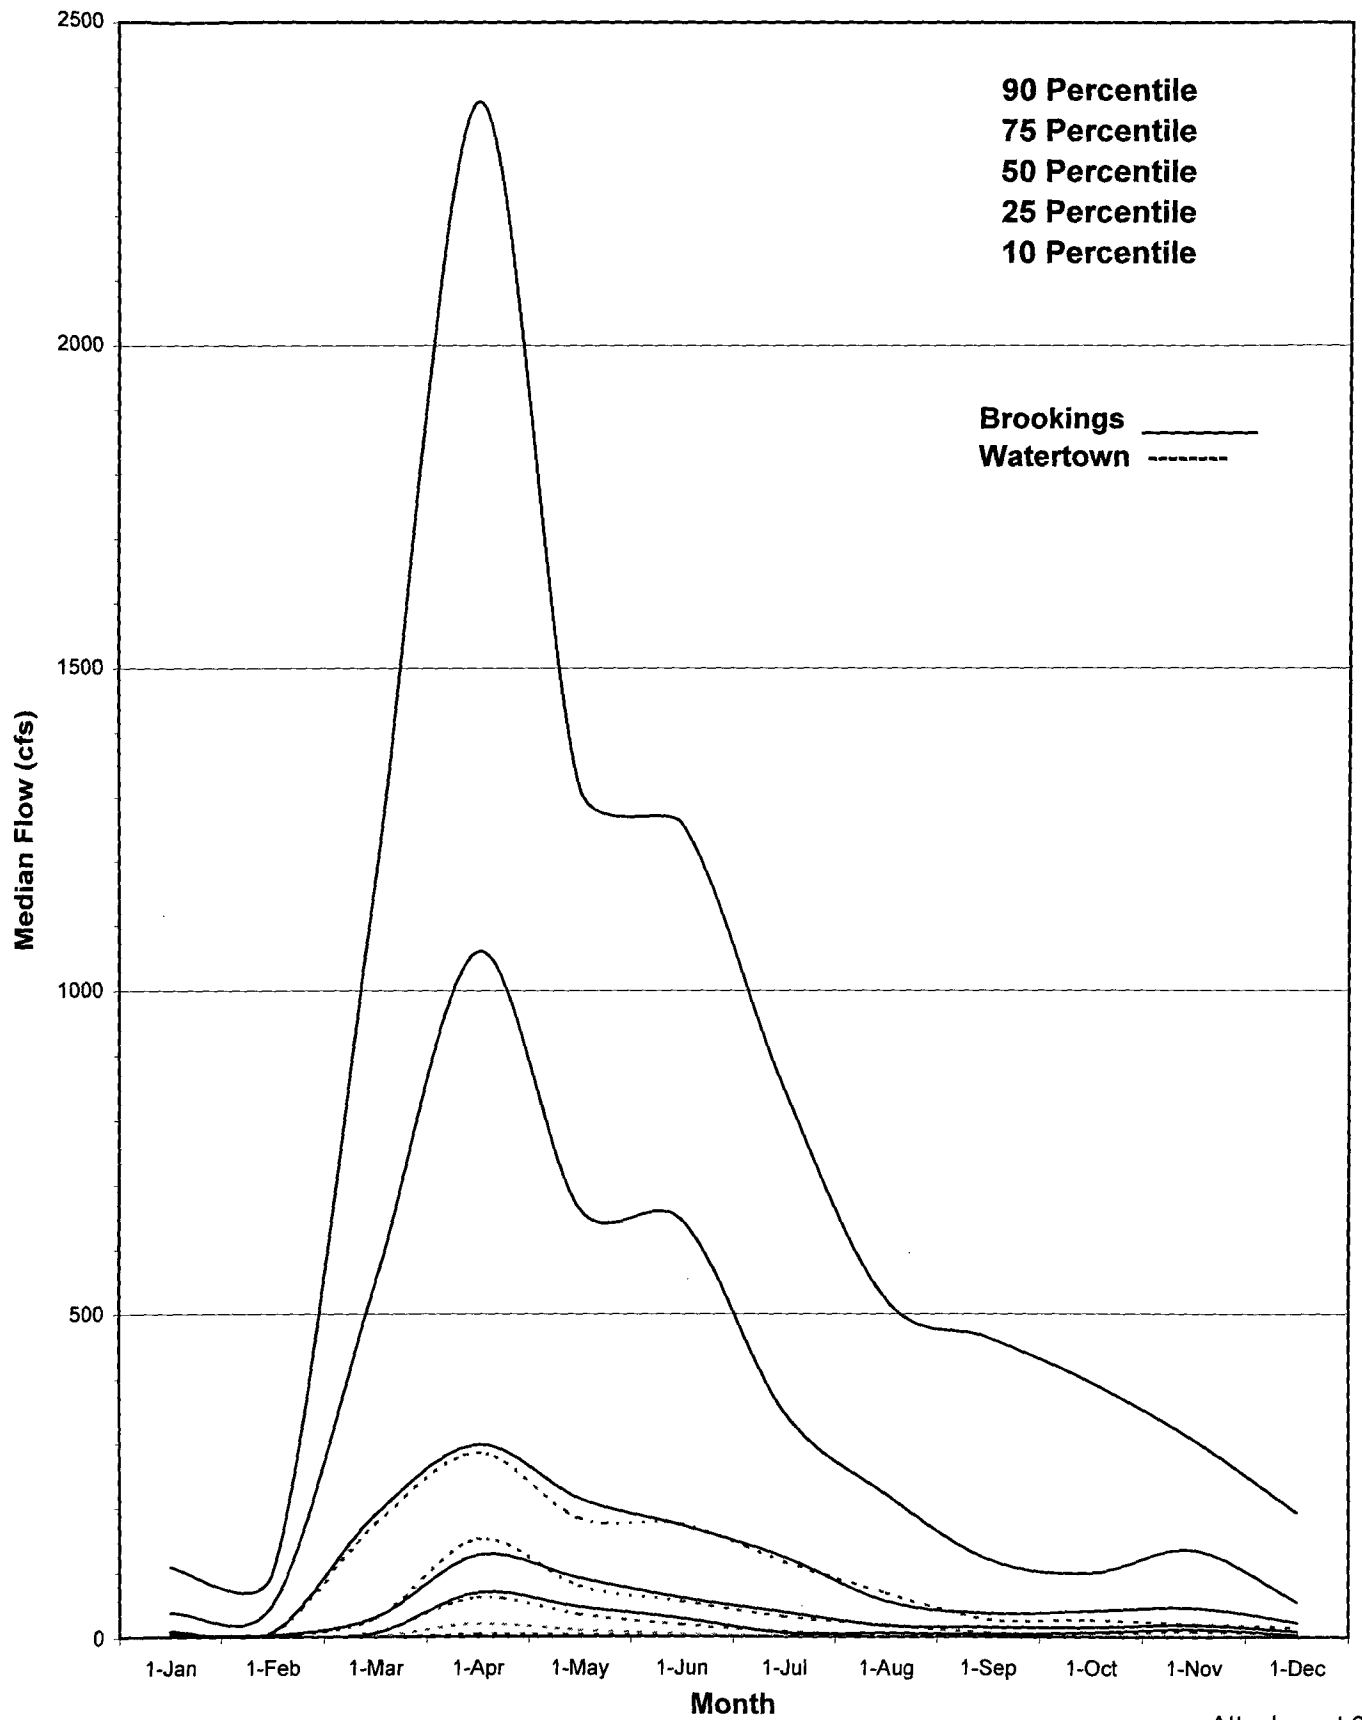


**Big Sioux River
Dell Rapids 1949-1998
Brookings 1953-1998**

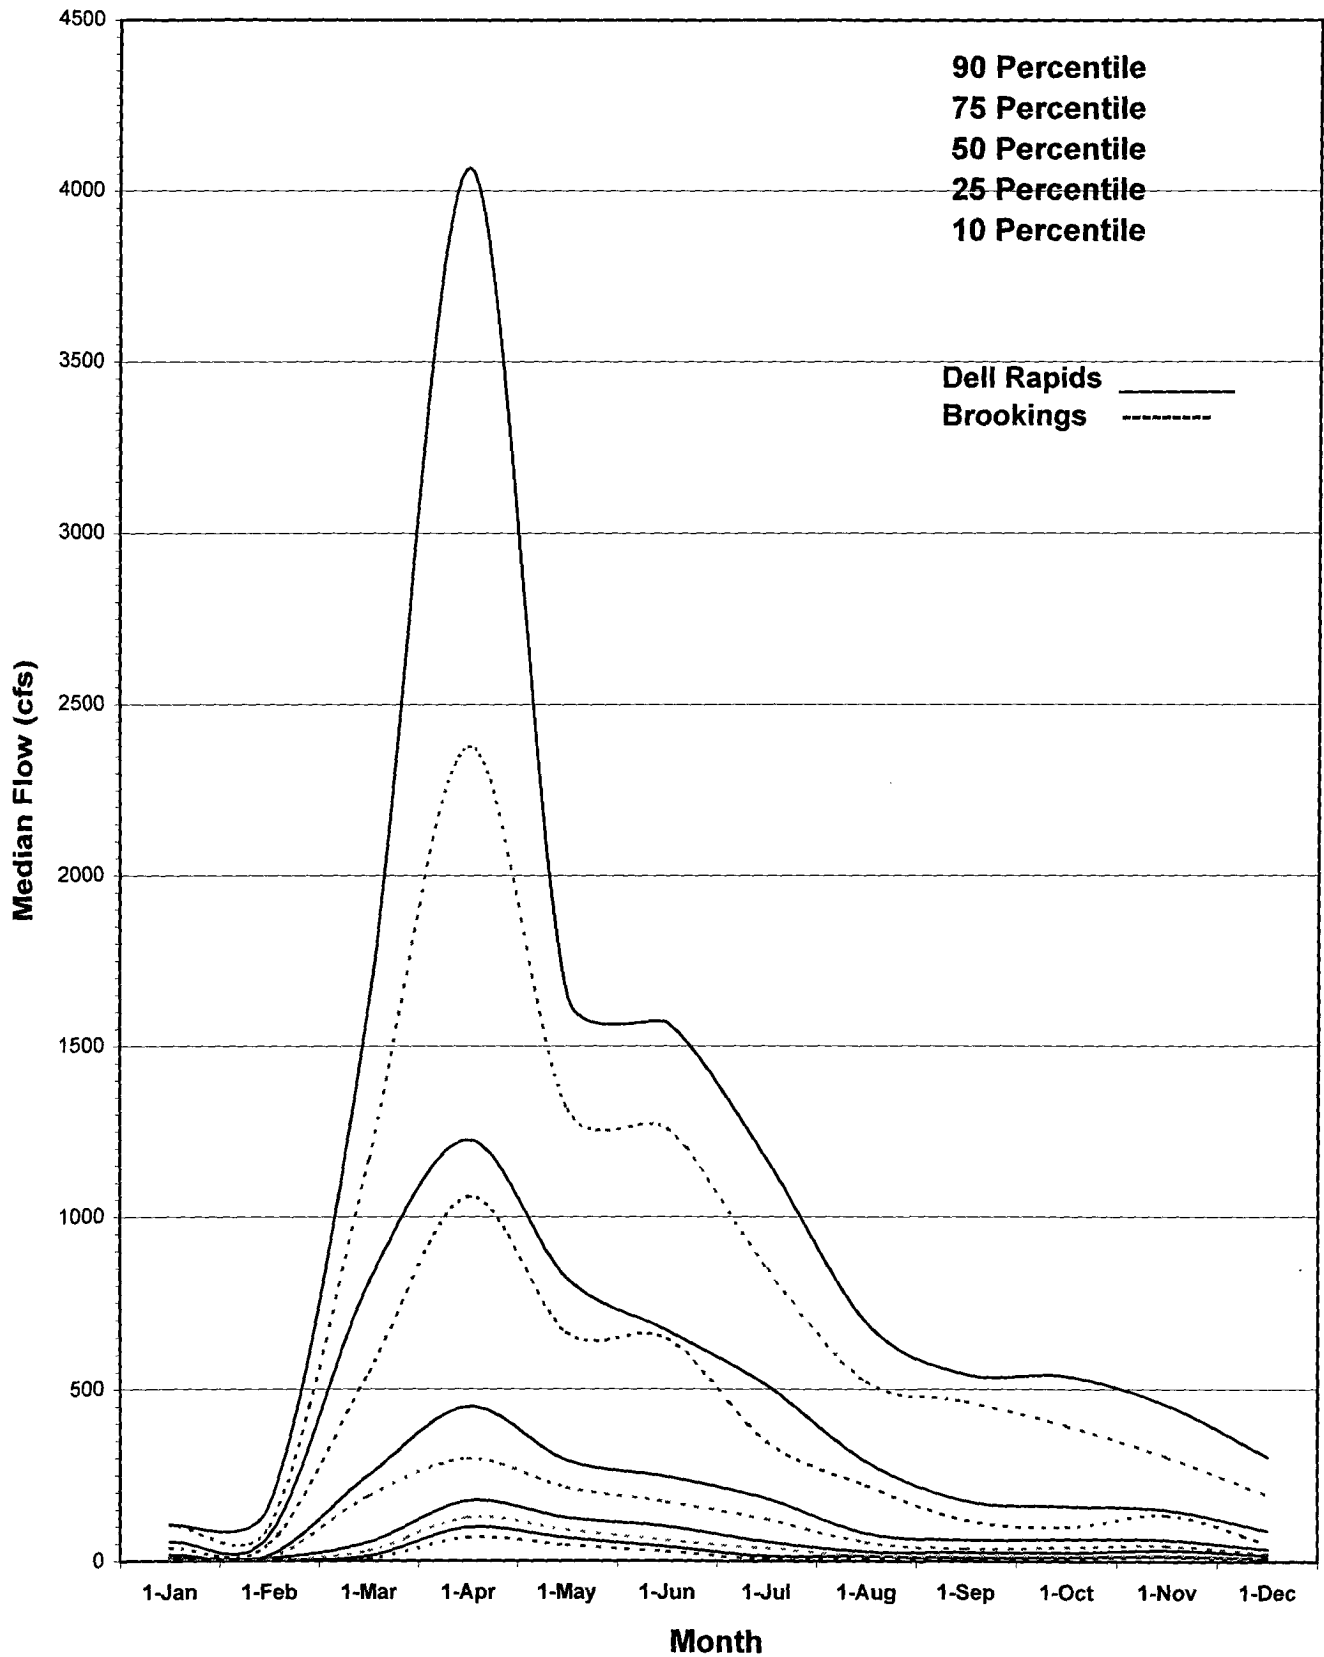


**Big Sioux River
Cliff Avenue 1971-1998
Dell Rapids 1949-1998**

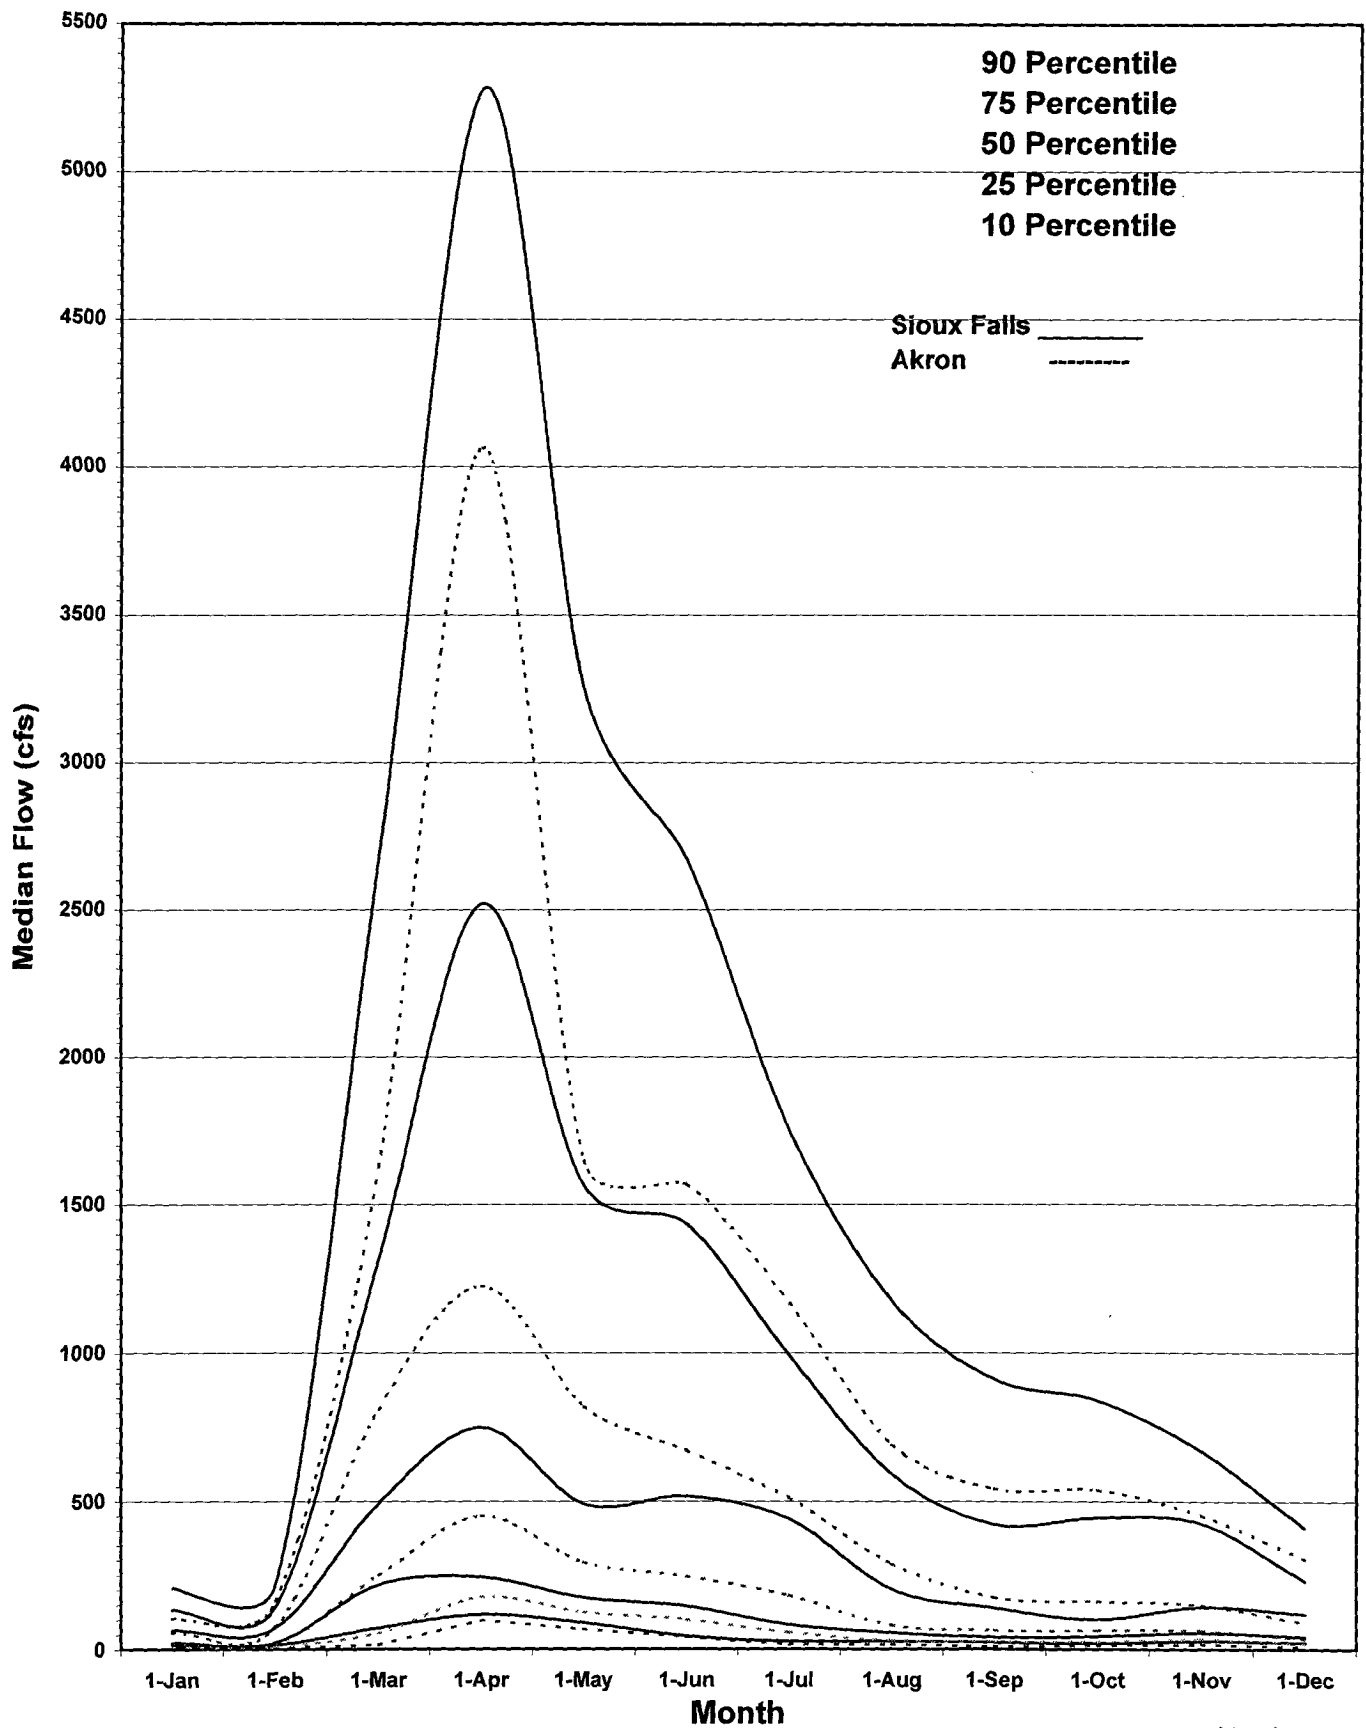

**Big Sioux River
Sioux Falls 1943-1972
Brandon 1959-1972**

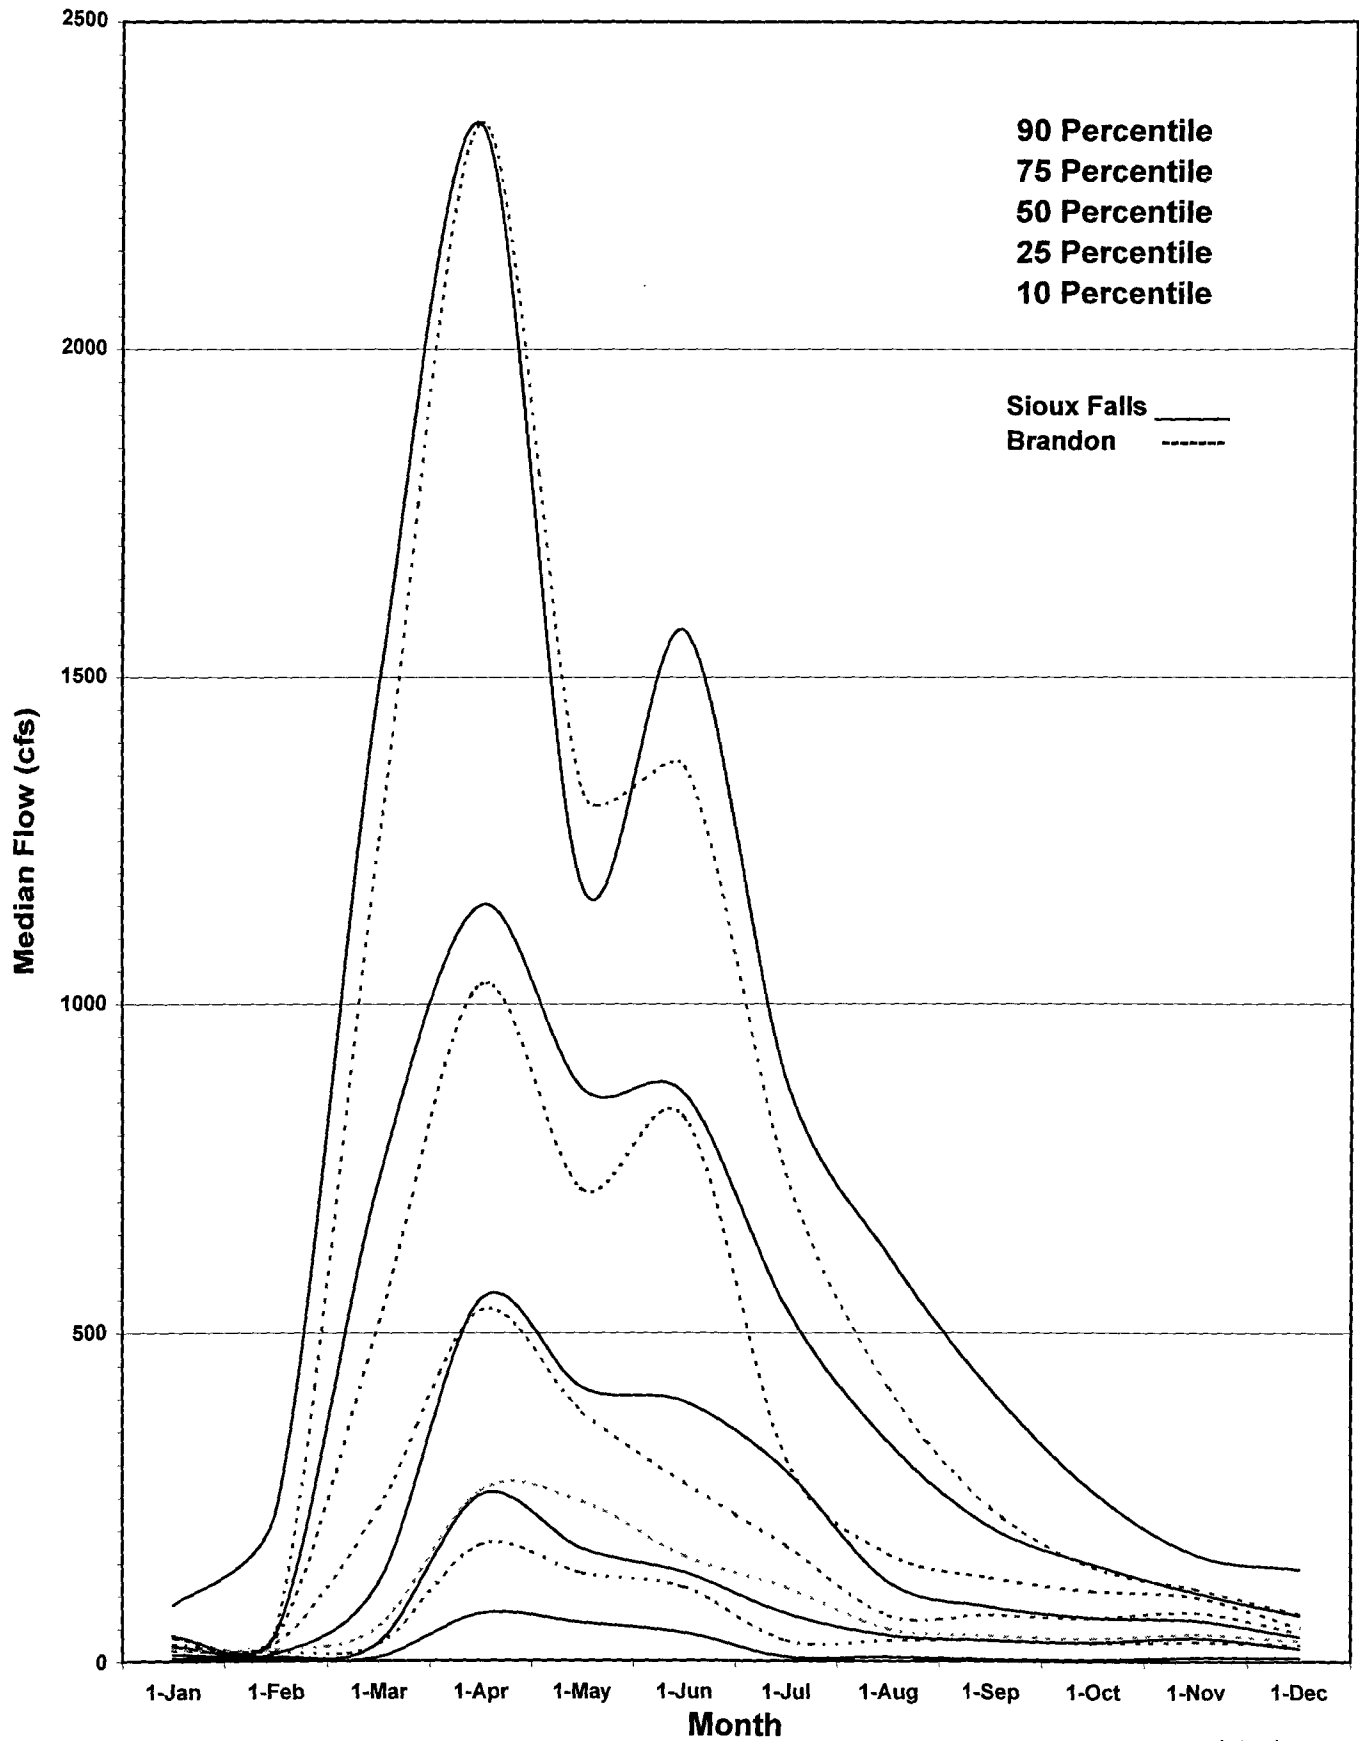

**Big Sioux River
Cliff Avenue 1971-1998
Akron, IA 1929-1997**

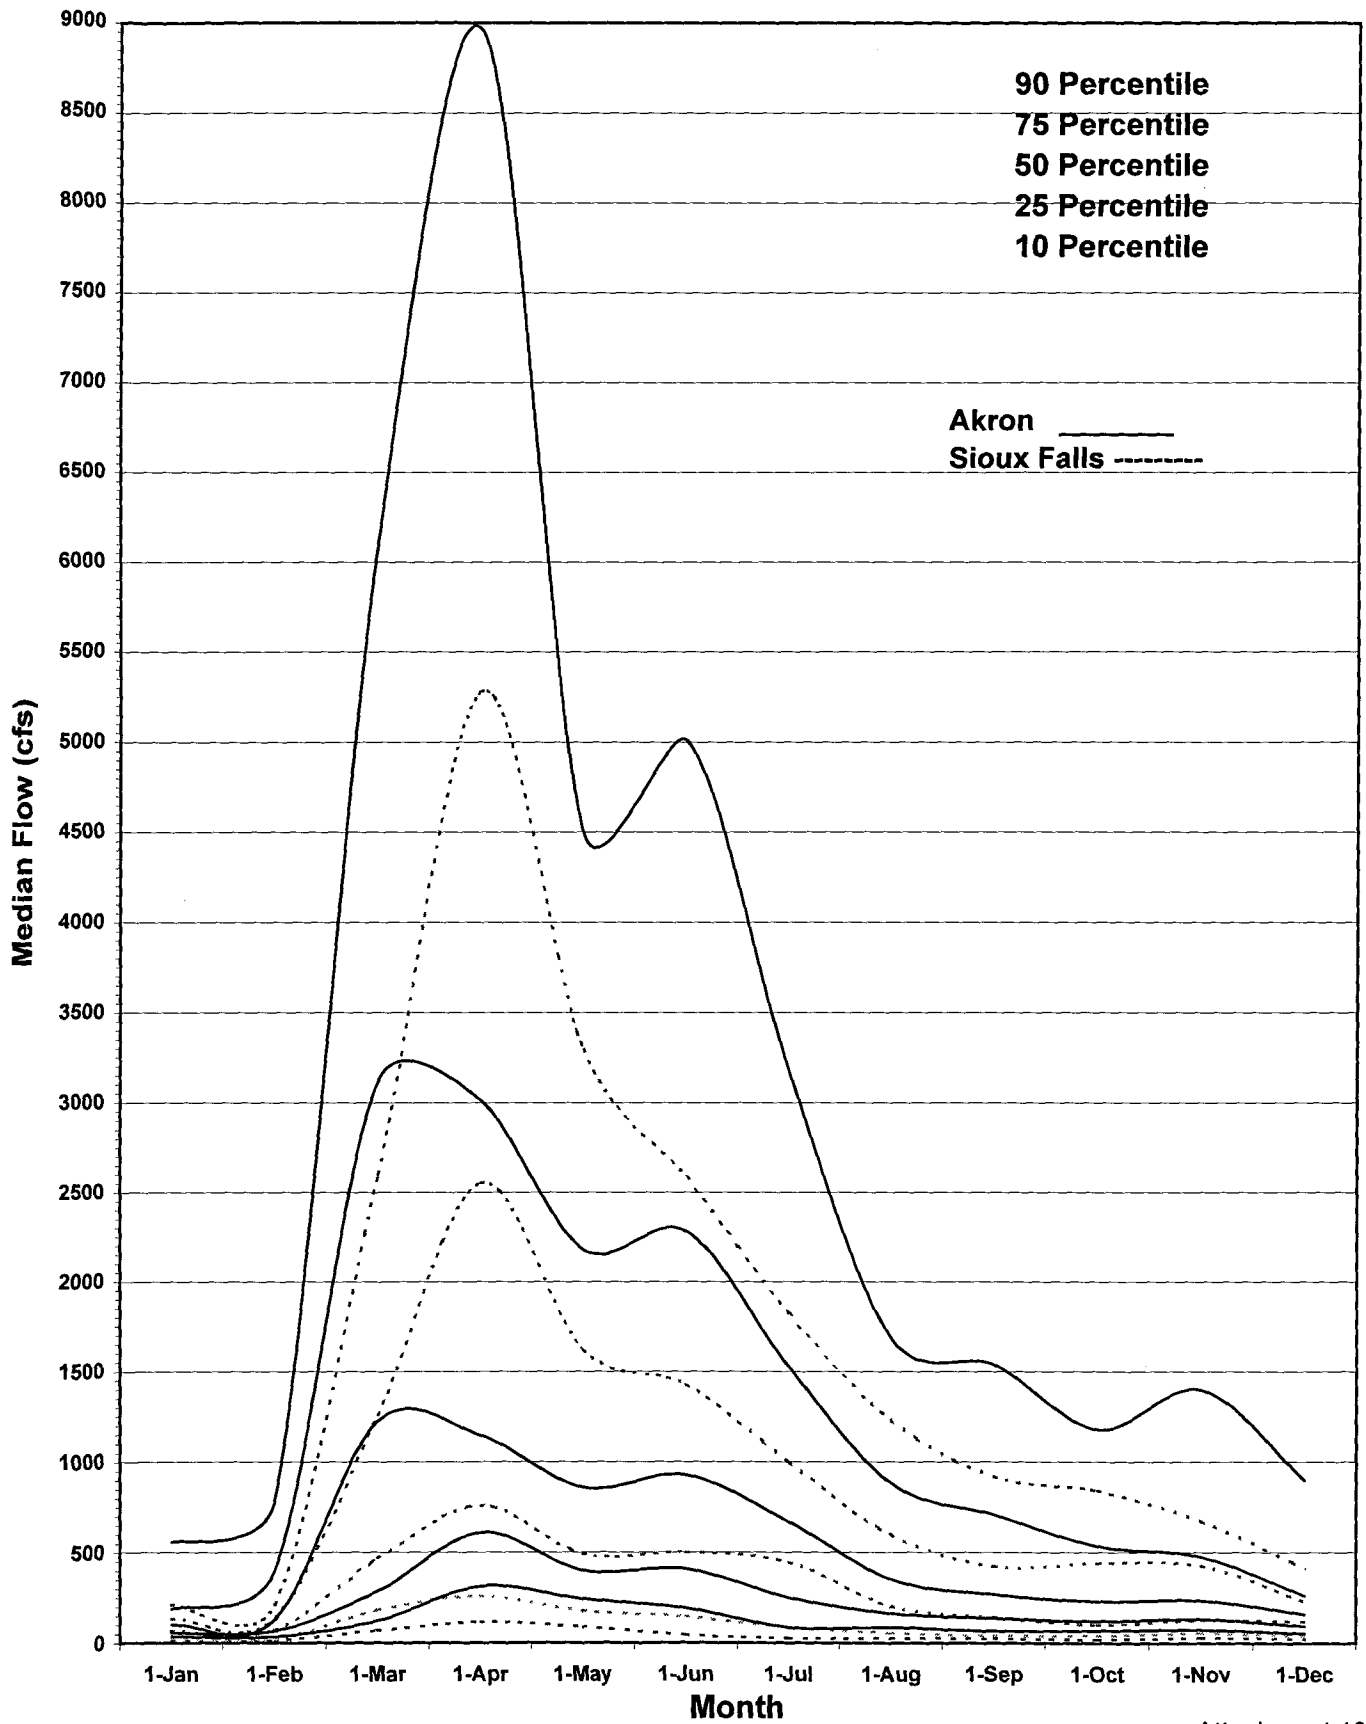



DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
www.state.sd.us/denr

August 18, 2000

Argus Leader
PO Box 5034
Sioux Falls SD 57117-5034

ATTENTION: Legal Public Notice


Enclosed is a Notice of Hearing on Application No. 6210-3 to Appropriate Water to be published twice. Please publish the first notice on August 24, 2000 with the second publication 7 days later.

The applicant must verify to you that the notice is to be published, before you make the first publication. **Please BILL the APPLICANT for the cost of publication.** The APPLICANT is the City of Sioux Falls, c/o Randy Janssen, Water Superintendent, 224 W 9th St, Sioux Falls SD (Ph # 605 367-7025).

Please send the Water Rights Program the first publication immediately. The publication is checked for accuracy so any corrections can be made in the second publication. You may use the form below or fax a copy of the first publication. Any fax should be sent to the attention of Karen Schlaak at (605) 773-4068. Publication errors can invalidate the public notice.

After the second publication, **please send us an affidavit or use the enclosed Proof of Publication form.** The applicant pays the cost of publication, but the Water Rights Program records require an affidavit or Proof of Publication. Delays in receiving the affidavit can be costly to the applicant.

Sincerely,


Eric Gronlund
Natural Resources Engineer
605 773-3352

enclosures

-----CUT HERE-----

No. 6210-3

TO: Eric Gronlund
Water Rights Program
Joe Foss Building
Pierre SD 57501-3181

Date _____

We are in receipt of your letter of August 18, 2000 enclosing Notice of Hearing to Appropriate Water by Application No. 6210-3 which was first published in our issue of _____. **ENCLOSED IS A COPY OF THIS FIRST PUBLICATION.**

Name

Newspaper



DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
www.state.sd.us/denr

August 18, 2000

Sioux Valley News
Box 255
Canton SD 57013-0255

ATTENTION: Legal Public Notice

Enclosed is a Notice of Hearing on Application No. 6210-3 to Appropriate Water to be published twice. Please publish the first notice on August 24, 2000 with the second publication 7 days later.

The applicant must verify to you that the notice is to be published, before you make the first publication. **Please BILL the APPLICANT for the cost of publication.** The APPLICANT is the City of Sioux Falls, c/o Randy Janssen, Water Superintendent, 224 W 9th St, Sioux Falls SD (Ph # 605 367-7025).

Please send the Water Rights Program the first publication immediately. The publication is checked for accuracy so any corrections can be made in the second publication. You may use the form below or fax a copy of the first publication. Any fax should be sent to the attention of Karen Schlaak at (605) 773-4068. Publication errors can invalidate the public notice.

After the second publication, **please send us an affidavit or use the enclosed Proof of Publication form.** The applicant pays the cost of publication, but the Water Rights Program records require an affidavit or Proof of Publication. Delays in receiving the affidavit can be costly to the applicant.

Sincerely,


Eric Gronlund
Natural Resources Engineer
605 773-3352

enclosures

-----CUT HERE-----

No. 6210-3.

TO: Eric Gronlund
Water Rights Program
Joe Foss Building
Pierre SD 57501-3181

Date _____
We are in receipt of your letter of August 18, 2000 enclosing Notice of Hearing to Appropriate Water by Application No. 6210-3 which was first published in our issue of _____. **ENCLOSED IS A COPY OF THIS FIRST PUBLICATION.**

Name

Newspaper



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3181
www.state.sd.us/denr

NOTE: TO BE SURE OF PUBLICATION ON
THE CORRECT DATES, CONTACT
THE NEWSPAPERS RIGHT AWAY.

August 18, 2000


Randy Janssen, Water Superintendent
City of Sioux Falls
224 West 9th St
Sioux Falls SD 57104

Dear Mr. Janssen:

Water Permit Application Nos. 6210-3, 6214-3 and 6215-3 for municipal use have been examined and found to comply with the South Dakota Water Laws and applicable rules. Two notices have been sent to the Publishers of the Argus Leader (Ph # 605 331-2200) and the Sioux Valley News, Canton SD (Ph # 605 987-2631). For your information, copies of the notices, the recommendations of the Chief Engineer and reports on the applications are enclosed. Please review the notice prior to publication and notify this office, if you have any corrections or questions.

Be sure to contact the above newspapers to authorize publication of the Notice of Hearings and to arrange for payment. Early contact with the papers can eliminate delays. The publishers have been instructed to publish your notice once each week for two consecutive weeks with the last publication to occur twenty days before the board meeting. The newspapers have been instructed to send us the Proof of Publication. We must receive Proof of Publication before action can be taken on the application.

Sincerely,


Eric Gronlund
Natural Resources Engineer
(605) 773-3352

enclosures

NOTE: If you plan to contest any part of the Chief Engineer's recommendation, you must file a petition pursuant to the procedures outlined in the attached notice of hearing. The Water Management Board will then consider your concerns during a hearing on the application.

AFFIDAVIT OF PUBLICATION

STATE OF SOUTH DAKOTA

COUNTY OF MINNEHAHA } ss

Christy Duncan being duly sworn, says: That The Argus Leader is, and during all the times hereinafter mentioned was, a daily legal newspaper as defined by SDCL 17-2-21, as amended published at Sioux Falls, Minnehaha County, South Dakota; that affiant is and during all of said times, was an employee of the publisher of such newspaper and has personal knowledge of the facts stated in this affidavit; that the notice, order or advertisement, a printed copy of which is hereto attached, was published in said newspaper upon


Thursday	, the	24	day of	August	2000,
Thursday	, the	31	day of	August	2000,
	, the		day of		2000,
	, the		day of		2000,
	, the		day of		2000,
	, the		day of		2000,
	, the		day of		2000,

and that \$120.92 was charged for publishing the same.

Christy Duncan

Subscribed and sworn to before me August 31, 2000.

Joan Stahl

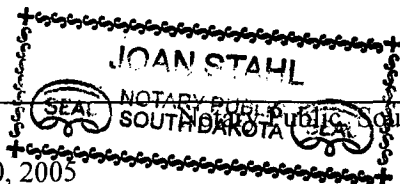

My Commission expires June 30, 2005

NOTICE OF APPLICATION
NO. 0-3 to Place Water to
Beneficial Use
Reserve under Future Use
Permit No. 3981A-3

Notice is given that the City of Sioux Falls, 224 West 9th St., Sioux Falls, SD 57104 has filed an application for a water permit to place to beneficial use 10,000 acre-feet annually from the Big Sioux River reserved under Future Use Permit No. 3981A-3. If approved, this water permit will retain the June 6, 1977 priority date assigned to Future Use Permit No. 3981A-3. The point of diversion is at the city's Big Sioux River pump station located in the NW1/4 NE1/4 Section 32; all in T102N-R49W. Currently, the city is authorized by Water Permit No. 5334-3 to divert up to 13.8 cubic feet of water per second (cfs) with a maximum annual volume of 10,000 acre feet from the pump station. Since the pump station is capable of diverting water at a maximum rate of 69.6 cfs, the city is also applying to increase the authorized diversion rate from 13.8 cfs to 69.6 cfs (55.8 cfs additional). Water is to be used for municipal purposes by the City of Sioux Falls.

Pursuant to SDCL 46-2A-2, the Chief Engineer recommends Approval of Application No. 6210-3 because 1) unappropriated water is available, 2) existing rights will not be unlawfully impaired, 3) it is a beneficial use of water, and 4) it is in the public interest.

Any person interested in opposing or supporting this application must file a written petition with BOTH the applicant and Chief Engineer. The applicant must also file a petition if opposed to the Chief Engineer's recommendation. The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E. Capitol, Pierre, SD 57501 (605 773-3352)" and the applicant's mailing address is given above. A petition filed by either an interested person or the applicant must be filed by September 15, 2000. The petition may be informal, but must include a statement describing the petitioner's interest in the applications, the petitioner's reasons for opposing or supporting these applications, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained.


The Water Management Board will consider this application at 8:30 am, September 28, 2000, Radisson (Angostura Room), 445 Mt. Rushmore Road, Rapid City, SD. The Chief Engineer's recommendation is not final or binding upon

the Board. The Board is authorized to 1) approve, 2) approve with qualifications, 3) defer, or 4) deny this application based on the facts presented at the public hearing. The September 28, 2000 hearing date will be automatically delayed for at least 20 days upon written request to the Chief engineer from the applicant or any interested person opposing the application. The request for an automatic delay must be filed by September 15, 2000.

Any hearing will be an adversary proceeding. Any person filing a petition and/or the applicant have the right to be represented by a lawyer and may present evidence or cross-examine witnesses according to SDCL 1-26. These and other due process rights will be forfeited if not exercised. Decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law. Contact Eric Gronlund by September 15, 2000, at the above Water Rights Program address to request copies of information pertaining to this application, to assure access to the hearing by the handicapped or to obtain an interpreter for the hearing impaired.

This application is made pursuant to SDCL 46-1-1 thru 46-1-9, 46-1-12 thru 46-1-16; 46-2-3, 46-2-9, 46-2-11, 46-2-13, 46-2-17; 46-2A-1 thru 46-2A-10, 46-2A-12, 46-2A-14, 46-2A-15, 46-2A-20, 46-2A-21; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-24, 46-5-25, 46-5-30.2, 46-5-30.4, 46-5-31, 46-5-38 thru 46-5-40; 46-5-20.1, 46-5-8.1; and Board Rules ARSD 74:02:01:01 thru 74:02:01:15; 74:02:01:24 thru 74:02:01:25; 74:02:01:15.02 thru 74:02:01:15.05.

Steven M. Pirner,
Secretary, Department of
Environment and Natural
Resources.
13716 Aug. 24, 31, 2000



Affidavit of Publication

STATE OF SOUTH DAKOTA
COUNTY OF LINCOLN

CONNIE RENLI

being first duly sworn on her oath says; that the Sioux Valley News is a legal weekly newspaper of general circulation as required by South Dakota Code of Nineteen Hundred Thirty-Nine, and any acts amendatory thereto, printed and published by the Sioux Valley News, Inc., in Canton, in said county and State, and has been such legal newspaper during the time hereinafter mentioned; that she is and during all of said time was bookkeeper of said newspaper and has personal knowledge of the facts stated in this affidavit; that the advertisement headed:

APPLICATION 6210-3

a printed copy of which is hereto attached, was printed and published in said newspaper for **TWO** successive weeks upon the following dates, to-wit:

AUGUST 24, 2000
AUGUST 31, 2000


that the full amount of the fees charged for publishing the same to-wit: the sum of **\$63.38** insures solely to the benefit of the publishers of said newspaper; that no agreement or understanding for any division of this sum has been made with any other person; and that no part of said sum has been agreed to be paid to any person whomsoever.

Connie Renli

Subscribed and sworn to before me this
31st day of **AUGUST, 2000.**

Jeanne M. Limoges
Notary Public, South Dakota

(Seal)



Jeanne M. Limoges
My Commission Expires
November 18, 2003

NOTICE OF APPLICATION NO. 6210-3 TO PLACE WATER TO BENEFICIAL USE RESERVED UNDER FUTURE USE PERMIT NO. 3981A-3

Notice is given that the City of Sioux Falls, 224 West 9th Street, Sioux Falls SD 57104 has filed an application for a water permit to place to beneficial use 10,000 acre-feet annually from the Big Sioux River reserved under Future Use Permit No. 3981A-3. If approved, this water permit will retain the June 6, 1977 priority date assigned to Future Use Permit No. 3981A-3. The point of diversion is at the city's Big Sioux River pump station located in the NW1/4NE1/4 Section 32, in T102N-R49W. Currently the city is authorized by Water Permit No. 5334-3 to divert up to 13.8 cubic feet of water per second (cfs) with a maximum annual volume of 10,000 acre feet from the pump station. Since the pump station is capable of diverting water at a maximum rate of 69.6 cfs, the city is also applying to increase the authorized diversion rate from 13.8 cfs to 69.6 cfs (55.8 cfs additional). Water is to be used for municipal purposes by the City of Sioux Falls.

Pursuant to SDCL 46-2A-2, the Chief Engineer recommends Approval of Application No. 6210-3 because 1) unappropriated water is available, 2) existing rights will not be unlawfully impaired, 3) it is a beneficial use of water and 4) it is in the public interest.

Any person interested in opposing or supporting this application must file a written petition with BOTH the applicant and Chief Engineer. The applicant must also file a petition if opposed to the Chief Engineer's recommendation. The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E. Capitol Pierre, SD 57501 (605-773-3352)" at the applicant's mailing address is given above. A petition filed by either an interested person or the applicant must be filed by September 15, 2000. The petition may be informal, but must include a statement describing the petitioner's interest in the application, the petitioner's reasons for opposing or supporting the application, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained.

The Water Management Board will consider this application at 8:30 a.m. September 28, 2000, Radisson (Angostura Room), 445 Mt. Rushmore Road, Rapid City, SD. The Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) approve with qualifications, 3) defer, or 4) deny this application based on the facts presented at the public hearing. The September 28, 2000 hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from the applicant or any interested person opposing the application. The request for an automatic delay must be filed by September 15, 2000.

Any hearing will be an adversary proceeding. Any person filing a petition and/or the applicant have the right to be represented by a lawyer and may present evidence or cross-examine witnesses according to SDCL 1-26. These and other due process rights will be forfeited if not exercised. Decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law. Contact Eric Gronlund by September 15, 2000, at the above Water Rights Program address to request copies of information pertaining to this application, to assure access to the hearing by the handicapped or to obtain an interpreter for the hearing impaired.

This application is made pursuant to SDCL 46-1-1 thru 46-1-9, 46-1-12 thru 46-1-16; 46-2-3.1, 46-2-9, 46-2-11, 46-2-13, 46-2-17; 46-2A-1 thru 46-2A-10, 46-2A-12, 46-2A-14, 46-2A-15, 46-2A-20, 46-2A-21; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-24, 46-5-25, 46-5-30.2, 46-5-30.4, 46-5-31, 46-5-38 thru 46-5-40; 46-5-20.1, 46-5-8.1 and Board Rules ARSD 74:02:01:01 thru 74:02:01:15; 74:02:01:24 thru 74:02:01:25; 74:02:01:15.02 thru 74:02:01:15.05 Steven M Pirner, Secretary, Department of Environment and Natural Resources. (8-24, 31)



Instruction to Newspaper - Publish first Notice on August 24, 2000 with the second publication 7 days later. The applicant is responsible for payment.

NOTICE OF APPLICATION NO. 6210-3 to Place Water to Beneficial Use
Reserved under Future Use Permit No. 3981A-3

Notice is given that the City of Sioux Falls, 224 West 9th St, Sioux Falls SD 57104 has filed an application for a water permit to place to beneficial use 10,000 acre-feet annually from the Big Sioux River reserved under Future Use Permit No. 3981A-3. If approved, this water permit will retain the June 6, 1977 priority date assigned to Future Use Permit No. 3981A-3. The point of diversion is at the city's Big Sioux River pump station located in the NW $\frac{1}{4}$ NE $\frac{1}{4}$ Section 32; all in T102N-R49W. Currently, the city is authorized by Water Permit No. 5334-3 to divert up to 13.8 cubic feet of water per second (cfs) with a maximum annual volume of 10,000 acre feet from the pump station. Since the pump station is capable of diverting water at a maximum rate of 69.6 cfs, the city is also applying to increase the authorized diversion rate from 13.8 cfs to 69.6 cfs (55.8 cfs additional). Water is to be used for municipal purposes by the City of Sioux Falls.

Pursuant to SDCL 46-2A-2, the Chief Engineer recommends Approval of Application No. 6210-3 because 1) unappropriated water is available, 2) existing rights will not be unlawfully impaired, 3) it is a beneficial use of water, and 4) it is in the public interest.

Any person interested in opposing or supporting this application must file a written petition with BOTH the applicant and Chief Engineer. The applicant must also file a petition if opposed to the Chief Engineer's recommendation. The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)" and the applicant's mailing address is given above. A petition filed by either an interested person or the applicant must be filed by September 15, 2000. The petition may be informal, but must include a statement describing the petitioner's interest in the application, the petitioner's reasons for opposing or supporting the application, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained.

The Water Management Board will consider this application at 8:30 am, September 28, 2000, Radisson (Angostura Room), 445 Mt. Rushmore Road, Rapid City SD. The Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) approve with qualifications, 3) defer, or 4) deny this application based on the facts presented at the public hearing. The September 28, 2000 hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from the applicant or any interested person opposing the application. The request for an automatic delay must be filed by September 15, 2000.

Any hearing will be an adversary proceeding. Any person filing a petition and/or the applicant have the right to be represented by a lawyer and may present evidence or cross-examine witnesses according to SDCL 1-26. These and other due process rights will be forfeited if not exercised. Decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law. Contact Eric Gronlund by September 15, 2000, at the above Water Rights Program address to request copies of information pertaining to this application, to assure access to the hearing by the handicapped or to obtain an interpreter for the hearing impaired.

This application is made pursuant to SDCL 46-1-1 thru 46-1-9, 46-1-12 thru 46-1-16; 46-2-3.1, 46-2-9, 46-2-11, 46-2-13, 46-2-17; 46-2A-1 thru 46-2A-10, 46-2A-12, 46-2A-14, 46-2A-15, 46-2A-20, 46-2A-21; 46-5-1 thru 46-5-11, 46-5-13 thru 46-5-15, 46-5-24, 46-5-25, 46-5-30.2, 46-5-30.4, 46-5-31, 46-5-38 thru 46-5-40; 46-5-20.1, 46-5-8.1; and Board Rules ARSD 74:02:01:01 thru 74:02:01:15; 74:02:01:24 thru 74:02:01:25; 74:02:01:15.02 thru 74:02:01:15.05. Steven M. Pirner, Secretary, Department of Environment and Natural Resources.



NOV 15 2000

**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
www.state.sd.us/denr

Randy Janssen, Water Superintendent
City of Sioux Falls
224 W 9th St
Sioux Falls SD 57104

Dear Mr. Janssen:

Enclosed are Water Permit Nos. 6210-3, 6214-3 and 6215-3 authorizing construction of the city's water diversion system and beneficial use of the water, not exceeding the limits as specified in the Water Permits.

Form 10, *Notice of Completion of Works and Application of Water to Beneficial Use*, are enclosed. Please return this completed form after you have finished the system and have put the water to beneficial use. An investigation can then be scheduled so the water license may be issued, thus completing the acquisition of a water right.

An informational sheet *Common Water Right Questions?* is also enclosed. This sheet is intended to answer some of the questions associated with obtaining and keeping a water right.

Sincerely,

Garland Erbele, Chief Engineer
Water Rights Program
(605) 773-3352

enclosures

NOTICE OF COMPLETION OF WORKS AND APPLICATION OF WATER TO BENEFICIAL USE

Date 12/18/00

TO: Water Rights Program, DENR
523 E. Capitol
Pierre, SD 57501-3181



FROM: City of Sioux Falls

(name)

224 West Ninth Street

(address)

Sioux Falls, SD 57104

(city, state, zip)

(605)367-7040

(phone)

I have completed the construction of the water use system and I have put the water to beneficial use to the maximum extent it is going to be used.

Water Permit No. 6210-3 states that the water use system is to be constructed by

September 28, 2005

(date)

, and water is to be put to beneficial use by

September 28, 2009

(date)

The water use system was completed on September 29, 2000


(date)

Applying the water to beneficial use was completed on September 30, 2000

(date)

You may schedule an investigation so that the water license may be issued.

Randy Janssen
(signature)
Water Supt.



Permit Nos. 5334-3 & 6210-3

Big Sioux River - Water District

Report of Examination of Works and/or Application of Water to Beneficial Use

TO: Chief Engineer, Water Rights Program, DENR, Foss Bldg., Pierre, SD 57501

I have this day, **July 24, 2002**, made a thorough examination of the water use system constructed by **City of Sioux Falls** of **224 West 9th St., Sioux Falls SD 57104** holder of Permit Nos. **5334-3 & 6210-3**, bearing the priority of **June 6, 1977 (established by Future Use Permit No. 3981A-3)** authorizing the diversion of **69.6** cu. ft. per second or **10,000** acre-feet annually of the waters of **the Big Sioux River** for **municipal use** purposes, in **Minnehaha** County.

Inspection contact & relationship to permit holder, if applicable: **Randy Janssen, Water Superintendent for the City of Sioux Falls.**

A. Works used to divert the water: Diversion point located in the NW¼ NE¼ Section 32-T102N-R49W.

Pump:

- 1) Make **3- Fairbanks / Morse**
- 2) Capacity **10,500** GPM each for a total of **31,500** GPM.

Motor:

- 1) Make **3-U.S. Electric**
- 2) Horsepower rating **450** hp each

B. Works used to transport water to place of use:

From river to the pumps:

- 1) Type **steel**
- 2) Size **36** inches
- 3) Length **300** feet

Leaving the pump house:

- 2) Type **ductile iron**
- 2) Size **48** inches
- 3) Length **2,750** feet

C. Works used to apply water to beneficial use: Water treatment plant and distribution system .

D. Compliance with Permit Requirements:


- 1) Permit qualifications being abided by **yes**

The system is in **good** condition with the point of diversion located as follows: **830' S and 2,465' W of the NE corner in the NW¼ NE¼ Section 32-T102N-R49W.** The works are capable of diverting and conveying to the place of use **70** cu. ft. per second of water which is to be used for **municipal use purposes.** Water has been put to beneficial use to the maximum extent as follows: **Municipal water supply for the City of Sioux Falls.**

The license should be issued for **69.6** cfs and/or **10,000** acre-feet annually.

All structures, wells and lands on map **yes**

Comments or other permit(s) associated with the project: Permit Nos. 5334-3 and 6210-3 place to beneficial use 10,000 acre-feet annually from Future Use Permit No. 3981A-3. These permits should be incorporated when licensed.


Lynn Beck

Natural Resources Engineer Specialist
DENR, Water Rights Program

Date report completed: **October 16, 2002**

WATER RIGHT NOS. 5334-3 & 6210-3

City of Sioux Falls



Lynn Beck

Lynn Beck
Natural Resources Engineer Specialist
DENR, Water Rights Program
October 16, 2002



South Dakota Department of
Environment and Natural Resources



Protecting South Dakota's Tomorrow ... Today

STATE OF SOUTH DAKOTA

WATER LICENSE NO. 6210-3

(1) The City of Sioux Falls, 224 W 9th St, Sioux Falls SD 57102 made Application No. 6210-3, May 10, 2000 for a water permit to divert an additional 55.8 cubic feet of water per second (cfs) (10,000 acre-feet annually) from the Big Sioux River, Minnehaha County, South Dakota for municipal purposes. Permit No. 6210-3, with a priority date of June 6, 1977 (established by Future Use No. 3981A-3) was approved September 28, 2000 and issued to the applicant for diversion of water with construction of the described water supply system to be completed on or before September 28, 2005 and for the application to beneficial use of water on or before September 25, 2009.

Water Permit No. 5334-3, priority date of June 6, 1977 (established by Future Use No. 3981A-3) authorized 13.8 cfs from the Big Sioux River. The applicable portions of No. 5334-3 are incorporated into No. 6210-3.

(2) The water supply system has been completed and water applied to beneficial use in accordance with South Dakota State Law. Pursuant to South Dakota Codified Law 46-5-30.1, the holder and/or owner of Incorporated Water Right No. 6210-3 is issued a license, bearing a priority date of June 6, 1977 to appropriate 69.6 cubic feet of water per second (10,000 acre-feet annually) from the Big Sioux River for municipal purposes.

The diversion point is located as follows:

830 feet south and 2,465 feet west of the northeast corner of **Section 32-T102N-R49W (NW ¼ NE ¼)**.

(3) This license is subject to South Dakota Water Law, any limitations or conditions listed in Incorporated Water Permit No. 6210-3 including the following qualifications:


- Low flows as needed for downstream domestic use, including livestock water and prior water rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River unless at least 20 cfs is being by-passed, when pumping at the Cliff Avenue USGS gauging station, or unless written orders have been issued by the Chief Engineer.
- The City of Sioux Falls shall report to the Chief Engineer annually the amount of water withdrawn each year from the Big Sioux River.

Garland Erbele

Garland Erbele, Chief Engineer
Water Rights Program
Department of Environment and Natural Resources

JUN 20 2003

date





**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
www.state.sd.us/denr

JUN 20 2003

Randy Jenssen
Sioux Falls Water Superintendent
2100 N Minnesota Ave
Sioux Falls SD 57104

Dear Mr. Jenssen:

Enclosed are Water License Nos. 5213-3, 5214-3, 5431-3, 5611-3, 5612-3, 5614-3, 5615-3, 5726-3, 6210-3, 6214-3 and 6215-3 for the City of Sioux Falls. A map prepared by Lynn Beck is also included for each permit as well as receipts for payment of the license fees.

These are the final water right documents completing the city's process of obtaining Water Rights.

As long as the city uses the water beneficially, as stated in the Water Licenses, State Water Laws provide a continuing right to use the water.

Sincerely,

Garland Erbele, Chief Engineer
Water Rights Program
(605) 773-3352

NOTE: The applicable portions of No. 5334-3 are incorporated into Water License No. 6210-3.
The applicable portions of Nos. 2923-3 and 5613-3 are incorporated into Water License No. 5726-3.

enclosures

6210-3 and 3981-3

Water Rights Program - DENR
Conversation File Documentation

NAME OF PERSON OR FILE: Water Right No. 6210-3, City of Sioux Falls

ADDRESS: 224 West 9th Street, Sioux Falls SD COUNTY: Minnehaha

DATE: August 22, 2007 TELEPHONE:

RE: Annual Acre Foot Volume authorized by Water Right No. 6210-3

Randy Janssen, Water Superintendent for the city of Sioux Falls called regarding my August 15, 2007 letter to Kevin Smith. This letter reflects an annual water volume authority of 10,000 acre feet of water from the Big Sioux River. Mr. Janssen stated that he believed the city should have an annual volume authority of 20,000 acre feet from the Big Sioux River. This is based on the following:

Water Right No. 5334-3 appropriated 13.8 cfs diversion rate authority and 10,000 acre feet annually from the river.

In May 2000, the city applied for additional diversion authority of 55.8 cfs to reflect the city's diversion rate capability (69.6 cfs) and construct and place to beneficial an additional 10,000 acre feet of water annually reserved by Future Use Permit No. 3981-3. This application was approved.

In June of 2003, Water License No. 6210-3 was issued incorporating Water Right Nos. 5334-3 and 6210-3 into one water license (No. 6210-3). The license as issued states a diversion rate authority of 69.6 cfs and an annual volume of 10,000 acre feet of water. The additional 10,000 acre feet of water was omitted from the water license.

Course of action to correct this apparent error

1. Include this file document in the administrative record for Water Right No. 6210-3 and Future Use Permit No. 3981-3.
2. Reissue Water License No. 6210-3 which incorporated Water Right No. 5334-3 for 69.6 cfs and an annual volume of 20,000 acre feet of water from the Big Sioux River. Change the water right database to reflect this amount.
3. Change the water right database for Future Use Permit No. 3981-3 to reflect 30,000 acre feet of water remaining in reserve.
4. Update the future use review table to reflect the proper amount remaining in reserve.

NAME: Eric Treeland



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

PMB 2020
JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
www.state.sd.us/denr

AUG 12 2009

6210-3

Randy Janssen
City of Sioux Falls
224 W 9th St
Sioux Falls SD 57102

Dear Mr. Janssen:

Enclosed is Reissued Water License No. 6210-3. The original water license has been reissued to correct an error in the annual acre foot limitation from the Big Sioux River.

As long as you use the water beneficially, as stated in the Water License, State Water Laws provide that you have a continuing right to use the water.

Sincerely,

Garland Erbele, Chief Engineer
Water Rights Program
(605) 773-3352

enclosures

STATE OF SOUTH DAKOTA

REISSUED WATER LICENSE NO. 6210-3

(1) The City of Sioux Falls, 224 W 9th St, Sioux Falls SD 57102 was issued Water License No. 6210-3, June 20, 2003 for a water right to divert 69.6 cubic feet of water per second (10,000 acre feet annually) from the Big Sioux River, Minnehaha County, South Dakota for municipal purposes. Water Right No. 6210-3, with a priority date of June 6, 1977 (established by Future Use Permit No. 3981-3) was issued to the city and incorporated the applicable portions of Water Permit No. 5334-3.


Water Permit Nos. 5334-3 and 6210-3 had each authorized a diversion rate and an annual volume of 10,000 acre feet of water. Upon licensing and incorporating the two permits together, the additional 10,000 acre feet of water was omitted. The license should have been issued for the combined annual volume of 20,000 acre feet. Water License No. 6210-3 is being reissued to correct the error.

(2) The water supply system has been completed and water applied to beneficial use in accordance with the provisions of South Dakota State Law. Pursuant to South Dakota Water Law 46-5-30.1 the City of Sioux Falls, 224 W 9th St, Sioux Falls SD 57102 the holder and/or owner of Incorporated Water Right No. 6210-3 is issued a license to appropriate water, the right to use 69.6 cubic feet of water per second with an annual volume of 20,000 acre feet from the Big Sioux River with a priority date of June 6, 1977 (established under Future Use Permit No. 3981-3) from the location specified in (2) of this license for municipal purposes.

The diversion point on the Big Sioux River is located 830 feet south and 2,465 feet west of the NE corner of Section 32, T102N, R49W (NW ¼ NE ¼).

(3) This license is subject to South Dakota Water Law, any limitations or conditions listed in Incorporated Water Right No. 6210-3 and subject to the following qualifications:

- Low flows as needed for downstream domestic use, including livestock water and prior water rights must be bypassed. This water right does not authorize diversion of water from the Big Sioux River unless at least 20 cfs is being bypassed when pumping at the Cliff Avenue USGS gauging station or unless written orders have been so issued by the Chief Engineer.
- The City of Sioux Falls shall report to the Chief Engineer annually the amount of water withdrawn each year from the Big Sioux River.


Garland Erbele, Chief Engineer
Water Rights Program
Department of Environment and Natural Resources

AUG 12 2009

date



Amendment to the qualifications contained in Water Right No. 6210-3

Deleted Qualification:

- Low flows as needed for downstream domestic use, including livestock water and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River unless at least 20 cfs is being by-passed, when pumping at the Cliff Avenue USGS Gaging Station, or unless written orders have been issued by the Chief Engineer.

New Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06482020 at North Cliff Avenue when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182

denr.sd.gov

May 22, 2018

NOTICE OF ENTRY OF ORDER

5431-3 6210-3

City of Sioux Falls
Greg Anderson
224 W 9th St
Sioux Falls SD 57102

Dear Mr. Anderson:

I am writing in response to action taken by the Water Management Board on May 3, 2018, regarding the Hearing to Amend the Bypass Qualifications on Big Sioux River water rights.

Attached is the qualification that was deleted from your water right and the new qualifications.

This amendment designates a US Geological Survey gaging station as the measuring point to determine if pumping is allowed. The gaging station has real time flow information that can be accessed online at <https://waterdata.usgs.gov/sd/nwis/rt>. However, the water right is also subject to written orders of the Chief Engineer regardless of the bypass criteria.

If you have questions concerning the Board action or your water right(s), please contact Mark Rath with our program at 605 773-3352 or mark.rath@state.sd.us.

Sincerely,

Jeanne Goodman, Chief Engineer
Water Rights Program

enclosure

cc: Diane Best, Assistant City Attorney, City of Sioux Falls

Amendment to the qualifications contained in Water Right No. 6210-3

Deleted Qualification:

- Low flows as needed for downstream domestic use, including livestock water and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River unless at least 20 cfs is being by-passed, when pumping at the Cliff Avenue USGS Gaging Station, or unless written orders have been issued by the Chief Engineer.

New Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06482020 at North Cliff Avenue when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

CERTIFICATION

I hereby certify that on May 22, 2018, I have personally deposited with the United States mail at Pierre, South Dakota, first class postage, prepaid envelopes containing a Notice of Entry of Order dated May 22, 2018 regarding amending bypass qualifications on Big Sioux River water rights addressed as stated below:


Elaine Ahlers, PO Box 186, Flandreau SD 57028
Adam Wiese, Operator, 22603 479th Ave, Flandreau SD 57028
Chad Anderson, 47880 244th St, Dell Rapids SD 57022
Ronnie J Boever, 47948 232nd St, Flandreau SD 57028
Brian Burkhart, 24482 482nd Ave, Dell Rapids SD 57022
Jim Czech, Operator, 45767 177th St, Watertown SD 57201
Marvin & Maxine Czech, 45848 176th St, Watertown SD 57201
Dell Rocky Run Golf Course, 47364 Golf View Drive, Dell Rapids SD 57022
Allen Fugere, Operator, 700 N Main, Estelline SD 57234
W J Sanderson & Alan Blum, 703 1st Ave S, Estherville IA 51334
Darren & Allison Hamilton, 22615 480th Ave, Flandreau SD 57028
Wayne Headrick, 47926 SD Hwy 32, Flandreau SD 57028
Mrs. Raymond D Jensen & Scott Jensen, Operator, 24348 478th Ave, Dell Rapids SD 57022
Larry J Jorgenson, 24048 477th Ave, Trent SD 57065
Ted Lacey, 24064 478th Ave, Trent SD 57065
Thomas A & Patricia K Munk Revocable Living Trust, 15683 State Hwy 105, Austin MN 55912
City of Sioux Falls, Greg Anderson, 224 W 9th St, Sioux Falls SD 57102
City of Sioux Falls, Kelby Mieras, 100 E 6th St, Sioux Falls SD 57104
Diane Best, Assistant City Attorney, City of Sioux Falls, PO Box 7402, Sioux Falls SD 57117-7402

Vickie Maberry
Vickie Maberry
Secretary/Water Rights

STATE OF SOUTH DAKOTA)
) SS
COUNTY OF HUGHES)

Sworn to, before me, this 22nd day of May, 2018.

Karen Schlaak
Karen Schlaak
Notary Public
My Commission expires April 1, 2019

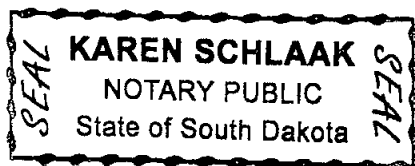



6210-3
DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES

PMB 2020
JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
denr.sd.gov

August 6, 2012

Dear Water Right Holder;

Due to low flows I am advising water right holders on the Big Sioux River of the possibility of shutoff orders in 2012 for the river reach from Watertown through Sioux Falls. This is **not a shutoff order**.

As a result of the continuing lack of precipitation, tributary flows throughout the Big Sioux River basin remain well below the historical average. The forecast for improved conditions for the near future is not favorable.

This letter is only intended to give you advanced warning that your ability to divert water may be cut short this year. If shut-off orders are issued, you will receive another letter from the department. In the meantime, water right holders can help by closely monitoring water usage and trying to avoid wasting water.

South Dakota water law gives the highest priority to domestic use, which includes livestock watering. There is generally adequate water available to meet both domestic use and other needs. However, once water availability reaches critical low levels, other uses, including irrigation, will begin to interfere with domestic use. If levels become critically low, the department must issue shut-off orders to protect domestic water uses. Once these orders are issued, the department will continue to monitor water availability and should conditions improve, the shutoff orders would be rescinded.

If you are interested, the US Geological Survey has an Internet site showing real-time river flows at 159 stream gauging stations across the state including three gages sites on the Big Sioux River. To access this information go to <http://waterdata.usgs.gov/sd/nwis/rt> and click on the link "Statewide Streamflow Current Conditions Table".

Thank you for your cooperation. If you have any questions, please contact Lynn Beck or Mark Rath at (605) 773-3352.

Sincerely,

Garland Erbele, Chief Engineer
Water Rights Program

CERTIFICATION

I hereby certify that on August 6, 2012, I have personally deposited with the United States mail at Pierre, South Dakota, first class postage, prepaid envelope(s) containing a Notice dated August 6, 2012 regarding shut off warnings on Big Sioux River addressed as stated below:

permitno	fname	lname	addrss2	city	state	zip
1696-3	DONALD G	AHLERS	22920 SD HWY 13	FLANDREAU	SD	57028
5530-3	TERRY & DENISE	ANDERSON	47558 237TH ST 26534 N SHORE PLACE	TRENT	SD	57065
6192-3	BERNE B	BAHNSON	PO BOX 366	HARTFORD	SD	57033
3806-3	BERNARD	BERGDALE	47948 232ND ST	ALCESTER	SD	57001
1175-3	HAROLD	BOEVER	4162 BIRCH AVE	FLANDREAU	SD	57028
4895-3	BILL B	BOYER	403 16TH ST	HAWARDEN	IA	51023
284-3	LUKE	BOYER, MGR	24482 482ND AVE	HAWARDEN	IA	51023
7110-3	BRIAN	BURKHART	32650 480TH AVE	DELL RAPIDS	SD	57022
5760-3	BRIAN	CHICOINE	29509 488TH AVE	ELK POINT	SD	57025
2255-3	JAMES H	COLE	47364 GOLF VIEW DR	HUDSON	SD	57034
6124-3		DELLS ROCKY RUN GOLF COURSE		DELL RAPIDS	SD	57022
4969-3	JOHN GILMAN	FRAZIER FARMS	BOX 423	PARKSTON	SD	57366
4969-3	JOHN TROY D & SANDY F	GILMAN	4162 BIRCH	HAWARDEN	IA	51023
249-3	DARREN & ALLISON	HAHN	6762 SMITH DR	WENTWORTH	SD	57075
2065-3 2952-3, 956- 3	WAYNE	HAMILTON	22615 480TH AVE	FLANDREAU	SD	57028
279-3	ROBERT	HEADRICK	47926 SD HWY 32	FLANDREAU	SD	57028
1350-3, 6042-3		JAGER, MGR	48495 299th ST	HAWARDEN	IA	51023
1302-3	RAYMOND D	JENSEN	24348 478TH AVE	DELL RAPIDS	SD	57022
1500-3, 213- 3	LARRY J	JORGENSEN	24048 477TH AVE	TRENT	SD	57065
	TED	LACEY	24064 478TH AVE	TRENT	SD	57065
	EUGENE	MOLLET	48011 332ND ST	JEFFERSON	SD	57038
3433-3	VIRGIL L	MOLLET JR	47991 334TH ST	JEFFERSON	SD	57038
1801-3	GAIL	MUNK	803 DAKOTA	DELL RAPIDS	SD	57022
113-3	PATTI	NASH	21660 469TH AVE	BROOKINGS	SD	57006
3914-3	OMAR F	PETTERSON	48378 276TH ST	CANTON	SD	57013
2350-3		RIVER VALLEY FARMS	PO BOX 486	ALCESTER	SD	57001
1801-3	HARVEY JOHN T & MELISSA R	SCHMIDT, OPERATOR	47528 244TH ST	DELL RAPIDS	SD	57022
1454-3		SCHUTTE	47973 W 5TH ST 47844 COUNTY RD 1B	CANTON	SD	57013
5814-3	PATRICK V	WALSH, OPERATOR	11726 NORWAY ST NW	ELK POINT COON RAPIDS	SD MN	57025 55448
597-3	DAN & JUDY	WHIPPLE WILLOW RUN MANAGEMENT COMPANY	8000 E HWY 42	SIOUX FALLS	SD	57110
5055-3		XCEL ENERGY	7100 E RICE ST	SIOUX FALLS	SD	57110
519-3A		NORTHERN STATES POWER COMPANY	414 NICOLLET MALL	MINNEAPOLIS	MN	55401
43-3, 519-3 5698-3, 6210-3	GREG ANDERSON	CITY SIOUX FALLS	224 W 9TH ST	SIOUX FALLS	SD	57102

Gail Jacobson


Gail Jacobson
Secretary/Water Rights

STATE OF SOUTH DAKOTA)
) SS
COUNTY OF HUGHES)

Sworn to, before me, this 4th day of August, 2012.

Karen Schlaak

Karen Schlaak
Notary Public
My Commission expires April 1, 2013

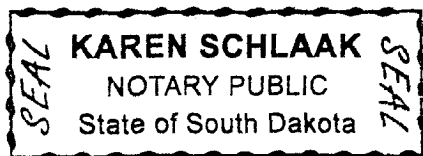



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

JOE FOSS BUILDING
PMB 2020
523 EAST CAPITOL
PIERRE SOUTH DAKOTA 57501-3182
www.denr.sd.gov

January 31, 2018

5431-3 6210-3

CITY OF SIOUX FALLS
GREG ANDERSON
224 W 9TH ST
SIOUX FALLS SD 57102

Subject: Bypass Qualifications on Big Sioux River Water Rights

Dear Mr. Anderson,

I am writing to inform you of an effort the SD Dept. of Environment and Natural Resources Water Rights Program is undertaking to review and update a number of water right permits authorized to pump water from the Big Sioux River. When a number of these permits were issued, they contained a qualification requiring a minimum flow bypass before the user is able to pump water from the river. The bypass qualification was placed on these permits to protect the use of water by downstream senior priority water right holders and domestic water users, which includes livestock watering. The review found, with the passage of time, a number of senior water right permits have been cancelled due to abandonment or forfeiture. Consequently, it may be possible to lower the flow bypass limitation on the remaining permits. In other words, the amount of flow in the river can be lower and pumping will still be allowed. The review also found an inconsistency between permits on where the bypass flow is to be measured.

The intent of this effort is to standardize and make consistent the bypass requirements for the remaining water users. In most cases, the proposed changes will reduce the flow bypass requirement on the individual permits. To make the permits consistent, the bypass measuring point will also be designated at a United States Geological Survey (USGS) stream gaging station. The USGS maintains a real-time stream gaging network on the Big Sioux River. Current river flow information can be easily accessed from the internet at the following internet address:

<https://waterdata.usgs.gov/sd/nwis/rt>

In order to amend a qualification on an existing water right permit, formal action by the SD Water Management Board is needed. In the next few weeks, you can expect to receive official notification scheduling a hearing before the Water Management Board. If you wish to participate in the hearing you can, but you are not required to. There will be instructions with the notification on how to participate in the hearing if you so choose.

If you have any questions concerning this effort, please contact Mark Rath of the Water Rights Program at phone (605) 773-3352.

Sincerely,


Jeanne Goodman, Chief Engineer
Water Rights Program



DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES

JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182

denr.sd.gov

February 12, 2018

5431-3 6210-3

City of Sioux Falls
Greg Anderson
224 W 9th St
Sioux Falls SD 57102

Subject: Bypass Qualifications on Big Sioux River Water Rights

Dear Mr. Anderson:

The SD Department of Environment and Natural Resources has evaluated the minimum flow bypass condition on water rights that pump from the Big Sioux River. The Chief Engineer is recommending amending the bypass qualification on 21 Big Sioux water rights. The intent is to bring uniformity to the bypass requirement placed on water rights in past years. Water Right(s) that you own or operate are included in those proposed to be amended.

Attached is the qualification to be deleted from the water right(s) and the proposed new qualifications.

The proposed amendment to your water right will not impose a more restrictive condition than currently is in place on your water right. In some cases the bypass requirement remains the same but generally the proposed amendment decreases the minimum bypass that must exist before a user is able to pump water from the river. The amendment does designate a US Geological Survey gaging station as the measuring point to determine if pumping is allowed. The gaging station has real time flow information that can be accessed on-line at <https://waterdata.usgs.gov/sd/nwis/rt>. Many, but not all, water rights referenced the bypass being located at the pump site where there isn't real time flow information.

A hearing before the Water Management Board is scheduled at 11:30 AM, Wednesday, March 7, 2018 in the Matthew Training Center, Joe Foss Building, 523 E Capitol Avenue, Pierre SD. Enclosed is the notice to be published on or before February 15, 2018, in one newspaper from each of the seven counties that the Big Sioux River flows through. This notice provides information on filing a petition in either support or opposition to the propose amendment. The filing of a petition must be postmarked by February 26, 2018. Additionally filing a petition affords you the opportunity to participate in the March 7th hearing before the Board if you choose.

The staff report including affected water rights and the proposed changes is available at <http://denr.sd.gov/public> or contact Mark Rath at 605 773-3352 or mark.rath@state.sd.us. If you have questions, please call. DENR is willing to work to answer any questions.

Sincerely,

Eric Gronlund
Water Rights Program, DENR
605 773-3352
Eric.gronlund@state.sd.us

enclosure

Proposed Qualification Revisions

In order to standardize the qualifications for the 5 existing water rights/permits containing bypass qualifications in the Big Sioux River reach between the USGS stream gaging station near Dell Rapids downstream to the USGS stream gaging station at North Cliff Avenue at Sioux Falls, the following changes are proposed.

Amendment to the qualifications contained in Water Right No. 6210-3

Delete Qualification:

- Low flows as needed for downstream domestic use, including livestock water and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River unless at least 20 cfs is being by-passed, when pumping at the Cliff Avenue USGS Gaging Station, or unless written orders have been issued by the Chief Engineer.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06482020 at North Cliff Avenue when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Review of Big Sioux River Water Rights and Report on Proposed Amendments

February 13, 2018

Introduction

The Big Sioux River is a prairie stream with headwaters located in the northern prairie coteau in southern Roberts, eastern Day and eastern Clark counties, in northeastern South Dakota. The river drains glacial till and outwash plains as it runs southward to its junction with the Missouri River near Sioux City, Iowa. The Big Sioux River physical geography is characterized by glaciated terrain and rolling plains. Rivers commonly follow the valleys formed by glacial lobes, which were glaciated as recently as 14,000 years ago. Drainages in this region formed after retreat of glaciers and are therefore poorly established in parts of the watershed. The poorly established drainage patterns are accompanied by numerous areas of internal drainages, or “potholes,” and are commonly referred to as the “Prairie Pothole Region” (Hoogestrat and Stamm, 2015).

As is typical of prairie streams in South Dakota, the peak runoff occurs during the spring months due to plains snowpack melt and from runoff of larger rain events. Runoff tends to decrease in the late summer months going in to fall and winter.

Qualification Status

A review of Water Right Program files shows there have been 163 water right permits (water permits) issued for the Big Sioux River, some with priority dates going back to statehood. Many of these have been cancelled due to abandonment or forfeiture, some have been incorporated into other water permits and some remain active. An examination of water right files found the Water Resources Commission placed the first bypass qualification, 20 cubic feet per second (cfs) bypass at the diversion point, on a Big Sioux River water permit in Moody County in 1960 (Water Rights, 2018).

After the Water Resources Commission placed the first bypass qualification on a Big Sioux River water permit in 1960, it appears from then until the mid-1990’s, with the advent of real-time accessible stream gaging, the management of water permits from the Big Sioux River was primarily addressed on a river reach basis and the presence of senior priority water permits. Water permits issued in a similar reach with relatively similar priority dates would have the same bypass requirements. Later when water permits were issued, the bypass requirement would be incrementally increased to account for protection of the senior priority water permits (Water Rights, 2018).

The northern most river reach, from the headwaters in southern Roberts County to the Brookings – Moody county line, only has a hand full of permits issued since 1960. Bypass qualifications range from 5 cfs for those water permits issued in the mid-1960’s to 35 cfs for those issued more recently (Water Rights, 2018).

In the Big Sioux River reach from the northern border of Moody County to Dell Rapids, which has the most water permits issued, the 20 cfs bypass requirement was placed on Big Sioux River water permits from 1960 until 1966 when the bypass requirement was raised to 30 cfs for new permits issued. In 1968 the bypass requirement was raised to 35 cfs and was then incrementally increased to 50 cfs by 1976. Many of these water permits have subsequently been cancelled due to abandonment or forfeiture. The most recent water permits issued in this reach contained a 43 cfs bypass requirement (Water Rights, 2018).

In the Big Sioux River reach immediately to the south between Dell Rapids where the Big Sioux River crosses Cliff Avenue on the eastern side of Sioux Falls there have been multiple water permits issued. These contain a 20 cfs bypass requirement. Earlier issued water permits require a 20 cfs bypassed at the diversion point while the later issued ones require a 20 cfs bypass at the United States Geologic Survey (USGS) stream gaging station at North Cliff Avenue in Sioux Falls (Water Rights, 2018 and USGS, 2018).

The southernmost river reach from where the river crosses North Cliff Avenue in eastern Sioux Falls to the confluence with Missouri River in southern Union County does not have any water permits with bypass requirements. This reach, even during drier climatic conditions has sufficient flow exceeding demand. The additional flow is attributed to effluent discharge from the Sioux Falls waste water treatment plant and contributions from downstream tributaries such as Split Rock Creek near Brandon (Water Rights, 2018).

Currently there are 59 active water permits authorized for the Big Sioux River from the headwaters in Roberts County to the mouth in Union County, Figure 1. There have been 49 water permits issued since 1960, when the first bypass requirement was enacted, to present which have subsequently been cancelled due to abandonment or forfeiture. Currently 21 of the existing water permits contain some sort of flow bypass qualification. When the water permits were issued with bypass qualifications, it was done because the senior priority water permits were active and being used, so the amount of the bypass requirement placed on the water permit was based on a level to protect senior priority water use. Since there has been significant attrition in the number of active water permits using Big Sioux River water since 1960, with many of them being cancelled, this leaves a somewhat disjointed system of bypass requirements for the remaining water permits. In addition, the City of Sioux Falls holds two active future use permits with 1977 priority dates reserving 30,000 acre-feet of Big Sioux River water in the river reach between the Dell Rapids gage and the North Cliff Avenue gage (Water Rights, 2018 and USGS, 2018).

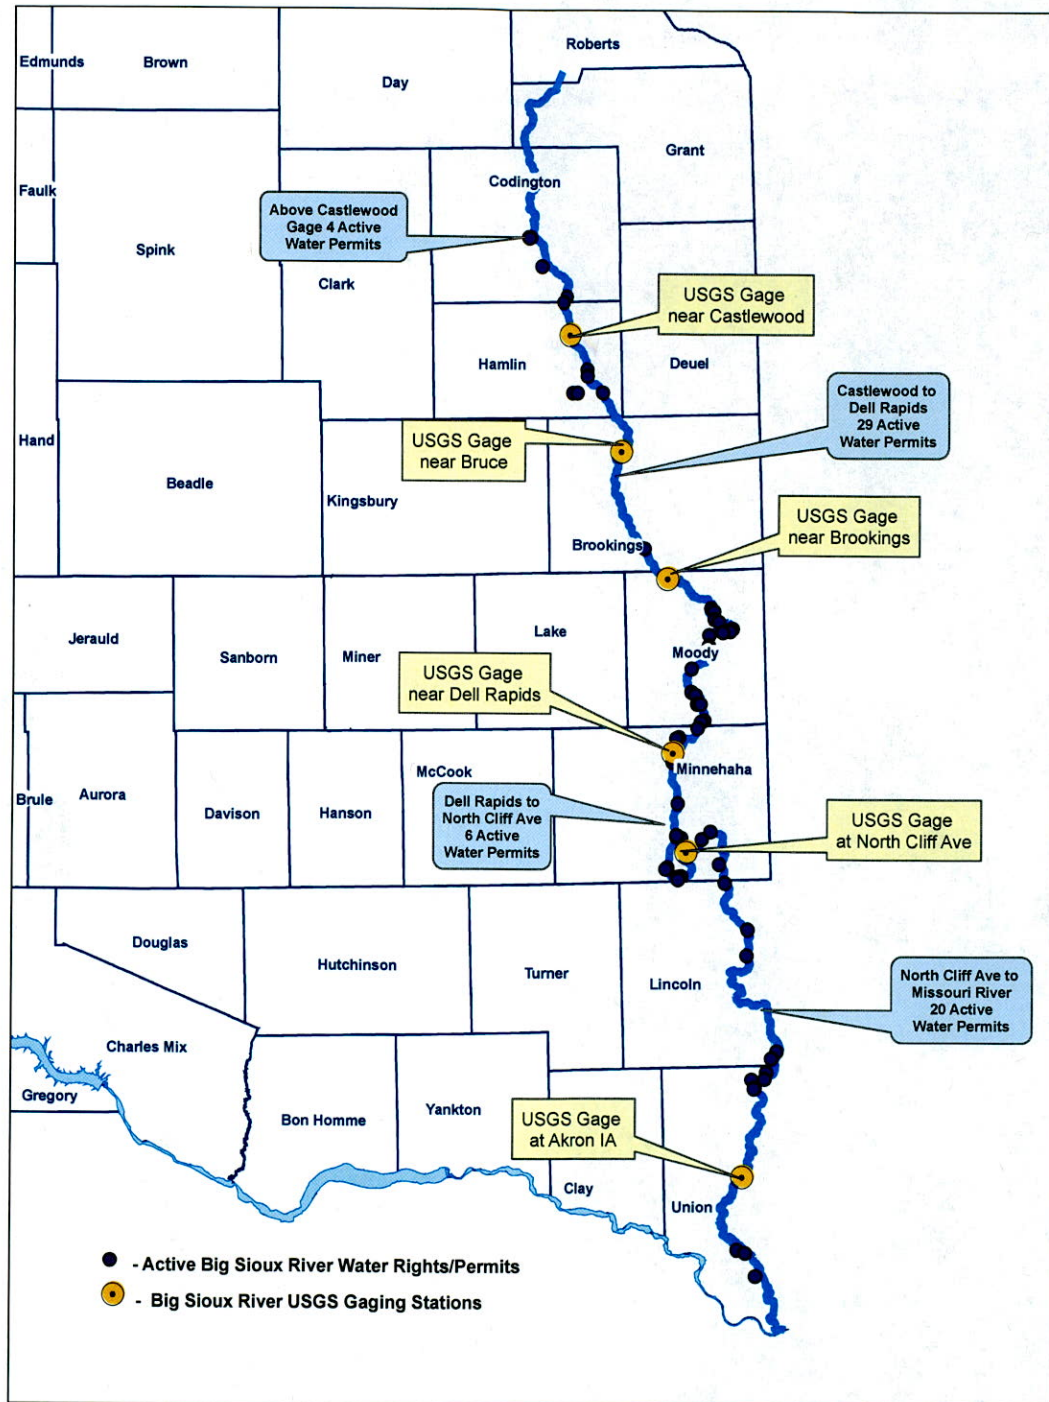


Figure 1. Area map of the Big Sioux River showing the locations of the active water rights/permits and USGS Big Sioux River stream flow gaging stations (Water Rights, 2018 and USGS, 2018).

It is proposed that the existing bypass qualifications for each of the active water permits be reviewed, taking into account the amount of bypass required, the presence of existing rights, the location of the diversions points, and the historical river flow conditions along the various reaches of the river. This review will determine if it is justified to recommend modifications of the existing bypass qualifications.

Authority

SDCL 46-1-14 gives the Water Management Board the authority to amend water right permits. Water permits issued by the board may be amended by the board with priority retained upon amendment. The board may alter terms, conditions, restrictions, qualifications or quantifications.

South Dakota Codified Law

46-1-14. Terms and conditions of permits and licenses--Amendment. The Water Management Board may issue any permit or license subject to terms, conditions, restrictions, qualifications, quantifications, or limitations on perpetuity consistent with this chapter which it considers necessary to protect the public interest and which are related to matters within the jurisdiction of the board. Water rights issued pursuant to this section may be amended by the board and priority is retained upon amendment. Upon amendment the board may alter terms, conditions, restrictions, qualifications, or quantifications consistent with this chapter.

46-2-3.1. Delegation of authority to chief engineer--Restrictions. The Water Management Board may delegate to the chief engineer authority to act on its behalf concerning the quasi-judicial functions of interpreting, applying, and enforcing existing rules and laws and ordering action or abatement of action. The board may not delegate any other quasi-judicial functions as defined in § 1-32-1, except as otherwise provided by law. The board may promulgate rules pursuant to chapter 1-26 to delegate to the chief engineer the authority to issue permits pursuant to § 46-1-14.

46-2-17. Chief engineer's general enforcement authority. The chief engineer may:

- 1) Investigate the use of the waters of the state and compliance with the provisions of water permits, licenses, rules, regulations, and laws relating to water rights;
- 2) Institute enforcement and other proceedings before the Water Management Board;
- 3) Enforce orders of the board; and
- 4) Perform other acts authorized by statute or regulation.

46-2-18. Chief engineer's authority to order discontinuance of water use. The provisions of chapter 1-26 notwithstanding, the chief engineer may, after appropriate investigation, issue an order to any person to shut off or limit the person's use of surface or groundwater, or to plug or otherwise control a well. The order may be issued only to protect another user who has higher or earlier priority or to cause a user of water to discontinue the use of water to which the user has no legal right. Upon a refusal to obey the order, the chief engineer may request a court of proper jurisdiction to issue a temporary restraining order or injunction to effectuate the provisions of the order.

The 21 remaining active water permits authorized to divert water from the Big Sioux River having bypass requirements are subject to SDCL 46-2-3.1, 46-2-17, and 46-2-18, as are all water permits. These statutes give the Chief Engineer the ability to issue written orders within the context of authority granted under the statutes. The remaining 37 active water permits without any bypass requirements authorized to use Big Sioux River water either have priority dates senior to 1960 or are located in the river reach between the North Cliff Avenue gage and the confluence with the Missouri River. There is no intent with this effort to place bypass qualifications on these 37 water permits that do not currently have bypass qualifications.

Evaluation of the Existing Flow Bypass Qualifications and River Reach

The active Big Sioux water permits containing bypass qualifications vary on where the flow bypass is to be measured. The ones with earlier priority dates require a minimum flow past the diversion point. Because it is

impractical for the water user to measure flow at their pump site the more recently issued permits contained bypass qualifications referenced to a nearby United States Geological Survey (USGS) stream flow gaging stations.

In the section of river from southern Codington County to a point where the Big Sioux River crosses North Cliff Avenue in eastern Sioux Falls, three of the USGS gaging stations allowing access to real-time stream flow information have been used as measuring points for bypass limits from the river. See Table 1 (USGS, 2018).

Station Number	Station Name	Years Operated
06479525	Big Sioux River near Castlewood SD	1977-2017
06481000	Big Sioux River near Dell Rapids SD	1949- 2017
06482020	Big Sioux River at North Cliff Ave at Sioux Falls SD	1972- 2017

Table 1. USGS Big Sioux River stream flow gaging stations located near Castlewood, near Dell Rapids and at North Cliff Avenue in Sioux Falls SD (USGS, 2018).

The USGS has collected daily flow data at these gaging stations over several years. The USGS maintains an archive of historical flow and statistical flow data for these gaging stations that can be accessed by the public. A major concern in setting bypass qualifications is to identify the times when the river is experiencing lower flows and also to identify when those lower flows occurred. A review will focus on events when a particular stream segment experiences the lower half of the daily flow. Median, otherwise referred to as 50 percentile (50%), is used to help understand the central tendency of a set of statistical results with the lower half of measured daily flow values being at or less than the 50% value. Based on the period of record for each gage site, the daily flow value or less would be expected to occur on average 10 out of 20 years. At the 25 percentile (25%) flow value, the daily flow would be expected to be at or below that value an average of 5 out of 20 years. At the 10 percentile (10%) flow value, the daily flow would be expected to be at or below that value an average of 2 out of 20 years, (USGS, 2018).

Analysis and Proposed Qualification Revisions

A fresh look was taken of the original bypass requirements to determine whether the original bypass levels would be effective limits for the existing active water rights. The review took into consideration the existing water rights, the qualifications, the authorized use, the location of the diversion points, the annual period of use, and historic stream flow data.

Based upon this review, the river was broken into four separate bypass management reaches. The upper most reach is from the headwaters down to the Castlewood gage. The next reach is from the Castlewood gage to the Dell Rapids gage. The third reach is from the Castlewood gage to the North Cliff Avenue gage at Sioux Falls, and the final reach is from the North Cliff Avenue gage to the confluence with the Missouri River at North Sioux City.

The bypass qualifications originally adopted in the 1960's by the Water Resources Commission of 5 cfs for the reach north of Castlewood and 20 cfs for the reach between Castlewood to Dell Rapids were based on Water Rights staff recommendations. The recommendations were based on water use and flow history for each of those reaches. The 20 cfs bypass requirement for the river reach between Dell Rapids and Sioux Falls was first placed on a water permit in 1989 by the Water Management Board, a successor to the Water Resources Commission, following a low flow analysis by Water Rights staff for the Big Sioux River in that reach (Water Rights, 2018).

Of the 21 existing water permits containing some sort of flow bypass qualification all but two are for irrigation use. The two permits not for irrigation are for municipal use and are held by the City of Sioux Falls. Since most of the water permits having bypass qualifications were issued for irrigation, the following discussion

references a typical crop irrigation season of May 1 to October 15. The analysis focused on the typical irrigation season because this is characteristically when water management actions, such as issuing of shutoff orders by the Chief Engineer, would occur.

The irrigation season for grasses, as would be grown on golf courses and parks, may extend outside the typical irrigation season and run from the early April through late October. Of the four existing water permits for irrigation one is for a golf course at Dell Rapids and three are for irrigating golf courses and soccer fields in Sioux Falls (Water Rights, 2018).

Headwaters to Castlewood Reach

On the upper Big Sioux River there are four existing water permits, two are for storage in lakes Pelican and Kampeska and the other two are for irrigation. The two irrigation water permits containing a bypass qualification both are located approximately five miles upstream from the USGS stream gaging station near Castlewood. The total current authorized diversion rate for this reach is 4.26 cfs. Figure 2 shows the total annual appropriated volume and reported usage volume for the years 1983 to 2016 (Water Rights, 2018).

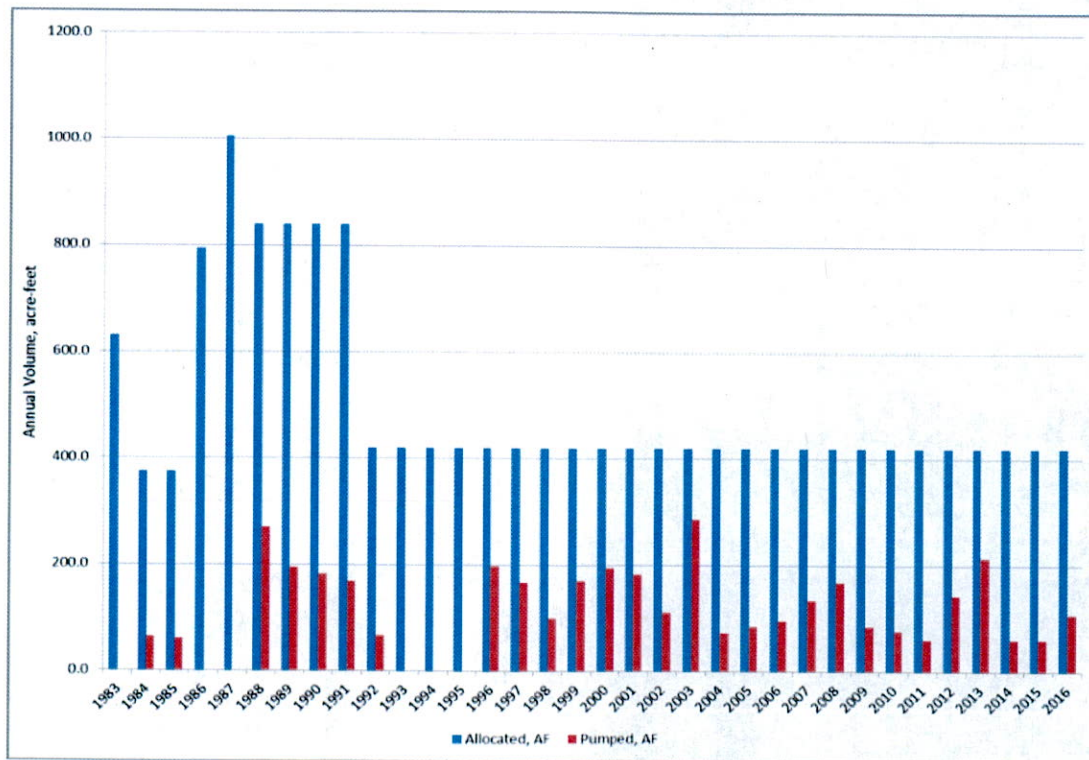


Figure 2. Total irrigation allocation and reported use from the Big Sioux River for the river reach upstream from the USGS gaging station near Castlewood (Water Rights, 2018).

On November 8, 1967, the Water Resources Commission set the initial bypass limit of 5 cfs on a water permit located in the upper river reach north of the Castlewood gage. The application for this water permit had been opposed at a previous meeting so the Commission deferred action and directed staff to investigate. At that time, staff determined excess water was available most years May through July, sometimes available in August and seldom available in September and October. In 2012, a permit was issued in this reach with a 35 cfs bypass qualification. This bypass requirement was the same one

previously placed on a downstream senior priority water permit located in the Castlewood to Dell Rapids reach (Water Rights, 2018).

Figure 3, is a hydrograph for the Castlewood gage showing the 50, 25 and 10 percentile daily flows for the 41 year period of record, 1977 to 2017. In Figure 3, the 10 percentile curve is above the 5 cfs line from the beginning of the irrigation season until the last 10 days of July. The 25 percentile curve is greater than 5 cfs throughout the irrigation season.

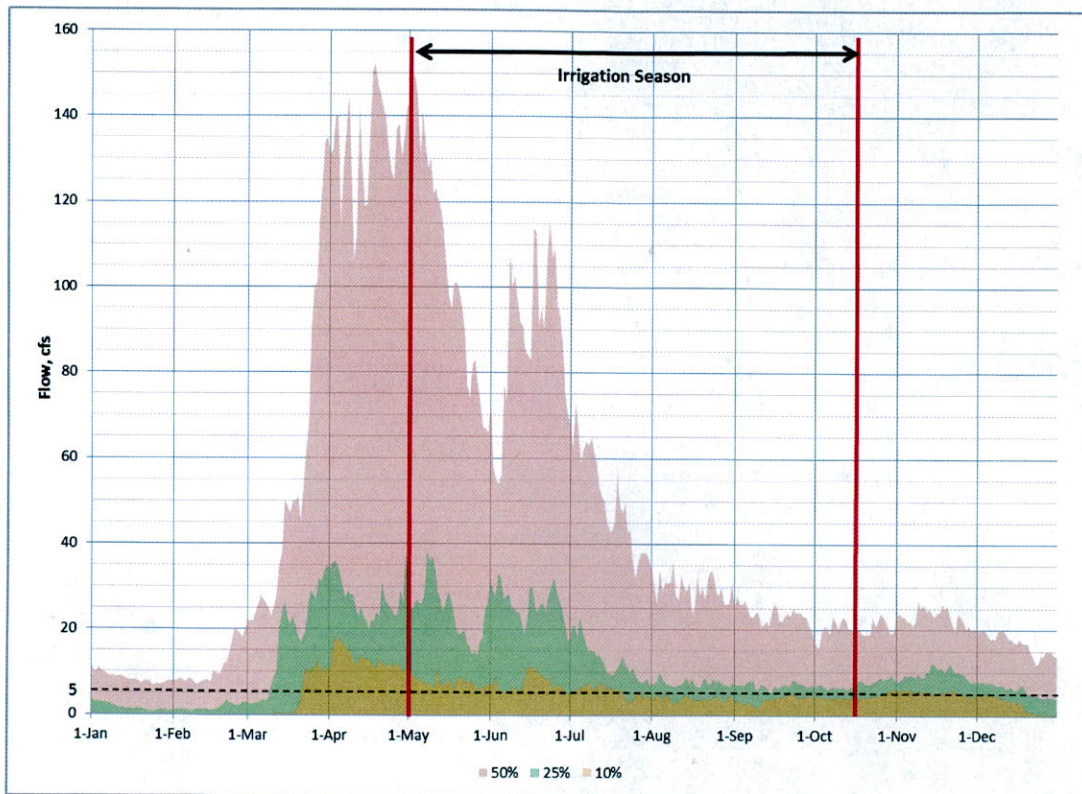


Figure 3. Daily percentile flow hydrographs for the USGS Big Sioux River near Castlewood 1977-2017, contributing drainage area 579 mi² (USGS, 2018).

The frequency of low flow events in the upper most river reach was examined by considering how many actual days the average daily flow was less than 5 cfs during the typical irrigation season of May through mid-October over the 41 year period of record. During that time frame 9.2% of the days that had flow less than 5 cfs fell within the May to mid-October irrigation season (USGS, 2018).

Figure 4 shows for the period of record at the Castlewood gage, the total number of days each year the average daily flow in the Big Sioux River was less than 5 cfs. This figure indicates this reach experiences dry climatic conditions causing several day periods of low flow less than 5cfs. The figure also shows there are many more years when the 5 cfs threshold is not met.

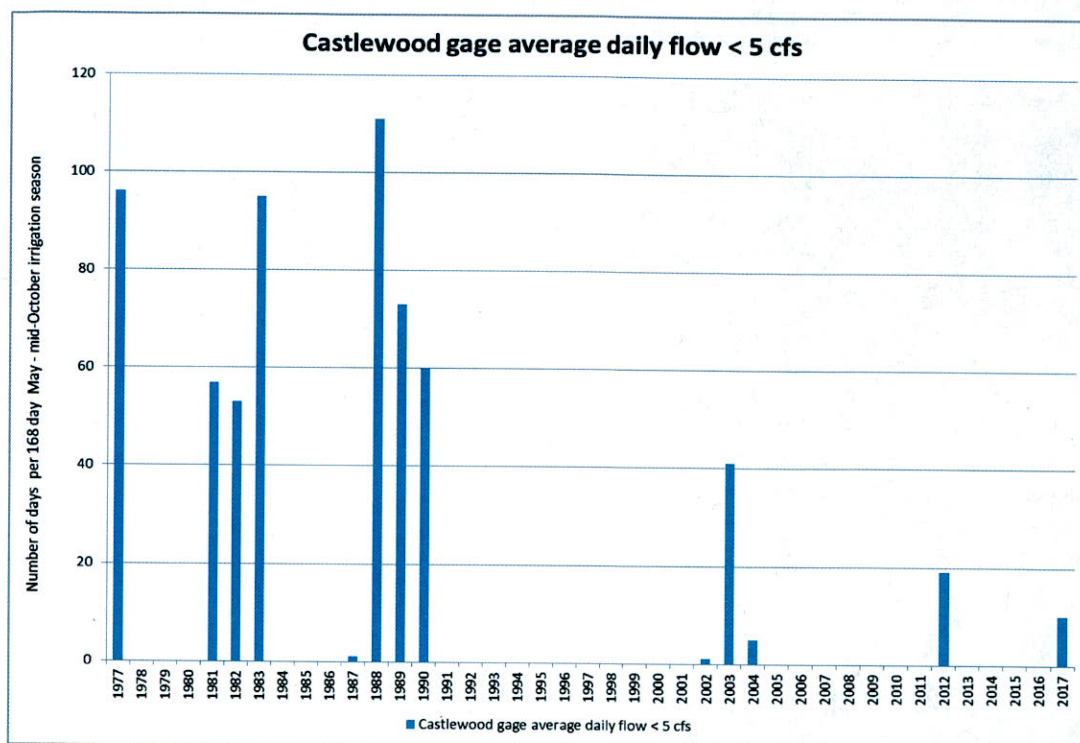


Figure 4. Total number of days for each year during the period of record the average daily flow in the Big Sioux River measured at the USGS gaging station near Castlewood was less than 5 cfs (USGS, 2018).

In this reach it is proposed for both of the existing irrigation water permits, the existing bypass qualification be amended to:

- Low flows as needed for downstream domestic use including livestock water and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, when pumping, unless at least 5 cfs is flowing past the USGS Gaging Station No. 06479525 near Castlewood, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.

Castlewood to Dell Rapids Reach

The river reach between the Castlewood gage and the Dell Rapids gage contains 29 active water permits. One of existing water permits is for flood flow diversion, two are for storage in Poinsett and Dry lakes and two water permits are for instream storage in Flandreau Dam and Dell Rapids Dam. The remaining 24 existing water permits are for irrigation, with 14 water permits containing bypass qualifications. The total current authorized diversion rate for this reach is 31.86 cfs. Figure 5 shows the total annual appropriated volume and reported usage volume for the years 1983 to 2016 (Water Rights, 2018).

In this Big Sioux River reach the original 20 cfs bypass requirement was placed on Big Sioux River water permits in April of 1960 by the Water Resources Commission based upon Water Rights staff review and recommendation to set bypass levels on permits. The bypass requirement was raised in 1966 to 30 cfs and was incrementally increased to 50 cfs by 1976. As stated earlier, many of these water permits have subsequently been cancelled due to abandonment or forfeiture (Water Rights, 2018).

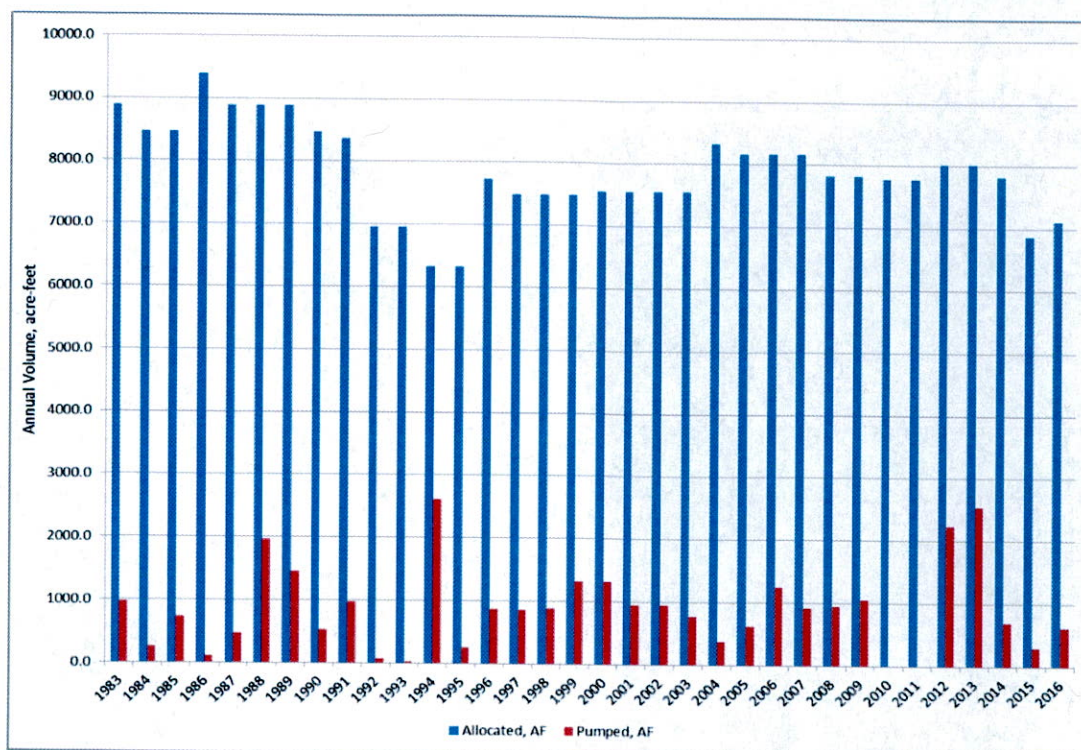


Figure 5. Total irrigation allocation and reported use from the Big Sioux River for the river reach between the USGS gaging stations near Castlewood to the gaging station near Dell Rapids (Water Rights, 2018).

The current bypass limits on existing water permits in this reach range from 20 cfs to 50 cfs with some of the limits set at the diversion point and some measured at the Dell Rapids gage. Using the original 20 cfs bypass as the benchmark, this bypass level was compared to the historic flow record for the Dell Rapids gage. Figure 6 shows the daily percentile flow hydrographs for a 68 year period of record dating back to 1948 for the USGS stream gaging station near Dell Rapids. The 10 percentile curve is above 20 cfs value from the beginning of the irrigation season until the last ten days of August (USGS, 2018).

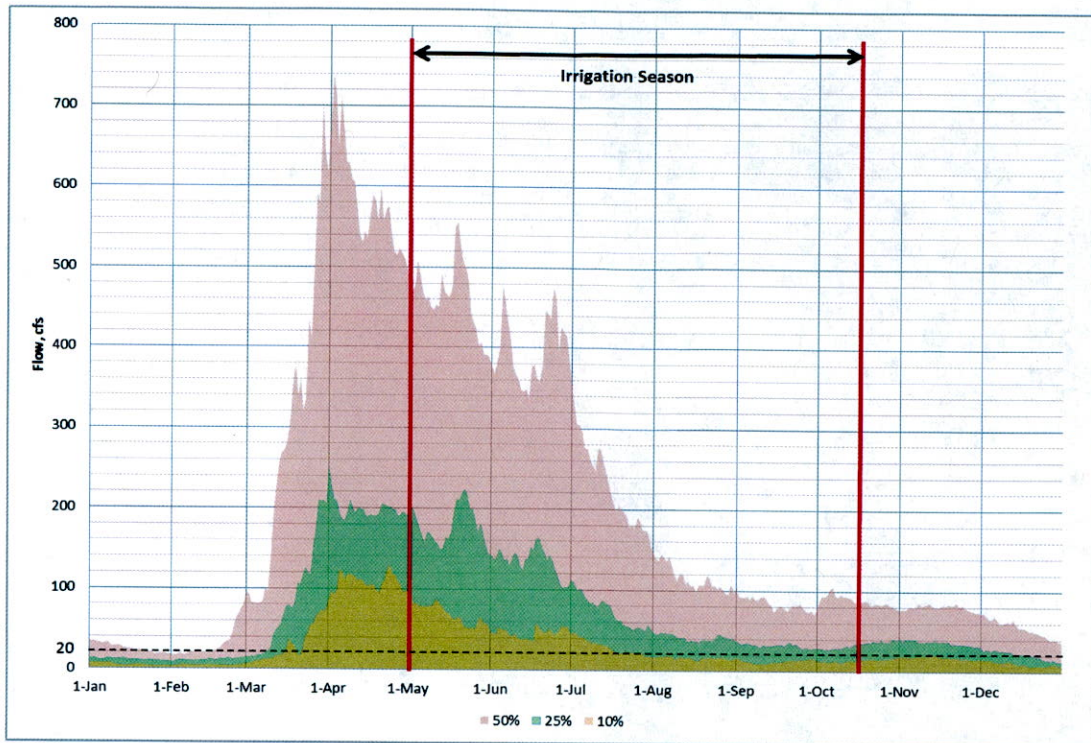


Figure 6. Daily percentile flow hydrographs for the USGS Big Sioux River gage near Dell Rapids 1949-2017, contributing drainage area 3057 mi² (USGS, 2018).

The frequency of low flow events in this reach was examined by considering how many actual days the average daily flow was less than 20 cfs during the typical irrigation season of May through mid-October over the 69 year period of record. During that time frame 7.2% of the days had flow less than 20 cfs within May to mid-October irrigation season (USGS, 2018).

Figure 7 shows for period of record at the Dell Rapids gage the total number of days for each year the average daily flow in the Big Sioux River was less than 20 cfs. Similar to what is seen in the upstream reach, this reach also experiences dry climatic conditions causing several days of low flow less than 20 cfs. The figure also shows there are many more years when the 20 cfs threshold is exceeded.

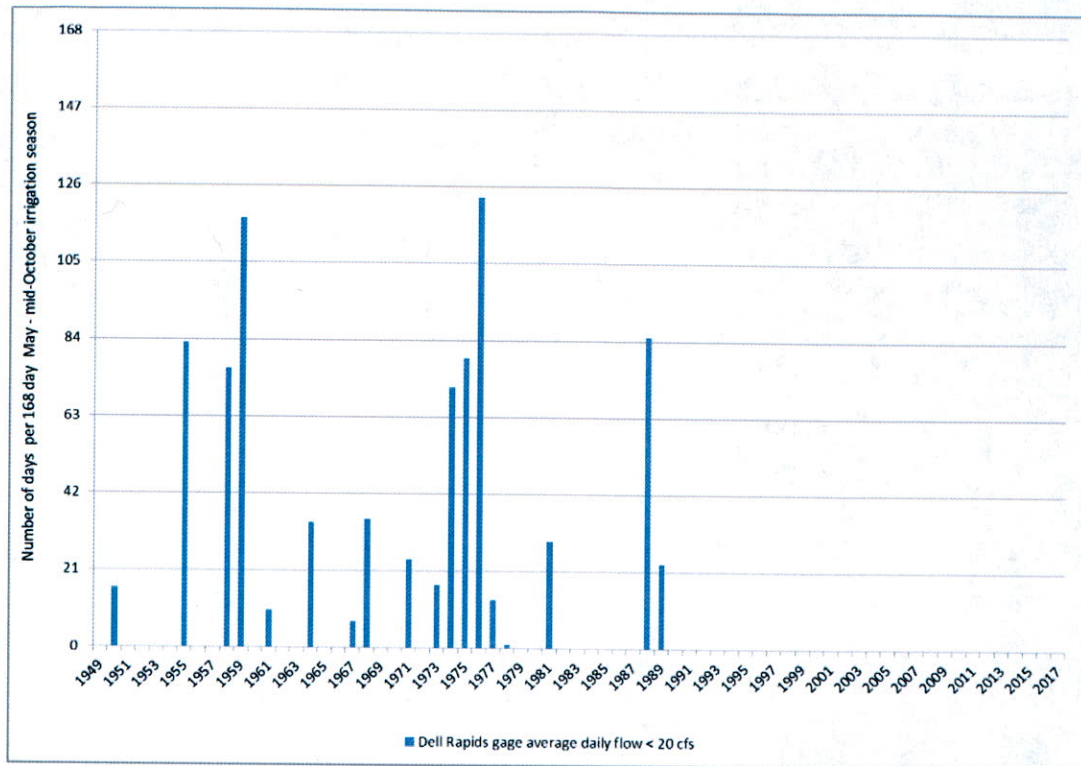


Figure 7. Total number of days for each year during the period of record the average daily flow in the Big Sioux River measured at the USGS gaging station near Dell Rapids was less than 20 cfs (USGS, 2018).

In this reach it is proposed for the 14 existing irrigation water permits the existing bypass qualification be amended to:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.

Dell Rapids to North Cliff Avenue at Sioux Falls Reach

In the river reach between the Dell Rapids gage and the North Cliff Avenue at Sioux Falls gage there are six existing water permits. The total current authorized diversion rate for this reach is 87.33 cfs. One right is for instream storage at Baltic Dam, two of the existing rights are for municipal use, and three are for irrigation. The bypass requirement for five existing rights with qualifications is 20 cfs. Three of the water permits require 20 cfs bypassing the diversion point and two requiring measurement of the flow bypass at the North Cliff Avenue gage. It should also be noted the City of Sioux Falls holds two future use permits located in this reach reserving up to 30,000 acre-feet from the Big Sioux River. The Water Management Board did a seven year status review of these permits in July of 2016. The Board ruled to allow these future use permits to remain in effect for the full 30,000 acre-feet for an additional seven years. Figure 8 shows the total annual appropriated volume and reported irrigation usage volume for the years 1983 to 2016, and Figure 9 shows the total annual appropriated volume and reported municipal usage volume for the years 1983 to 2016 in this reach (Water Rights, 2018).

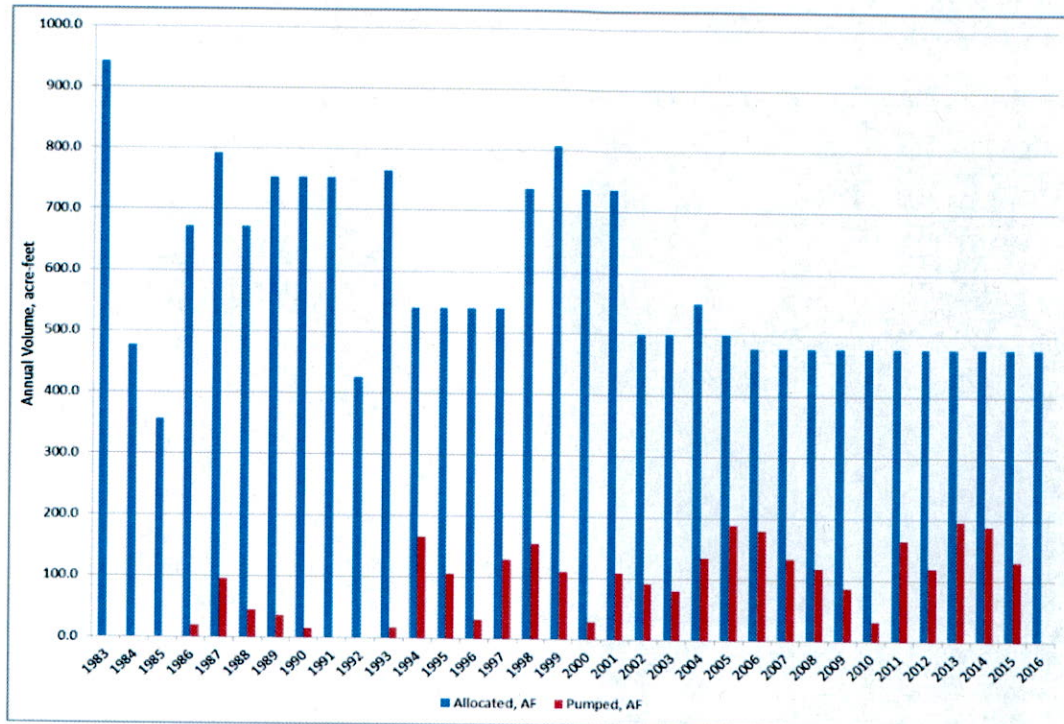


Figure 8. Total irrigation allocation and reported use from the Big Sioux River for the river reach between the USGS gaging stations near Dell Rapids to the gaging station at North Cliff Avenue at Sioux Falls (Water Rights, 2018).

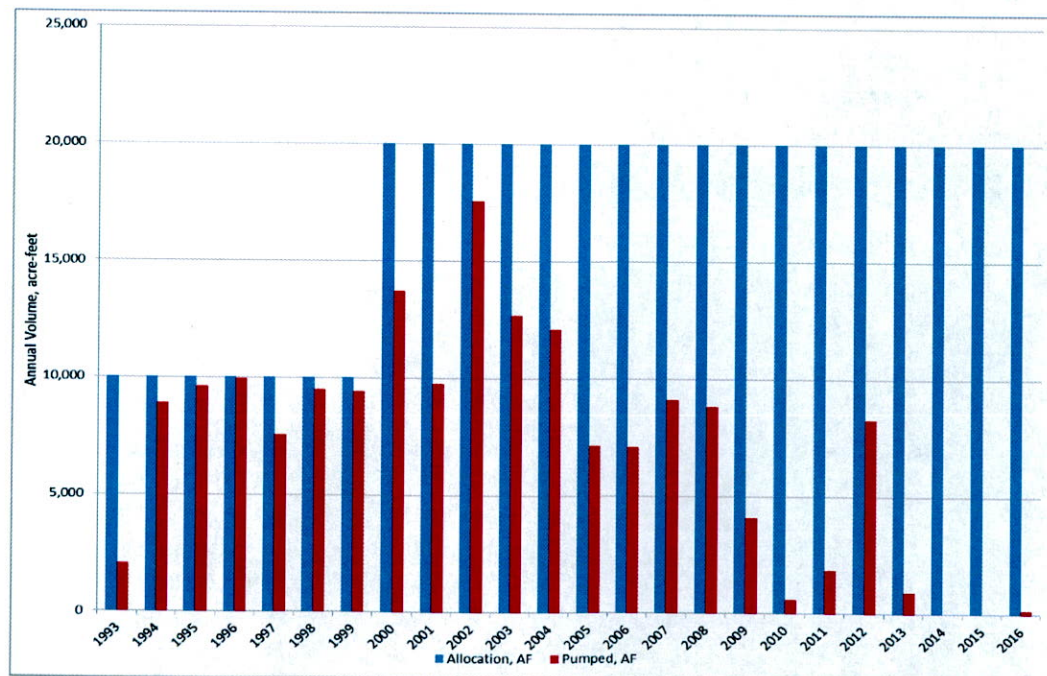


Figure 9. Total municipal allocation and reported use from the Big Sioux River for the river reach between the USGS gaging stations near Dell Rapids to the gaging station at North Cliff Avenue at Sioux Falls (Water Rights, 2018).

Figure 10 shows the daily percentile flow hydrographs for a 45 year period of record dating back to 1971 for the USGS stream gaging station at North Cliff Avenue at Sioux Falls. The 10 percentile curve is above 20 cfs value from the beginning of the irrigation season until the curve drops slightly below 20 cfs line for a few days the first part of September before rising above 20 cfs for the remainder of the irrigation season (USGS, 2018).

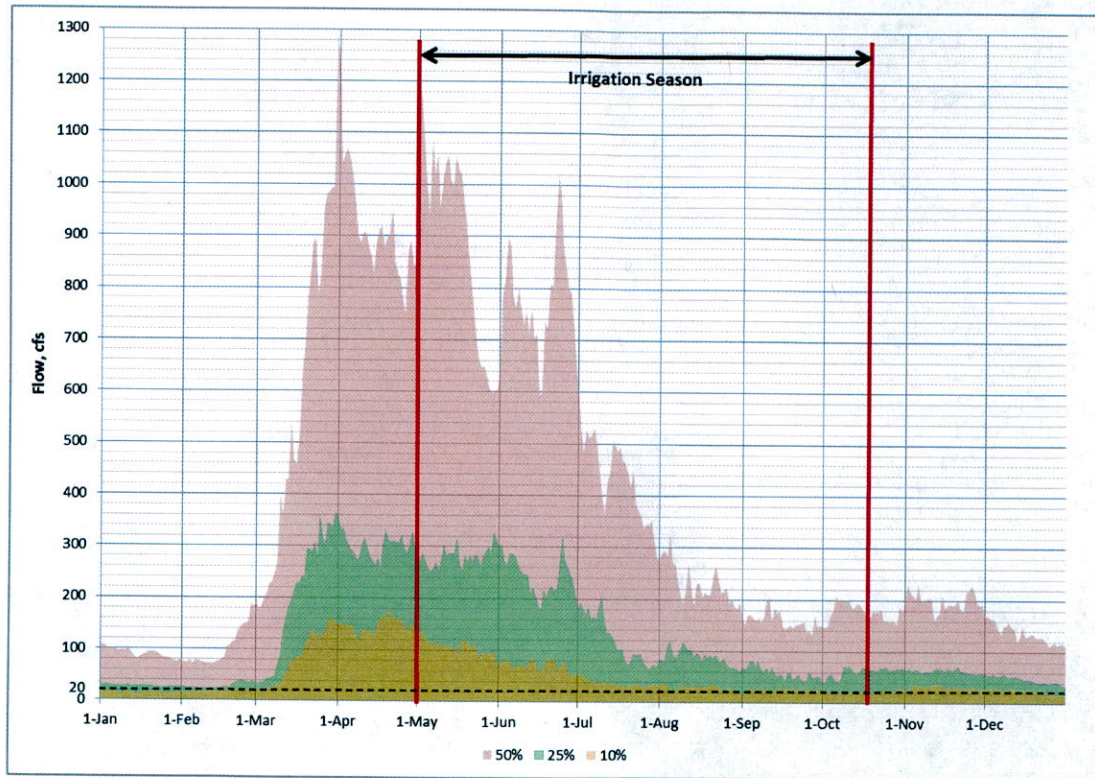


Figure 10. Daily percentile flow hydrographs for the USGS Big Sioux River gage at North Cliff Ave at Sioux Falls 1971-2017, contributing drainage area 3778 mi² (USGS, 2018).

The frequency of low flow events in this reach was examined by considering how many actual days the average daily flow was less than 20 cfs during the typical irrigation season of May through mid-October over the 45 year period of record. During that time frame 2.6% of the days had flow less than 20 cfs fell within May to mid-October irrigation season (USGS, 2018).

Figure 11 shows for period of record at the North Cliff Avenue gage the total number of days for each year the average daily flow in the Big Sioux River was less than 20 cfs. Similar to what was experienced in the upstream reaches, this reach can also experience during dry climatic conditions causing several day periods of low flow less than 20 cfs. The figure also shows there are many more years when the 20 cfs threshold is exceeded.

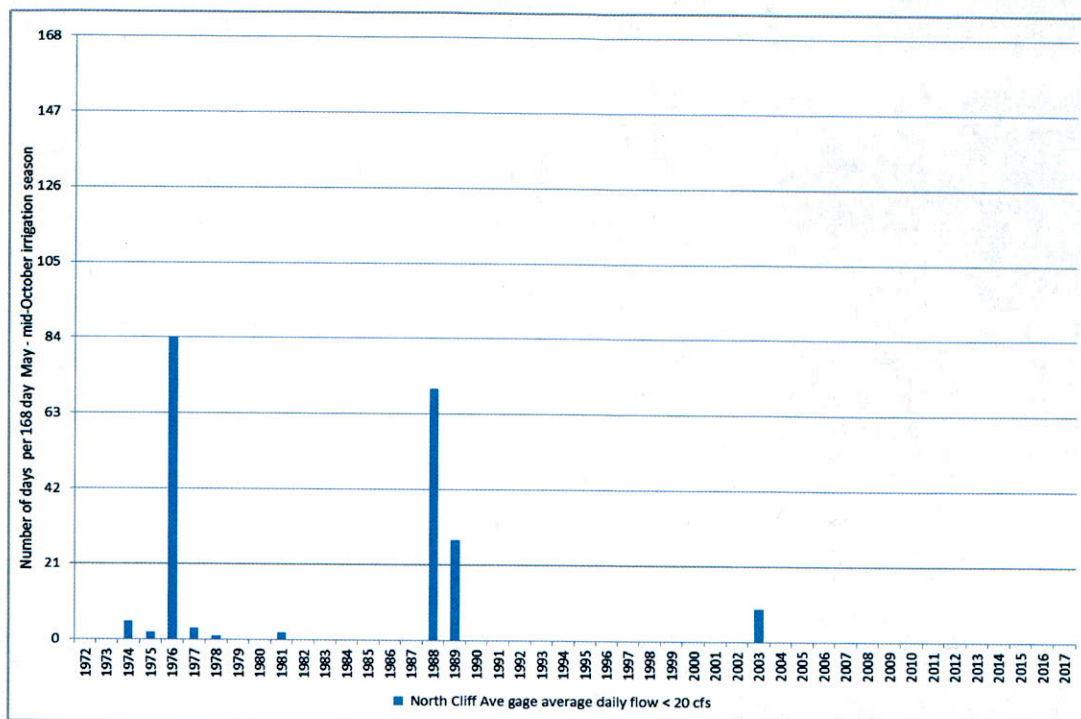


Figure 11. Total number of days for each year during the period of record the average daily flow in the Big Sioux River measured at the USGS gaging station at North Cliff Avenue at Sioux Falls was less than 20 cfs (USGS, 2018).

The five existing water permits in this Big Sioux River reach all contain a 20 cfs bypass requirement. The earlier issued water permits required 20 cfs bypassed at the diversion point while the later issued ones required a 20 cfs bypass at the USGS gaging station at North Cliff Avenue in Sioux Falls (Water Rights, 2018). In this reach it is proposed the existing bypass qualification on these five permits retain the 20 cfs bypass requirement but the qualification be amended to:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06482020 at North Cliff Avenue when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.

North Cliff Avenue at Sioux Falls to the Missouri River Confluence Reach

The southern reach of the Big Sioux River from the North Cliff Gage to the confluence with the Missouri River in southern Union County does not have any active water permits having bypass qualifications. As shown in Figure 12, the 10 percentile curve is above 50 cfs value throughout the entire irrigation season. This reach has not historically experienced a water shortage, and the Chief Engineer has not had to issue shutoff orders for any of the existing water permits located in this reach. There is not a proposal to amend any of the existing water permits in this lower reach of the Big Sioux River (USGS, 2018).

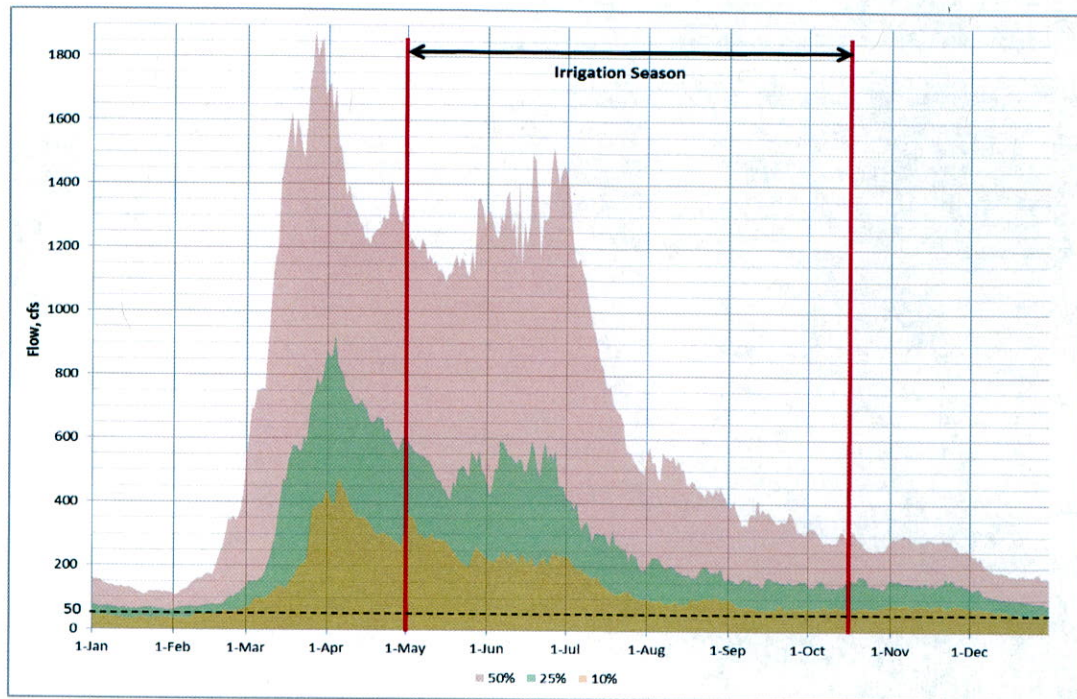


Figure 12. Daily percentile flow hydrographs for the USGS Big Sioux River gage at Akron IA 1971-2017, contributing drainage area 6995 mi² (USGS, 2018).

Considering Future Water Use

Anticipating future water demands from the Big Sioux River and climatic conditions may change over time. Particularly with the City of Sioux Falls holding two future use permits bearing a 1977 priority date reserving up to 30,000 acre-feet of water. It is proposed the following qualification be placed on all of the water permits being amended:

- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

The existing water permits without bypass qualifications and not targeted to be amended by this effort, will continue to be managed based upon their individual priority dates and location along the river.

Specific Proposed Qualification Revisions by Water Permit

In order to standardize the bypass qualifications for the existing water permits containing bypass qualifications in the Big Sioux River reach upstream from the USGS stream gaging station near Castlewood, the following changes are proposed.

Amendment to the qualifications contained in Water Right No. 1437-3

Delete Qualification:

- Diversions of water under this permit can only be made when there is flow of 5 or more cubic feet per second of water flowing at the diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, when pumping, unless at least 5 cfs is flowing past the USGS Gaging Station No. 06479525 near Castlewood, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Permit No. 7350-3

Delete Qualification:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, when pumping, unless at least 35 cfs is flowing past the USGS Gaging Station No. 06479525 near Castlewood, unless written orders have been issued by the Chief Engineer.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, when pumping, unless at least 5 cfs is flowing past the USGS Gaging Station No. 06479525 near Castlewood when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

To standardize the bypass qualifications for the 14 existing water rights/permits containing bypass qualifications in the Big Sioux River reach between the USGS stream gaging station near Castlewood downstream to the USGS stream gaging station near Dell Rapids, the following changes are proposed.

Amendment to the qualifications contained in Water Right No. 956-3

Delete Qualification:

- Natural flows in the Big Sioux River are not a dependable source of water during the latter part of the summer. Prior appropriative rights and downstream domestic use must be respected. This Permit is granted allowing withdrawals of water whenever 20 cfs or more is flowing past your diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 1175-3

Delete Qualification:

- Natural flows in the Big Sioux River are not a dependable source of water during the latter part of the summer. Prior appropriative rights and downstream domestic use must be respected. This Permit is granted allowing withdrawals of water whenever 20 cfs or more is flowing past your diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 1302-3

Delete Qualification:

- Natural flows in the Big Sioux River are not a dependable source of water during the latter part of the summer. Prior appropriative rights and downstream domestic use must be respected. This Permit is granted allowing withdrawals of water whenever 20 cfs or more is flowing past your diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 1350-3

Delete Qualification:

- Natural flows in the Big Sioux River are not a dependable source of water during the latter part of the summer. Prior appropriative rights and downstream domestic use must be respected. This Permit is granted allowing withdrawals of water whenever 30 cfs or more is flowing past your diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids

when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.

- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 1500-3

Delete Qualification:

- Natural flows in the Big Sioux River are not a dependable source of water during the latter part of the summer. Prior appropriative rights and downstream domestic use must be respected. This Permit is granted allowing withdrawals of water whenever 30 cfs or more is flowing past your diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 1696-3

Delete Qualification:

- Natural flows in the Sioux River are not a dependable source of water during the latter part of the summer. Prior appropriative rights and downstream domestic use must be respected. This Sioux River portion of this permit is granted allowing withdrawals of water whenever 35 cfs of water or more is flowing past your diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 1801-3

Delete Qualification:

- Natural flows in the Big Sioux River are not a dependable source of water during the latter part of the summer. Prior appropriative rights and downstream domestic use must be respected. This permit is granted allowing withdrawals of water whenever 35 cfs of water or more is flowing past your diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 1812-3**Delete Qualification:**

- Natural flows in the Big Sioux River are not a dependable source of water during the latter part of the summer. Prior appropriative rights and downstream domestic use must be respected. This permit is granted allowing withdrawals of water whenever 35 cfs of water or more is flowing past your diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 2065-3**Delete Qualification:**

- Natural flows in the Big Sioux River are not a dependable source of water during the latter part of the summer. Prior appropriative rights and downstream domestic use must be respected. This permit is approved allowing withdrawals whenever 45 cfs of water or more is flowing past your diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 2952-3**Delete Qualification:**

- Natural flows in the Big Sioux River are not a dependable source of water during the latter part of the summer. Prior appropriative rights and downstream domestic use must be respected. This permit is approved allowing withdrawals whenever 40 cfs of water or more is flowing past your diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 6042-3

Delete Qualification:

- Low flows as needed for downstream domestic use, including livestock water and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River unless at least 41 cfs is flowing past the Dell Rapids USGS Gaging Station, or unless written orders have been issued by the Chief Engineer. Diversions under this Permit are shall be in accordance with any written orders issued by the Chief Engineer.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 6124-3

Delete Qualification:

- Natural flows in the Big Sioux River are not a dependable source of water during the latter part of the summer. Prior appropriative rights and downstream domestic use must be respected. This permit is approved allowing withdrawals whenever 50 cfs of water or more is flowing past your diversion point.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.

- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 7110-3

Delete Qualification:

- Low flows as needed for domestic use, including livestock water and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, when pumping, unless at least 43 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, or unless written orders have been issued by the Chief Engineer. Diversions under this permit are shall be in accordance with any written orders issued by the Chief Engineer.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 8195-3

Delete Qualification:

- Low flows as needed for downstream domestic use, including livestock water and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, when pumping, unless at least 20 cfs is flowing at the North Cliff Avenue USGS Gaging Station No. 06482020 and 43 cfs is flowing at the Dell Rapids USGS Gaging Station No. 06481000, unless written orders have been issued by the Chief Engineer. Diversions under this Permit are shall be in accordance with any written orders issued by the Chief Engineer.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

To standardize the qualifications for the 5 existing water rights/permits containing bypass qualifications in the Big Sioux River reach between the USGS stream gaging station near Dell Rapids downstream to the USGS stream gaging station at North Cliff Avenue at Sioux Falls, the following changes are proposed.

Amendment to the qualifications contained in Water Right No. 5431-3

Delete Qualification:

- Permit No. 5431-3 does not authorize pumping from the Big Sioux River unless at least 20 cfs can be bypassed when pumping.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06482020 at North Cliff Avenue when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 5512-3

Delete Qualification:

- Permit No. 5512-3 does not authorize pumping from the Big Sioux River unless at least 20 cfs is being bypassed when pumping.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06482020 at North Cliff Avenue when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 5698-3

Delete Qualification:

- Permit No. 5698-3 does not authorize pumping from the Big Sioux River unless at least 20 cfs is being bypassed when pumping.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06482020 at North Cliff Avenue when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 6210-3

Delete Qualification:

- Low flows as needed for downstream domestic use, including livestock water and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River,

when pumping, unless at least 20 cfs is flowing at the Cliff Avenue USGS Gaging Station, or unless written orders have been issued by the Chief Engineer.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06482020 at North Cliff Avenue when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Amendment to the qualifications contained in Water Right No. 6210A-3

Delete Qualification:

- Low flows as needed for downstream domestic use, including livestock water and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, when pumping, unless at least 20 cfs is flowing at the North Cliff Avenue USGS Gaging Station No. 06482020, or unless written orders have been issued by the Chief Engineer. Diversions under this Permit are subject to senior water rights and any written orders issued by the Chief Engineer.

Add Qualifications:

- Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06482020 at North Cliff Avenue when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
- The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

Conclusions

1. Currently there are 58 active water permits authorized for the Big Sioux River from the headwaters in Roberts County to the mouth in Union County. Currently 21 of the existing water permits contain some sort of flow bypass qualification.
2. Since many water permits have been cancelled over the years, the system of various bypass requirements on several existing Big Sioux water permits are not putting water to beneficial use to the highest extent possible for the current water permit holders. The system is also difficult to manage for the Water Rights Program.
3. A fresh look was taken of the original bypass requirements to determine whether the original bypass levels would be effective limits for the existing active water rights. The review was completed of the original bypass requirements taking into consideration the existing water rights, the qualifications placed on them, their authorized use, the location of their diversion points, their annual period of use and historic stream flow data.

4. Based upon this review, the river was broken into four separate bypass management reaches and standardized qualifications are proposed for each of these reaches.
5. Anticipating future water demands from the Big Sioux River and climatic conditions may change over time, the amendments to the water permits being amended should also contain a qualification allowing the Water Management Board to retain jurisdiction to address future issues if as necessary.
6. On the reach upstream from the Castlewood gaging station, for the two water permits containing bypass requirements replace those qualifications with:
 - Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, when pumping, unless at least 5 cfs is flowing past the USGS Gaging Station No. 06479525 near Castlewood, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
 - The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.
7. On the reach between the Castlewood gaging station and the Dell Rapids gaging station, for the 14 water permits containing bypass requirements replace those qualifications with:
 - Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
 - The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.
8. On the reach upstream from the Dell Rapids gaging station to the North Cliff Avenue gaging station, for the five water permits containing bypass requirements replace those qualifications with:
 - Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06482020 at North Cliff Avenue when pumping, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.
 - The Water Management Board is retaining jurisdiction of this permit in the event additional information shows that adjustments need to be made to the bypass requirements.

9. The existing water permits without bypass qualifications and not targeted to be amended by this effort, will continue to be managed based upon their individual priority dates and location along the river.



Mark D. Rath
Natural Resources Engineer III

References

- Hoogestraat, G.K. and J. F. Stamm, 2015. Climate and Streamflow Characteristics for Selected Streamgages in Eastern South Dakota, Water Years 1945–2013. USGS Scientific Investigations Report 2015-5146.
- USGS. 2018. United States Geological Survey, National Water Information System – Stream Gaging Station Network for South Dakota.
- Water Rights. 2018. Water Right/Permit Files. SD DENR-Water Rights Program, Joe Foss Bldg., Pierre, South Dakota.

NOTICE OF HEARING ON CHIEF ENGINEER'S RECOMMENDATION FOR BIG SIOUX RIVER WATER RIGHTS

Notice is given that the Water Rights Program, Department of Environment and Natural Resources, 523 E Capitol Avenue, Pierre SD 57501 proposes that the Water Management Board amend conditions placed on many Big Sioux River water rights in South Dakota. The objective is to bring consistency among water rights from the river and the ability for the Chief Engineer to issue written orders to allow pumping to continue if climatic conditions are favorable. The amendments will not increase either the authorized diversion rate or number of irrigated acres authorized under existing Big Sioux River water rights.

Currently, water rights differ in the amount of water that must be bypassed at the pump site or at a United States Geological Survey (USGS) gaging station in order for pumping to occur. The Water Rights Program has reviewed all Big Sioux River water rights and determined that the conditions can be modified to a standard bypass at one of three gaging stations depending on the stream segment where the water right is located. It is proposed that the bypass condition along the river is best managed in three segments identified by USGS gaging stations as follows:

1. River reach upstream from the USGS gaging station near Castlewood;
2. River reach between USGS gaging station near Castlewood downstream to gaging station near Dell Rapids;
3. River reach between USGS gaging station near Dell Rapids downstream to gaging station near North Cliff Avenue in Sioux Falls.

Water rights that currently have a bypass condition will be amended such that those water rights upstream of the Castlewood gaging station will have a 5 cubic feet of water per second (cfs) bypass requirement. Those water rights in the two other reaches described above will have a 20 cfs bypass requirement referenced to either the Dell Rapids or North Cliff Avenue gaging station depending on the location of the water right. Water rights with senior priority dates that do not currently have a bypass requirement will see no change.

The proposed amendment will not impose any conditions more restrictive than the conditions currently in place on any water right. Big Sioux River water right holders whose bypass condition is proposed for amendment will be provided personal notice of the proposed amendment to their water right.

The Chief Engineer recommends that the Water Management Board approve deletion of the existing bypass condition on applicable water rights and add the following qualifications specific to the bypass flow at a referenced gaging station depending on the location of the water right.

1. Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This water right does not authorize diversion of water from the Big Sioux River, when pumping, unless at least "X" cfs is flowing past the USGS Gaging Station "IDENTIFY APPLICABLE STATION" unless written orders have been issued by the Chief Engineer. Diversions under this water right shall be in accordance with any written orders issued by the Chief Engineer.
2. The Water Management Board is retaining jurisdiction of this water right in the event additional information shows that adjustments need to be made to the bypass requirements.

Any interested person opposing or supporting the proposed amendment and intending to participate in the hearing shall file a petition with the Chief Engineer. The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)". A petition filed by either an interested person or a water right holder must be filed by February 26, 2018.

The petition may be informal, but shall be in writing and shall include a statement describing the petitioner's interest, the petitioner's reasons for opposing or supporting the proposed change, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained. The hearing is an adversary proceeding and any party has the right to be present at the hearing and to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing and decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law.

The staff report including affected water rights and the proposed changes is available at <http://denr.sd.gov/public> or contact Eric Gronlund for this information, or other information, at the Water Rights Program address provided above.

The Water Management Board will consider the proposed changes at 11:30 a.m. on March 7, 2018, in the Matthew Training Center, Joe Foss Bldg, 523 E. Capitol Ave. Pierre SD. The hearing will be held pursuant to the provisions of SDCL 46-1-14 and 46-2-17.

The Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) modify, 3) defer, or 4) deny the proposed amendments after it reaches a conclusion based on facts at the public hearing. The Board has legal authority and jurisdiction to consider this matter pursuant to SDCL 46-2-9 and 46-2-11.

The March 7, 2018 hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from any person who has filed a petition to oppose or support the proposed change. The request for an automatic delay must be filed by February 26, 2018. If an automatic delay is requested, the hearing will be rescheduled for a future Board meeting and personal notice will be provided to all petitioners regarding the time, date and location.

Notice is given to individuals with disabilities that this hearing is being held in a physically accessible place. Please notify the Department of Environment and Natural Resources at least 48 hours before the hearing if you have a disability for which special arrangements must be made at the hearing. The telephone number for making arrangements is (605) 773-3352.

Under SDCL 1-26-18.3, in any contested case, if the amount in controversy exceeds \$2,500.00 "or if a property right may be terminated, any party to the contested case may require the agency to use the Office of Hearing Examiners by giving notice of the request to the agency no later than ten days after service of a notice of hearing issued pursuant to SDCL 1-26-17." If you choose to use the Office of Hearing Examiners rather than the hearing procedure before the Water Management Board set forth above, you need to notify the Chief Engineer (Water Rights Program, 523 E Capitol Avenue, Pierre SD) by February 26, 2018.

Steven M. Pirner, Secretary, Department of Environment and Natural Resources. Published once at an approximate cost of_____.

Schlaak, Karen

From: Schlaak, Karen
Sent: Friday, February 09, 2018 8:36 AM
To: allegals@argusleader.com
Subject: Notice of Hearing - Big Sioux River Water Rights
Attachments: BigSiouxWRqualif.wmb.docx; FORM8.FRM.doc

Attached is a notice to be published on February 15, 2018.

The Water Rights Program will pay for this publication.

Please send the affidavit or return the attached Proof of Publication form and the invoice as soon as possible to the Water Rights Program, 523 E Capitol, Pierre SD 57501.

Let me know if you have questions. Please acknowledge receipt of this email.

Karen Schlaak
SD DENR, Water Rights Program
(605) 773-3352



Schlaak, Karen

From: Schlaak, Karen
Sent: Friday, February 09, 2018 8:37 AM
To: mce6@mcisweb.com
Subject: Notice of Hearing - Big Sioux River Water Rights
Attachments: BigSiouxWRqualif.wmb.docx; FORM8.FRM.doc

Attached is a notice to be published on February 14, 2018.

The Water Rights Program will pay for this publication.

Please send the affidavit or return the attached Proof of Publication form and the invoice as soon as possible to the Water Rights Program, 523 E Capitol, Pierre SD 57501.

Let me know if you have questions. Please acknowledge receipt of this email.

Karen Schlaak
SD DENR, Water Rights Program
(605) 773-3352



Schlaak, Karen

From: Schlaak, Karen
Sent: Friday, February 09, 2018 8:35 AM
To: svn@siouxvalleynewsonline.com
Subject: Notice of Hearing - Big Sioux River Water Rights
Attachments: BigSiouxWRqualif.wmb.docx; FORM8.FRM.doc

Attached is a notice to be published on February 15, 2018.

The Water Rights Program will pay for this publication.

Please send the affidavit or return the attached Proof of Publication form and the invoice as soon as possible to the Water Rights Program, 523 E Capitol, Pierre SD 57501.

Let me know if you have questions. Please acknowledge receipt of this email.

Karen Schlaak
SD DENR, Water Rights Program
(605) 773-3352



Schlaak, Karen

From: Schlaak, Karen
Sent: Friday, February 09, 2018 8:34 AM
To: Hamlin County Publishing (hcp@itctel.com)
Subject: Notice of Hearing - Big Sioux River Water Rights
Attachments: BigSiouxWRqualif.wmb.docx; FORM8.FRM.doc

Attached is a notice to be published on February 14, 2018 in the Hamlin County Republican, Castlewood SD.

The Water Rights Program will pay for this publication.

Please send the affidavit or return the attached Proof of Publication form and the invoice as soon as possible to the Water Rights Program, 523 E Capitol, Pierre SD 57501.

Let me know if you have questions. Please acknowledge receipt of this email.

Karen Schlaak
SD DENR, Water Rights Program
(605) 773-3352



Schlaak, Karen

From: Schlaak, Karen
Sent: Friday, February 09, 2018 8:32 AM
To: legals@thepublicopinion.com
Subject: Notice of Hearing - Big Sioux River Water Rights
Attachments: BigSiouxWRqualif.wmb.docx; FORM8.FRM.doc

Attached is a notice to be published on February 15, 2018.

The Water Rights Program will pay for this publication.

Please send the affidavit or return the attached Proof of Publication form and the invoice as soon as possible to the Water Rights Program, 523 E Capitol, Pierre SD 57501.

Let me know if you have questions. Please acknowledge receipt of this email.

Karen Schlaak
SD DENR, Water Rights Program
(605) 773-3352



Schlaak, Karen

From: Schlaak, Karen
Sent: Friday, February 09, 2018 8:37 AM
To: registerclassifieds (registerclassifieds@brookingsregister.com)
Subject: Notice of Hearing - Big Sioux River Water Rights
Attachments: BigSiouxWRqualif.wmb.docx; FORM8.FRM.doc

Attached is a notice to be published on February 15, 2018.

The Water Rights Program will pay for this publication.

Please send the affidavit or return the attached Proof of Publication form and the invoice as soon as possible to the Water Rights Program, 523 E Capitol, Pierre SD 57501.

Let me know if you have questions. Please acknowledge receipt of this email.

Karen Schlaak
SD DENR, Water Rights Program
(605) 773-3352



Schlaak, Karen

From: Schlaak, Karen
Sent: Friday, February 09, 2018 8:38 AM
To: G5 (leader1@iw.net)
Subject: Notice of Hearing - Big Sioux River Water Rights
Attachments: BigSiouxWRqualif.wmb.docx; FORM8.FRM.doc

Attached is a notice to be published on February 15, 2018.

The Water Rights Program will pay for this publication.

Please send the affidavit or return the attached Proof of Publication form and the invoice as soon as possible to the Water Rights Program, 523 E Capitol, Pierre SD 57501.

Let me know if you have questions. Please acknowledge receipt of this email.

Karen Schlaak
SD DENR, Water Rights Program
(605) 773-3352



CUSTOMER NUMBER:	78306	Argus Leader P.O. Box 677349, Dallas, TX 75267-7349
INVOICE NUMBER:	2727212	
RUN DATES:	2/15, 2018	
		AMOUNT DUE: \$162.36

RECEIVED
FEB 20 2018
WATER RIGHTS PROGRAM

Attn: Karen Schlaak
 Water Rights Program
 523 E. Capital - Jose Foss Building
 Pierre, SD 57501-0000

DETACH THIS STUB AND RETURN WITH PAYMENT

PAYMENT DUE UPON RECEIPT

AFFIDAVIT OF PUBLICATION

Customer Number: 78306
 Invoice Number: 902065

523 E. Capital - Jose Foss Building

Argus Leader

AFFIDAVIT OF PUBLICATION

STATE OF SOUTH DAKOTA

COUNTY OF MINNEHAHA } ss

Sara Kruse being duly sworn, says: That The **Argus Leader** is, and during all the times hereinafter mentioned was, a daily legal newspaper as defined by SDCL 17-2-2.1, as amended published at Sioux Falls, Minnehaha County, South Dakota; that affiant is and during all of said times, was an employee of the publisher of such newspaper and has personal knowledge of the facts stated in this affidavit; that the notice, order or advertisement, a printed copy of which is hereto attached, was published in said newspaper upon

Thursday	the	15	day of	February	2018	,
	the		day of		2018	,
	the		day of		2018	,
	the		day of		2018	,
	the		day of		2018	,
	the		day of		2018	,
	the		day of		2018	,
	the		day of		2018	,

and that \$162.36 was charged for publishing the same


Sara Kruse

Subscribed and sworn to before me 2/15/18

Betty Gates

Notary Public, South Dakota

My Commission expires March 14, 2023

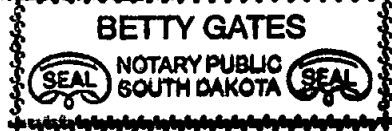

amendments will not increase either the authorized diversion rate or number of irrigated acres authorized under existing Big Sioux River water rights. Currently, water rights differ in the amount of water that must be bypassed at the pump site or at a United States Geological Survey (USGS) gaging station in or near the water right. The Water Rights Program has reviewed all Big Sioux River water rights and determined that the conditions can be modified to a standard bypass of one of three gaging stations depending on the stream segment where the water right is located. It is proposed that the bypass condition along the river is best managed in three segments identified by USGS gaging stations as follows:

1. River reach upstream from the USGS gaging station near Castlewood;
2. River reach between USGS gaging station near Castlewood downstream to gaging station near Dell Rapids;
3. River reach between USGS gaging station near Dell Rapids downstream to gaging station near North Cliff Avenue in Sioux Falls.

Water rights that currently have a bypass condition will be amended such that those water rights upstream of the Castlewood gaging station will have a 5 cubic feet per second (cfs) bypass requirement. Those water rights in the two other reaches described above will have a 20 cfs bypass requirement referenced to either the Dell Rapids or North Cliff Avenue gaging station depending on the location of the water right. Water rights with senior priority dates that do not currently have a bypass requirement will see no change.

The proposed amendment will not impose any conditions more restrictive than the conditions currently in place on any water right. Big Sioux River water right holders whose bypass condition is proposed for amendment will be provided personal notice of the proposed amendment to their water rights in South Dakota. The objective is to bring consistency among the Water Rights Program and the ability for the Chief Engineer to issue written condition orders to allow pumping to continue if climatic conditions are favorable. The referenced gaging station depending on the location of the water right.

1. Low flows as needed for downstream domestic use, including livestock water, and prior rights must be bypassed. This water right does not authorize diversion of water from the Big Sioux River, when pumping, unless at least "X" cfs is flowing past the USGS Gaging Station "IDENTIFY APPLICABLE STATION" unless written orders have been issued by the Chief Engineer.
2. The Water Management Board is retaining jurisdiction of this water right in the event additional information shows that adjustments need to be made to the bypass requirements. Any interested person opposing or supporting the proposed amendment and intending to participate in the hearing shall file a petition with the Chief Engineer. The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E. Capitol, Pierre SD 57501 (605 773-3352)". A petition filed by either an interested person or a water right holder must be filed by February 26, 2018.

The petition may be informal, but shall be in writing and shall include a statement describing the petitioner's interest, the petitioner's reasons for opposing or supporting the proposed change, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if the hearing is an adversary proceeding and any party has the right to be present at the hearing and to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing and decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law.

The staff report including affected water rights and the proposed changes is available at <http://denr.sd.gov/public> or contact Eric Gronlund for this information, or other information, at the Water Rights Program address provided above.

The Board will consider the proposed changes at 11:30 a.m. on March 7, 2018, in the Matthew Training Center, Joe Foss Bldg, 523 E. Capitol Ave, Pierre SD. The hearing will be held pursuant to the provisions of SDCL 46-1-14 and 46-2-17. The Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) modify, 3) defer, or 4) deny the proposed amendments after it reaches a conclusion based on facts at the public hearing. The Board has legal authority and jurisdiction to consider this matter pursuant to SDCL 46-2-9 and 46-2-11.

The March 7, 2018 hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from any person who has filed a petition to oppose or support the proposed change. The request for an automatic delay must be filed by February 26, 2018. If an automatic delay is requested, the hearing will be rescheduled for a future Board meeting. The Chief Engineer's and personal notice will be provided to all petitioners regarding the time, date and location.

Notice is given to individuals with disabilities that this hearing is being held in a physically accessible place. Please notify the Department of Environment and Natural Resources at least 48 hours before the hearing if you have a disability for which special arrangements must be made at the hearing. The telephone number for making arrangements is (605) 773-3352.

Under SDCL 1-26-18.3, in any contested case, if the amount in controversy exceeds \$2,500.00 "or if a party right may be terminated, any party to the contested case may require the agency to use the Office of Hearing Examiners by giving notice of the request to the agency no later than ten days after service of a notice of hearing issued pursuant to SDCL 1-26-17." If you choose to use the Office of Hearing Examiners rather than the hearing procedure before the Water Management Board, you need to notify the Chief Engineer (Water Rights Program, 523 E. Capitol Avenue, Pierre SD) by February 26, 2018.

Steven M. Pirner, Secretary, Department of Environment and Natural Resources. Published once on an approximate cost of \$162.36. Feb 15, 2018

NOTICE OF HEARING ON CHIEF ENGINEER'S RECOMMENDATION FOR BIG SIOUX RIVER WATER RIGHTS

Notice is given that the Water Rights Program, Department of Environment and Natural Resources, 523 Big Sioux River water right E. Capitol Avenue, Pierre SD 57501 proposes that the Water Management Board amend conditions placed on many Big Sioux River water rights in South Dakota. The objective is to bring consistency among the Water Rights Program and the ability for the Chief Engineer to issue written condition orders to allow pumping to continue if climatic conditions are favorable. The

February 20, 2018

PAYMENT REQUEST FORM

PAYEE: Argus Leader
PO Box 677349
Dallas, TX

FROM: DENR Water Rights Program
523 E. Capitol Ave
Pierre, SD 57501-3181

DESCRIPTION OF SERVICE, PRODUCE OR TRANSFER

Affidavit of Publication

AMOUNT: \$162.36

FUNDING SOURCE:


GENERAL: X

FEDERAL:

OTHER:

COMMENTS:

AUTHORIZATION:

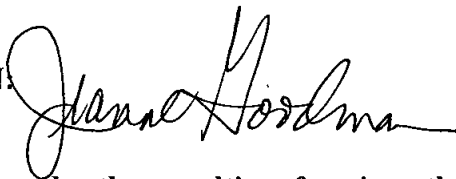

I declare and affirm under the penalties of perjury that this claim is in all things, true and correct. I further agree to comply with the provisions of the Civil Rights Act of 1964 and regulations issued thereunder relating to nondiscrimination in federal assisted programs.

RECEIVED

MAR 07 2018

WATER RIGHTS
PROGRAM

Affidavit of Publication

State of South Dakota

Exhibit "A"

ss

County of Brookings

Katherine Foiles of said county, first duly sworn, on oath, says: That she is the office clerk of THE BROOKINGS REGISTER, a daily newspaper, printed and published in the City of Brookings, in said County of Brookings, and State of South Dakota; that she has full and personal knowledge of the facts herein stated; that said newspaper is a legal newspaper and has a bona fide circulation of at least two hundred copies of each issue daily; that said newspaper has been published within the said County of Brookings and State of South Dakota, for more than one year prior to the first publication of Exhibit "A," hereto attached and herein mentioned, and was and is printed that the


Leg#164 Notice on Hearing

same was published, is hereto attached marked Exhibit said newspaper for _____ 1 times, to-wit:

February 15, 2018

said Exhibit "A" inures to the sole benefit for the publishers of said newspaper; that no agreement or understanding for the division thereof has been made with any other person, and that no part thereof has been agreed to be paid to any person whomsoever; that the fees charged for the publication thereof are:

Sixty-Seven Dollars and Seventy-Three Cents \$67.73

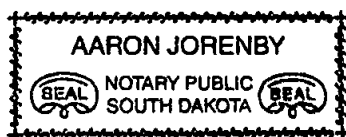

KM Foiles

26 day of

February

2018

Notary Public in and for the County of Brookings, South Dakota.
My Commission expires February 22, 2020.

Legal 164, 1x, 2/15
NOTICE OF HEARING
ON CHIEF ENGINEER'S RECOMMENDATION FOR BIG SIOUX RIVER WATER RIGHTS

Notice is given that the Water Rights Program, Department of Environment and Natural Resources, 523 E Capitol Avenue, Pierre SD 57501 proposes that the Water Management Board amend conditions placed on many Big Sioux River water rights in South Dakota. The objective is to bring consistency among water rights from the river and the ability for the Chief Engineer to issue written orders to allow pumping to continue if climatic conditions are favorable. The amendments will not increase either the authorized diversion rate or number of irrigated acres authorized under existing Big Sioux River water rights. Currently, water rights differ in the amount of water that must be bypassed at the pump site or at a United States Geological Survey (USGS) gaging station in order for pumping to occur. The Water Rights Program has reviewed all Big Sioux River water rights and determined that the conditions can be modified to a standard bypass at one of three gaging stations depending on the stream segment where the water right is located. It is proposed that the bypass condition along the river is best managed in three segments identified by USGS gaging stations as follows:

1. River reach upstream from the USGS gaging station near Castlewood;
 2. River reach between USGS gaging station near Castlewood downstream to gaging station near Dell Rapids;
 3. River reach between USGS gaging station near Dell Rapids downstream to gaging station near North Cliff Avenue in Sioux Falls.
- Water rights that currently have a bypass condition will be amended such that those water rights upstream of the Castlewood gaging station will have a 5 cubic feet of water per second (cfs) bypass requirement. Those water rights in the two other reaches described above will have a 20 cfs bypass requirement referenced to either the Dell Rapids or North Cliff Avenue gaging station depending on the location of the water right. Water rights with senior priority dates that do not currently have a bypass requirement will see no change.
- The proposed amendment will not impose any conditions more restrictive than the conditions currently in place on any water right. Big Sioux River water right holders whose bypass condition is proposed for amendment will be provided personal notice of the proposed amendment to their water right.
- The Chief Engineer recommends that the Water Management Board approve deletion of the existing bypass condition on applicable water rights and add the following qualifications specific to the bypass flow at a referenced gaging station depending on the location of the water right.
1. Low flows as needed for downstream domestic use, including livestock water, and prior rights must be bypassed. This water right does not authorize diversion of water from

the Big Sioux River, when pumping, unless at least "X" cfs is flowing past the USGS Gaging Station "IDENTIFY APPLICABLE STATION" unless written orders have been issued by the Chief Engineer. Diversions under this water right shall be in accordance with any written orders issued by the Chief Engineer.

2. The Water Management Board is retaining jurisdiction of this water right in the event additional information shows that adjustments need to be made to the bypass requirements.

Any interested person opposing or supporting the proposed amendment and intending to participate in the hearing shall file a petition with the Chief Engineer.

The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)". A petition filed by either an interested person or a water right holder must be filed by February 26, 2018.

The petition may be informal, but shall be in writing and shall include a statement describing the petitioner's interest, the petitioner's reasons for opposing or supporting the proposed change, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained. The hearing is an adversary proceeding and any party has the right to be present at the hearing and to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing and decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law.

The staff report including affected water rights and the proposed changes is available at <http://denr.sd.gov/public> or contact Eric Gronlund for this information, or other information, at the Water Rights Program address provided above.

The Water Management Board will consider the proposed changes at 11:30 a.m. on March 7, 2018, in the Matthew Training Center, Joe Foss Bldg, 523 E. Capitol Ave. Pierre SD. The hearing will be held pursuant to the provisions of SDCL 46-1-14 and 46-2-17.

The Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) modify, 3) defer, or 4) deny the proposed amendments after it reaches a conclusion based on facts at the public hearing. The Board has legal authority and jurisdiction to consider this matter pursuant to SDCL 46-2-9 and 46-2-11.

The March 7, 2018 hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from any person who has filed a petition to oppose or support the proposed change. The request for an automatic delay must be filed by February 26, 2018. If an automatic delay is requested, the hearing will be rescheduled for a future Board meeting and personal notice will be provided to all petitioners regarding the time, date and location. Notice is given to individuals with disabilities that this hearing is being held in a physically accessible place. Please notify the Department of Environment and Natural Resources at least 48 hours before the hearing if you have a disability for which special arrangements must be made at the hearing. The telephone number for making arrangements is (605)

773-3352.

Under SDCL 1-26-18.3, in any contested case, if the amount in controversy exceeds \$2,500.00 "or if a property right may be terminated, any party to the contested case may require the agency to use the Office of Hearing Examiners by giving notice of the request to the agency no later than ten days after service of a notice of hearing issued pursuant to SDCL 1-26-17." If you choose to use the Office of Hearing Examiners rather than the hearing procedure before the Water Management Board set forth above, you need to notify the Chief Engineer (Water Rights Program, 523 E Capitol Avenue, Pierre SD) by February 26, 2018. Steven M. Pirner, Secretary, Department of Environment and Natural Resources. Published once at the total approximate cost of \$67.73.

March 7, 2018

PAYMENT REQUEST FORM

PAYEE: Brookings Register
PO Box 177
Brookings, SD 57006-0177

FROM: DENR Water Rights Program
523 E. Capitol Ave
Pierre, SD 57501-3181

DESCRIPTION OF SERVICE, PRODUCE OR TRANSFER

Notice of Hearing

AMOUNT: \$67.73

FUNDING SOURCE:


GENERAL: X

FEDERAL:

OTHER:

COMMENTS:

AUTHORIZATION:

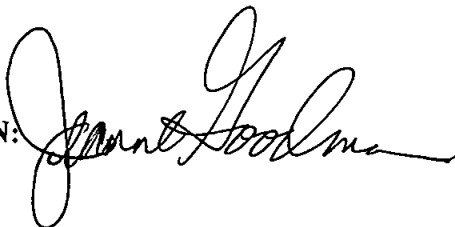

I declare and affirm under the penalties of perjury that this claim is in all things, true and correct. I further agree to comply with the provisions of the Civil Rights Act of 1964 and regulations issued thereunder relating to nondiscrimination in federal assisted programs.

312 5TH ST
P.O. BOX 177
BROOKINGS, SD 57006-0177
Phone (605) 692-6271 Fax (605) 692-2979

WATER RIGHTS PROGRAM

CUSTOMER NUMBER 106003

SD-WATER RIGHTS PROGRAM
ATTN: ERIC GRONLUND
523 E CAPITOL- JOE FOSS BLDG
PIERRE SD 57501-3181

AMOUNT \$ _____
ENCLOSED _____

DOCUMENT	DATE	TYPE	REFERENCES	AMOUNT													
372411	02/15/18	INVOICE	Leg164 Notice on Hearing	67.73													
<table border="1"> <thead> <tr> <th rowspan="2">CURRENT</th> <th colspan="3">PAST DUE AMOUNTS</th> <th rowspan="2">AMOUNT DUE</th> </tr> <tr> <th>OVER 30 DAYS</th> <th>OVER 60 DAYS</th> <th>OVER 90 DAYS</th> </tr> </thead> <tbody> <tr> <td>67.73</td> <td>.00</td> <td>.00</td> <td>.00</td> <td>67.73</td> </tr> </tbody> </table>					CURRENT	PAST DUE AMOUNTS			AMOUNT DUE	OVER 30 DAYS	OVER 60 DAYS	OVER 90 DAYS	67.73	.00	.00	.00	67.73
CURRENT	PAST DUE AMOUNTS			AMOUNT DUE													
	OVER 30 DAYS	OVER 60 DAYS	OVER 90 DAYS														
67.73	.00	.00	.00	67.73													

Affidavit of Publication

STATE OF SOUTH DAKOTA
COUNTY OF MOODY) SS

MARY LYNN HEADRICK, of said county, being first duly sworn on oath says that she is the bookkeeper of the Moody County Enterprise, a weekly newspaper printed and published in said county of Moody and State of South Dakota, and has full and personal knowledge of all the facts herein stated; that said newspaper is a legal newspaper and has a bona fide circulation of at least 200 copies weekly, and has been published within said county for 52 consecutive weeks next prior to the publication of the notice herein mentioned, and was and is printed wholly or in part in an office maintained at said place of publication; that the advertisement headed:

*Notice of hearing on Chief
Engineer's Recommendation
for Big Sioux River Water Rights*

a printed copy of which, taken from the newspaper in which the same was published, is attached to this sheet and is made a part of this affidavit, was published in said newspaper at least once in each week for 1 successful weeks, on the day of each week on which said newspaper was regularly published, to wit:

2-14-18

that the full amount of the fee charged for the publication of said Notice inures to the benefit of the publisher of said newspaper; that no agreement or understanding for the division thereof has been made with any person, and that no part thereof has been agreed to be paid to any person whomsoever, and that the fees charged for the publication thereof are

\$ 75⁶²

M. L. Headrick bookkeeper
Subscribed and sworn to before me this

15th day of February AD 2018

Notary Public, County Moody, South Dakota
ROGER W. JANSSEN

NOTARY PUBLIC
SOUTH DAKOTA

My commission expires 2/14/18

RECEIVED

FEB 28 2018

WATER RIGHTS
PROGRAM

NOTICE OF HEARING ON CHIEF ENGINEER'S RECOMMENDATION FOR BIG SIOUX RIVER WATER RIGHTS

Notice is given that the Water Rights Program, Department of Environment and Natural Resources, 523 E Capitol Avenue, Pierre SD 57501 proposes that the Water Management Board amend conditions placed on many Big Sioux River water rights in South Dakota. The objective is to bring consistency among water rights from the river and the ability for the Chief Engineer to issue written orders to allow pumping to continue if climatic conditions are favorable. The amendments will not increase either the authorized diversion rate or number of irrigated acres authorized under existing Big Sioux River water rights.

Currently, water rights differ in the amount of water that must be bypassed at the pump site or at a United States Geological Survey (USGS) gaging station in order for pumping to occur. The Water Rights Program has reviewed all Big Sioux River water rights and determined that the conditions can be modified to a standard bypass at one of three gaging stations depending on the stream segment where the water right is located. It is proposed that the bypass condition along the river is best managed in three segments identified by USGS gaging stations as follows:

1. River reach upstream from the USGS gaging station near Castlewood;
2. River reach between USGS gaging station near Castlewood downstream to gaging station near Dell Rapids;
3. River reach between USGS gaging station near Dell Rapids downstream to gaging station near North Cliff Avenue in Sioux Falls.

Water rights that currently have a bypass condition will be amended such that those water rights upstream of the Castlewood gaging station will have a 5 cubic feet of water per second (cfs) bypass requirement. Those water rights in the two other reaches described above will have a 20 cfs bypass requirement referenced to either the Dell Rapids or North Cliff Avenue gaging station depending on the location of the water right. Water rights with senior priority dates that do not currently have a bypass requirement will see no change.

The proposed amendment will not impose any conditions more restrictive than the conditions currently in place

on any water right. Big Sioux River water right holders whose bypass condition is proposed for amendment will be provided personal notice of the proposed amendment to their water right.

The Chief Engineer recommends that the Water Management Board approve deletion of the existing bypass condition on applicable water rights and add the following qualifications specific to the bypass flow at a referenced gaging station depending on the location of the water right.

1. Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This water right does not authorize diversion of water from the Big Sioux River, when pumping, unless at least "X" cfs is flowing past the USGS Gaging Station "IDENTIFY APPLICABLE STATION" unless written orders have been issued by the Chief Engineer. Diversions under this water right shall be in accordance with any written orders issued by the Chief Engineer.

2. The Water Management Board is retaining jurisdiction of this water right in the event additional information shows that adjustments need to be made to the bypass requirements.

Any interested person opposing or supporting the proposed amendment and intending to participate in the hearing shall file a petition with the Chief Engineer. The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)". A petition filed by either an interested person or a water right holder must be filed by February 26, 2018.

The petition may be informal, but shall be in writing and shall include a statement describing the petitioner's interest, the petitioner's reasons for opposing or supporting the proposed change, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained. The hearing is an adversary proceeding and any party has the right to be present at the hearing and to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing and decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law.

The staff report including affected water rights and the proposed changes is available at <http://denr.sd.gov/public> or contact Eric Gronlund for this information, or other information, at the

County of _____

AFFIDAVIT OF PUBLICATION

Filed in the office of _____

on the _____ day

Attorney for _____

Water Rights Program address provided above.

The Water Management Board will consider the proposed changes at 11:30 a.m. on March 7, 2018, in the Matthew Training Center, Joe Foss Bldg, 523 E. Capitol Ave. Pierre SD. The hearing will be held pursuant to the provisions of SDCL 46-1-14 and 46-2-17.

The Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) modify, 3) defer, or 4) deny the proposed amendments after it reaches a conclusion based on facts at the public hearing. The Board has legal authority and jurisdiction to consider this matter pursuant to SDCL 46-2-9 and 46-2-11.

The March 7, 2018 hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from any person who has filed a petition to oppose or support the proposed change. The request for an automatic delay must be filed by February 26, 2018. If an automatic delay is requested, the hearing will be rescheduled for a future Board meeting and personal notice will be provided to all petitioners regarding the time, date and location.

Notice is given to individuals with disabilities that this hearing is being held in a physically accessible place. Please notify the Department of Environment and Natural Resources at least 48 hours before the hearing if you have a disability for which special arrangements must be made at the hearing. The telephone number for making arrangements is (605) 773-3352.

Under SDCL 1-26-18.3, in any contested case, if the amount in controversy exceeds \$2,500.00 "or if a property right may be terminated, any party to the contested case may require the agency to use the Office of Hearing Examiners by giving notice of the request to the agency no later than ten days after service of a notice of hearing issued pursuant to SDCL 1-26-17." If you choose to use the Office of Hearing Examiners rather than the hearing procedure before the Water Management Board set forth above, you need to notify the Chief Engineer (Water Rights Program, 523 E Capitol Avenue, Pierre SD) by February 26, 2018.

Steven M. Pirner, Secretary, Department of Environment and Natural Resources.

Published once at approximate cost of \$76

March 2, 2018

PAYMENT REQUEST FORM

PAYEE: Moody County Enterprise
PO Box 71
Flandreau, SD 57028

FROM: DENR Water Rights Program
523 E. Capitol Ave
Pierre, SD 57501-3181

DESCRIPTION OF SERVICE, PRODUCE OR TRANSFER

Notice of Hearing

AMOUNT: \$75.62

FUNDING SOURCE:

GENERAL: X

FEDERAL:

OTHER:

COMMENTS:

AUTHORIZATION: 

I declare and affirm under the penalties of perjury that this claim is in all things, true and correct. I further agree to comply with the provisions of the Civil Rights Act of 1964 and regulations issued thereunder relating to nondiscrimination in federal assisted programs.

Invoice
Moody County Enterprise
PO Box 71
Flandreau, SD 57028

Water Rights
523 E Capitol
Pierre SD 57501

Date	Item advertised	Rate
2-14-18	Notice of Hearing	75.62
Total		\$75.62

Payment can be sent to us at the above address.
Thank you

Affidavit of Publication

STATE OF SOUTH DAKOTA
COUNTY OF LINCOLN

ANDY WILCOX


being first duly sworn on his oath says; that the Sioux Valley News is a legal weekly newspaper of general circulation as required by South Dakota Code of Nineteen Hundred Thirty-Nine, and any acts amendatory thereto, printed and published by the Sioux Valley News, Inc., in Canton, in said county and State, and has been such legal newspaper during the time hereinafter mentioned; that he is and during all of said time was publisher of said newspaper and has personal knowledge of the facts stated in this affidavit; that the advertisement headed:

**DENR Water Rights Program
Notice of Hearing**


a printed copy of which is hereto attached, was printed and published in said newspaper for ONE successive week(s) upon the following dates, to-wit:

February 15, 2018

that the full amount of the fees charged for publishing the same to-wit: the sum of \$72.47 inures solely to the benefit of the publishers of said newspaper; that no agreement or understanding for any division of this sum has been made with any other person; and that no part of said sum has been agreed to be paid to any person whomsoever.

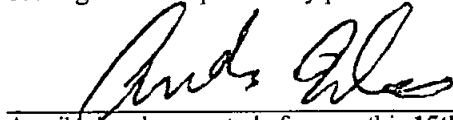


Ascribed and sworn to before me this 15th day of
February, 2018.

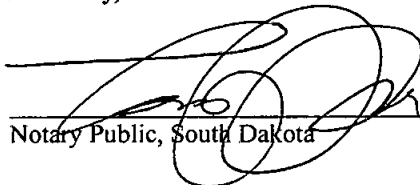

Notary Public, South Dakota

(Seal)

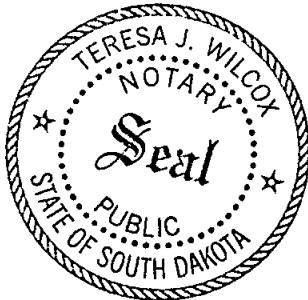

**NOTICE OF HEARING
ON CHIEF ENGINEER'S
RECOMMENDATION FOR BIG
SIOUX RIVER WATER RIGHTS**

Notice is given that the Water Rights Program, Department of Environment and Natural Resources, 523 E Capitol Avenue, Pierre SD 57501 proposes that the Water Management Board amend conditions placed on many Big Sioux River water rights in South Dakota. The objective is to bring consistency among water rights from the river and the ability for the Chief Engineer to issue written orders to allow pumping to continue if climatic conditions are favorable. The amendments will not increase either the authorized diversion rate or number of irrigated acres authorized under existing Big Sioux River water rights.

Currently, water rights differ in the amount of water that must be bypassed at the pump site or at a United States Geological Survey (USGS) gaging station in order for pumping to occur. The Water Rights Program has reviewed all Big Sioux River water rights and determined that the conditions can be modified to a standard bypass at one of three gaging stations depending on the stream segment where the water right is located. It is proposed that the bypass condition along the river is best managed in three segments identified by USGS gaging stations as follows:

1. River reach upstream from the USGS gaging station near Castlewood;
2. River reach between USGS gaging station near Castlewood downstream to gaging station near Dell Rapids;
3. River reach between USGS gaging station near Dell Rapids downstream to gaging station near North Cliff Avenue in Sioux Falls.

Water rights that currently have a bypass condition will be amended such that those water rights upstream of the Castlewood gaging station will have a 5 cubic feet of water per second (cfs) bypass requirement. Those

water rights in the two other reaches described above will have a 20 cfs bypass requirement referenced to either the Dell Rapids or North Cliff Avenue gaging station depending on the location of the water right. Water rights with senior priority dates that do not currently have a bypass requirement will see no change.

The proposed amendment will not impose any conditions more restrictive than the conditions currently in place on any water right. Big Sioux River water right holders whose bypass condition is proposed for amendment will be provided personal notice of the proposed amendment to their water right.

The Chief Engineer recommends that the Water Management Board approve deletion of the existing bypass condition on applicable water rights and add the following qualifications specific to the bypass flow at a referenced gaging station depending on the location of the water right.

1. Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This water right does not authorize diversion of water from the Big Sioux River, when pumping, unless at least "X" cfs is flowing past the USGS Gaging Station "IDENTIFY APPLICABLE STATION" unless written orders have been issued by the Chief Engineer. Diversions under this water right shall be in accordance with any written orders issued by the Chief Engineer.

2. The Water Management Board is retaining jurisdiction of this water right in the event additional information shows that adjustments need to be made to the bypass requirements.

Any interested person opposing or supporting the proposed amendment and intending to participate in the

My Commission Expires
December 9, 2020

RECEIVED

FEB 26 2018

**WATER RIGHTS
PROGRAM**

hearing shall file a petition with the Chief Engineer. The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)". A petition filed by either an interested person or a water right holder must be filed by February 26, 2018.

The petition may be informal, but shall be in writing and shall include a statement describing the petitioner's interest, the petitioner's reasons for opposing or supporting the proposed change, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained. The hearing is an adversary proceeding and any party has the right to be present at the hearing and to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing and decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law.

The staff report including affected water rights and the proposed changes is available at <http://denr.sd.gov/public> or contact Eric Gronlund for this information, or other information, at the Water Rights Program address provided above.

The Water Management Board will consider the proposed changes at 11:30 a.m. on March 7, 2018, in the Matthew Training Center, Joe Foss Bldg, 523 E. Capitol Ave. Pierre SD. The hearing will be held pursuant to the provisions of SDCL 46-1-14 and 46-2-17.

The Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) modify, 3) defer, or 4) deny the proposed amendments after it reaches a conclusion based on facts at the public hearing. The Board has legal authority and jurisdiction to consider this matter pursuant to SDCL 46-2-9 and 46-2-11.

* The March 7, 2018 hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from any person who has filed a petition to oppose or support the proposed change. The request for an automatic delay must be filed by February 26, 2018. If an automatic delay is requested, the hearing will be rescheduled for a future Board meeting and personal notice will be provided to all petitioners regarding the time, date and location.

Notice is given to individuals with disabilities that this hearing is being held in a physically accessible place. Please notify the Department of Environment and Natural Resources at least 48 hours before the hearing if you have a disability for which special arrangements must be made at the hearing. The telephone number for making arrangements is (605) 773-3352.

Under SDCL 1-26-18.3, in any contested case, if the amount in controversy exceeds \$2,500.00 "or if a property right may be terminated, any party to the contested case may require the agency to use the Office of Hearing Examiners by giving notice of the request to the agency no later than ten days after service of a notice of hearing issued pursuant to SDCL 1-26-17." If you choose to use the Office of Hearing Examiners rather than the hearing procedure before the Water Management Board set forth above, you need to notify the Chief Engineer (Water Rights Program, 523 E Capitol Avenue, Pierre SD) by February 26, 2018.

Steven M. Pirner, Secretary,
Department of Environment and
Natural Resources.

Published in the Sioux Valley News
on February 15, 2018, at the total
approximate cost of \$72.47.

February 26, 2018

PAYMENT REQUEST FORM

PAYEE: Sioux Valley News Inc.
PO Box 255
Canton, SD

FROM: DENR Water Rights Program
523 E. Capitol Ave
Pierre, SD 57501-3181

DESCRIPTION OF SERVICE, PRODUCE OR TRANSFER

Affidavit of Publication-Big Sioux River

AMOUNT: \$72.47

FUNDING SOURCE:

GENERAL: X

FEDERAL:

OTHER:

COMMENTS:

AUTHORIZATION: 

I declare and affirm under the penalties of perjury that this claim is in all things, true and correct.
I further agree to comply with the provisions of the Civil Rights Act of 1964 and regulations issued thereunder relating to nondiscrimination in federal assisted programs.

Sioux Valley News Inc.
213 East 5th St P O Box 255
Canton SD 57013

Statement	2/22/2018	50
	DATE	NUMBER

Phone Number: (605) 764-2000
Please return yellow copy
with payment.

Next Closing Day March 29, 2018

ID# 541

Dept of Environment & Natural Resou
Attn: Karen Water Rights Program
523 East Capitol, Joe Foss Building
Pierre SD 57501

We now offer online Subscriptions!
www.SiouxValleyNewsOnline.com

Balance Due: 72.47

Date	Description	Units	Debit	Credit
02/15/2018	Legals		72.47	
	Big Sioux River Notice			
	Balance Due		72.47	

Current	30	60	90	90+
72.47	0.00	0.00	0.00	0.00

Service charge of 1-3/4% per month (21% per year) on accounts 30 days past due. Minimum charge \$30.
In addition, costs and reasonable attorney's fees for collection may be charged.

RECEIVED

FEB 22 2018

Form 8

WATER RIGHTS
PROGRAM

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)

County of Codington) SS

I, Jackie Wettstad

certify that the attached printed Notice was taken

from the Watertown

Public Opinion

printed and published in Watertown

County of Codington and

state of South Dakota. The notice was published

in the newspaper on the following date:

February 15, 2018

Cost of Printing \$131.01

Jackie Wettstad
(Signature)

Accounting Clerk
(Title)

2/19/18
(Date Signed)

DEPT OF ENVIRONMENT AND NATURAL RESOURCES

NOTICE OF HEARING
ON CHIEF ENGINEER'S
RECOMMENDATION FOR BIG
SIOUX RIVER WATER RIGHTS
Notice is given that the Water
Rights Program, Department
of Environment and Natural
Resources, 523 E Capitol Avenue,
Pierre SD 57501 proposes that
the Water Management Board
amend conditions placed on
many Big Sioux River water rights
in South Dakota. The objective is
to bring consistency among water
rights from the river and the ability
for the Chief Engineer to issue
written orders to allow pumping to
continue if climatic conditions are
favorable. The amendments will
not increase either the authorized
diversion rate or number of
irrigated acres authorized under
existing Big Sioux River water
rights.

Currently, water rights differ in
the amount of water that must be
bypassed at the pump site or at a
United States Geological Survey
(USGS) gaging station in order
for pumping to occur. The Water
Rights Program has reviewed all
Big Sioux River water rights and
determined that the conditions
can be modified to a standard
bypass at one of three gaging
stations depending on the stream
segment where the water right is
located. It is proposed that the
bypass condition along the river is
best managed in three segments
identified by USGS gaging
stations as follows:

1. River reach upstream from
the USGS gaging station near
Castlewood;
2. River reach between USGS
gaging station near Castlewood
downstream to gaging station
near Dell Rapids;
3. River reach between USGS
gaging station near Dell Rapids
downstream to gaging station
near North Cliff Avenue in Sioux
Falls.

Water rights that currently have a
bypass condition will be amended
such that those water rights
upstream of the Castlewood
gaging station will have a 5 cubic
feet of water per second (cfs)
bypass requirement. Those water
rights in the two other reaches
described above will have a 20 cfs
bypass requirement referenced to
either the Dell Rapids or North Cliff
Avenue gaging station depending
on the location of the water right.
Water rights with senior priority
dates that do not currently have
a bypass requirement will see no
change.

The proposed amendment will
not impose any conditions more
restrictive than the conditions
currently in place on any water
right. Big Sioux River water right
holders whose bypass condition
is proposed for amendment will
be provided personal notice of
the proposed amendment to their
water right.

The Chief Engineer recommends
that the Water Management
Board approve deletion of the
existing bypass condition on
applicable water rights and add
the following qualifications specific
to the bypass flow at a referenced
gaging station depending on the
location of the water right.

1. Low flows as needed for
downstream domestic use,
including livestock water, and
prior rights must be by-passed.
This water right does not
authorize diversion of water
from the Big Sioux River, when
pumping, unless at least "X"
cfs is flowing past the USGS
Gaging Station "IDENTIFY
APPLICABLE STATION" unless
written orders have been
issued by the Chief Engineer.
Divisions under this water right
shall be in accordance with any
written orders issued by the
Chief Engineer.

2. The Water Management
Board is retaining jurisdiction
of this water right in the
event additional information
shows that adjustments need
to be made to the bypass
requirements.

Any interested person opposing
or supporting the proposed
amendment and intending to
participate in the hearing shall file
a petition with the Chief Engineer.
The Chief Engineer's address is
"Water Rights Program, Foss
Building, 523 E Capitol, Pierre SD
57501 (605 773-3352)". A petition
filed by either an interested person
or a water right holder must be
filed by February 26, 2018.

The petition may be informal,
but shall be in writing and shall
include a statement describing
the petitioner's interest, the
petitioner's reasons for opposing
or supporting the proposed
change, and the signature and
mailing address of the petitioner
or the petitioner's legal counsel,
if legal counsel is obtained.

The hearing is an adversary
proceeding and any party has the
right to be present at the hearing
and to be represented by a lawyer.
These and other due process
rights will be forfeited if they are
not exercised at the hearing and
decisions of the Board may be
appealed to the Circuit Court and
State Supreme Court as provided
by law.

The staff report including affected
water rights and the proposed
changes is available at <http://denr.sd.gov/public> or contact Eric
Gronlund for this information, or
other information, at the Water
Rights Program address provided
above.

The Water Management Board
will consider the proposed
changes at 11:30 a.m. on March
7, 2018, in the Matthew Training
Center, Joe Foss Bldg, 523 E.
Capitol Ave, Pierre SD. The
hearing will be held pursuant to
the provisions of SDCL 46-1-14
and 46-2-17.

The Chief Engineer's
recommendation is not final or
binding upon the Board. The
Board is authorized to 1) approve,
2) modify, 3) defer, or 4) deny the
proposed amendments after it
reaches a conclusion based on
facts at the public hearing. The
Board has legal authority and
jurisdiction to consider this matter
pursuant to SDCL 46-2-9 and 46-
2-11.

The March 7, 2018 hearing date
will be automatically delayed
for at least 20 days upon written
request to the Chief Engineer
from any person who has filed a
petition to oppose or support the
proposed change. The request
for an automatic delay must be
filed by February 26, 2018. If
an automatic delay is requested,
the hearing will be rescheduled
for a future Board meeting and
personal notice will be provided to
all petitioners regarding the time,
date and location.

Notice is given to individuals with
disabilities that this hearing is be-
ing held in a physically accessible
place. Please notify the Depart-
ment of Environment and Natural
Resources at least 48 hours before
the hearing if you have a disabili-
ty for which special arrangements
must be made at the hearing. The
telephone number for making ar-
rangements is (605) 773-3352.

Under SDCL 1-26-18.3, in any
contested case, if the amount in
controversy exceeds \$2,500.00
"or if a property right may be
terminated, any party to the
contested case may require the
agency to use the Office of Hearing
Examiners by giving notice of the
request to the agency no later than
ten days after service of a notice of
hearing issued pursuant to SDCL
1-26-17." If you choose to use the
Office of Hearing Examiners rather
than the hearing procedure before
the Water Management Board
set forth above, you need to notify
the Chief Engineer (Water Rights
Program, 523 E Capitol Avenue,
Pierre SD) by February 26, 2018.
Steven M. Pinner, Secretary, De-
partment of Environment and Nat-
ural Resources.

Published once at an approxi-
mate cost of \$126.01.
(February 15, 2018)

February 22, 2018

PAYMENT REQUEST FORM

PAYEE: Watertown Public Opinion
120 3rd Avenue NW
Watertown, SD

FROM: DENR Water Rights Program
523 E. Capitol Ave
Pierre, SD 57501-3181

DESCRIPTION OF SERVICE, PRODUCE OR TRANSFER

Notice of Hearing-Big Sioux River

AMOUNT: \$131.01

FUNDING SOURCE:


GENERAL: X

FEDERAL:

OTHER:

COMMENTS:

AUTHORIZATION:

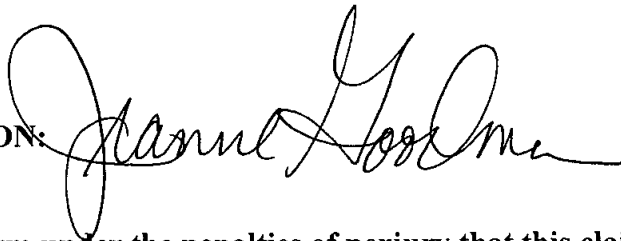A handwritten signature in black ink, appearing to read "Hannah Goodman", is written over the "AUTHORIZATION:" label.

I declare and affirm under the penalties of perjury that this claim is in all things, true and correct. I further agree to comply with the provisions of the Civil Rights Act of 1964 and regulations issued thereunder relating to nondiscrimination in federal assisted programs.

RECEIVED

FEB 20 2018

WATER RIGHTS
PROGRAM

Form 8

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)

County of Hamlin) SSI, LeeAnne Dufek

certify that the attached printed Notice was taken

from the Hamlin County
Republicanprinted and published in CastlewoodCounty of Hamlin and

state of South Dakota. The notice was published

in the newspaper on the following date:

Feb 14, 2018Cost of Printing \$69.09LeeAnne Dufek
(Signature)Owner
(Title)2-14-2018
(Date Signed)**NOTICE OF HEARING ON CHIEF
ENGINEER'S RECOMMENDA-
TION FOR BIG SIOUX RIVER
WATER RIGHTS**

Notice is given that the Water Rights Program, Department of Environment and Natural Resources, 523 E Capitol Avenue, Pierre SD 57501 proposes that the Water Management Board amend conditions placed on many Big Sioux River water rights in South Dakota. The objective is to bring consistency among water rights from the river and the ability for the Chief Engineer to issue written orders to allow pumping to continue if climatic conditions are favorable. The amendments will not increase either the authorized diversion rate or number of irrigated acres authorized under existing Big Sioux River water rights.

Currently, water rights differ in the amount of water that must be bypassed at the pump site or at a United States Geological Survey (USGS) gaging station in order for pumping to occur. The Water Rights Program has reviewed all Big Sioux River water rights and determined that the conditions can be modified to a standard bypass at one of three gaging stations depending on the stream segment where the water right is located. It is proposed that the bypass condition along the river is best managed in three segments identified by USGS gaging stations as follows:

River reach upstream from the USGS gaging station near Castlewood;

River reach between USGS gaging station near Castlewood downstream to gaging station near Dell Rapids;

River reach between USGS gaging station near Dell Rapids downstream to gaging station near North Cliff Avenue in Sioux Falls.

Water rights that currently have a bypass condition will be amended such that those water rights upstream of the Castlewood gaging station will have a 5 cubic feet of water per second (cfs) bypass requirement. Those water rights in the two other reaches described above will have a 20 cfs bypass requirement referenced to either the Dell Rapids or North Cliff Avenue gaging station depending on the location of the water right. Water rights with senior priority dates that do not currently have a bypass requirement will see no change.

The proposed amendment will not impose any conditions more restrictive than the conditions currently in place on any water right. Big Sioux River water right holders whose bypass condition is proposed for amendment will be provided personal notice of the proposed amendment to their water right.

The Chief Engineer recommends that the Water Management Board approve deletion of the existing bypass condition on applicable water rights and add the following qualifications specific to the bypass flow at a referenced gaging station depending on the location of the water right.

Low flows as needed for downstream domestic use, including live-stock water, and prior rights must be by-passed. This water right does not authorize diversion of water from the Big Sioux River, when pumping, unless at least "X" cfs is flowing past the USGS Gaging Station "IDENTIFY APPLICABLE STATION" unless written orders have been issued by the Chief Engineer. Diversions under this water right shall be in accordance with any written orders issued by the Chief Engineer.

The Water Management Board is retaining jurisdiction of this water right in the event additional information shows that adjustments need to be made to the bypass requirements.

Any interested person opposing or supporting the proposed amendment and intending to participate in the hearing shall file a petition with the Chief Engineer. The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)". A petition filed by either an interested person or a water right holder must be filed by February 26, 2018.

The petition may be informal, but shall be in writing and shall include a statement describing the petitioner's interest, the petitioner's reasons for opposing or supporting the proposed change, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained. The hearing is an adversary proceeding and any party has the right to be present at the hearing and to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing and decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law.

The staff report including affected water rights and the proposed changes is available at <http://denr.sd.gov/public> or contact Eric Gronlund for this information, or other information, at the Water Rights Program address provided above.

The Water Management Board will consider the proposed changes at 11:30 a.m. on March 7, 2018, in the Matthew Training Center, Joe Foss Bldg, 523 E. Capitol Ave. Pierre SD. The hearing will be held pursuant to the provisions of SDCL 46-1-14 and 46-2-17.

The Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) modify, 3) defer, or 4) deny the proposed amendments after it reaches a conclusion based on facts at the public hearing. The Board has legal authority and jurisdiction to consider this matter pursuant to SDCL 46-2-9 and 46-2-11.

The March 7, 2018 hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from any person who has filed a petition to oppose or support the proposed change. The request for an automatic delay must be filed by February 26, 2018. If an automatic delay is requested, the hearing will be rescheduled for a future Board meeting and personal notice will be provided to all petitioners regarding the time, date and location.

Notice is given to individuals with disabilities that this hearing is being held in a physically accessible place. Please notify the Department of Environment and Natural Resources at least 48 hours before the hearing if you have a disability for which special arrangements must be made at the hearing. The telephone number for making arrangements is (605) 773-3352.

Under SDCL 1-26-18.3, in any contested case, if the amount in controversy exceeds \$2,500.00, "or if a property right may be terminated, any party to the contested case may require the agency to use the Office of Hearing Examiners by giving notice of the request to the agency no later than ten days after service of a notice of hearing issued pursuant to SDCL 1-26-17." If you choose to use the Office of Hearing Examiners rather than the hearing procedure before the Water Management Board set forth above, you need to notify the Chief Engineer (Water Rights Program, 523 E Capitol Avenue, Pierre SD) by February 26, 2018.

Steven M. Pimer, Secretary
Department of Environment and Natural Resources.

Published Feb. 14, 2018, at total cost of \$69.09.

February 20, 2018

PAYMENT REQUEST FORM

PAYEE: Hamlin County Publishing Inc.
PO Box 50
Castlewood, SD 57223

FROM: DENR Water Rights Program
523 E. Capitol Ave
Pierre, SD 57501-3181

DESCRIPTION OF SERVICE, PRODUCE OR TRANSFER

Notice of Hearing Big Sioux River

AMOUNT: \$69.09

FUNDING SOURCE:

GENERAL: X

FEDERAL:

OTHER:

COMMENTS:

AUTHORIZATION:

A handwritten signature in black ink, appearing to read "James Goodman", written over a horizontal line.

I declare and affirm under the penalties of perjury that this claim is in all things, true and correct.
I further agree to comply with the provisions of the Civil Rights Act of 1964 and regulations issued
thereunder relating to nondiscrimination in federal assisted programs.

Statement

B 2 0 2018

Bill To

DENR

Teresa Williams

Air Quality Program

523 E. Capitol, Joe Foss Bldg.

Pierre, SD 57501

Date	Description	Amount	Balance
02/13/18	Balance forward		0.00
02/14/18	Water Rights Notice of Hearing	69.09	69.09

Current	1-30 Days Past Due	31-60 Days Past Due	61-90 Days Past Due	OVER 90 Days Past Due	Amount Due
\$69.09	\$0.00	\$0.00	\$0.00	\$0.00	\$69.09

AFFIDAVIT OF PUBLICATION

State of South Dakota)
:ss
County of Union)

Bruce L. Odson,
the publisher of the Leader-Courier, deposes and says that
The Leader-Courier
is a legal weekly newspaper of a general circulation, printed and published in Elk Point, County of Union, State of South Dakota, and has been such legal newspaper during the time hereinafter mentioned, and that affiant is and was during all the time hereinafter mentioned in charge of the advertising department thereof, and has personal knowledge of all the facts stated in this affidavit: and that the notice and advertisement headed:

Notice of Hearing

a printed copy of which is hereunto attached and made a part hereof, was printed and published in the said newspaper at least once in

each week for 1 successive weeks; that said newspaper at the time of the first publication of said notice hereinafter stated, had, and still has, a bona fide circulation of over two hundred paid copies weekly, and had been published in the said County of Union for more than one year immediately prior to the date of the said publication of said notice, and that said newspaper during said times, was, and is, printed in part in an office maintained at said city of Elk Point, the said place of publication; that the first publication of said notice in said newspaper was

on Thursday, the 15 day of February, 2018

and that the succeeding publications were

on Thursday, the _____ day of _____, _____

on Thursday, the _____ day of _____, _____

on Thursday, the _____ day of _____, _____

that the fees for the printing and publishing of said notice and advertisement in said newspaper as aforesaid were


\$ 70.99, that the full amount of the fee charged insures to the benefit of the publisher of the said newspaper, that no agreement or understanding for the division thereof has been made with any other person and that no part thereof has been agreed to be paid to any other person whomsoever.


Subscribed and sworn to before me

this 15 day of February, 2018

My commission expires 7-12-23

SUSAN ODSON
NOTARY PUBLIC
SOUTH DAKOTA


Notary Public

NOTICE OF HEARING ON CHIEF ENGINEER'S RECOMMENDATION FOR BIG SIOUX RIVER WATER RIGHTS

Notice is given that the Water Rights Program, Department of Environment and Natural Resources, 523 E Capitol Avenue, Pierre SD 57501 proposes that the Water Management Board amend conditions placed on many Big Sioux River water rights in South Dakota. The objective is to bring consistency among water rights from the river and the ability for the Chief Engineer to issue written orders to allow pumping to continue if climatic conditions are favorable. The amendments will not increase either the authorized diversion rate or number of irrigated acres authorized under existing Big Sioux River water rights.

Currently, water rights differ in the amount of water that must be bypassed at the pump site or at a United States Geological Survey (USGS) gaging station in order for pumping to occur. The Water Rights Program has reviewed all Big Sioux River

water rights and determined that the conditions can be modified to a standard bypass at one of three gaging stations depending on the stream segment where the water right is located. It is proposed that the bypass condition along the river is best managed in three segments identified by USGS gaging stations as follows:

1. River reach upstream from the USGS gaging station near Castlewood;

2. River reach between USGS gaging station near Castlewood downstream to gaging station near Dell Rapids;

3. River reach between USGS gaging station near Dell Rapids downstream to gaging station near North Cliff Avenue in Sioux Falls.

Water rights that currently have a bypass condition will be amended such that those water rights upstream of the Castlewood gaging station will have a 5 cubic feet of water per second (cfs) bypass requirement. Those water rights in the two other reaches described above will have a 20 cfs bypass requirement referenced to either the Dell Rapids or North Cliff Avenue gaging station depending on the location of the water right. Water rights with senior priority dates that do not currently have a bypass requirement will see no change.

RECEIVED

FEB 20 2018

WATER RIGHTS
PROGRAM

The proposed amendment will not impose any conditions more restrictive than the conditions currently in place on any water right. Big Sioux River water right holders whose bypass condition is proposed for amendment will be provided personal notice of the proposed amendment to their water right.

The Chief Engineer recommends that the Water Management Board approve deletion of the existing bypass condition on applicable water rights and add the following qualifications specific to the bypass flow at a referenced gaging station depending on the location of the water right.

1. Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This water right does not authorize diversion of water from the Big Sioux River, when pumping, unless at least "X" cfs is flowing past the USGS Gaging Station "IDENTIFY APPLICABLE STATION" unless written orders have been issued by the Chief Engineer. Diversions under this water right shall be in accordance with any written orders issued by the Chief Engineer.

2. The Water Management Board is retaining jurisdiction of this water right in the event additional information

shows that adjustments need to be made to the bypass requirements.

Any interested person opposing or supporting the proposed amendment and intending to participate in the hearing shall file a petition with the Chief Engineer. The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)". A petition filed by either an interested person or a water right holder must be filed by February 26, 2018.

The petition may be informal, but shall be in writing and shall include a statement describing the petitioner's interest, the petitioner's reasons for opposing or supporting the proposed change, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained. The hearing is an adversary proceeding and any party has the right to be present at the hearing and to be represented by a lawyer. These and other due process rights will be forfeited if they are not exercised at the hearing and decisions of the Board may be appealed to the Circuit Court and State Supreme Court as provided by law.

The staff report including affected water rights and the proposed changes is available at <http://denr.sd.gov/public> or

contact Eric Gronlund for this information, or other information, at the Water Rights Program address provided above.

The Water Management Board will consider the proposed changes at 11:30 a.m. on March 7, 2018, in the Matthew Training Center, Joe Foss Bldg, 523 E. Capitol Ave. Pierre SD. The hearing will be held pursuant to the provisions of SDCL 46-1-14 and 46-2-17.

The Chief Engineer's recommendation is not final or binding upon the Board. The Board is authorized to 1) approve, 2) modify, 3) defer, or 4) deny the proposed amendments after it reaches a conclusion based on facts at the public hearing. The Board has legal authority and jurisdiction to consider this matter pursuant to SDCL 46-2-9 and 46-2-11.

The March 7, 2018 hearing date will be automatically delayed for at least 20 days upon written request to the Chief Engineer from any person who has filed a petition to oppose or support the proposed change. The request for an automatic delay must be filed by February 26, 2018. If an automatic delay is requested, the hearing will be rescheduled for a future Board meeting and personal notice will be provided to all petitioners regarding the

time, date and location.

Notice is given to individuals with disabilities that this hearing is being held in a physically accessible place. Please notify the Department of Environment and Natural Resources at least 48 hours before the hearing if you have a disability for which special arrangements must be made at the hearing. The telephone number for making arrangements is (605) 773-3352.

Under SDCL 1-26-18.3, in any contested case, if the amount in controversy exceeds \$2,500.00 "or if a property right may be terminated, any party to the contested case may require the agency to use the Office of Hearing Examiners by giving notice of the request to the agency no later than ten days after service of a notice of hearing issued pursuant to SDCL 1-26-17." If you choose to use the Office of Hearing Examiners rather than the hearing procedure before the Water Management Board set forth above, you need to notify the Chief Engineer (Water Rights Program, 523 E Capitol Avenue, Pierre SD) by February 26, 2018.

Steven M. Pirner, Secretary, Department of Environment and Natural Resources.
Publish Feb. 15, 2018
Published once the total approximate cost of \$70.99
7-4-231

February 20, 2018

PAYMENT REQUEST FORM

PAYEE: Southern Union County Leader-Courier
PO Box 310
Elk Point, SD

FROM: DENR Water Rights Program
523 E. Capitol Ave
Pierre, SD 57501-3181

DESCRIPTION OF SERVICE, PRODUCE OR TRANSFER

Notice of Hearing-Big Sioux River

AMOUNT: \$70.99

FUNDING SOURCE:


GENERAL: X

FEDERAL:

OTHER:

COMMENTS:

AUTHORIZATION:

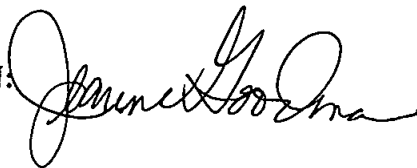

I declare and affirm under the penalties of perjury that this claim is in all things, true and correct. I further agree to comply with the provisions of the Civil Rights Act of 1964 and regulations issued thereunder relating to nondiscrimination in federal assisted programs.

Southern Union County **LEADER-COURIER**

*The community newspaper of Dakota Dunes, Elk Point,
Jefferson, McCook Lake and North Sioux City.*

RECEIVED

FEB 20 2018

**WATER RIGHTS
PROGRAM**

**Water Rights Program
523 E Capitol Ave
Pierre, SD 57501**

2/15/18

DATE	INVOICE	DESCRIPTION	CHARGES	BALANCE
2/15/18	SJ073117	Notice of Hearing- Big Sioux River	\$70.99	\$70.99

Finance Charge \$0.00

AMOUNT DUE* \$70.99

*Includes finance charges on amounts more than 30 days past due.

**PO Box 310
Elk Point, SD 57025
Phone 605-356-2632
Fax 605-356-3626**

**PO Box 1457
North Sioux City, SD 57049
Phone 605-235-1914
Fax 605-232-3679**

FEB 26 2018

WATER RIGHTS
PROGRAMCity of
Sioux Falls

City Attorney

Providing a Better Quality of Life for You!

KAREN A. LEONARD
Deputy City Attorney
kleonard@siouxfalls.org

DANIEL J. BROWN
Assistant City Attorney
dbrown4@siouxfalls.org

RYAN J. SAGE
Assistant City Attorney
rsage@siouxfalls.org

100 S. Dakota Ave., Ste. 200
P.O. Box 7402
Sioux Falls, SD 57117-7402
605-367-8880

KEITH E. ALLENSTEIN, JR.
Assistant City Attorney
Police and Fire Legal Advisor
kallenstein@siouxfalls.org

(Law Enforcement Center)
320 W. Fourth Street
Sioux Falls, SD 57104-2413
605-367-8880

COLLEEN M. MORAN
Assistant City Attorney
ADA Coordinator
cmoran@siouxfalls.org

KATIE L. DUNN
Assistant City Attorney
Human Relations Legal Advisor
kdunn@siouxfalls.org

224 W. Ninth Street
P.O. Box 7402
Sioux Falls, SD 57117-7402
605-367-8745

PAUL M. BENGFORD
Assistant City Attorney
Public Works Legal Advisor
pbengford@siouxfalls.org

DIANE P. BEST
Assistant City Attorney
Public Works Legal Advisor
dbest@siouxfalls.org

(Public Works Administration)
224 W. Ninth Street
P.O. Box 7402
Sioux Falls, SD 57117-7402
605-367-8880

605-367-7039 TTY
605-367-7330 FAX
www.siouxfalls.org

February 23, 2018

SENT VIA U.S. MAIL AND EMAIL TO: DENRINTERNET@STATE.SD.US

Ms. Jeanne Goodman
Chief Engineer
Water Rights Program, DENR
523 E. Capitol Avenue,
Pierre, SD 57501

Re: Big Sioux River Recommendations

Dear Ms. Goodman,

Please consider this letter as the City of Sioux Falls' Petition to Intervene in the pending Big Sioux River Water Rights matter now scheduled for March 7, 2018.

The City of Sioux Falls ("*Sioux Falls*") appreciates the the Department of Environment & Natural Resources ("*DENR*") objective of bringing consistency to the water right permits and their administration along the Big Sioux River ("*BSR*"). Changing the qualifications to ensure they are all based on USGS river gages is a good thing. Sioux Falls does have some concerns that it would like to share with the South Dakota Water Management Board ("*Board*").

The proposed new qualifications for each stretch of the BSR would be based on the next USGS gage below the water permit involved. For example, irrigation above the Castlewood gage would be allowed so long as the Castlewood gage was at 5 cfs or more. As such, this qualification would tend to assure these upstream irrigators have the right to irrigate so long as the stream gage below them meets a particular criteria, without regard to what is happening to senior users further downstream. Under this scenario, a junior irrigator above the Castlewood gage could irrigate if the Castlewood gage was at 5 cfs regardless of whether the gages at Dell Rapids and Sioux Falls were below 20 cfs. At the same time, a senior appropriator would be constrained by the 20 cfs qualification at the downstream gages. While I understand these qualifications are intended to provide for flexibility by the Chief Engineer and as such, the Chief Engineer could seek cooperation among the upstream junior appropriators, the language of these qualifications seems to reduce the legal means for the senior water right holders to take action against junior water right holders that impair water rights downstream.

Ms. Jeanne Goodman
Page 2
February 23, 2018

Sioux Falls would suggest all downstream gage criteria be incorporated in the qualifications. For the two permits above Castlewood, we would propose the qualification state as follows:

Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, when pumping, unless at least 5 cfs is flowing past the USGS Gaging Station No. 06479525 near Castlewood, at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids, and at least 20 cfs is flowing past USGS Gaging Station No. 6482020 at North Cliff Avenue in Sioux Falls, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.

Similarly, for the 14 permits above Dell Rapids, we would propose the qualification state as follows:

Low flows as needed for downstream domestic use, including livestock water, and prior rights must be by-passed. This permit does not authorize diversion of water from the Big Sioux River, when pumping, unless at least 20 cfs is flowing past the USGS Gaging Station No. 06481000 near Dell Rapids, and at least 20 cfs is flowing past USGS Gaging Station No. 6482020 at North Cliff Avenue in Sioux Falls, unless written orders have been issued by the Chief Engineer. Diversions under this Permit shall be in accordance with any written orders issued by the Chief Engineer.


We appreciate the fact that administering these diversions during severe drought will be a challenge. We would respectfully submit, however, that the qualifications, as stated above, would protect the senior water rights and also be a better means to protect the flows in the river for the entire stretch impacted.

We also reserve our right to address any other issues that may be presented by other intervenors or the Board at a hearing.

At the hearing Sioux Falls may also address the extent to which releases from the Sioux Falls Water Reclamation Plant augment other available flows in the BSR.

Due to scheduling constraints, Sioux Falls is exercising its right to automatically delay the hearing for at least twenty (20) days as provided by state law.

Sincerely,

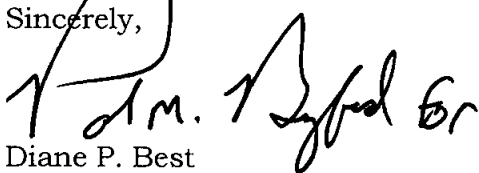

Diane P. Best
Assistant City Attorney

DPB/amr

Sioux Falls Ordinances

§ 53.015 USE OF PUBLIC SEWERS REQUIRED.

(a) It shall be unlawful for any person to place, deposit or permit to be deposited in any unsanitary manner on public or private property within the city, or in any area under the jurisdiction of the city, any human or animal excrement, garbage or other objectionable waste.

(b) It shall be unlawful to discharge to any natural outlet within the city or in any area under the jurisdiction of the city any wastewater or other polluted waters, except where suitable treatment has been provided in accordance with this subchapter, or permitted by the DENR or EPA.

(c) Except as provided in this subchapter, it shall be unlawful to construct or maintain any privy, privy vault, septic tank, cesspool or other facility intended or used for the disposal of wastewater.

(d) The owner of each house, building or property used for human occupancy, employment, recreation or other purposes, in the city and abutting on any street, alley or right-of-way in which there is located or may be located a public sanitary sewer of the city, shall at the owner's expense install suitable toilet facilities therein, and connect the facilities directly with the proper public sewer in accordance with the provisions of this subchapter, within five years after the date of official notice to do so, provided that the public sewer is within 200 feet of the property line and reasonably accessible as determined by the city engineer.

(1992 Code, § 41-111) (Ord. 47-81, passed 6-1-1981; Ord. 57-93, passed 7-12-1993; Ord. 102-96, passed 9-3-1996; Ord. 48-03, passed 6-9-2003) Penalty, see § 53.999

§ 53.016 PRIVATE WASTEWATER DISPOSAL.

(a) Where a public sanitary sewer is not available under the provisions of § 53.015(d), the building sewer shall be connected to a private wastewater disposal system complying with the provisions of this subchapter and State of South Dakota Administrative Rules for individual and small on-site wastewater systems (ARSD Chapter 74:03:01).

(b) Before commencement of construction of a private wastewater disposal system, the owner shall first obtain a written permit signed by the city engineer. The application for the permit shall be made on a form furnished by the city which the applicant shall supplement by any plans, specifications and other information deemed necessary by the city. A permit and inspection fee established by ordinance shall be paid to the city when the application is filed.

(c) A permit for a private wastewater disposal system shall not become effective until the installation is completed to the satisfaction of the city engineer. The city engineer shall be allowed to inspect the work at any stage of construction, and in any event, the applicant for the permit shall notify the city engineer when the work is ready for final inspection, and before any underground portions are covered. The inspection shall be made within three hours of the receipt of notice by the city engineer.

(d) The type, capacity, location and layout of a private wastewater disposal system shall comply with all recommendations of the state department of health. For persons with a public water supply, no permit shall be issued for any private wastewater disposal system employing subsurface soil absorption facilities where the area of the lot is less than one-half acre. For persons with a private well, no permit shall be issued for any private wastewater disposal system employing subsurface soil absorption facilities where the area of the lot is less than one acre. No septic tank or cesspool shall be permitted to discharge to any natural outlet.

(e) When a public sewer becomes available to a property served by a private wastewater disposal system, as provided in § 53.015(d), a direct connection shall be made to the public sewer within five years in compliance with this subchapter, and any septic tanks, cesspools and similar private wastewater disposal facilities shall be cleaned of sludge and filled with suitable material.

(f) The owner shall operate and maintain the private wastewater disposal facilities in a sanitary manner at all times, at no expense to the city.

(g) No statement contained in this subchapter shall be construed to interfere with any additional requirements that may be imposed by a health officer.

(1992 Code, § 41-112) (Ord. 47-81, passed 6-1-1981; Ord. 19-82, passed 3-8-1982; Ord. 57-93, passed 7-12-1993; Ord. 102-96, passed 9-3-1996; Ord. 48-03, passed 6-9-2003)



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**


JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182

denr.sd.gov

February 27, 2018

NOTICE

TO: Diane Best
Assistant City Attorney
City of Sioux Falls
PO Box 7402
Sioux Falls SD 57117-7402

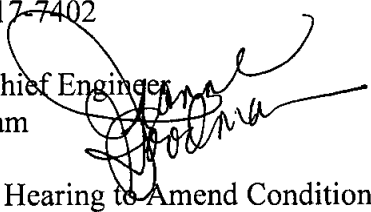FROM: Jeanne Goodman, Chief Engineer
Water Rights Program 

SUBJECT: Automatic Delay of Hearing to Amend Conditions Placed on Many Big Sioux River
Water Rights

The city of Sioux Falls filed a petition to intervene in response to the public notice regarding the Water Management Board hearing to consider an amendment to the conditions on many Big Sioux River water rights. The city's petition included a request for an automatic delay of the March 7, 2018 hearing date. Therefore, the hearing on this matter is automatically delayed pursuant to SDCL 46-2A-4 and 46-2A-5 and will not be held on March 7, 2018.

The hearing to consider amendment to the conditions on many Big Sioux River water rights is tentatively scheduled for the Water Management Board meeting to be held May 2 - 3, 2018, in Pierre. The Board will formalize its next meeting date at their March 7th meeting. Future notice of the time and place of the hearing will be provided.

Please contact Eric Gronlund at (605) 773-3352 if you have questions regarding the hearing process.

c: Ann Mines Bailey, Assistant Attorney General

CERTIFICATION

I hereby certify that on February 27, 2018, I have personally deposited with the United States mail at Pierre, South Dakota, first class postage, prepaid envelopes containing a Notice dated February 27, 2018, regarding automatic delay of the hearing to consider amendment to the conditions on many Big Sioux River water rights, as addressed below:

Diane Best
Assistant City Attorney
City of Sioux Falls
PO Box 7402
Sioux Falls SD 57117-7402

Sent Inter-office to:

Ann Mines Bailey, Assistant Attorney General
1302 East Highway 14, Suite 1
Pierre SD 57501-8501




Eric Gronlund
Water Rights Program, DENR

STATE OF SOUTH DAKOTA)
) SS
COUNTY OF HUGHES)

Sworn to, before me, this 27th day of February, 2018



Karen Schlaak
Notary Public
My Commission expires April 1, 2019

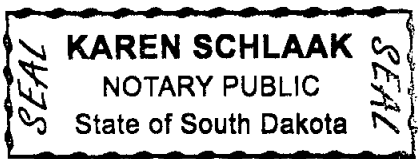



DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES


JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182

denr.sd.gov

April 4, 2018

NOTICE

TO: Diane Best
Assistant City Attorney
City of Sioux Falls
PO Box 7402
Sioux Falls SD 57117-7402

FROM: Jeanne Goodman, Chief Engineer
Water Rights Program 

SUBJECT: Scheduling of Hearing to Amend Conditions Placed on Many Big Sioux River
Water Rights

The city of Sioux Falls filed a petition to intervene in response to the public notice published in the Argus Leader regarding proposed amendment to conditions placed on many Big Sioux River water rights. The March 7, 2018, hearing was postponed at the city's request. This notice reschedules the hearing for May 3, 2018.

The Water Management Board will now conduct a hearing to consider proposed amendment to conditions placed on many Big Sioux River water rights at 8:30 AM (Central Time) on Thursday, May 3, 2018, at the Floyd Matthew Training Center, Joe Foss Building, 523 E. Capitol Avenue, Pierre SD. The agenda time is an estimate and may be delayed due to prior items. Future notice will be provided to all parties if there is a significant change to the hearing time.

Applicable provisions of the public notice of hearing published in the Argus Leader on February 15, 2018, still apply.

Questions regarding the hearing process may be directed to Eric Gronlund, Water Rights Program at (605) 773-3352 or eric.gronlund@state.sd.us.

c: Ann Mines Bailey, Assistant Attorney General

CERTIFICATION

I hereby certify that on April 4, 2018, I have personally deposited with the United States mail at Pierre, South Dakota, first class postage, prepaid envelopes containing a Notice dated April 4, 2018, regarding scheduling of the hearing to consider amendment to the conditions on many Big Sioux River water rights, as addressed below:

Diane Best
Assistant City Attorney
City of Sioux Falls
PO Box 7402
Sioux Falls SD 57117-7402

Sent Inter-office to:

Ann Mines Bailey, Assistant Attorney General
1302 East Highway 14, Suite 1
Pierre SD 57501-8501



Eric Gronlund
Water Rights Program, DENR

STATE OF SOUTH DAKOTA)
) SS
COUNTY OF HUGHES)

Sworn to, before me, this 4th day of April, 2018



Karen Schlaak
Notary Public
My Commission expires April 1, 2019

