

WATER PERMIT NO. 7059-3

Name of Applicant: **WE Investments LLC**

Address: **125 Gateway Dr, North Sioux City SD 57049**

Phone: **605 232-4000**

Amount of Water Claimed: **3.11 cfs – 393.3 AF**

Total Acres: **NA**

Source of Water Supply: **groundwater (one well)**

Water to be used for: **recreational use**

County: **Union**

Type of Waste Disposal System:

Location: **Dakota Dunes residential development**

PRIORITY

Date Received: **8-28-08**

Application/License Fee: **\$325**

Corrected Application Received:

Period of Annual Use: **April 1 – Octob12 31**

Remarks: **Well water will supply a recreational pond at a residential development**

Diversion Point: **NE ¼ Sec 35-T89N-R48W**

Land to be Irrigated: **NA**

Depth of Well: **60 feet deep**

Well Driller: :

Remarks:


Type of Map: **topo**

Prepared by: **Kyle L Mullenix, PE**

Reviewed and the Number Assigned on: **9-3-08**

By: **Karen Schlaak**

Notice of Hearing - date to intervene: _____

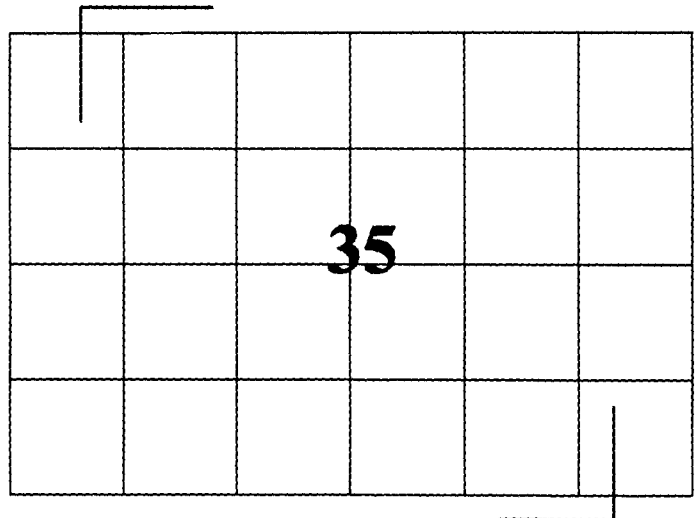

Mail to:
Water Rights Program
Joe Foss Building
523 E. Capitol
Pierre, SD 57501-3181
(605) 773-3352

No. 7059-3 (office use only)
Hydrologic Unit 10170101
Basin Missouri River
Newspaper Southern Union Co. Leader-Courier
605-356-2632 (Thurs) P.O. Box 310 Elk Point

RECEIVED
AUG 28 2008
WATER RIGHTS
PROGRAM

Application For Permit To Appropriate Water Within The State Of South Dakota

Check use(s) of water:

☐ Municipal ☐ Suburban Housing ☒ Recreational ☐ Institutional
☐ Rural Water System ☐ Commercial ☐ Fish & Wildlife ☐ Geothermal Heat
☐ Domestic (over 18 gpm) ☐ Industrial ☐ Other

Type of Application:
(check one)

☒ New ☐ Vested Right (Use predates Mar 2, 1955) ☐ Future Use Reservation
☐ Place to Beneficial Use Water Reserved by Future Use Permit No. _____
☐ Amendment/Correction to Permit No. _____

Description of amendment/correction: (i.e. change diversion point(s), add diversion point(s), change use, etc.)

- Name of Applicant WE Investments LLC Phone (605) 232-4000
(check one) ☒ Owner ☐ Tenant/lessee
Mailing Address 125 Gateway Drive North Sioux City State SD 57049
(Street, RR, or Box and City) (Zip Code)
- Amount of water claimed 3.11 *CFS or 1400 **GPM 393.3 ***AF
(*Cubic Feet per Second) (**Gallons per Minute) (***)Acre Feet - storage capacity of dam/dugout or annual use if applicable
- Source of water supply On-site well
- Location of point of diversion (example - 3 wells in SW1/4 NE1/4 section 12-T104N-R53W) County Union
Well in N 1/2, Sec. 35, T89N, R48W SE 1/4 NE 1/4 Pond NE 1/4 SE 1/4 S 35
Feeding the water level in a pond at the same location
- County or counties where water will be used Union
- Annual period during which water is to be used April - October Jan 1 - Dec 31
- Give a description of the project. When available include any preliminary engineering report or other reports or information that will help explain the project. (Attach sheet if more space is needed)

A residential development in Dakota Dunes, SD along the Missouri River. Soil needed to build the lots up above the 100 year flood level will be obtained on-site creating a recreational pond for residents of the development. The water level is to be supplemented by the use of the well.

STATE OF SOUTH DAKOTA)

County of Union

SS

Attachments: Attach Form 2A if diversion is from a well or dugout, or if storage of water is proposed. Attach map and any other technical information. (see instructions)

I, Nick Hegerty, the applicant, certify that I have read this application, have examined the attached map and that the matters stated are true and that I intend, and am able to complete the necessary construction.

Applicant's signature

Subscribed and sworn to before me this 25th day of August 20 08



Tracie Kittler
Notary Public signature
My commission expires on August 22, 2012

**SOUTH DAKOTA
WATER PERMIT NO. 7059-3**

Date of first receipt of application August 28, 2008.

The Chief Engineer, on behalf of the Water Management Board, issues Water Permit No. 7059-3 to WE Investments LLC, 125 Gateway Dr, North Sioux City SD 57049 authorizing the construction of the water use system and the placing of water to beneficial use subject to the following limitations, conditions and qualifications:

1. Water Permit No. 7059-3 appropriates 3.11 cubic feet of water per second from one well to be completed into the Missouri:Elk Point Aquifer (approximately 60 feet deep) located in the SE ¼ NE ¼ Section 35-T89N-R48W. Water will be pumped from the well to maintain 393.3 acre-feet storage pond located in the NE ¼, SE ¼ NW¼ Section 35-T89N-R48W.
2. The water appropriated shall be used for recreational purposes at a residential development and may not exceed the amount of water needed for beneficial use.
3. The water is to be used during the following described annual period: January 1 – December 31.
4. The date of approval of Permit No. 7059-3 is November 17, 2008.
5. The date from which applicant may claim right is August 28, 2008.
6. One-fifth of the construction is to be completed on or before May 17, 2011.
7. All construction is to be completed on or before November 17, 2013.
8. Water is to be put to beneficial use on or before November 17, 2018.
9. Water rights obtained in compliance with the laws of the State of South Dakota may not be unlawfully impaired by this appropriation.


QUALIFICATIONS

1. The well approved under this Permit will be located near domestic wells and other wells which may obtain water from the same aquifer. The well owner under this Permit shall control his withdrawals so there is not a reduction of needed water supplies in adequate domestic wells or in adequate wells having prior water rights.
2. The well authorized by Permit No. 7059-3 shall be constructed by a licensed well driller and construction of the well and installation of the pump shall comply with Water Management Board Well Construction Rules, Chapter 74:02:04 with the well casing pressure grouted (bottom to top) pursuant to Section 74:02:04:28.
3. Water Permit No. 7059-3 authorizes a storage pond with a storage capacity of 393.3 acre feet of water. Diversion of water from the well to the pond shall occur only to the extent necessary to maintain the pond.

WATER MANAGEMENT BOARD

By: Garland Erbele
Garland Erbele, Chief Engineer
Water Rights Program
Department of Environment and Natural Resources

DEC 15 2008
date



Supplemental Information

(type or print in ink)

1. Well Information - Proposed Construction

- a) Drill Hole Diameter 32" Depth 60'+/-
- b) Casing Type PVC Diameter 16" Thickness 1/2"
- c) Screen Type PVC Diameter 16" Thickness 1/2"
- d) Gravel Pack Armor Coat Length of Gravel Pack 45'
- e) Depth to Top of Water Bearing Material 15'
- f) Depth to Water (ground surface to water level) 15'
- g) Distance to nearest existing domestic well:
- On applicants property Yes On property owned by others _____

2. Wastewater Disposal System Information

- a) Type of System (i.e. septic tank, drain field) _____
- b) System Capacity (gallons) _____ Year Constructed _____
- c) Connected to the City of Dakota Dunes, SD Sanitary System

3. Dugout Information


- a) Surface Dimensions 17.6 Acres Depth 26.5'
- b) Depth to water (ground surface to water level) 1.5'

4. Water Storage Dams


If the proposed water use system contains one or more storage dams, please furnish the information requested below for each dam. The locations of the dams need to be shown on the map submitted with the application.

- a) If a private engineering firm or government agency was involved in the design of this dam, please give their name and address:

DeWild Grant Reckert and Associates
6115 Whispering Creek Drive
Sioux City, IA 51106
712-266-1554

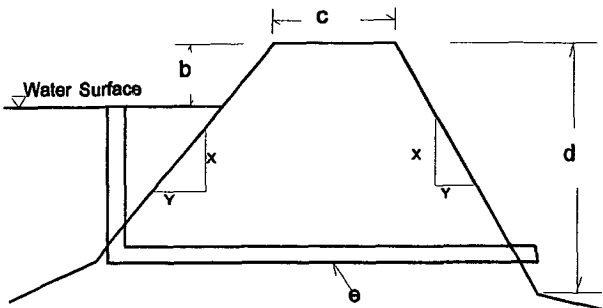





- b) Freeboard 7.5'
- c) Crest Width 12'
Crest Length _____
- d) Height 9'
- e) Primary Outlet Capacity _____
If pipe, diameter 15"@1.3%
- f) Secondary Spillway Capacity N/A
Spillway Width _____
- g) X & Y Slope _____
Upstream 1:8.7
Downstream 1:5
- h) Surface Area of Impoundment 17.6Ac
- i) Storage 393.3 Acre Feet
- j) Drainage Area Above Dam 46.5 Acres

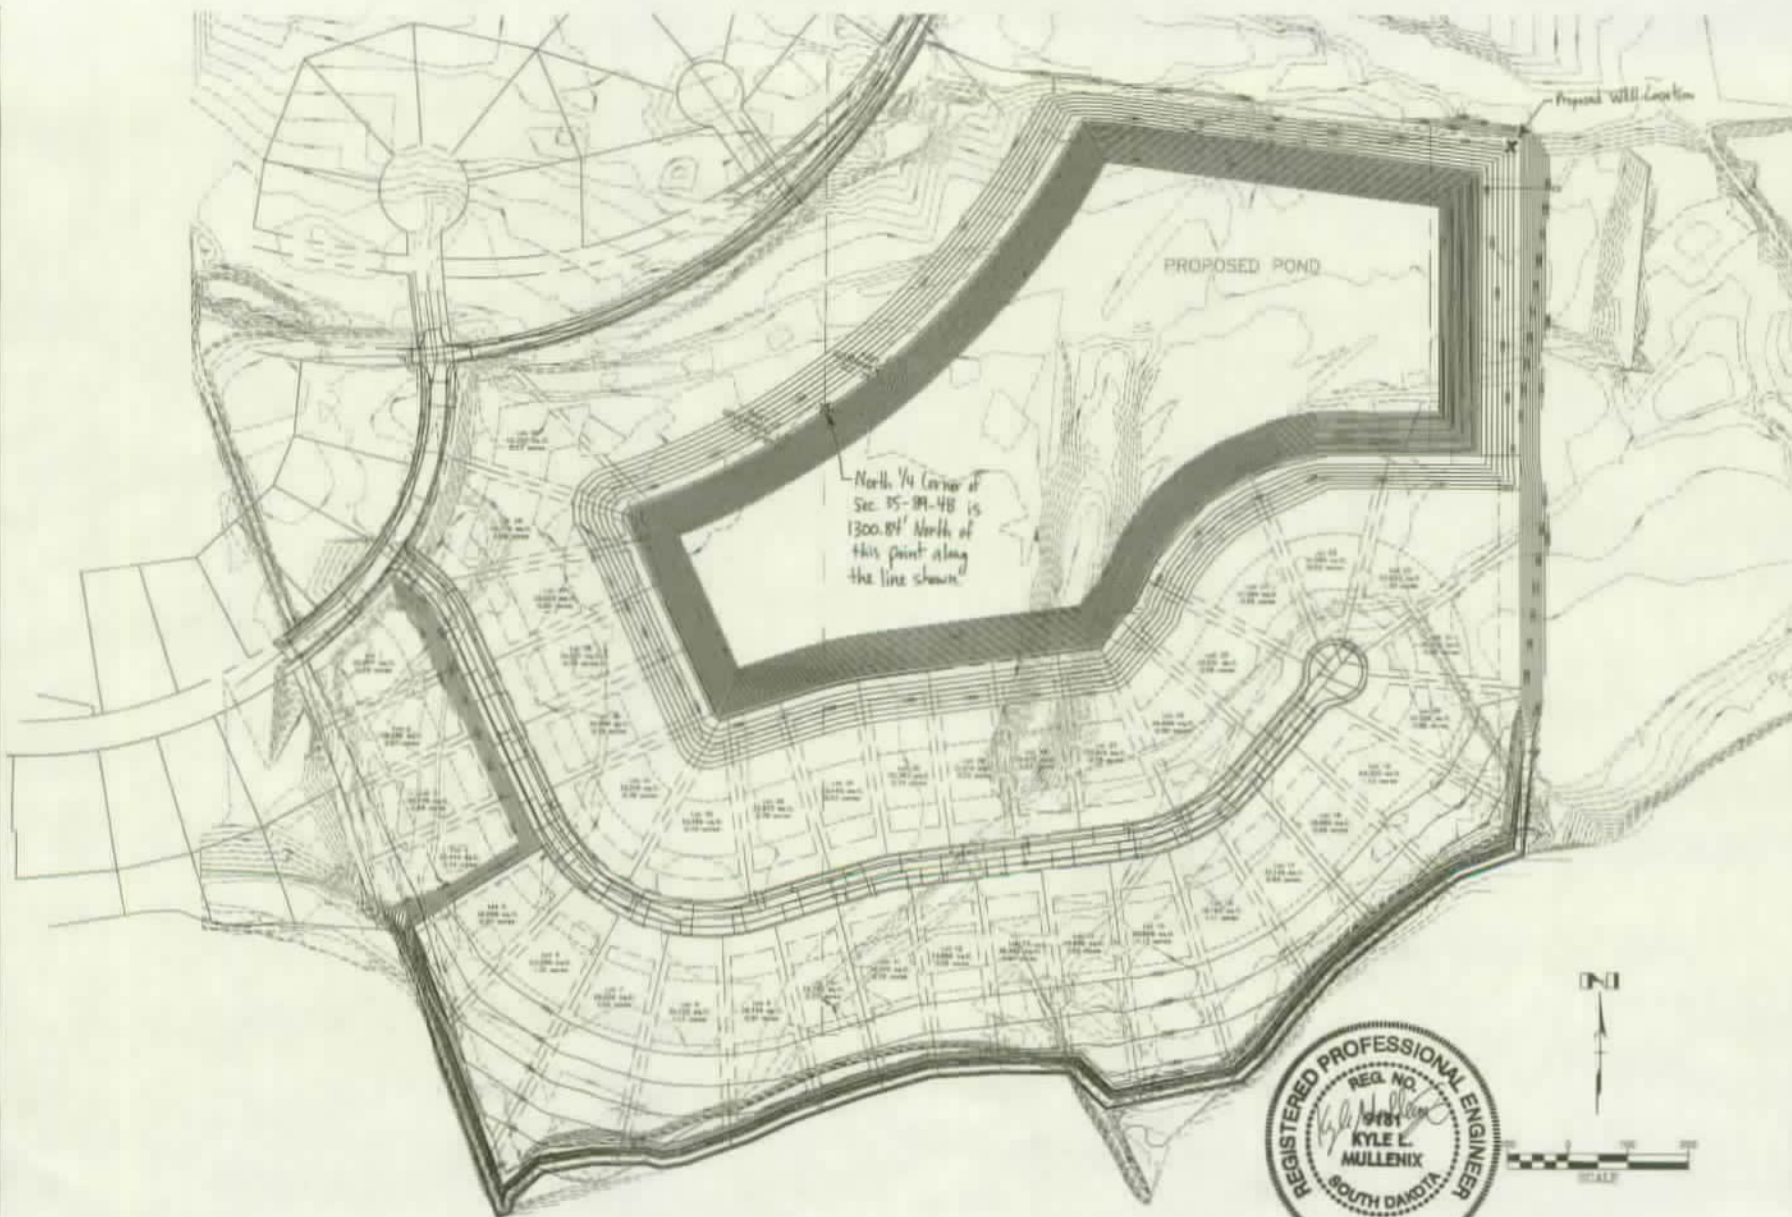

RECEIVED

AUG 28 2008


WATER RIGHTS
PROGRAM

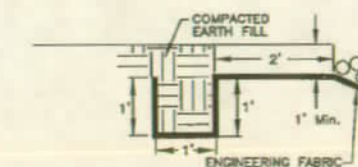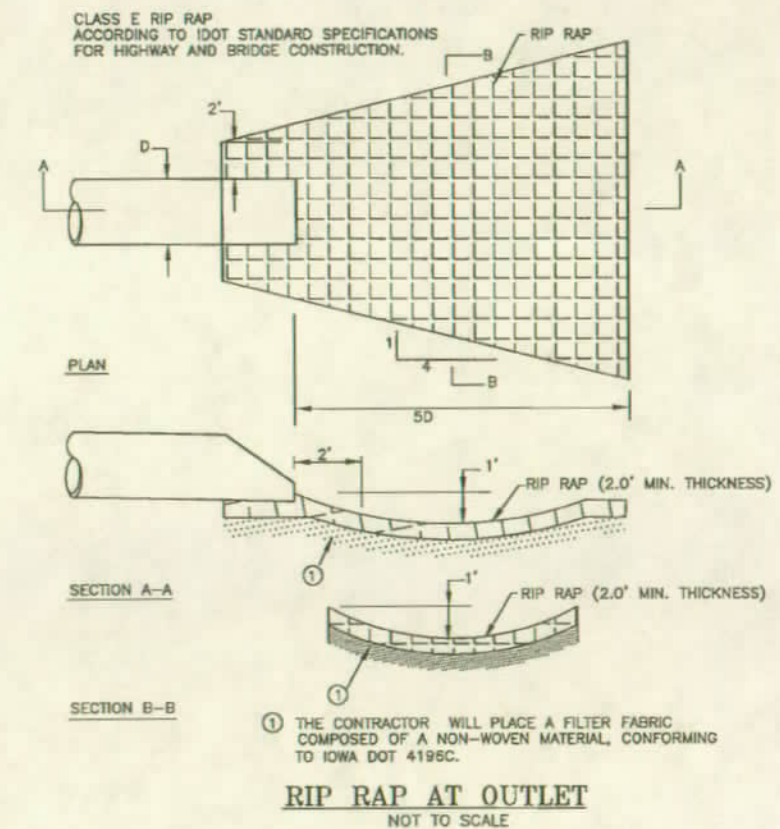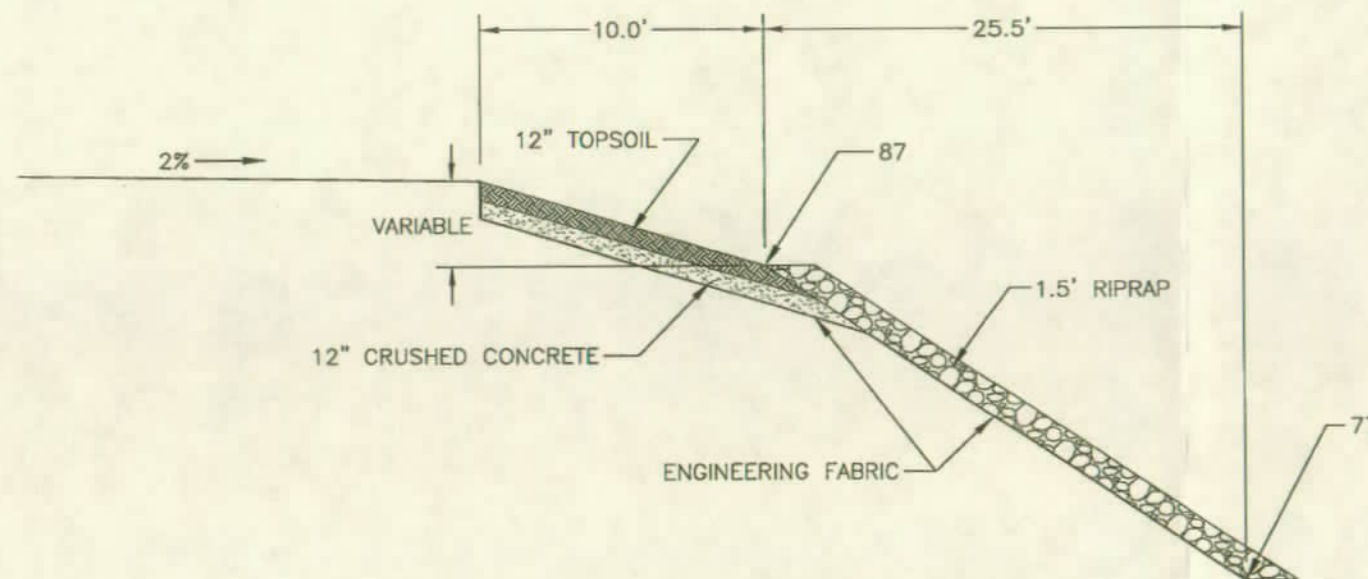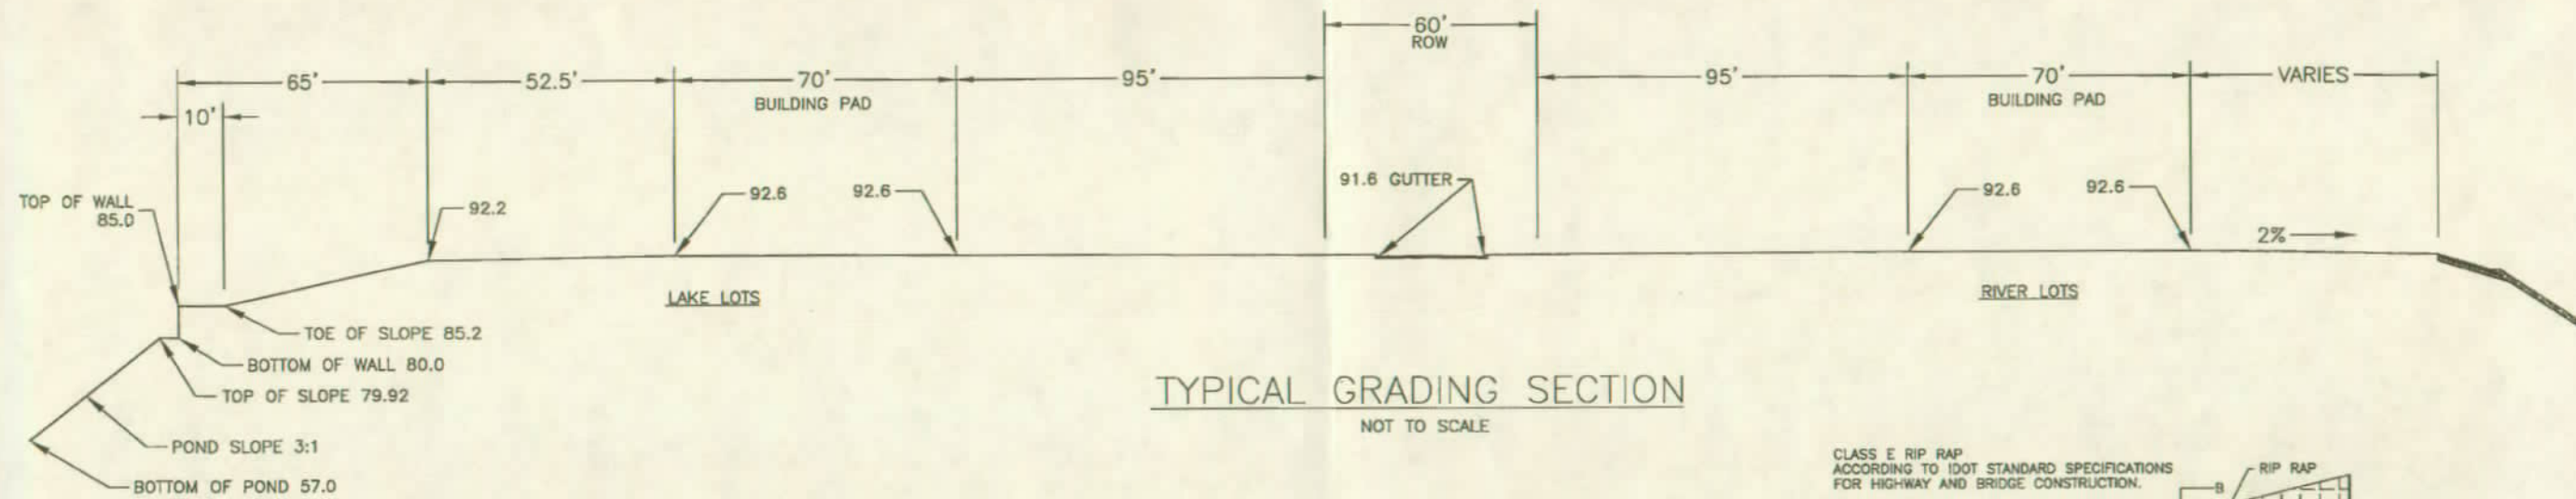

CONSTRUCTION DETAILS

DeWild Grant Reckert and Associates Company
Consulting Engineers and Land Surveyors
Rock Rapids, IA • Sioux Falls, SD
(712) 286-1554 • (605) 339-4157

PROJECT NO.
257086
SHEET
B.05

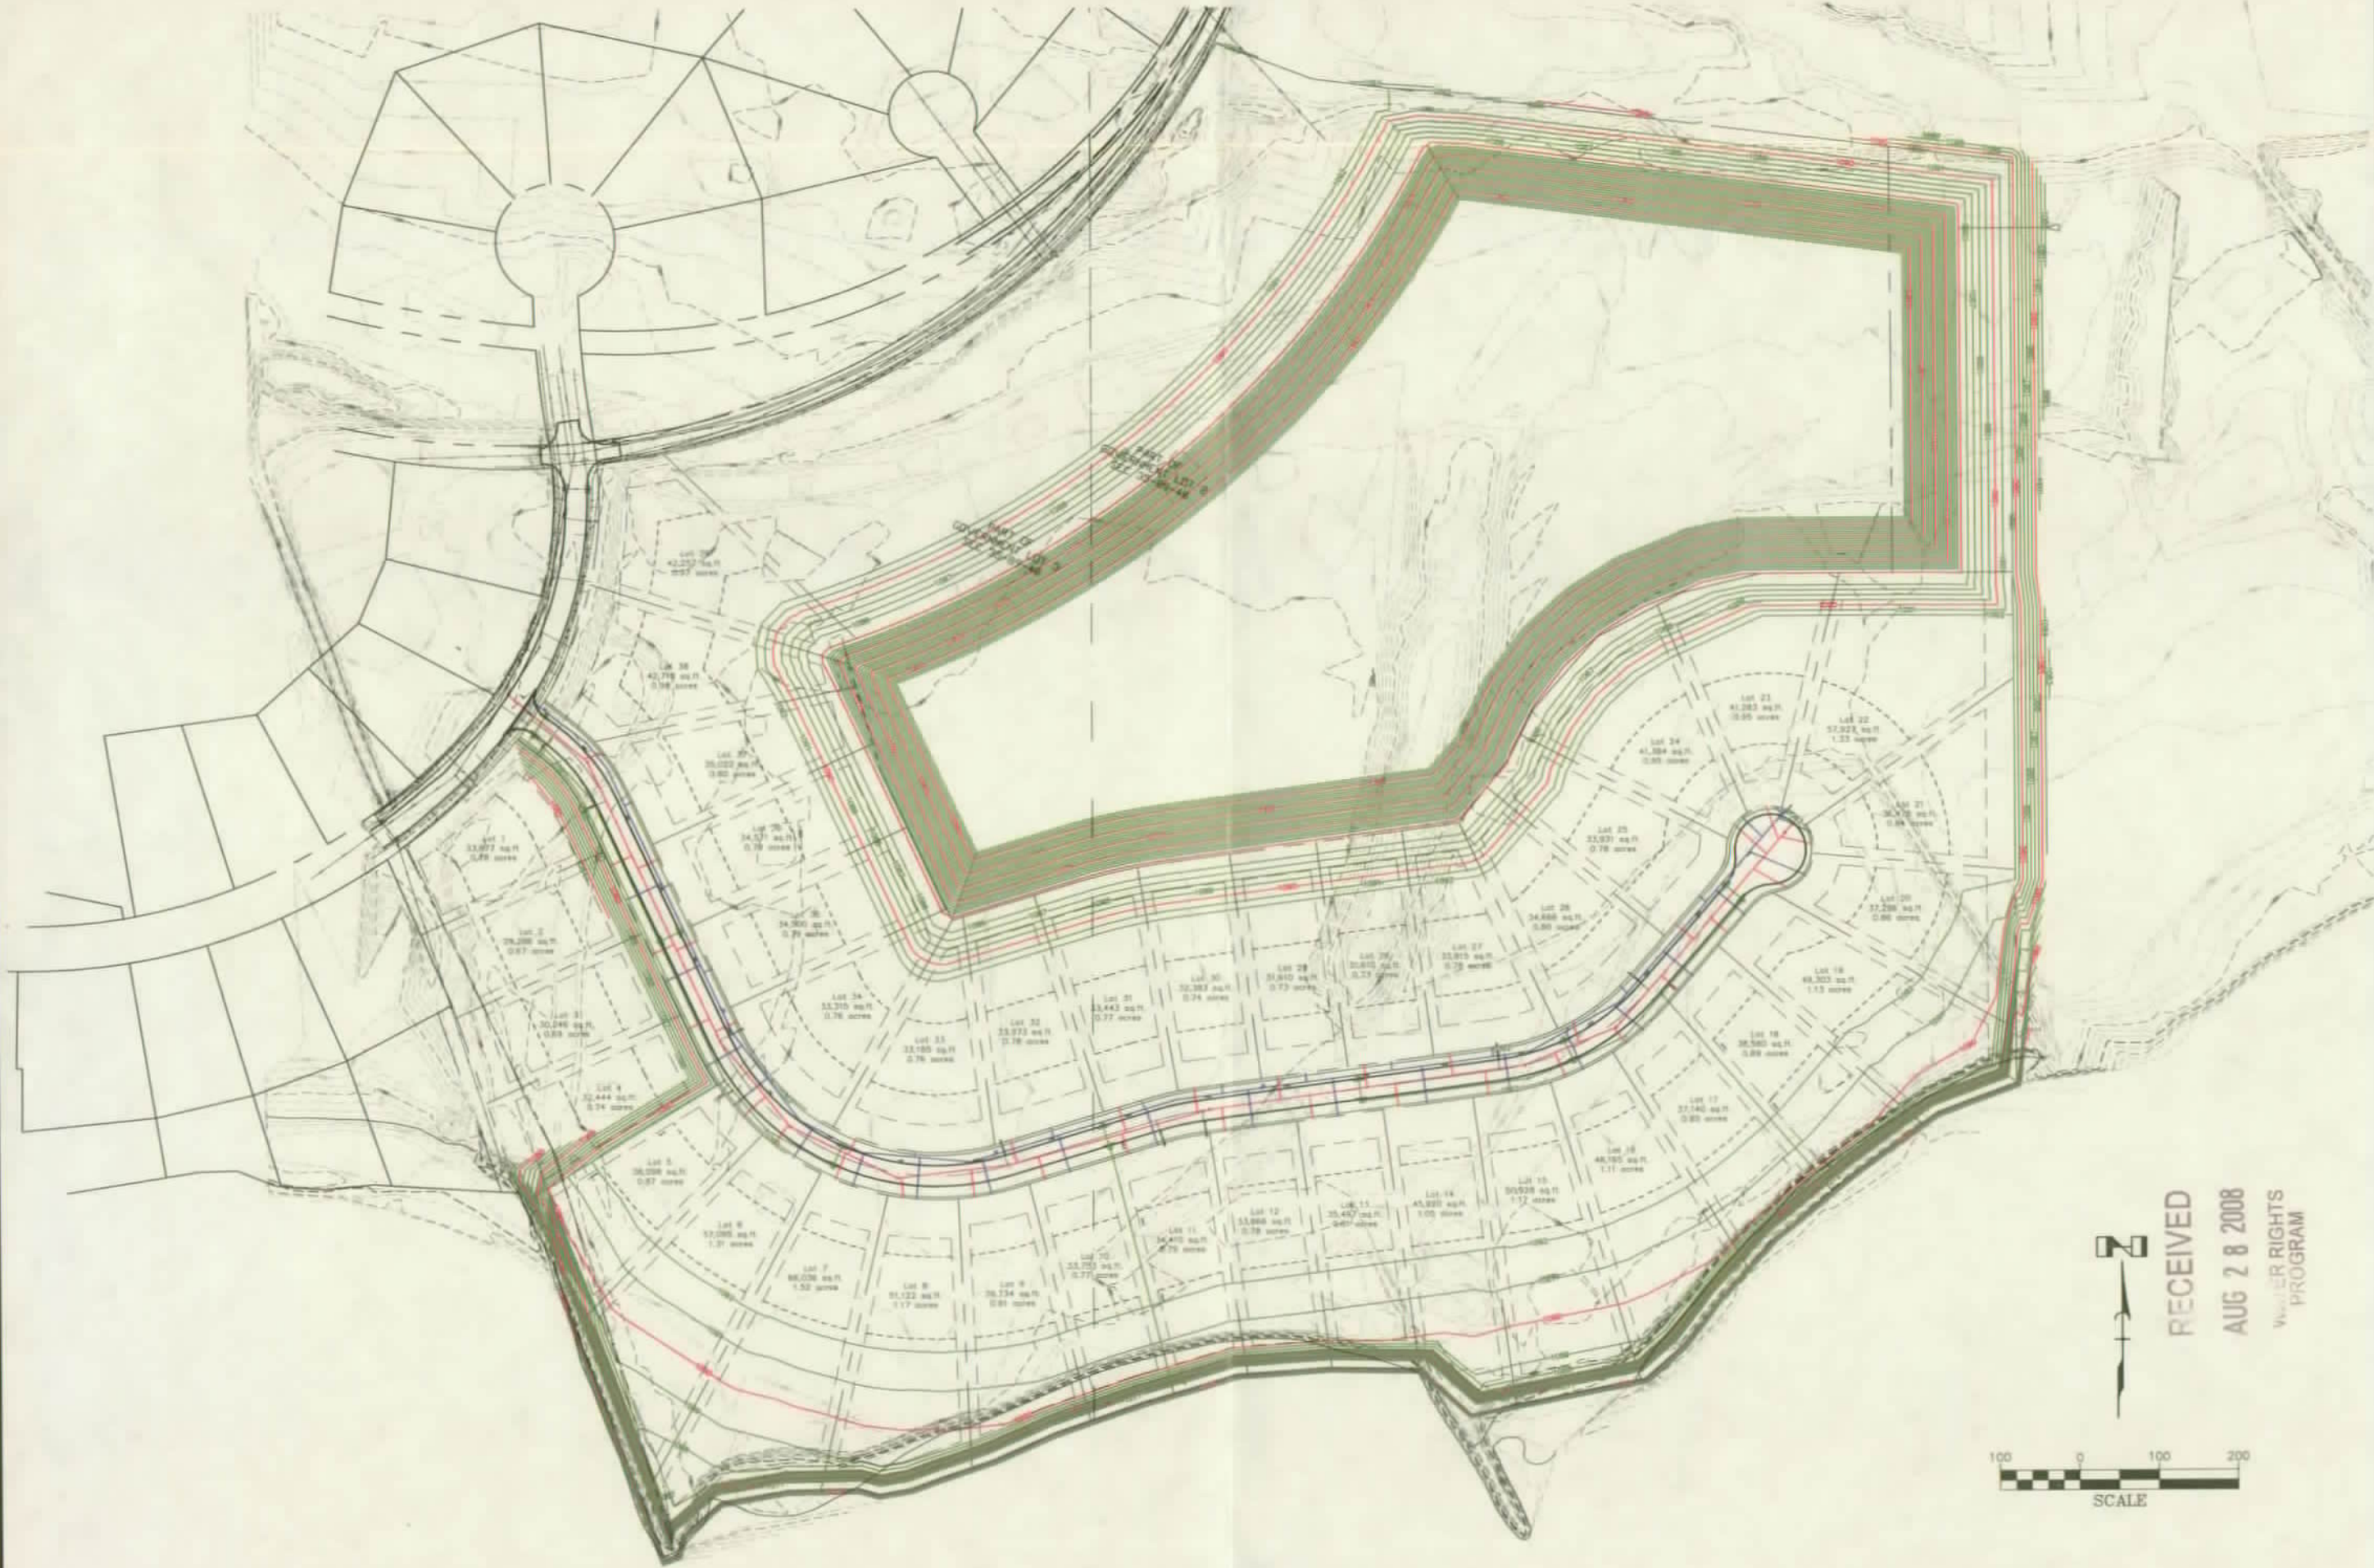

RECEIVED
AUG 28 2008
WATER RIGHTS
PROGRAM



RECEIPT

WATER RIGHTS PROGRAM

South Dakota Department of Environment and Natural Resources

Date 9/2, 20 08

RECEIVED OF WE Investments LLC PO Box 770 N Sioux City SD 57049

The following amount in fees for services rendered as provided for by law:

Fee for Application for Permit No. <u>7059-3</u> to Appropriate Water, to construct and to put water to beneficial use	275	00
Fee for Application for Permit No. _____ to Appropriate Water for Future use		
Fee to retain Future Use Permit No. _____ after period of seven years.		
Fee for Inspecting Constructed Works, confirming beneficial use and issuing Water License No. <u>7059-3</u>	50	00
Fee for Filing Transfer Form _____		
Fee for _____		
Fee for Issuing New Well Driller's License No. _____ for C.Y. _____		
Fee for Renewal of Well Driller's License No. _____ for C.Y. _____		
Fee for Issuing Well Pump Installer's License No. _____ for C.Y. _____		
Fee for Renewal of Well Pump Installer's License No. _____ for C.Y. _____		
(Any Other Work Provided by Law)	TOTAL	325 00

No.

03759

By

Salvador Erbe
Chief Engineer



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

PMB 2020
JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
www.state.sd.us/denr

**RECOMMENDATION OF CHIEF ENGINEER FOR WATER PERMIT
APPLICATION NO. 7059-3, WE Investments LLC**

Pursuant to SDCL 46-2A-2, the following is the recommendation of the Chief Engineer, Water Rights Program, Department of Environment and Natural Resources concerning Water Permit Application No. 7059-3, WE Investments LLC, c/o Nick Hegerty, 125 Gateway Drive, North Sioux City SD 57049.

The Chief Engineer is recommending APPROVAL of Application No. 7059-3 because 1) there is reasonable probability that there is unappropriated water available for the applicant's proposed use, 2) the proposed diversion can be developed without unlawful impairment of existing rights, 3) the proposed use is a beneficial use and 4) it is in the public interest with the following qualifications:

1. The well approved under this Permit will be located near domestic wells and other wells which may obtain water from the same aquifer. The well owner under this Permit shall control his withdrawals so there is not a reduction of needed water supplies in adequate domestic wells or in adequate wells having prior water rights.
2. The well authorized by Permit No. 7059-3 shall be constructed by a licensed well driller and construction of the well and installation of the pump shall comply with Water Management Board Well Construction Rules, Chapter 74:02:04 with the well casing pressure grouted (bottom to top) pursuant to Section 74:02:04:28.
3. Water Permit No. 7059-3 authorizes a storage pond with a storage capacity of 393.3 acre feet of water. Diversion of water from the well to the pond shall occur only to the extent necessary to maintain the pond.

See report on application for additional information.

Garland Erbele, Chief Engineer
October 22, 2008

REPORT ON WATER PERMIT APPLICATION NO. 7059-3
For WE Investments LLC
September 30, 2008

Application No. 7059-3 proposes to appropriate 3.11 cfs (1,400 gpm) from one well approximately 60 feet deep located in the SE $\frac{1}{4}$ NE $\frac{1}{4}$ of section 35, T89N R48W in Union County. Water from the well will be pumped to a 393.3 acre-feet storage pond located in the S $\frac{1}{2}$ NE $\frac{1}{4}$ and the SE $\frac{1}{4}$ NW $\frac{1}{4}$ of section 35, T89N R48W for recreational purposes at a residential development.

AQUIFER – MISSOURI ELK POINT (M-EP)

The Missouri Elk Point is an alluvium mantled outwash (sand and gravel) under water table conditions in this area. The aquifer underlies 99,600 acres and contains an estimated 1.5 million acre-feet of recoverable water in storage in Union County (Hedges, 1982). This area roughly corresponds to the Missouri aquifer as described by Niehus in the Union County Study (Niehus, 1994). The aquifer is hydraulically connected to the Lower James Missouri aquifer to the north, the Big Sioux South aquifer to the north, in the subsurface to the Dakota aquifer and to both the Missouri and Big Sioux Rivers. Ground water movement is probably from the northwest to southeast in southern Union County (Niehus, 1994). However this area is so close to both the Big Sioux River to the north and the Missouri River to the south that the stage of the rivers determines the ground water level.

No test hole or well log was supplied with this application. However there are four production wells for Dakota Dunes located within one-half mile of this proposed site. All of the production wells sand and gravel near the surface to depths of about 144 feet. The logs also indicate clay layers in the sand and gravel in the 30 to 70 feet range but nothing continuous or obvious in all four wells.


The Water Rights Program monitors eighteen observation wells completed into the Missouri Elk Point aquifer in southern Union County. The nearest observation well is UN-78C which is located about three miles northwest of this application. Water levels records for this well show good response to climatic conditions. Water levels rise during wet years (recharge) and gradually decline during dry years. In general the water level record indicates the aquifer is capable of sustaining additional withdrawals (Water Rights, 2008). Also the hydrograph also shows a slight decline in water levels over the period of record. This is probably due to the gradually entrenching of the river system in this area. With the entrenchment of the river the stage of the river lowers somewhat thus causing a general lowering the ground water level caused by discharge of ground water into the river. This phenomenon is obvious in observation wells completed into the Missouri Elk Point aquifer that are located near to the Missouri River. A hydrograph for observation well UN-78C is included with this report.

REVIEW OF EXISTING WATER PERMITS/RIGHTS

There are two existing water rights for four wells that are located within one-half mile of this proposed well site. The two closest wells for Water Right No. 6074-3 (2 wells, 3.34 cfs) are completed into the Dakota Formation (total well depths of 307 and 308 feet). Although there appears to be hydraulic communication between the Missouri Elk Point aquifer and the Dakota Formation in this area interference is not expected to be a concern. The other Water Right is No. 5437-3 (2 wells, 3.33 cfs) with the nearest existing well about 1,700 feet southwest of this proposed site. Interference is also not a concern with this diversion either.

CONCLUSIONS

1. Water is available from the Missouri Elk Point aquifer.
2. The aquifer is under water table conditions in this area. Drawdown created by pumping is not expected to be significant nor cause any adverse effects. Interference is not a concern.
3. This pond/dugout will probably have a static water level ten to 15 feet below land surface. It is completed into the Missouri Elk Point aquifer. It is doubtful that pumping even at the rate requested will have much of an effect on the pond water levels. The pond should simply revert to the natural ground water level whatever that would be depending upon the year. The pond would probably have to be lined to maintain a higher water level.
4. It would seem to be a waste of resources to simply pump water into a dugout that would leak the water out as fast as pumped in.
5. This well must be constructed in accordance with SD Well Construction Standards.

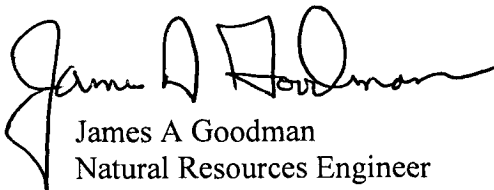

James A Goodman
Natural Resources Engineer


BIBLIOGRAPHY

Hedges, L.S., and others, 1984, Evaluation of Ground-Water Resources Eastern SD and Upper Big Sioux River, SD and Iowa, for US Army Corps of Engineers, SD DENR, SDGS, Vermillion, SD, 57069.

Niehus, C.A., 1994, Water-Resources of Lincoln and Union Counties, South Dakota, Water Resources Investigation Report 93-4195, USGS, Rapid City, SD, 57702.

Water Rights, 2008, Unpublished Observation Well Data for Union County, SD DENR, DES, Water Rights Program, Pierre, SD, 57501.

**WATER RIGHTS' OBSERVATION WELL
UN-78C**

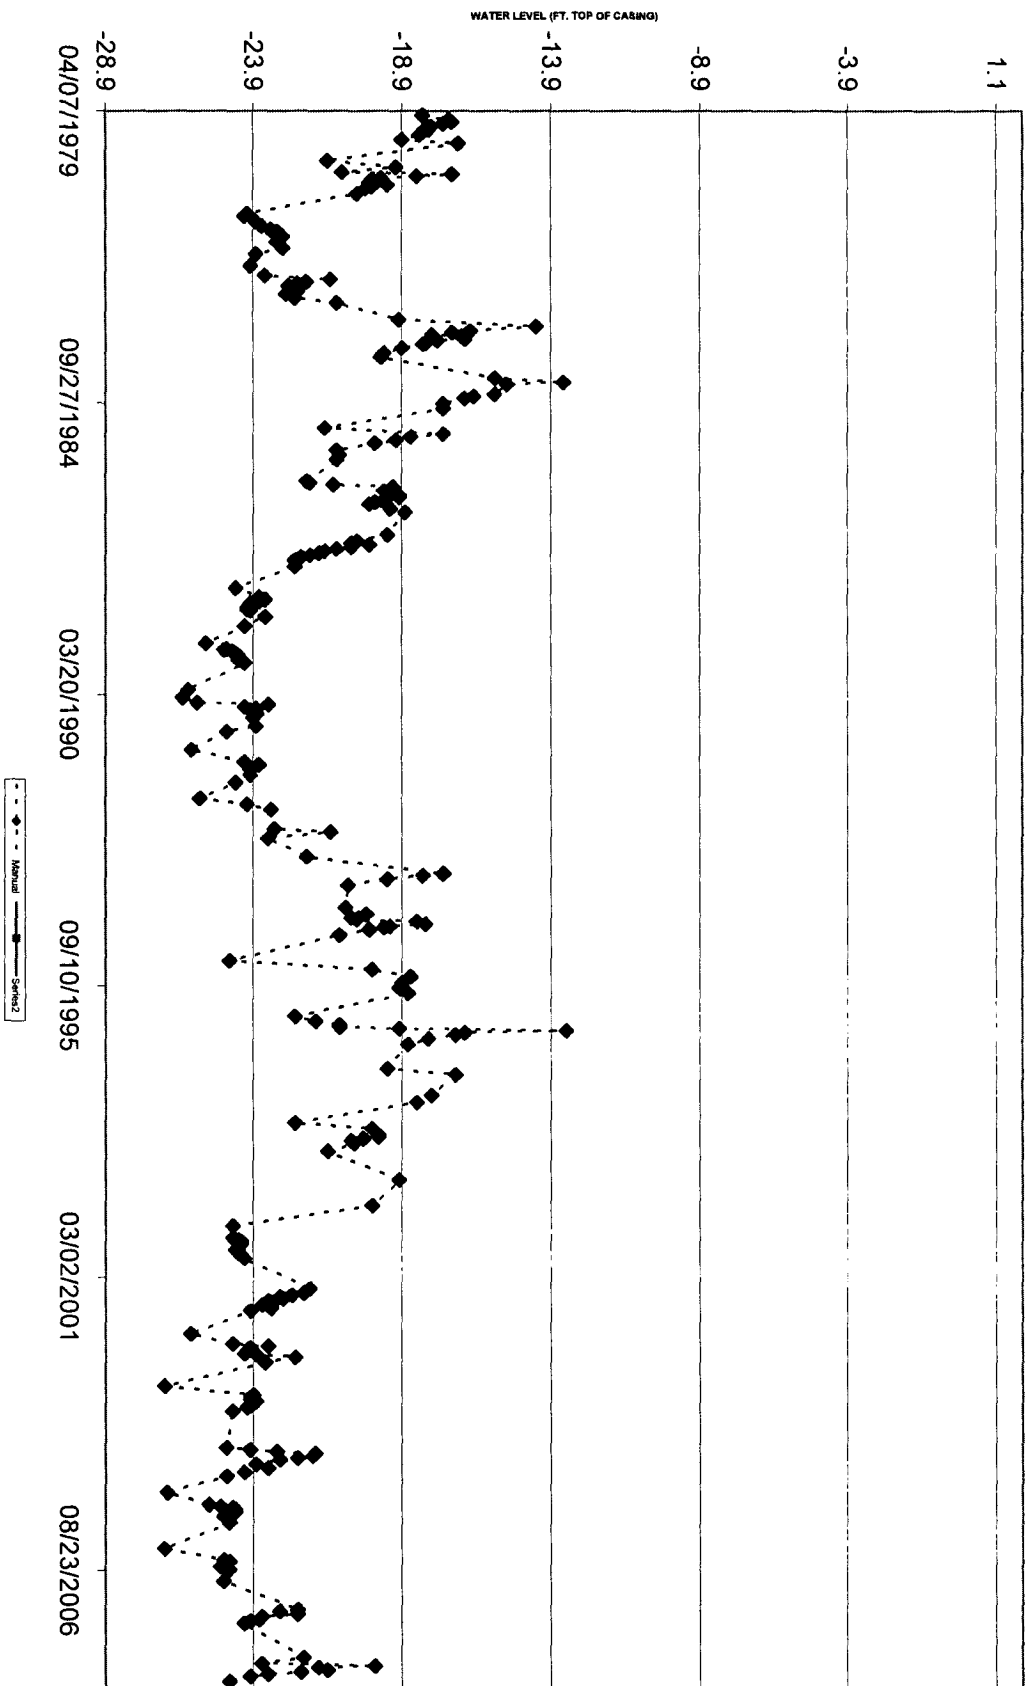

RECEIVED

NOV 10 2008

WATER RIGHTS
PROGRAM

Form 8

PROOF OF PUBLICATION

STATE OF SOUTH DAKOTA)

County of Union) SSI, Susan Odsoncertify that the attached printed Notice was
takenfrom the Leader-Courierprinted and published in Elk PointCounty of Union andstate of South Dakota. The notice was
published

in the newspaper on the following two dates:

October 30, 2008November 6, 2008Cost of Printing \$ 49.55Susan Odson
(Signature)Affidavits Coordinator
(Title)11-6-2008
(Date Signed)**NOTICE OF APPLICATION
NO. 7059-3 TO
APPROPRIATE WATER**

Notice is given that WE Investments LLC, c/o Nick Hegerty, 125 Gateway Drive, North Sioux City SD 57049 has filed an application for a water permit to appropriate 3.11 cubic feet of water per second from one well to be completed into the Missouri: Elk Point Aquifer (approximately 60 feet deep) located in the SE1/4 NE1/4 Section 35-T89N-R48W. Water will be pumped from the well to maintain 393.3 acre-feet storage pond located in the NE1/4, SE1/4 NW1/4 Section 35-T89N, R48W for recreational purposes at a residential development.

Pursuant to SDCL 46-2A-2, the Chief Engineer recommends APPROVAL of Application No. 7059-3 because 1) unappropriated water is available, 2) existing rights will not be unlawfully impaired, 3) it is a beneficial use of water, and 4) it is in the public interest. In accordance with SDCL 46-2A-23, the Chief Engineer will act on this application, as recommended, unless a petition is filed opposing the application or the applicant files a petition contesting the Chief Engineer's recommendation. If a petition opposing the application or contesting the recommendation is filed, then a hearing will be scheduled and the Water Management Board will consider this application. Notice of the hearing will be given to the applicant and any person filing a petition.

Any person interested in opposing or supporting this application or recommendation must file a written petition with BOTH the applicant and Chief Engineer. The applicant must file a petition if contesting the Chief Engineer's recommendation. The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E. Capitol, Pierre, SD 57501 (605 773-3352)" and the applicant's mailing address is given above. A petition filed by either an interested person or the applicant must be filed by November 17, 2008.

The petition may be informal, but must include a statement describing the petitioner's interest in the application, the petitioner's reasons for opposing or supporting the application, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained. Contact Eric Gronlund at the above Water Rights Program address to request copies of information pertaining to this application.

Steven M. Pirner, Secretary,
Department of Environment and
Natural Resources.

Publish October 30 and November
6, 2008
44-6-74



DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES

PMB 2020
JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
www.state.sd.us/denr

October 22, 2008

Southern Union County Leader Courier
PO Box 310
Elk Point SD 57025

ATTENTION: Legal Public Notice

Enclosed is a Notice on Application No. 7059-3 to Appropriate Water to be published twice. Please publish the first notice on October 30, 2008 with the second publication 7 days later. The text of the notice can be e-mailed to your paper by contacting Karen Schlaak at (605) 773-3352.

The applicant must verify to you that the notice is to be published, before you make the first publication. **Please BILL the APPLICANT for the cost of publication.** The APPLICANT is WE Investments LLC, c/o Nick Hegerty, 125 Gateway Dr., N Sioux City SD 57049 (Ph # 605-232-4000).

Please send the Water Rights Program the first publication immediately. The publication is checked for accuracy so any corrections can be made in the second publication. You may use the form below or fax a copy of the first publication. Any fax should be sent to the attention of Karen Schlaak at (605) 773-4068. Publication errors can invalidate the public notice.

After the second publication, **please send us an affidavit or use the enclosed Proof of Publication form.** The applicant pays the cost of publication, but the Water Rights Program records require an affidavit or Proof of Publication. Delays in receiving the affidavit can be costly to the applicant.

Sincerely,

Eric Gronlund
Natural Resources Engineer
605 773-3352

enclosures

-----CUT HERE-----

No. 7059-3


TO: Eric Gronlund
Water Rights Program
Joe Foss Building
Pierre SD 57501-3181

Date _____

We are in receipt of your letter of October 22, 2008 enclosing Notice to Appropriate Water by Application No. 7059-3 which was first published in our issue of _____. ENCLOSED IS A COPY OF THIS FIRST PUBLICATION.

Name

Newspaper

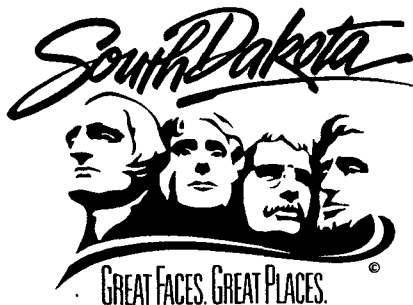

DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES

PMB 2020
JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
www.state.sd.us/denr

NOTE: TO BE SURE OF PUBLICATION ON
THE CORRECT DATES, CONTACT
THE NEWSPAPER RIGHT AWAY.

October 22, 2008

WE Investments LLC
c/o Nick Hegerty
125 Gateway Dr
N Sioux City SD 57049

Dear Mr. Hegerty

Water Permit Application No. 7059-3 for recreational use has been examined and found to comply with the South Dakota Water Laws and applicable rules. A notice has been sent to the Publisher of the Southern Union Co Leader Courier printed at Elk Point SD (Ph # 605-356-2632). You will need to contact the newspaper and authorize publication of this notice. For your information, a copy of the notice, the recommendation of the Chief Engineer and report on the application are enclosed. Please review the notice prior to publication and notify this office, if you have any corrections or questions.

Be sure to contact the above newspaper to authorize publication of your Notice and to arrange for payment. Early contact with the paper can eliminate delays. Upon receiving authorization, the publisher has been instructed to publish your notice once each week for two consecutive weeks. The newspaper has also been instructed to send us the Proof of Publication. We must receive Proof of Publication before action can be taken on the application.

Sincerely,

Eric Gronlund
Natural Resources Engineer
(605) 773-3352

enclosures

NOTE: If you plan to contest any part of the Chief Engineer's recommendation, you must file a petition pursuant to the procedures outlined in the attached notice of hearing. The Water Management Board will then consider your concerns during a hearing on the application.

Instruction to Newspaper - Publish first Notice on October 30, 2008 with the second publication 7 days later. The applicant is responsible for payment.

NOTICE OF APPLICATION NO. 7059-3 to Appropriate Water

Notice is given that WE Investments LLC, c/o Nick Hegerty, 125 Gateway Drive, North Sioux City SD 57049 has filed an application for a water permit to appropriate 3.11 cubic feet of water per second from one well to be completed into the Missouri:Elk Point Aquifer (approximately 60 feet deep) located in the SE ¼ NE ¼ Section 35-T89N-R48W. Water will be pumped from the well to maintain 393.3 acre-feet storage pond located in the NE ¼, SE ¼ NW¼ Section 35-T89N, R48W for recreational purposes at a residential development.

Pursuant to SDCL 46-2A-2, the Chief Engineer recommends APPROVAL of Application No. 7059-3 because 1) unappropriated water is available, 2) existing rights will not be unlawfully impaired, 3) it is a beneficial use of water, and 4) it is in the public interest. In accordance with SDCL 46-2A-23, the Chief Engineer will act on this application, as recommended, unless a petition is filed opposing the application or the applicant files a petition contesting the Chief Engineer's recommendation. If a petition opposing the application or contesting the recommendation is filed, then a hearing will be scheduled and the Water Management Board will consider this application. Notice of the hearing will be given to the applicant and any person filing a petition.

Any person interested in opposing or supporting this application or recommendation must file a written petition with BOTH the applicant and Chief Engineer. The applicant must file a petition if contesting the Chief Engineer's recommendation. The Chief Engineer's address is "Water Rights Program, Foss Building, 523 E Capitol, Pierre SD 57501 (605 773-3352)" and the applicant's mailing address is given above. A petition filed by either an interested person or the applicant must be filed by November 17, 2008.

The petition may be informal, but must include a statement describing the petitioner's interest in the application, the petitioner's reasons for opposing or supporting the application, and the signature and mailing address of the petitioner or the petitioner's legal counsel, if legal counsel is obtained. Contact Eric Gronlund at the above Water Rights Program address to request copies of information pertaining to this application. Steven M. Pirner, Secretary, Department of Environment and Natural Resources.



**DEPARTMENT of ENVIRONMENT
and NATURAL RESOURCES**

PMB 2020
JOE FOSS BUILDING
523 EAST CAPITOL
PIERRE, SOUTH DAKOTA 57501-3182
www.state.sd.us/denr

DEC 15 2001

WE Investments LLC
Nick Hegerty
125 Gateway Dr
N Sioux City SD 57049

Dear Mr. Hegerty:

Enclosed is Water Permit No. 7059-3 authorizing construction of your water diversion system and beneficial use of the water, not exceeding the limits as specified in the Water Permit.

Form 10, *Notice of Completion of Works and Application of Water to Beneficial Use*, is enclosed. Please return this completed form after you have finished the system and have put the water to beneficial use. An investigation can then be scheduled so the water license may be issued, thus completing the acquisition of a water right.

An informational sheet *Common Water Right Questions?* is also enclosed. This sheet is intended to answer some of the questions associated with obtaining and keeping a water right.

Sincerely,

Garland Erbele, Chief Engineer
Water Rights Program
(605) 773-3352

enclosures